


Lokey Volkswagen

Lokey Nissan

Rooms To Go Furniture Store - Clearwater




Primrose Ln

Cumberland Cir

name Cir




Rain Gauge
Treatment Plant

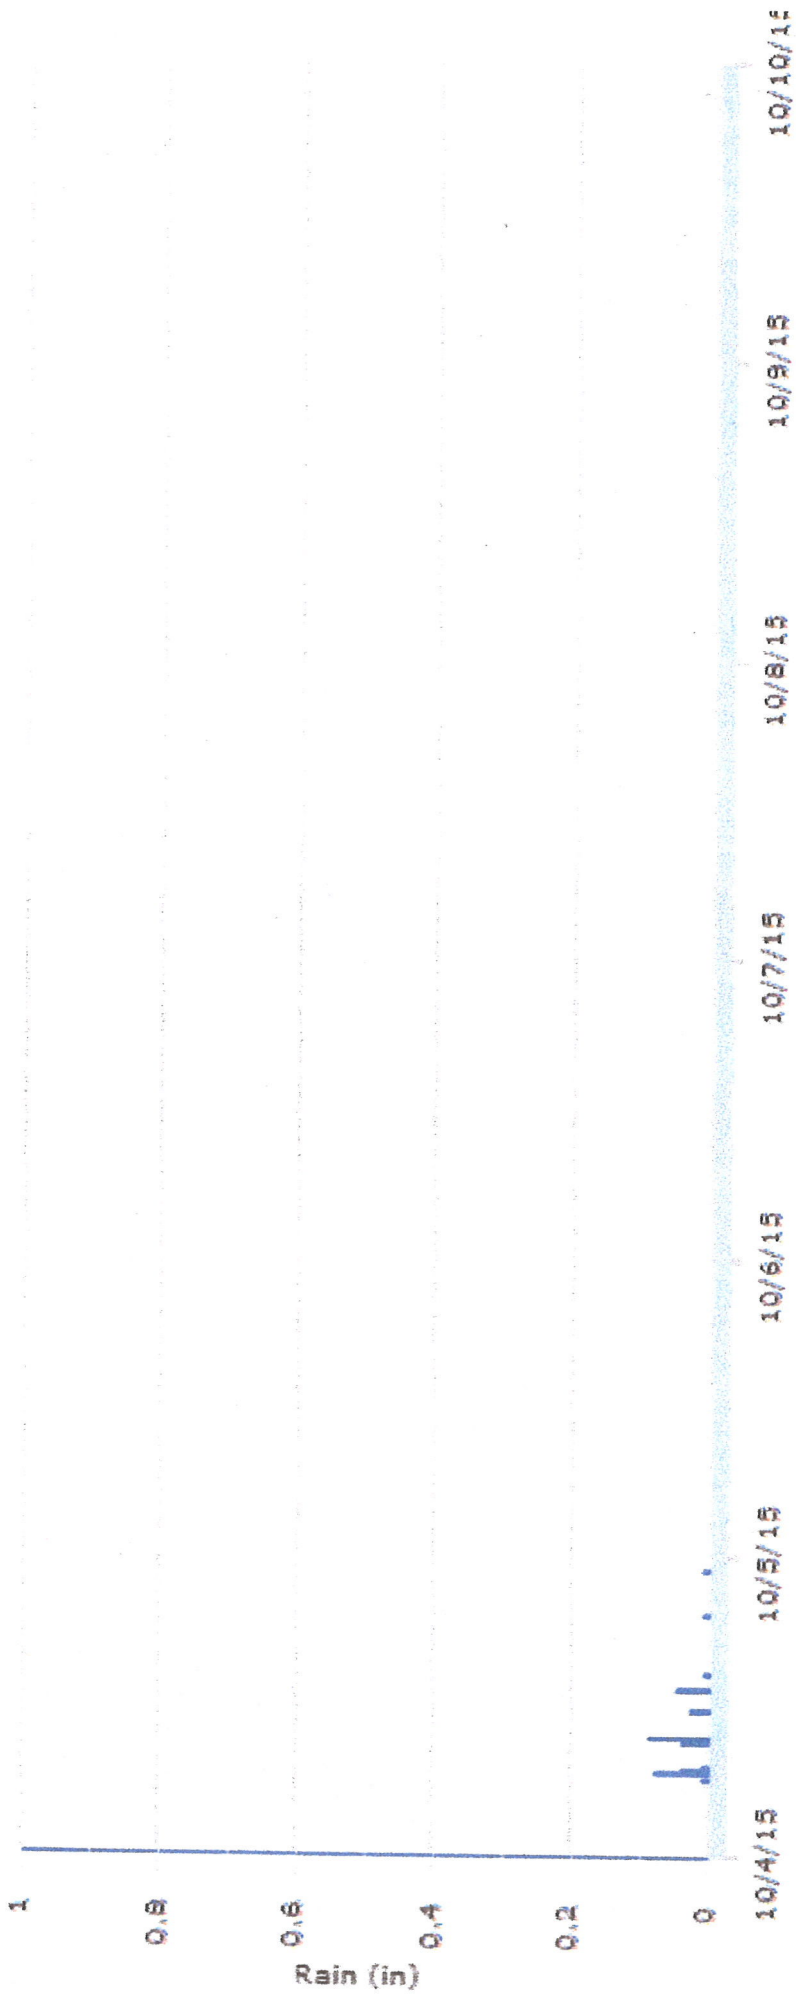

■ Rain (in)

MH 09

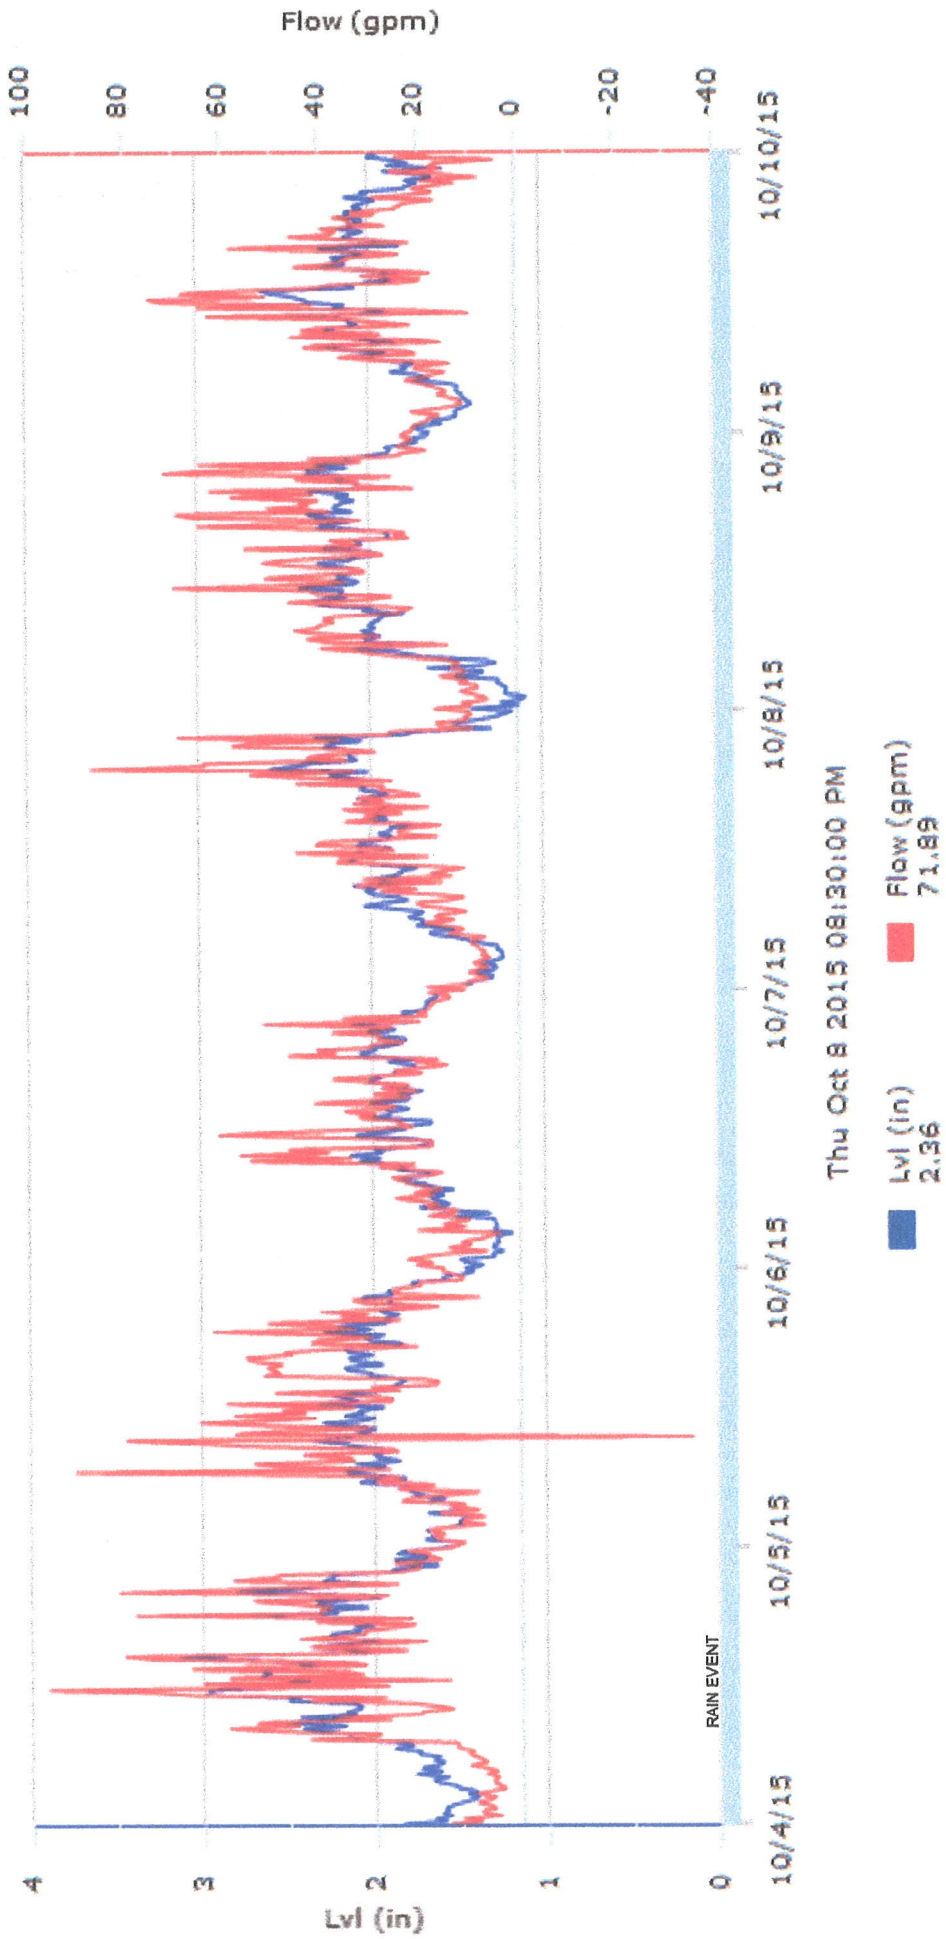

Data Summary Report

Custom
Utilities, Inc.
MH 09

10/04/2015 12:00 AM - 10/10/2015 12:00 AM

Flow Summary

Maximum (gpm): 96.59 10/04/2015 12:00 PM
Minimum (gpm): -34.90 10/05/2015 09:15 AM
Average (gpm): 28.76
Total (gal): 248,462.8

Date	Maximum (gpm)	Maximum Time	Minimum (gpm)	Minimum Time	Average (gpm)	Total (gal)
10/04/2015 12:00 AM	96.59	12:00	3.98	03:15	30.19	43,473.8
10/05/2015 12:00 AM	91.04	06:15	-34.90	09:15	32.47	46,756.2
10/06/2015 12:00 AM	61.39	11:30	4.02	03:00	24.61	35,439.9
10/07/2015 12:00 AM	87.31	19:00	6.18	02:00	24.35	35,071.0
10/08/2015 12:00 AM	71.89	20:30	6.40	01:00	32.85	47,308.9
10/09/2015 12:00 AM	74.95	11:30	4.33	23:30	28.06	40,413.0

Data Summary Report

Custom
Utilities, Inc.
MH 09

10/04/2015 12:00 AM - 10/10/2015 12:00 AM

Level Summary

Maximum (in): 3.15 10/04/2015 02:45 PM
Minimum (in): 1.10 10/08/2015 01:15 AM
Average (in): 1.90

Date	Maximum (in)	Maximum Time	Minimum (in)	Minimum Time	Average (in)
10/04/2015 12:00 AM	3.15	14:45	1.41	03:00	2.08
10/05/2015 12:00 AM	2.37	09:00	1.43	23:45	1.91
10/06/2015 12:00 AM	2.14	09:45	1.20	03:00	1.73
10/07/2015 12:00 AM	2.59	19:00	1.24	02:45	1.82
10/08/2015 12:00 AM	2.41	10:45	1.10	01:15	1.91
10/09/2015 12:00 AM	2.62	12:15	1.41	02:30	1.93

Data Summary Report

Custom
Utilities, Inc.
MH 09

10/11/2015 12:00 AM - 10/24/2015 11:15 AM

Flow Summary

Maximum (gpm): 97.82 10/24/2015 08:00 AM
Minimum (gpm): 3.12 10/16/2015 03:00 AM
Average (gpm): 24.89
Total (gal): 482,704.8

Date	Maximum (gpm)	Maximum Time	Minimum (gpm)	Minimum Time	Average (gpm)	Total (gal)
10/11/2015 12:00 AM	66.09	18:15	5.05	03:45	25.89	37,284.4
10/12/2015 12:00 AM	80.94	07:15	5.53	03:45	22.67	32,639.4
10/13/2015 12:00 AM	55.46	08:45	7.01	05:15	21.89	31,523.1
10/14/2015 12:00 AM	85.99	14:15	5.20	03:30	27.31	39,320.0
10/15/2015 12:00 AM	63.23	06:30	7.50	03:30	24.09	34,695.6
10/16/2015 12:00 AM	63.40	18:00	3.12	03:00	22.85	32,902.8
10/17/2015 12:00 AM	64.61	11:30	8.06	02:45	28.45	40,967.0
10/18/2015 12:00 AM	46.53	11:45	3.95	03:30	21.50	30,960.8
10/19/2015 12:00 AM	50.77	13:15	6.07	01:45	24.82	35,744.8
10/20/2015 12:00 AM	63.27	09:45	5.98	03:30	27.47	39,561.5
10/21/2015 12:00 AM	48.99	21:00	6.44	02:15	23.50	33,835.5
10/22/2015 12:00 AM	67.17	17:15	8.77	02:45	25.03	36,046.9
10/23/2015 12:00 AM	77.72	07:45	9.26	02:45	28.54	41,098.4
10/24/2015 12:00 AM	97.82	08:00	6.61	02:30	23.89	16,124.6

Data Summary Report

Custom
Utilities, Inc.
MH 09


10/11/2015 12:00 AM - 10/24/2015 11:15 AM

Level Summary


Maximum (in): 3.30 10/18/2015 03:15 PM
Minimum (in): 1.26 10/16/2015 02:00 AM
Average (in): 2.04

Date	Maximum (in)	Maximum Time	Minimum (in)	Minimum Time	Average (in)
10/11/2015 12:00 AM	2.65	16:00	1.37	03:45	1.88
10/12/2015 12:00 AM	2.57	07:15	1.42	01:45	1.92
10/13/2015 12:00 AM	2.38	19:00	1.31	01:30	1.90
10/14/2015 12:00 AM	2.91	18:30	1.36	02:30	2.09
10/15/2015 12:00 AM	2.99	06:30	1.44	14:30	1.93
10/16/2015 12:00 AM	2.67	17:00	1.26	02:00	1.85
10/17/2015 12:00 AM	3.06	19:00	1.54	02:15	2.20
10/18/2015 12:00 AM	3.30	15:15	1.27	03:30	1.99
10/19/2015 12:00 AM	2.70	20:45	1.40	02:30	2.04
10/20/2015 12:00 AM	2.71	09:00	1.47	04:00	2.13
10/21/2015 12:00 AM	2.59	19:15	1.45	03:00	2.12
10/22/2015 12:00 AM	2.64	10:15	1.56	01:45	2.16
10/23/2015 12:00 AM	2.72	18:15	1.58	02:15	2.26
10/24/2015 12:00 AM	3.13	08:00	1.49	04:30	2.05

Rain Gauge Treatment Plant

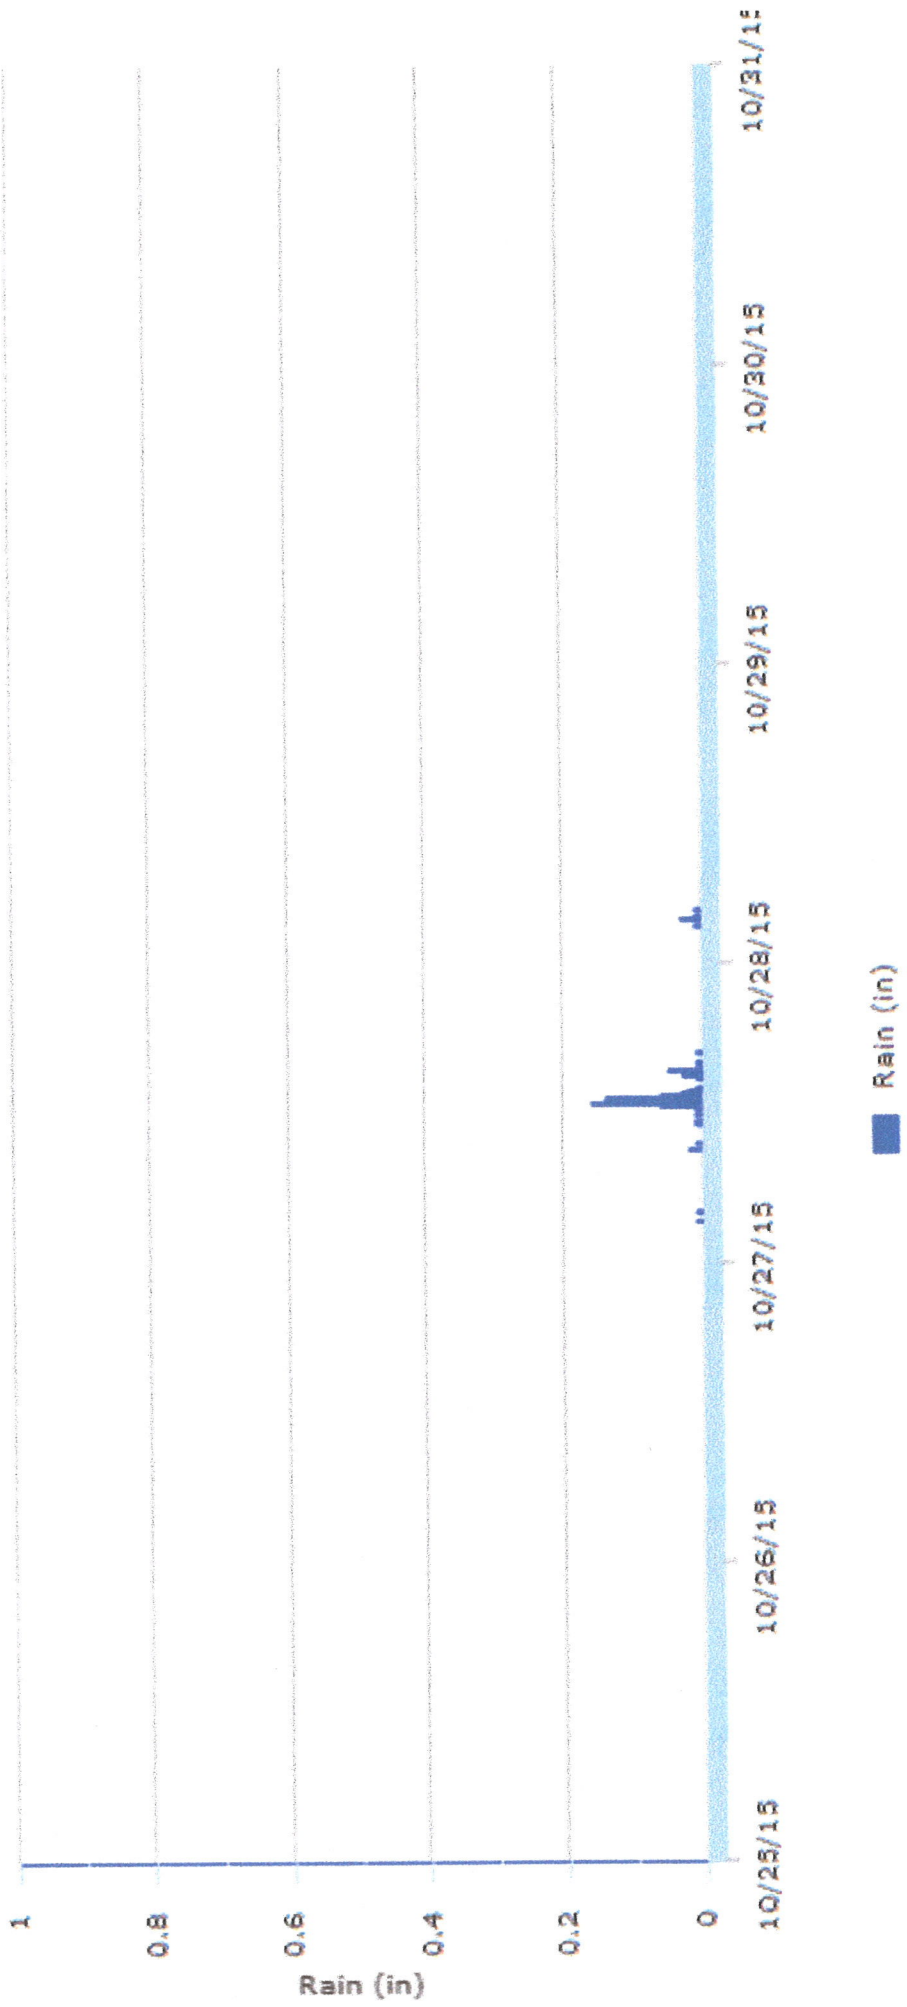

MH 09

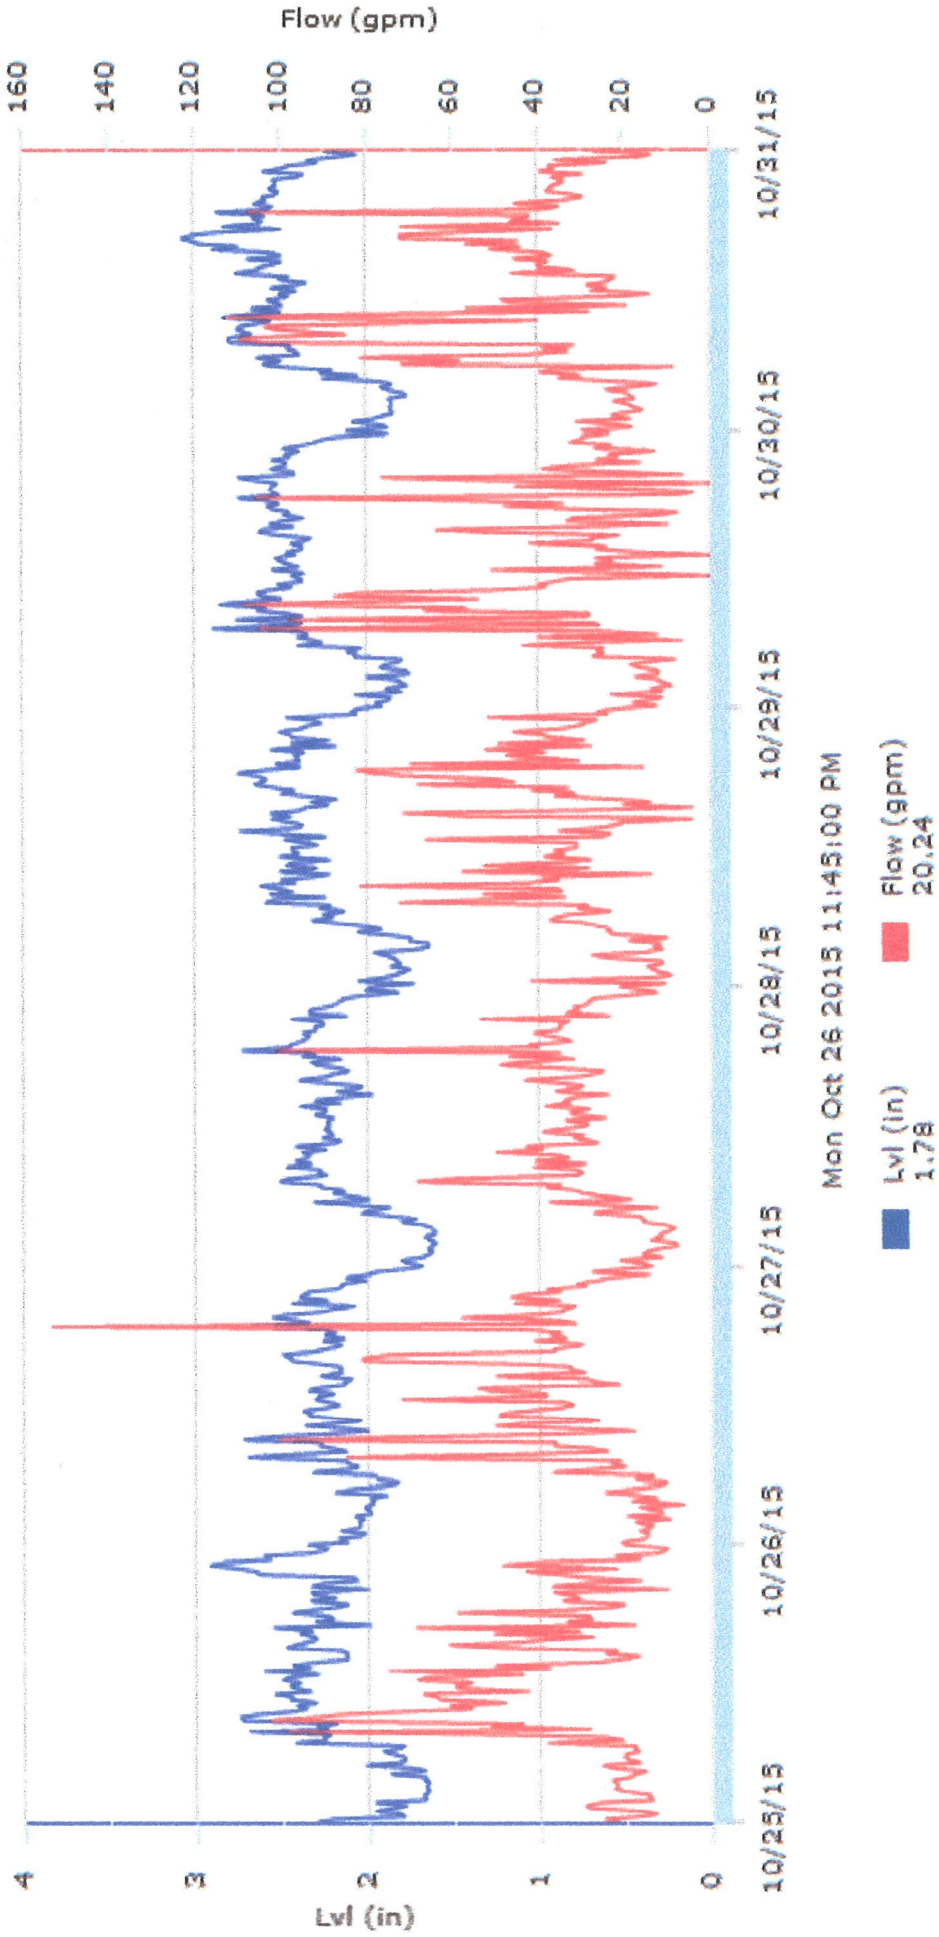

Data Summary Report

Custom
Utilities, Inc.
MH 09

10/25/2015 12:00 AM - 10/31/2015 12:00 AM

Flow Summary

Maximum (gpm): 153.56 10/26/2015 06:45 PM
Minimum (gpm): 0.00 10/29/2015 11:30 AM
Average (gpm): 34.78
Total (gal): 300,479.4

Date	Maximum (gpm)	Maximum Time	Minimum (gpm)	Minimum Time	Average (gpm)	Total (gal)
10/25/2015 12:00 AM	102.96	09:00	10.24	20:15	36.02	51,863.1
10/26/2015 12:00 AM	153.56	18:45	6.73	03:30	34.85	50,190.4
10/27/2015 12:00 AM	101.32	18:30	8.13	01:45	30.51	43,928.5
10/28/2015 12:00 AM	82.82	18:45	3.96	15:30	33.82	48,697.7
10/29/2015 12:00 AM	108.75	09:00	0.00	11:30	31.37	45,178.6
10/30/2015 12:00 AM	112.50	09:45	8.30	05:30	42.10	60,621.1

Data Summary Report

Custom
Utilities, Inc.
MH 09

10/25/2015 12:00 AM - 10/31/2015 12:00 AM

Level Summary

Maximum (in): 3.07 10/30/2015 04:30 PM
Minimum (in): 1.61 10/27/2015 02:00 AM
Average (in): 2.27

Date	Maximum (in)	Maximum Time	Minimum (in)	Minimum Time	Average (in)
10/25/2015 12:00 AM	2.93	22:15	1.65	03:30	2.22
10/26/2015 12:00 AM	3.03	18:45	1.78	23:45	2.21
10/27/2015 12:00 AM	2.73	18:30	1.61	02:00	2.14
10/28/2015 12:00 AM	2.76	18:30	1.65	03:45	2.28
10/29/2015 12:00 AM	2.90	07:00	1.76	03:00	2.35
10/30/2015 12:00 AM	3.07	16:30	1.77	03:00	2.44

Data Summary Report

Custom
Utilities, Inc.
MH 09

11/01/2015 12:00 AM - 11/07/2015 12:00 AM

Flow Summary

Maximum (gpm): 121.43 11/02/2015 09:00 PM
Minimum (gpm): -34.51 11/06/2015 03:30 PM
Average (gpm): 36.95
Total (gal): 319,281.0

Date	Maximum (gpm)	Maximum Time	Minimum (gpm)	Minimum Time	Average (gpm)	Total (gal)
11/01/2015 12:00 AM	111.19	12:00	9.43	03:00	37.40	53,855.9
11/02/2015 12:00 AM	121.43	21:00	9.39	02:15	35.38	50,944.8
11/03/2015 12:00 AM	80.94	20:15	6.39	03:30	34.22	49,270.8
11/04/2015 12:00 AM	57.85	19:30	3.55	03:45	34.82	50,139.5
11/05/2015 12:00 AM	102.94	07:00	13.28	04:00	43.04	61,975.4
11/06/2015 12:00 AM	88.94	18:30	-34.51	15:30	36.87	53,094.6

Data Summary Report

Custom
Utilities, Inc.
MH 09


11/01/2015 12:00 AM - 11/07/2015 12:00 AM

Level Summary


Maximum (in): 2.96 11/03/2015 08:15 PM
Minimum (in): 1.53 11/02/2015 02:15 AM
Average (in): 2.35

Date	Maximum (in)	Maximum Time	Minimum (in)	Minimum Time	Average (in)
11/01/2015 12:00 AM	2.87	12:00	1.58	04:00	2.15
11/02/2015 12:00 AM	2.92	21:00	1.53	02:15	2.17
11/03/2015 12:00 AM	2.96	20:15	1.72	03:15	2.36
11/04/2015 12:00 AM	2.87	21:15	1.81	03:45	2.41
11/05/2015 12:00 AM	2.95	07:00	1.87	03:45	2.50
11/06/2015 12:00 AM	2.95	20:45	1.86	03:45	2.52

Rain Gauge Treatment Plant

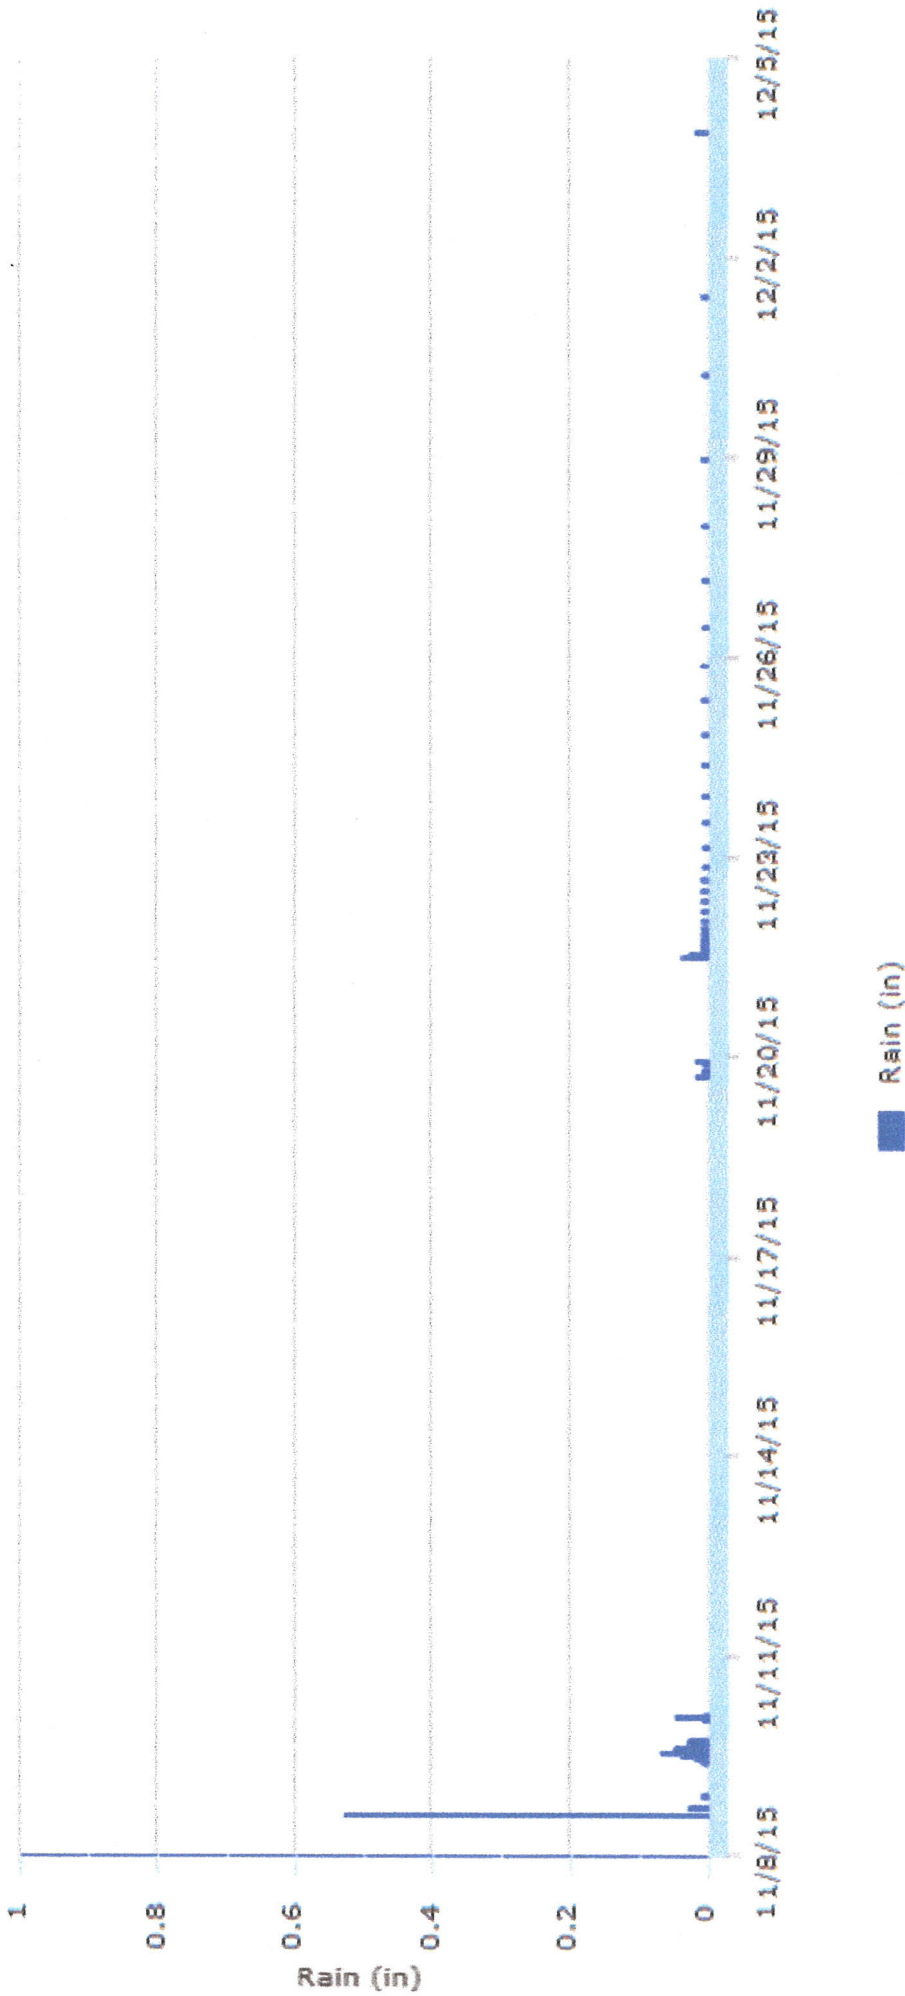

MH 09

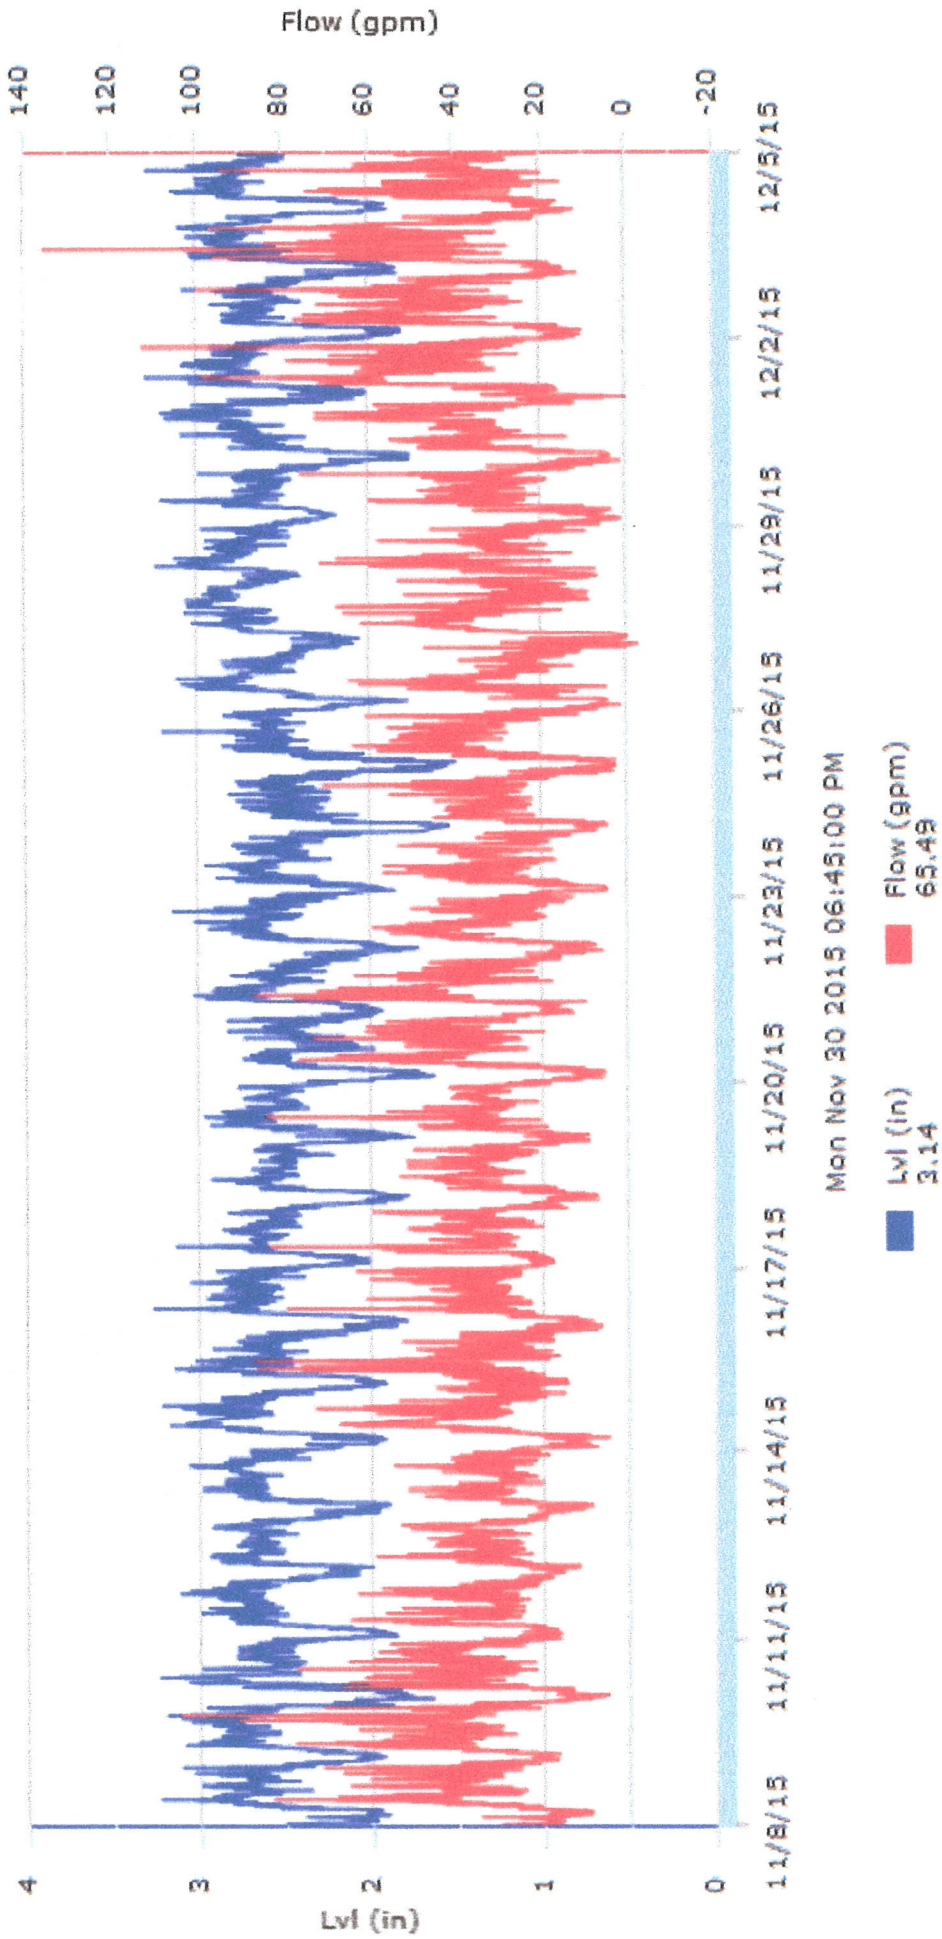

Data Summary Report

Custom
Utilities, Inc.
MH 09

11/08/2015 12:00 AM - 12/05/2015 12:00 AM

Flow Summary

Maximum (gpm): 135.56 12/03/2015 10:30 AM
 Minimum (gpm): -2.70 11/27/2015 02:30 AM
 Average (gpm): 32.95
 Total (gal): 1,281,186.4

Date	Maximum (gpm)	Maximum Time	Minimum (gpm)	Minimum Time	Average (gpm)	Total (gal)
11/08/2015 12:00 AM	83.16	10:15	8.90	05:45	34.45	49,613.6
11/09/2015 12:00 AM	104.72	19:15	16.61	04:00	40.53	58,363.3
11/10/2015 12:00 AM	77.75	13:15	5.01	03:15	35.13	50,588.2
11/11/2015 12:00 AM	65.33	08:30	16.06	03:15	32.29	46,492.5
11/12/2015 12:00 AM	59.26	08:45	11.99	05:15	31.01	44,654.3
11/13/2015 12:00 AM	55.18	18:30	8.67	04:15	28.89	41,605.7
11/14/2015 12:00 AM	73.36	17:45	4.91	05:15	33.92	48,851.5
11/15/2015 12:00 AM	87.48	12:15	14.46	03:30	34.26	49,335.7
11/16/2015 12:00 AM	79.69	08:15	6.39	01:45	31.47	45,322.1
11/17/2015 12:00 AM	84.04	08:15	14.49	23:15	33.18	47,780.4
11/18/2015 12:00 AM	53.74	11:30	7.14	02:30	29.73	42,808.7
11/19/2015 12:00 AM	84.41	10:30	9.23	01:45	30.74	44,259.8
11/20/2015 12:00 AM	77.05	09:00	5.43	04:15	35.57	51,215.0
11/21/2015 12:00 AM	87.32	09:45	9.69	07:15	35.70	51,402.3
11/22/2015 12:00 AM	59.77	12:00	5.79	03:15	28.84	41,533.3
11/23/2015 12:00 AM	57.20	09:30	4.72	02:45	28.67	41,285.4
11/24/2015 12:00 AM	71.10	19:30	4.59	04:15	28.25	40,683.4
11/25/2015 12:00 AM	64.05	10:45	2.72	03:15	30.15	43,415.1
11/26/2015 12:00 AM	64.92	12:15	1.53	02:30	24.40	35,142.8
11/27/2015 12:00 AM	67.80	16:45	-2.70	02:30	27.39	39,441.0
11/28/2015 12:00 AM	71.30	09:30	6.73	04:45	30.86	44,440.1
11/29/2015 12:00 AM	75.93	20:45	1.19	03:00	26.56	38,252.6
11/30/2015 12:00 AM	72.44	19:45	1.19	01:45	32.72	47,111.2
12/01/2015 12:00 AM	112.81	21:30	0.00	02:00	41.96	60,418.9
12/02/2015 12:00 AM	99.81	19:15	10.10	04:00	41.26	59,420.4
12/03/2015 12:00 AM	135.56	10:30	11.12	01:30	44.89	64,634.6
12/04/2015 12:00 AM	94.47	17:45	12.00	02:30	36.89	53,114.8

Data Summary Report

Custom
Utilities, Inc.
MH 09

11/08/2015 12:00 AM - 12/05/2015 12:00 AM

Level Summary

Maximum (in): 3.30 12/01/2015 09:30 AM
Minimum (in): 1.50 11/25/2015 04:45 AM
Average (in): 2.52

Date	Maximum (in)	Maximum Time	Minimum (in)	Minimum Time	Average (in)
11/08/2015 12:00 AM	3.23	10:15	1.90	04:15	2.52
11/09/2015 12:00 AM	3.20	19:15	1.88	23:15	2.59
11/10/2015 12:00 AM	3.24	10:15	1.64	01:45	2.47
11/11/2015 12:00 AM	3.12	18:45	1.86	02:00	2.57
11/12/2015 12:00 AM	2.95	08:30	2.00	05:00	2.56
11/13/2015 12:00 AM	3.07	18:30	1.90	04:30	2.55
11/14/2015 12:00 AM	3.23	18:45	1.92	04:15	2.64
11/15/2015 12:00 AM	3.15	09:15	1.92	03:30	2.51
11/16/2015 12:00 AM	3.27	08:15	1.79	03:45	2.53
11/17/2015 12:00 AM	3.14	08:15	2.01	03:45	2.51
11/18/2015 12:00 AM	2.93	10:15	1.78	03:45	2.41
11/19/2015 12:00 AM	2.97	10:30	1.75	02:45	2.47
11/20/2015 12:00 AM	2.84	23:45	1.63	03:00	2.31
11/21/2015 12:00 AM	3.03	09:45	1.94	03:45	2.44
11/22/2015 12:00 AM	3.15	18:15	1.72	04:15	2.45
11/23/2015 12:00 AM	2.96	12:15	1.85	02:30	2.48
11/24/2015 12:00 AM	2.82	16:00	1.54	04:00	2.31
11/25/2015 12:00 AM	3.21	16:30	1.50	04:45	2.37
11/26/2015 12:00 AM	3.12	13:00	1.77	04:15	2.53
11/27/2015 12:00 AM	3.08	14:15	2.06	04:45	2.65
11/28/2015 12:00 AM	3.24	08:15	2.39	04:30	2.74
11/29/2015 12:00 AM	3.21	10:15	2.18	04:30	2.56
11/30/2015 12:00 AM	3.21	19:45	1.76	04:30	2.57
12/01/2015 12:00 AM	3.30	09:30	2.01	03:30	2.66
12/02/2015 12:00 AM	3.08	19:15	1.81	04:30	2.48
12/03/2015 12:00 AM	3.20	10:30	1.83	01:30	2.59
12/04/2015 12:00 AM	3.29	17:45	1.89	02:45	2.62

Data Summary Report

Custom
Utilities, Inc.
MH 09

12/06/2015 12:00 AM - 12/17/2015 12:00 AM

Flow Summary

Maximum (gpm): 127.05 12/11/2015 09:15 AM
Minimum (gpm): 1.76 12/10/2015 04:00 AM
Average (gpm): 31.96
Total (gal): 506,270.0

Date	Maximum (gpm)	Maximum Time	Minimum (gpm)	Minimum Time	Average (gpm)	Total (gal)
12/06/2015 12:00 AM	97.93	20:00	5.90	05:15	35.97	51,796.1
12/07/2015 12:00 AM	91.52	21:45	2.51	02:15	38.95	56,094.0
12/08/2015 12:00 AM	110.67	12:30	1.81	03:45	37.75	54,359.1
12/09/2015 12:00 AM	83.10	08:30	2.61	02:00	34.57	49,787.7
12/10/2015 12:00 AM	91.75	20:15	1.76	04:00	30.72	44,242.8
12/11/2015 12:00 AM	127.05	09:15	7.75	01:30	32.84	47,294.5
12/12/2015 12:00 AM	104.52	10:15	2.93	02:00	31.49	45,338.5
12/13/2015 12:00 AM	79.28	10:00	5.71	03:15	29.87	43,016.9
12/14/2015 12:00 AM	86.01	18:00	3.44	02:45	30.06	43,288.1
12/15/2015 12:00 AM	57.86	20:15	2.49	04:30	25.25	36,362.1
12/16/2015 12:00 AM	47.49	00:15	2.70	02:15	24.09	34,690.3

Data Summary Report

Custom
Utilities, Inc.
MH 09


12/06/2015 12:00 AM - 12/17/2015 12:00 AM

Level Summary


Maximum (in): 3.55 12/06/2015 11:00 AM
Minimum (in): 1.52 12/14/2015 04:30 AM
Average (in): 2.53

Date	Maximum (in)	Maximum Time	Minimum (in)	Minimum Time	Average (in)
12/06/2015 12:00 AM	3.55	11:00	2.01	05:00	2.68
12/07/2015 12:00 AM	3.19	19:30	1.91	03:15	2.67
12/08/2015 12:00 AM	3.35	10:30	1.87	02:45	2.73
12/09/2015 12:00 AM	3.26	09:00	1.89	02:15	2.62
12/10/2015 12:00 AM	3.00	15:45	1.80	04:00	2.51
12/11/2015 12:00 AM	3.16	09:15	1.95	01:30	2.55
12/12/2015 12:00 AM	3.22	09:00	1.88	05:45	2.57
12/13/2015 12:00 AM	3.12	12:15	1.82	06:00	2.44
12/14/2015 12:00 AM	3.05	18:00	1.52	04:30	2.45
12/15/2015 12:00 AM	2.83	06:45	1.84	02:15	2.37
12/16/2015 12:00 AM	2.64	10:00	1.73	03:15	2.27

Rain Gauge Treatment Plant

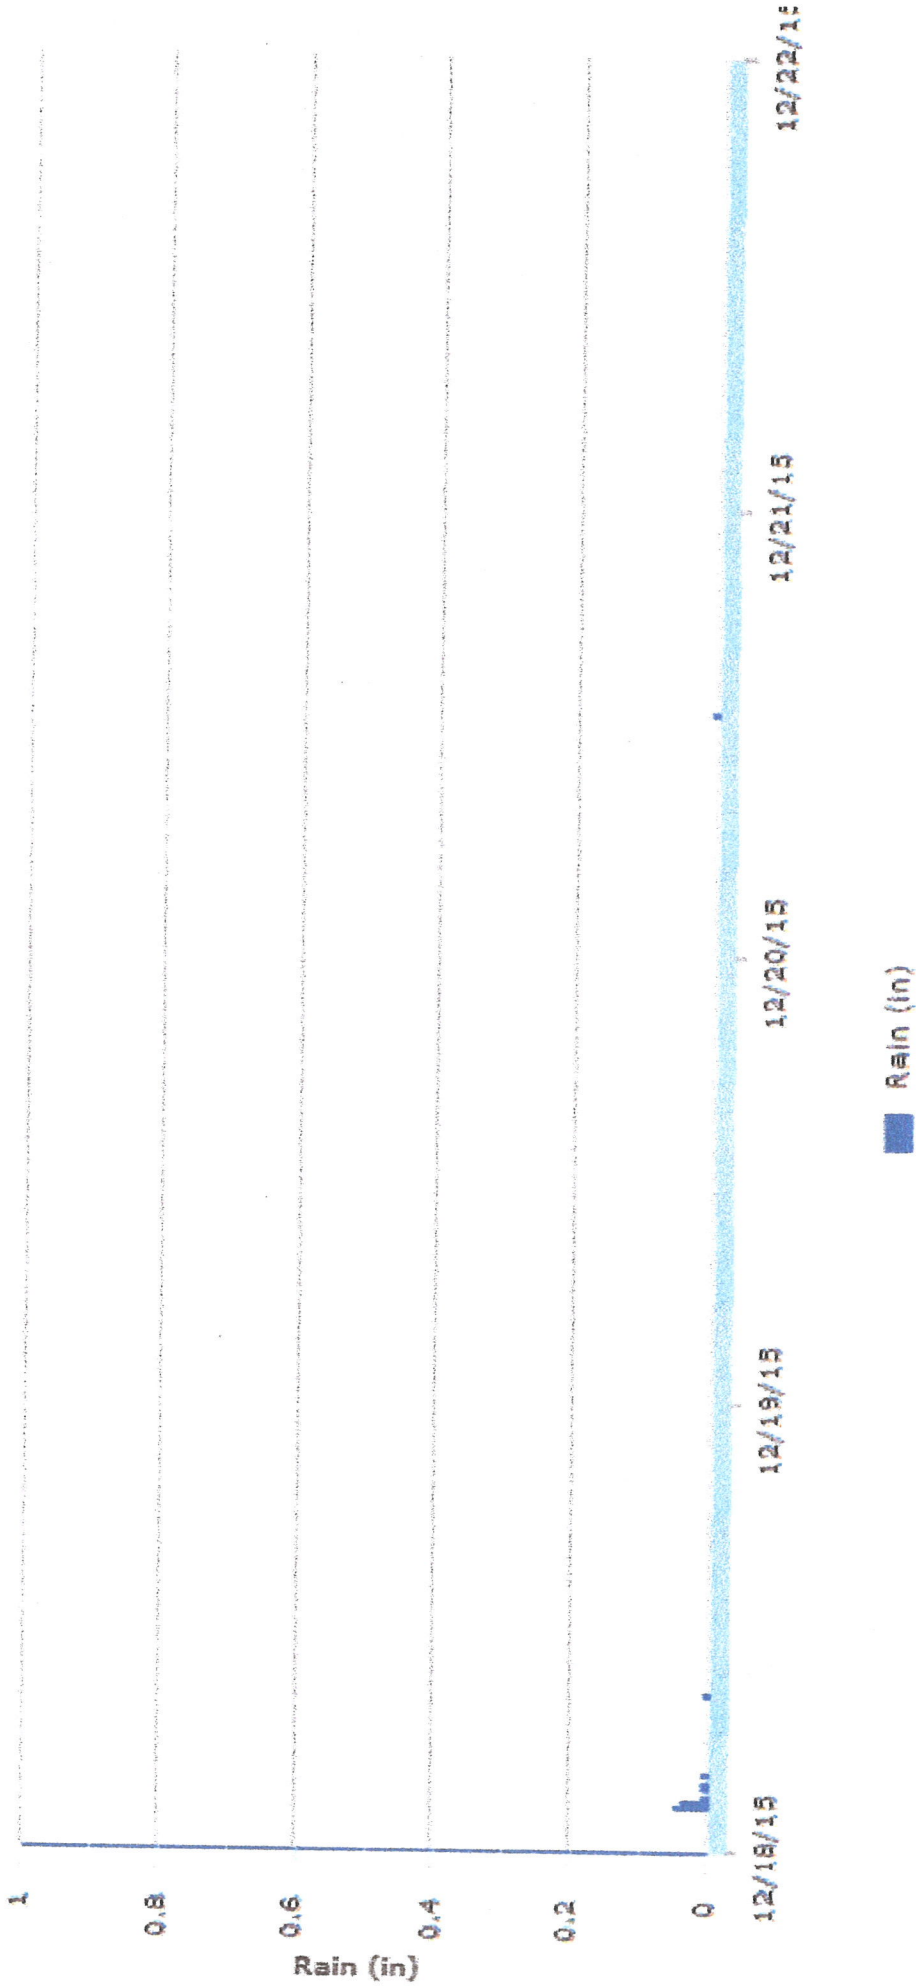

MH 09

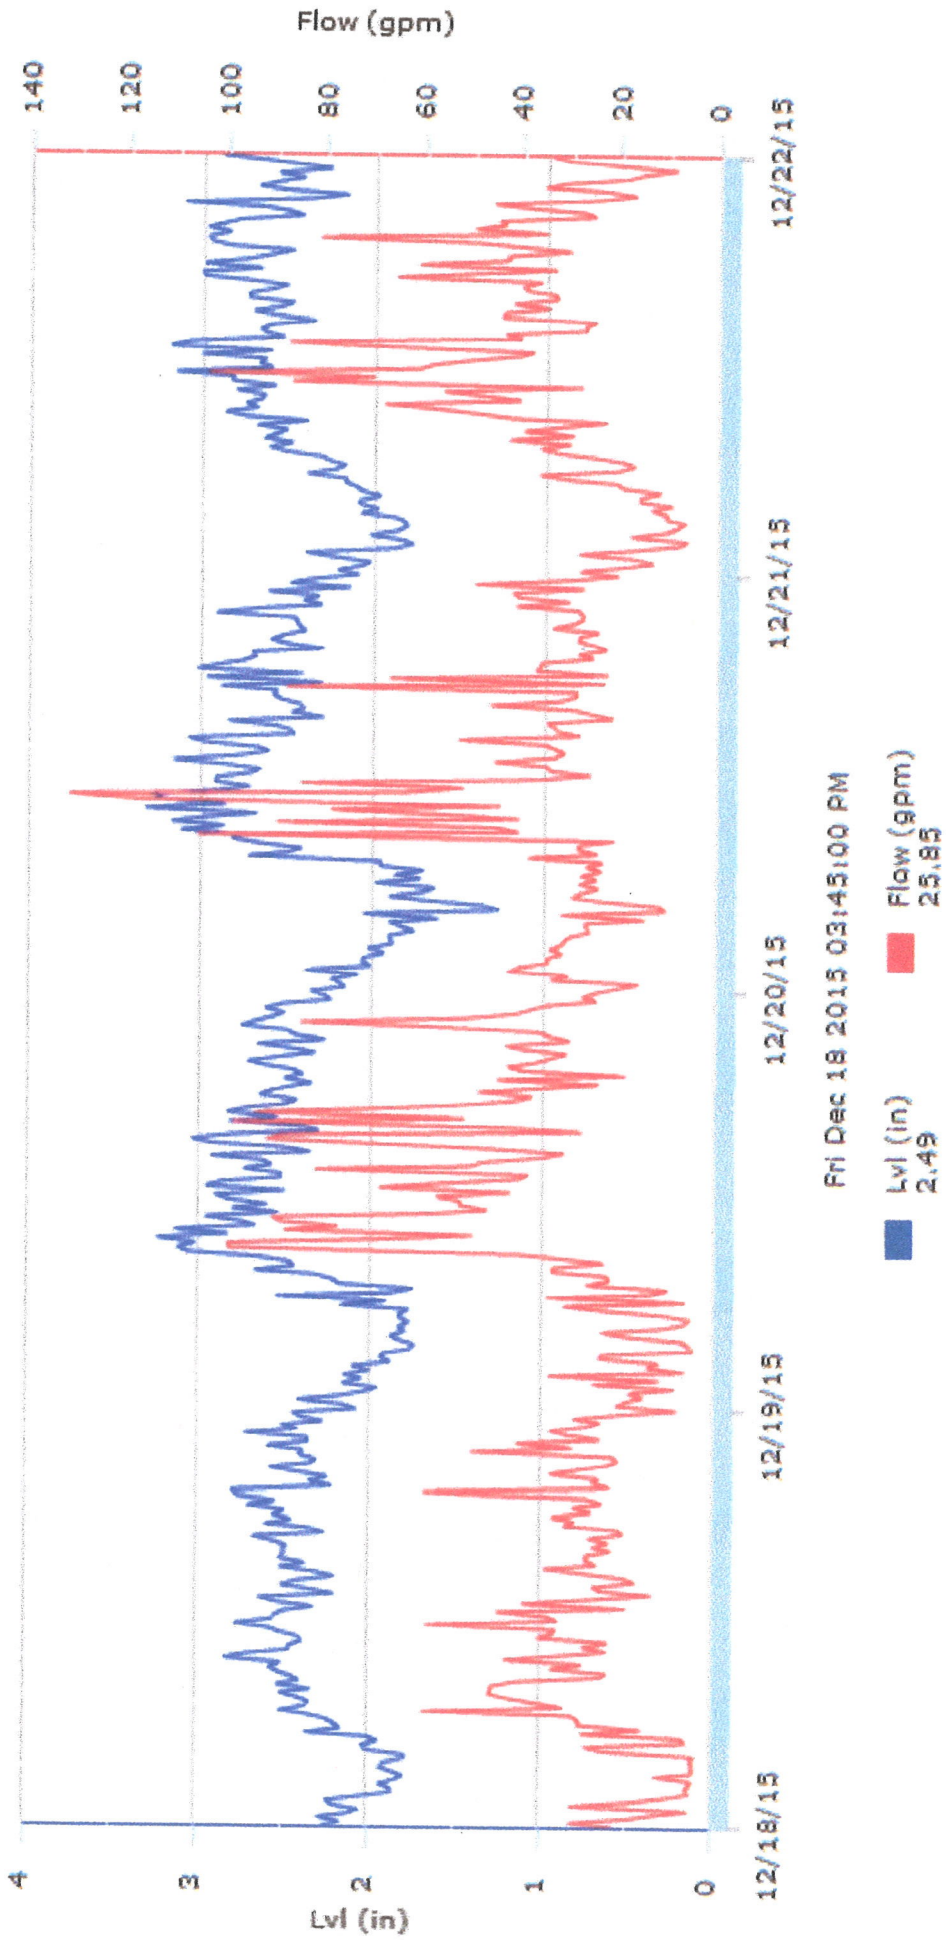

Data Summary Report

Custom
Utilities, Inc.
MH 09

12/18/2015 12:00 AM - 12/22/2015 12:00 AM

Flow Summary

Maximum (gpm): 131.93 12/20/2015 11:15 AM
Minimum (gpm): 3.56 12/18/2015 04:15 AM
Average (gpm): 34.14
Total (gal): 196,639.0

Date	Maximum (gpm)	Maximum Time	Minimum (gpm)	Minimum Time	Average (gpm)	Total (gal)
12/18/2015 12:00 AM	59.13	19:15	3.56	04:15	25.19	36,275.9
12/19/2015 12:00 AM	99.22	09:30	4.28	03:30	39.44	56,786.7
12/20/2015 12:00 AM	131.93	11:15	10.62	04:45	36.96	53,222.0
12/21/2015 12:00 AM	104.23	11:30	6.67	02:00	34.97	50,354.4

Data Summary Report

Custom
Utilities, Inc.
MH 09


12/18/2015 12:00 AM - 12/22/2015 12:00 AM

Level Summary


Maximum (in): 3.33 12/20/2015 10:30 AM
Minimum (in): 1.27 12/20/2015 04:45 AM
Average (in): 2.44

Date	Maximum (in)	Maximum Time	Minimum (in)	Minimum Time	Average (in)
12/18/2015 12:00 AM	2.83	09:45	1.79	04:15	2.35
12/19/2015 12:00 AM	3.25	09:45	1.75	03:45	2.44
12/20/2015 12:00 AM	3.33	10:30	1.27	04:45	2.44
12/21/2015 12:00 AM	3.20	13:00	1.79	01:45	2.51

Rain Gauge Treatment Plant

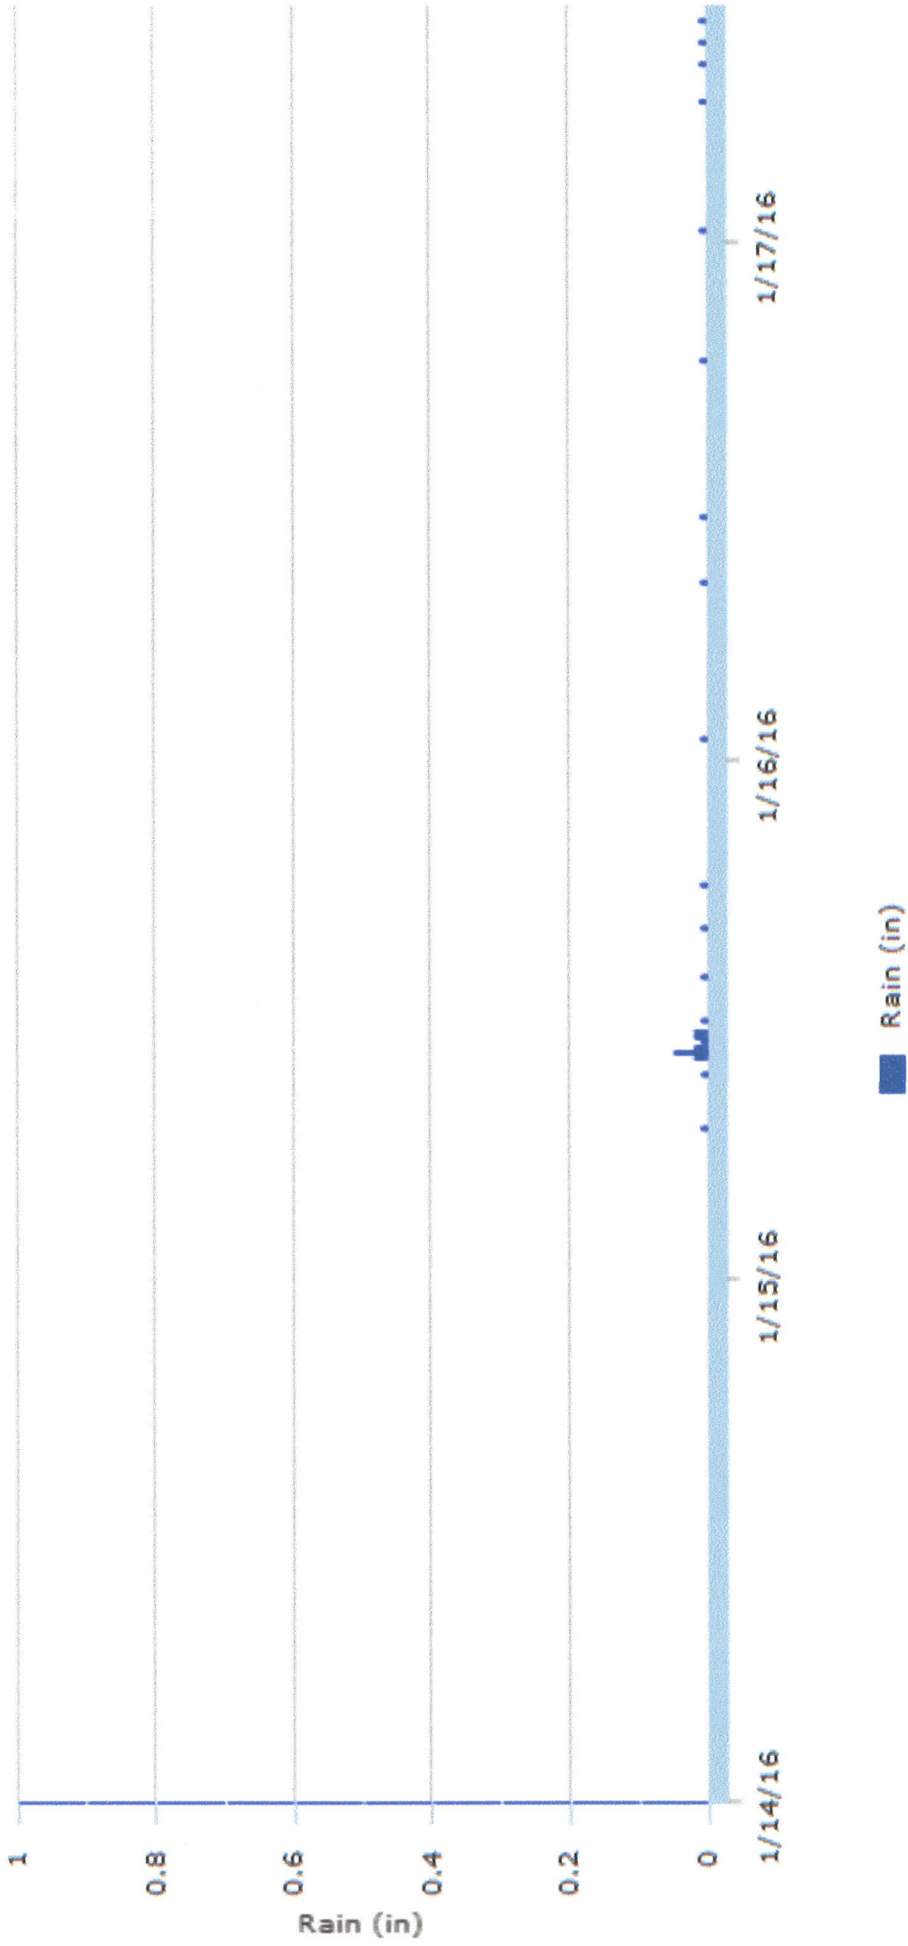

MH 09

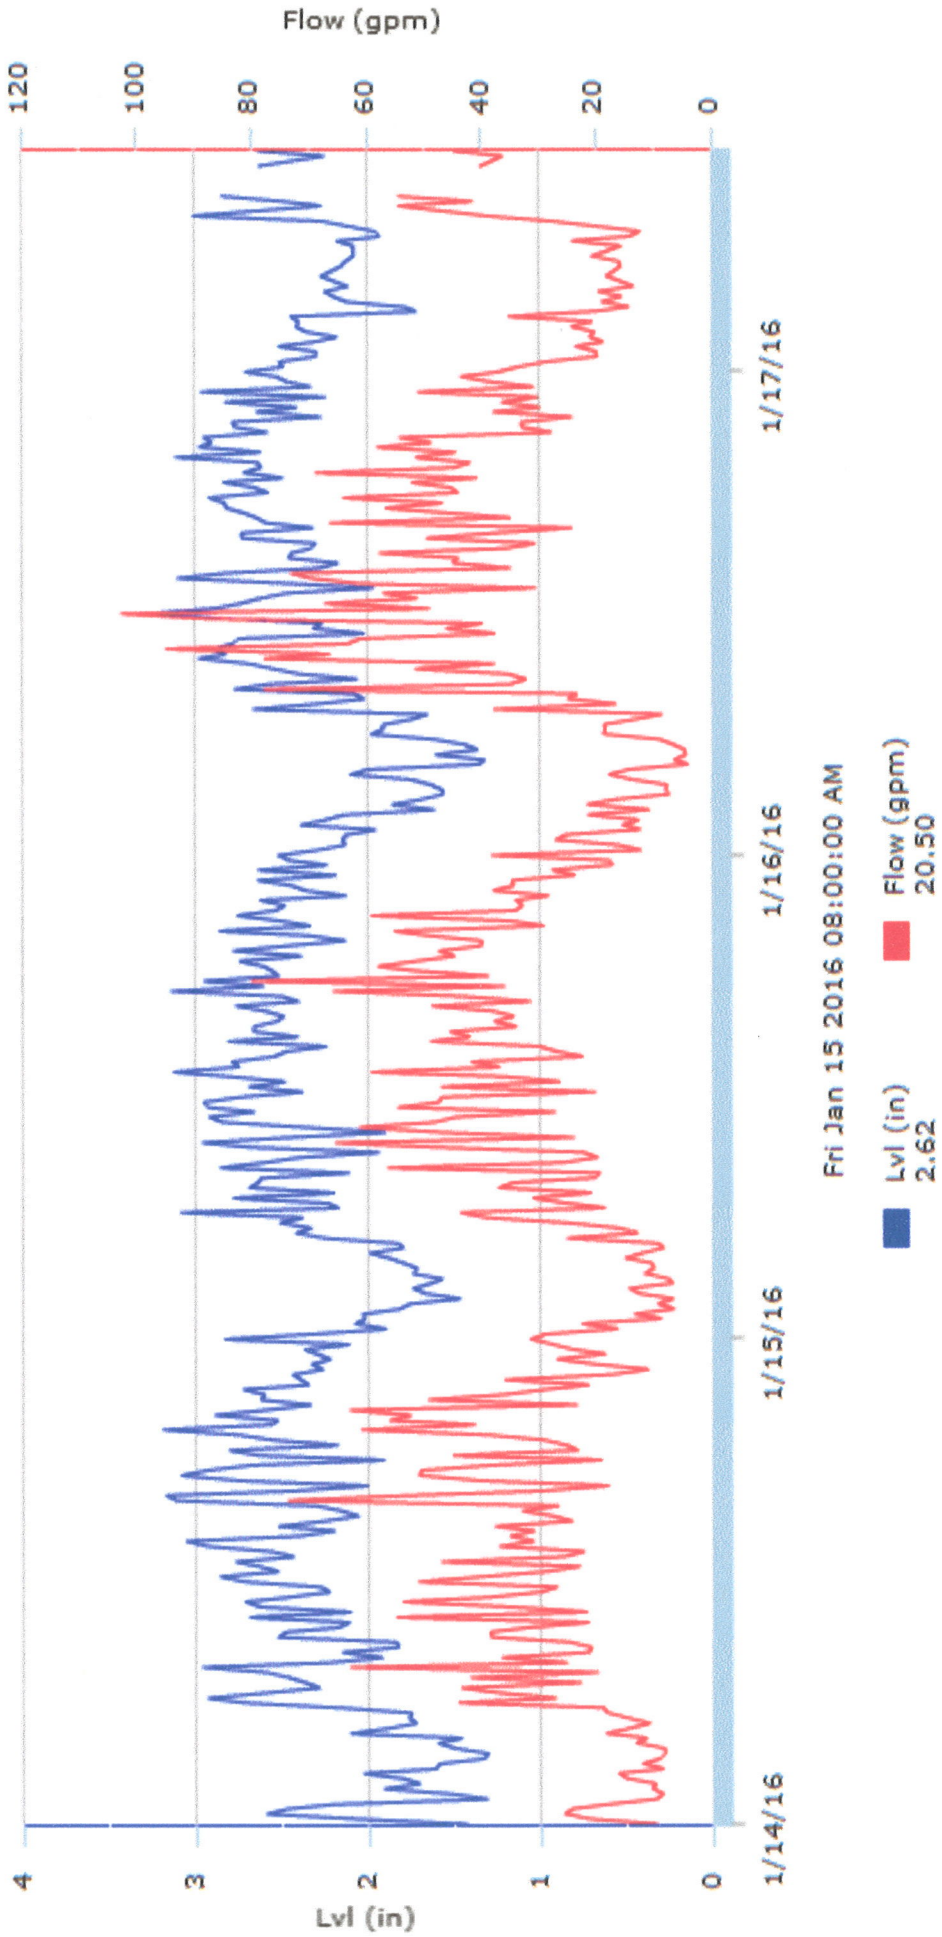

Data Summary Report

Custom
Utilities, Inc.
MH 09

01/14/2016 12:00 AM - 01/17/2016 11:00 AM

Flow Summary

Maximum (gpm): 102.76 01/16/2016 12:00 PM
Minimum (gpm): 4.25 01/16/2016 04:30 AM
Average (gpm): 32.29
Total (gal): 157,894.7

Date	Maximum (gpm)	Maximum Time	Minimum (gpm)	Minimum Time	Average (gpm)	Total (gal)
01/14/2016 12:00 AM	73.94	16:00	8.36	03:30	29.63	42,665.1
01/15/2016 12:00 AM	80.30	17:45	6.76	01:30	32.72	47,114.5
01/16/2016 12:00 AM	102.76	12:00	4.25	04:30	37.65	54,217.5
01/17/2016 12:00 AM	54.55	08:45	12.40	07:00	24.38	13,897.6

Data Summary Report

Custom
Utilities, Inc.
MH 09

01/14/2016 12:00 AM - 01/17/2016 11:00 AM

Level Summary


Maximum (in): 3.27 01/16/2016 12:00 PM
Minimum (in): 1.30 01/14/2016 01:15 AM
Average (in): 2.36

Date	Maximum (in)	Maximum Time	Minimum (in)	Minimum Time	Average (in)
01/14/2016 12:00 AM	3.19	19:30	1.30	01:15	2.32
01/15/2016 12:00 AM	3.14	17:15	1.46	02:00	2.41
01/16/2016 12:00 AM	3.27	12:00	1.32	04:45	2.37
01/17/2016 12:00 AM	3.01	07:45	1.72	03:00	2.28


VEVA

RAIN EVENT
NOV. 8

Rain Gauge Treatment Plant

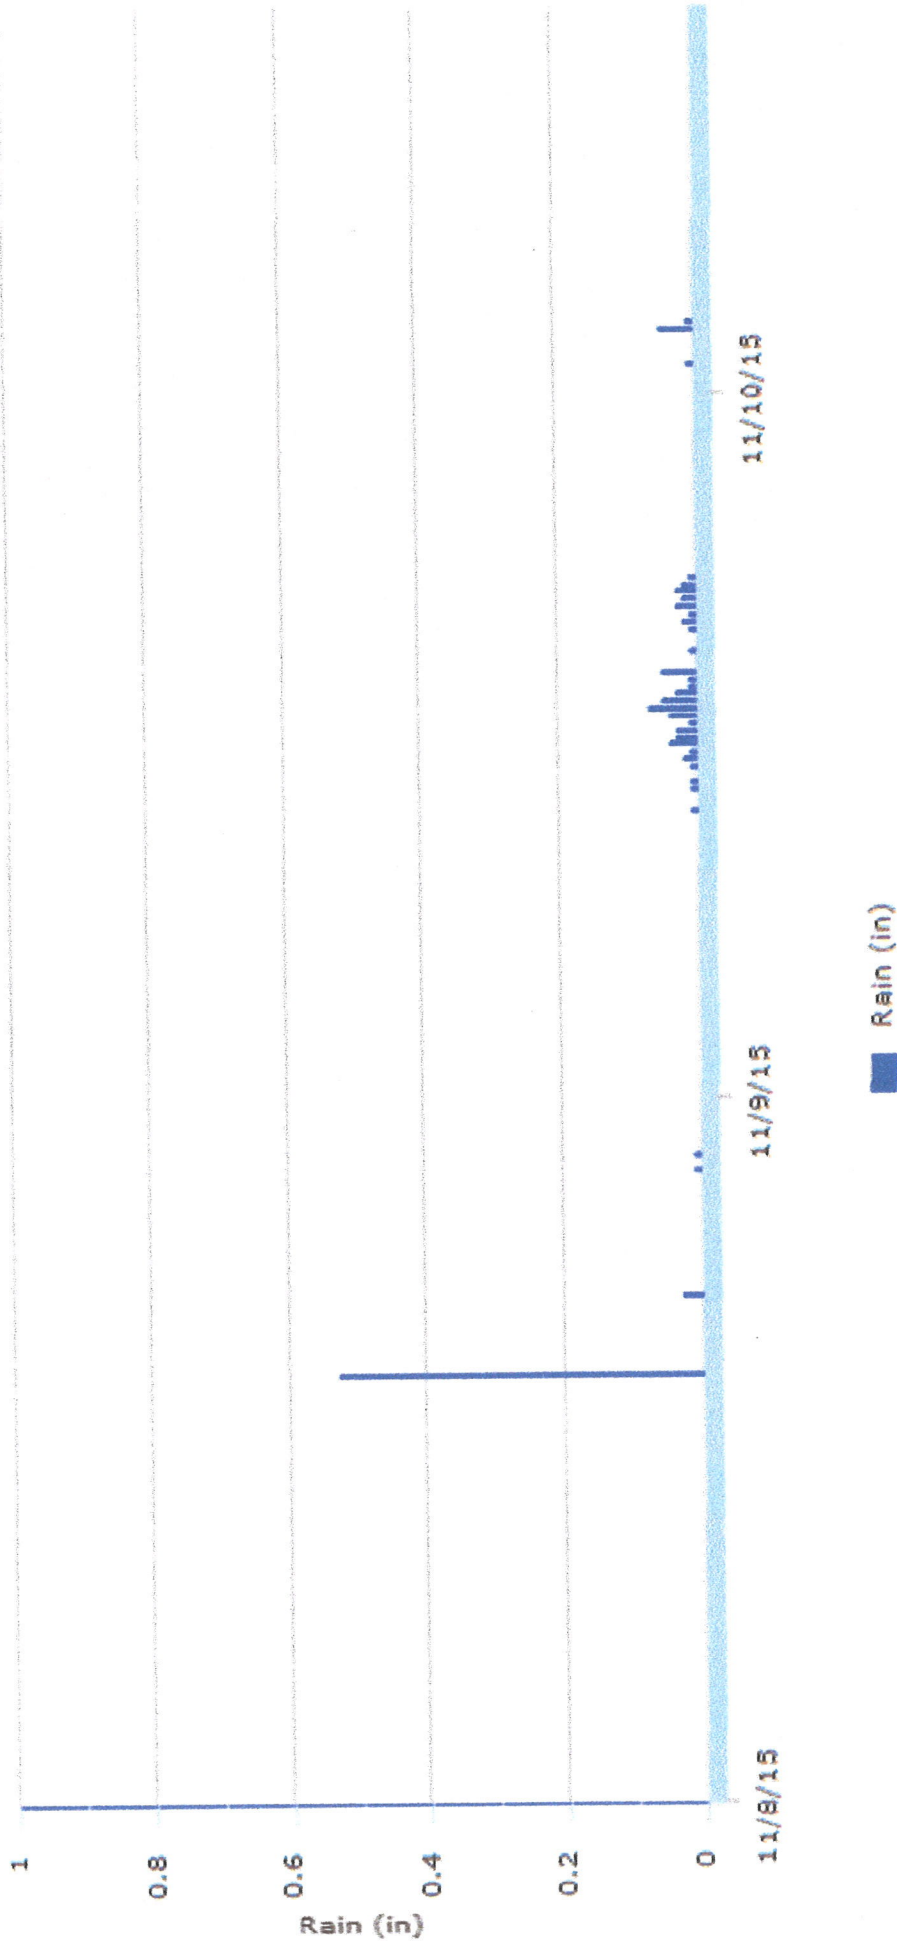

MH 09

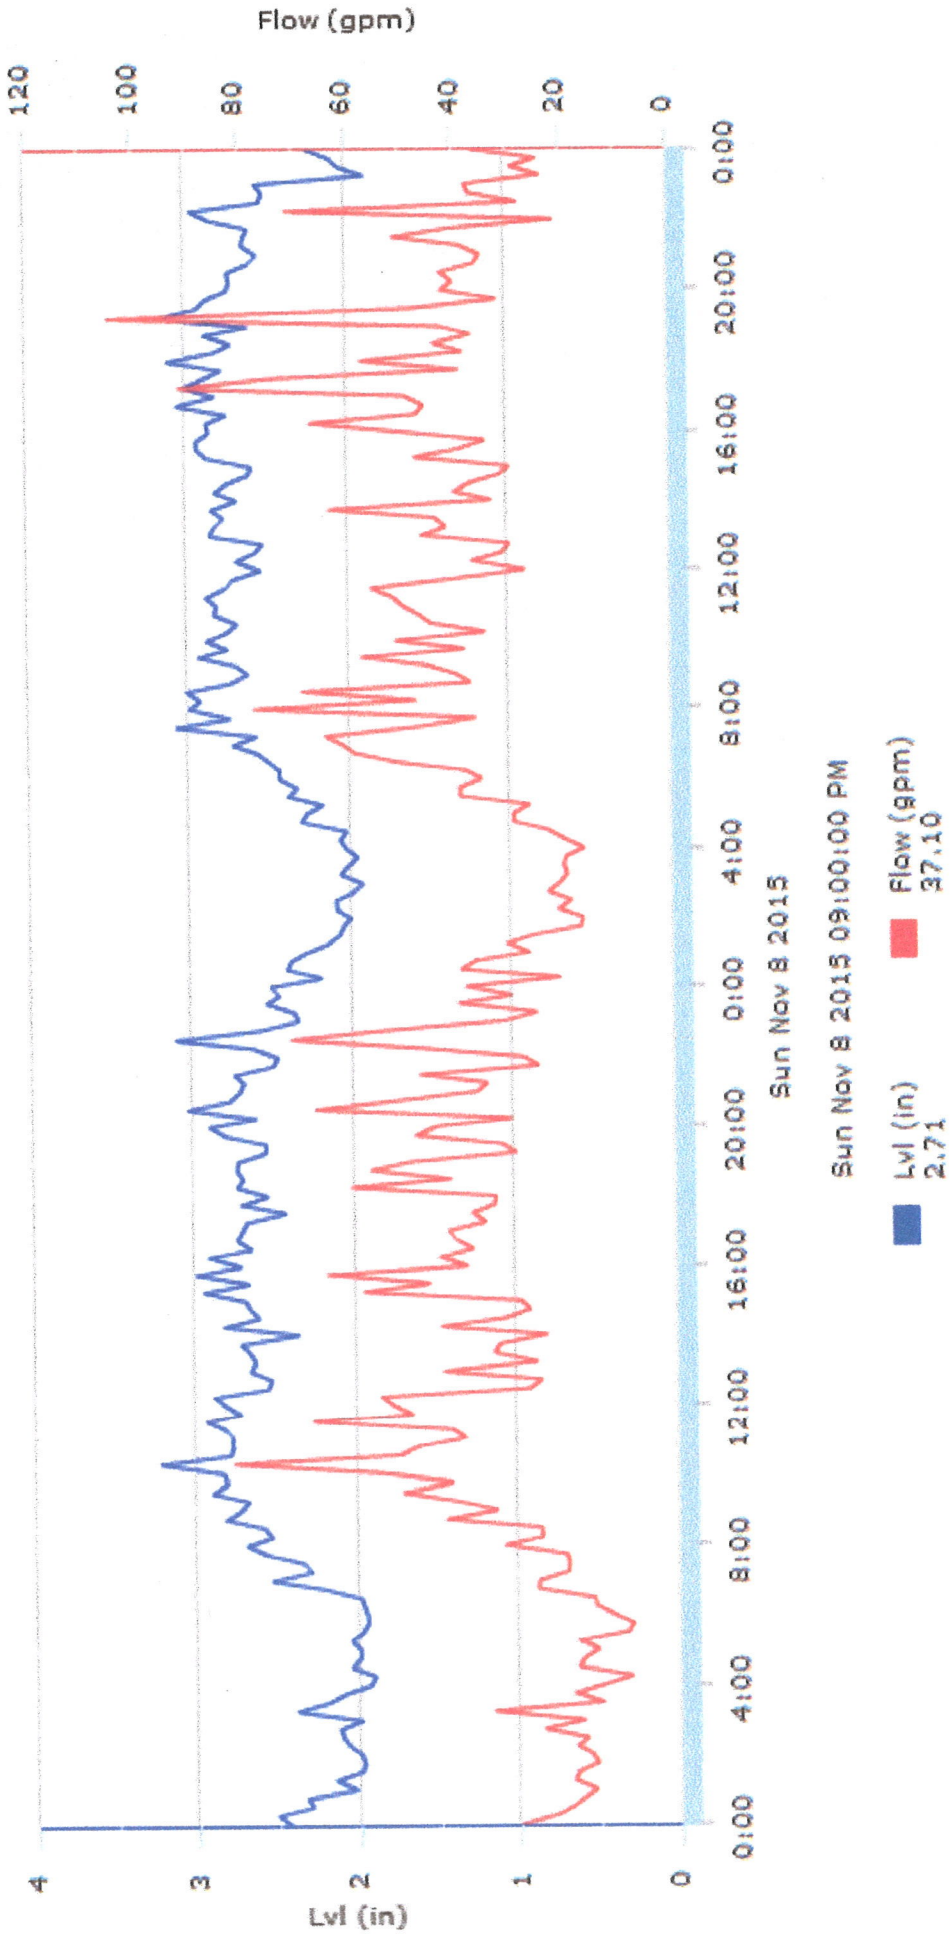

Data Summary Report

Custom
Utilities, Inc.
MH 09

11/08/2015 07:00 AM - 11/09/2015 01:00 AM

Flow Summary

Maximum (gpm): 83.16 11/08/2015 10:15 AM
Minimum (gpm): 20.76 11/08/2015 07:30 AM
Average (gpm): 40.67
Total (gal): 43,919.0

Date	Maximum (gpm)	Maximum Time	Minimum (gpm)	Minimum Time	Average (gpm)	Total (gal)
11/08/2015 07:00 AM	26.37	07:00	20.76	07:30	22.34	1,340.7
11/08/2015 08:00 AM	43.66	08:45	25.74	08:15	32.03	1,922.0
11/08/2015 09:00 AM	51.68	09:30	33.97	09:00	42.37	2,542.5
11/08/2015 10:00 AM	83.16	10:15	48.56	10:45	59.78	3,586.9
11/08/2015 11:00 AM	68.35	11:30	39.80	11:00	50.03	3,001.5
11/08/2015 12:00 PM	55.41	12:15	25.56	12:45	40.59	2,435.5
11/08/2015 01:00 PM	43.91	13:00	26.17	13:15	34.42	2,065.2
11/08/2015 02:00 PM	44.33	14:15	24.23	14:00	32.03	1,921.7
11/08/2015 03:00 PM	65.53	15:45	29.29	15:00	49.90	2,994.1
11/08/2015 04:00 PM	44.34	16:15	38.15	16:30	40.72	2,443.1
11/08/2015 05:00 PM	42.71	17:00	34.03	17:45	37.65	2,258.8
11/08/2015 06:00 PM	60.89	18:15	33.88	18:00	48.48	2,908.9
11/08/2015 07:00 PM	49.60	19:00	29.82	19:15	40.14	2,408.4
11/08/2015 08:00 PM	67.18	20:30	30.31	20:15	48.58	2,914.9
11/08/2015 09:00 PM	47.82	21:30	25.53	21:45	36.40	2,184.1
11/08/2015 10:00 PM	71.67	22:30	28.37	22:00	50.37	3,022.0
11/08/2015 11:00 PM	40.29	23:30	25.62	23:15	31.96	1,917.6
11/09/2015 12:00 AM	39.71	00:30	21.17	00:15	34.18	2,051.1

Data Summary Report

Custom
Utilities, Inc.
MH 09

11/08/2015 07:00 AM - 11/09/2015 01:00 AM

Level Summary

Maximum (in): 3.23 11/08/2015 10:15 AM
Minimum (in): 2.19 11/09/2015 12:15 AM
Average (in): 2.67

Date	Maximum (in)	Maximum Time	Minimum (in)	Minimum Time	Average (in)
11/08/2015 07:00 AM	2.56	07:45	2.29	07:15	2.44
11/08/2015 08:00 AM	2.82	08:45	2.53	08:15	2.66
11/08/2015 09:00 AM	2.90	09:30	2.68	09:15	2.78
11/08/2015 10:00 AM	3.23	10:15	2.77	10:45	2.91
11/08/2015 11:00 AM	2.94	11:30	2.72	11:45	2.81
11/08/2015 12:00 PM	2.89	12:15	2.53	12:45	2.70
11/08/2015 01:00 PM	2.72	13:45	2.63	13:15	2.67
11/08/2015 02:00 PM	2.82	14:15	2.35	14:00	2.61
11/08/2015 03:00 PM	3.00	15:45	2.67	15:30	2.83
11/08/2015 04:00 PM	2.91	16:15	2.65	16:30	2.75
11/08/2015 05:00 PM	2.71	17:45	2.42	17:30	2.63
11/08/2015 06:00 PM	2.74	18:45	2.54	18:00	2.68
11/08/2015 07:00 PM	2.81	19:45	2.56	19:30	2.66
11/08/2015 08:00 PM	3.04	20:30	2.60	20:15	2.83
11/08/2015 09:00 PM	2.74	21:30	2.51	21:45	2.66
11/08/2015 10:00 PM	3.11	22:30	2.47	22:00	2.70
11/08/2015 11:00 PM	2.53	23:30	2.34	23:00	2.42
11/09/2015 12:00 AM	2.51	00:00	2.19	00:15	2.37