AUSLEY MCMULLEN

Attorneys and Counselors at Law
123 South Calhoun Street
P.O. Box 391 32302
Tallahassee, FL 32301
P: (850) 224-9115
F: (850) 222-7560
ausley.com

February 28, 2025

VIA: ELECTRONIC MAIL

Mr. Tom Ballinger, Director
Division of Engineer
Florida Public Service Commission
Room 215J – Gerald L. Gunter Building
2540 Shumard Oak Boulevard
Tallahassee, FL 32399-0850
tballing@psc.state.fl.us

Re: Wood Pole Inspection and Annual Reliability Performance Reports

Dear Mr. Ballinger:

Submitted herewith is Tampa Electric Company's 2024 Wood Pole Inspection and Annual Reliability Performance Report. In addition, similar to last year, Tampa Electric will submit the annual update of Storm Protection Plan activities, which includes the legacy Storm Hardening activities, on June 2, 2025.

Please let me know if you have any questions.

Sincerely,

Malcolm N. Means

MNM/bml
Enclosure
cc: Ashley Sizemore, TECO
TECO Regulatory

2024
ANNUAL WOOD POLE INSPECTION REPORT
&
ANNUAL RELIABILITY PERFORMANCE REPORT

FILED: February 28, 2025

TECO TAMPA ELECTRIC AN EMERA COMPANY

Table of Contents

Summary of 2024 Wood Pole Inspection and Reliability Performance Report……1
Tampa Electric's Wood Pole Inspection Program……3
Annual Wood Pole Inspection Report……7
Section IV – Rule 25-6.0455 F.A.C……8
2024 Reliability Performance……8
Generation Events……11
Transmission Events……11
Extreme Weather……16
Other Distribution……16
Distribution Substation……16
2024 Adjusted Distribution Reliability……23
Three Percent Feeder……23
Regional Reliability Indices……26
Regional Reliability Trends……28
Overhead – Underground Reliability……31
Five-Year Trends – Reliability Performance……31
Reliability-Related Customer Complaints……33
Appendix-Annual Reliability Performance Report……36
Reliability Appendix A ……37
Form PSC/ECR 102-1(a)(8/06)……37
Form 102 – Part II – Actual……38
Form 102 – Part III – Actual……39
Form 102 – Part III continued – Actual……40
Reliability Appendix B……41
Form PSC/ECR 102-1(b)(8/06)……41
Form 103 - PART II – Adjusted……42
Form 103 - PART III – Adjusted……43

Form 103 Part III continued Adjusted…….44
Actual Data: CMI, CI and Documented Exclusions…….45
2024 Adjustments: Planned Distribution Outage Events……..46
Feeder Specific and Attached Laterals Data……..220

SUMMARY OF 2024

WOOD POLE INSPECTION AND ANNUAL RELIABILITY PERFORMANCE REPORT

In 2024, Tampa Electric continued the performance of the company's third year of its current Storm Protection Plan ("SPP"). The company's 2022-2031 Storm Protection Plan is Tampa Electric's second SPP and provides a comprehensive approach to protect and strengthen its electric utility infrastructure to withstand extreme weather conditions as well as to reduce restoration costs and outage times in a prudent, practical, and cost-effective manner. As part of the company's prior three-year Storm Hardening Plans and SPPs, Tampa Electric continued to perform the required system hardening activities such as equipment upgrades, system and equipment maintenance, upgrading of distribution wood structures, replacement of transmission wood structures and the company's distribution and transmission inspection processes. As agreed upon in the Commission's Staff workshop that was conducted on January 21, 2021, the company will submit the annual update of SPP activities, which includes the legacy storm hardening activities, on the first of June each year.

Tampa Electric's 2024 distribution reliability "Adjusted" indices showed a decline when compared to 2023, in System Average Interruption Duration Index ("SAIDI"), System Average Interruption Frequency Index ("SAIFI"), Momentary Average Interruption Event ("MAIFIe"), Customers Experiencing More than Five Interruptions ("CEMI-5"), and Customer Average Interruption Duration Index ("CAIDI"). Momentary Average Interruption Event ("MAIFIe") showed improvement when compared to 2023 and set a new record. Tampa Electric's 2024 distribution reliability "Actual" indices showed a decline in performance in all the reliability indices when compared to 2023.

The following reports are included below:

1. Tampa Electric's 2024 Annual Wood Pole Inspection Report as required by Docket Nos. 20070634-EI and 20070635-TL, Order No. PSC-2007-0918-PAA-PU issued November 14, 2007.
2. Tampa Electric's 2024 Annual Distribution Service Reliability Report as required by Rule 25-6.0342 FAC.

Tampa Electric's Wood Pole Inspection Program

Tampa Electric's Wood Pole Inspection Initiative is part of a comprehensive program initiated by the FPSC for Florida investor-owned electric utilities to harden the electric system against severe weather.

This inspection program complies with Order No. PSC-2006-0144-PAA-EI, issued February 27, 2006, in Docket No. 20060078-EI which requires each investor-owned electric utility to implement an inspection program of its wooden transmission and distribution poles on an eight-year cycle based on the requirements of the National Electrical Safety Code ("NESC"). Tampa Electric has approximately 285,000 distribution and lighting wood poles and 25,000 transmission poles appropriate for inspection for a total pole inspection population of approximately 310,000. Approximately 12.5 percent of the known system will be targeted for inspections annually although the actual number of poles may vary from year to year due to recently constructed circuits, de-energized circuits, reconfigured circuits, etc. This program provides a systematic identification of poles that require repair, reinforcement, or replacement to meet strength requirements of the NESC.

The wood pole inspections will be conducted on a substation circuit basis with a goal of inspecting the entire wood pole population every eight years. An average of 35,625 wooden distribution poles will be inspected annually with each pole receiving a visual inspection, a sound and bore procedure, and a groundline/excavation inspection (except for chromated copper arsenate "CCA" poles less than 16 years of age).

Inspection Method and Procedure: Tampa Electric utilizes three basic inspection procedures for determining the condition of wooden poles. These procedures include a visual inspection, sound and bore, and excavation when required.

Visual Inspection: An initial visual inspection shall be made on all poles from the ground line to the pole top to determine the condition of the pole before any additional inspection work is completed. The visual inspection shall include a review

of the pole condition itself and any attachments to the pole for conditions that jeopardize reliability and are in need of replacement, repair or minor follow-up. After a pole passes the initial visual inspection, the balance of the required inspection methods will be performed.

Sound and Bore: After passing the visual inspection, the pole shall be sounded to a minimum height of seven feet above the ground line to locate any rotten conditions or pockets of decay inside the pole. Borings shall be made to determine the location and extent of internal decay or voids. All borings shall be plugged with preservative treated wooden dowels. After the pole has passed the sound and bore inspection, an excavation inspection will be performed, if required.

Excavation: For poles requiring excavation, the pole shall be excavated to a minimum depth of 18 inches below the ground line. Any external decay shall be removed to expose the remaining sound wood. The remaining pole strength shall be calculated.

For a pole in concrete or pavement where excavation is not possible, Tampa Electric will utilize a shell boring technique. This will consist of boring two 3/8-inch holes at a 60-degree angle to a depth of 16 to 18 inches below ground level. Upon withdrawing the drill bit, the technician will examine the condition of the wood shavings to determine whether decay is present. A “Shell Gauge” is used to determine the thickness of the shell, which is then used to calculate the pole strength. All borings shall be plugged as previously described.

Hardware Inspection: The inspector shall inspect all of Tampa Electric’s guying, grounding provisions and hardware that is visible from the ground. Any deficiencies or problems will be corrected as directed or reported to Tampa Electric to correct.

Inspection and Treatment Labeling: After completion of the ground line inspection, an aluminum tag identifying the contractor and date of inspection shall be attached

to the pole above the birthmark. Additionally, a tag shall be attached identifying any preservative treatments applied and the date of application.

Data Collection: The collected data shall be managed in a database and include information related to pole class, material, vintage, location, pole strength and any pole deficiencies that required follow-up actions.

Inspection in Conjunction with Other Field Work: As part of day-to-day operations, operation personnel are at times required to climb poles to perform different types of field work. Prior to climbing any pole, personnel will assess the condition of the pole. This will include a visual check and may include sounding to determine pole integrity. This type of inspection will supplement the systematic inspection approach otherwise outlined in this pole inspection program.

Disposition of Poles: Poles with early-stage decay that do not require remediation to meet the NESC strength requirements shall be treated with an appropriate preservative treatment. Poles with moderate decay that have substantial sound wood shall be considered for reinforcement. Analysis shall be performed to determine if reinforcement will bring the deficient pole into compliance with the requirements of the NESC. If it is determined that the pole can be reinforced, the pole shall be treated with an appropriate preservative treatment and may be reinforced or replaced if needed. Poles with advanced decay shall fail the inspection and be replaced.

Shared Poles: Tampa Electric supports the Commission's effort to establish pole inspection requirements on the owners of all utility poles. Tampa Electric will coordinate with third-party owners of utility poles that carry the company's facilities. With regard to the third-party's inspection process, the company will rely upon the third-party's inspection requirements and share data requested by the third-party to be utilized in their inspection procedure. Tampa Electric will cooperate, as requested, in the work associated with pole replacement where joint use exists. Third-party poles

are visually inspected and sounded for internal decay. Issues found are provided to the third-party owner for resolution.

Chromated Copper Arsenate Pole Inspections: In Docket No. 20080219-EI, Order No. PSC-2008-0615-PAA-EI, issued September 23, 2008, the FPSC approved a modification to Tampa Electric's Wood Pole Inspection Program involving chromated copper arsenate ("CCA") poles. Specifically, the modification requires CCA treated poles less than 16 years of age to be sound and selectively bored. Selective boring shall be performed on poles suspected of internal decay. Additionally, one percent of the annual number of CCA treated poles inspected less than 16 years of age shall be excavated to validate this inspection method. Finally, all CCA treated poles over 16 years of age shall be excavated.

Reporting: Tampa Electric will file the Annual Wood Pole Inspection Report, as an inclusion to the company's Annual Report and Annual Reliability Performance Reports, by March 1st of each year in full accordance with the reporting requirements set forth in Docket No. 20070634-EI, Order No. PSC-2007-0918-PAA-PU, issued November 14, 2007. The report will contain the methods used to determine the strength and structural integrity of wooden poles, the selection criteria for inspected poles, a summary of the results of the inspections, the cause(s) of inspection failures, and the corrective action taken for the failures. The 2024 Annual Wood Pole Inspection Report is on the next page:

Annual Wood Pole Inspection Report:

ORDER NO. PSC-2007-0918-PAA-PU
DOCKET NOS. 20070634-EI, 20070635-TL

TAMPA ELECTRIC COMPANY
Annual Wood Pole Inspection Report
2024

a	b	c	d	e	f	g	h	i	j	k	l	m
Total # of Wooden Poles in the Company Inventory	# of Pole Inspections Planned this Annual Inspection	# of Poles Inspected this Annual Inspection	# of Poles Failing Inspection this Annual Inspection	Pole Failure Rate (%) this Annual Inspection	# of Poles Designated for Replacement this Annual Inspection	Total # of Poles Replaced this Annual Inspection	# of Poles Requiring Minor Follow-up this Annual Inspection (Anchors/Guys)	# of Poles Overloaded this Annual Inspection	Methods(s) V = Visual E = Excavation P = Prod S = Sound B = Bore R = Resistograph	# of Pole Inspections Planned for Next Annual Inspection Cycle	Total # of Poles Inspected (Cumulative) in the 8-Year Cycle to Date	% of Poles Inspected (Cumulative) in the 8-Year Cycle to Date
Distribution and Transmission				Distribution Reinforcement **0.11%**	Distribution Reinforcement **308**	Distribution Reinforcement **42**						
				Distribution Replacement **4.23%**	Distribution Replacement **1,292**	Distribution Replaced **304**						
CYCLE THREE WOOD POLE POPULATION								Distribution Poles Overloaded				
Distribution 285,000	Distribution **35,625**	Distribution **36,789**	Distribution **1,600**	Distribution **4.35%**	Distribution **1,600**	Distribution **346**	Distribution **436**	0	VESB	** Distribution **35,625**	Distribution **126,788**	Distribution **44.49%**
Transmission	Transmission	Transmission	Transmission	Transmission	Transmission	Transmission	Transmission	Transmission	VESB	Transmission	Transmission	Transmission
2,548	**124**	**125**	**26**	**20.80%**	**472**	**428**	**0**	**0**		161	613	**24.06%**
Total Poles **287,548**	Total **35,749**	Total **36,914**	Total **1,626**		Total **2,072**	Total **774**	Total **436**	Total **0**		Total **35,786**	Total **127,401**	Total **44.31%**
If b - c > 0, provide explanation												
If d - g > 0, provide explanation	Contract process and negotiations caused a gap in work execution.											
Description of selection criteria for inspections	Pole inspections changed from region based to circuit based in 2016. Circuits to be inspected are selected by a combination of poor reliability circuits and circuits due for inspection											

SECTION IV – Rule 25-6.0455 F.A.C.

2024 Reliability Performance

1) Overview

Tampa Electric's 2024 distribution reliability "Actual" indices showed a decline in performance in all reliability indices when compared to 2023. Tampa Electric's distribution reliability "Adjusted" indices showed a decline in all reliability indices except MAIFIe. The unfavorable results in SAIDI, CAIDI, SAIFI, AND CEMI-5 are attributed to Hurricane Helene and Milton, two major hurricanes that hit Florida in 2024, with Hurricane Milton landing within 50 miles of Tampa Electric service territory.

2) Summary

Below is a summary of Tampa Electric's reliability performance for 2024 as compared to 2023.

Tampa Electric's 2024 Reliability Performance Summary				
ACTUAL	**2023**	**2024**	**Difference**	**Percent Change**
SAIDI	74.01	4,226.61	4,152.60	5610.86%
CAIDI	61.35	1,192.84	1,131.49	1844.32%
SAIFI	1.21	3.54	2.33	192.56%
MAIFIe	7.29	9.44	2.15	29.49%
L-BAR	122.76	904.09	781.33	636.47%
CEMI-5	1.11%	5.14%	4.03%	363.06%
ADJUSTED	**2023**	**2024**	**Difference**	**Percent Change**
SAIDI	57.27	108.74	51.47	89.87%
CAIDI	69.96	104.53	34.57	49.41%
SAIFI	0.82	1.04	0.22	26.83%
MAIFIe	6.44	5.44	-1.00	-15.53%
L-BAR	130.33	194.61	64.28	49.32%
CEMI-5	0.12%	0.31%	0.19%	158.33%

Tampa Electric experienced an increase of 3,767 overall outages in 2024 as compared to 2023. Table 2 details the primary cause of outages events by year. Compared to 2024,

outages caused primarily by animals and down wire decreased and the remaining primary causes increased.

Table 2: Cause of Outage Events by Year					
	2020	2021	2022	2023	2024
Vegetation	2,434	1,409	1,593	1,403	2,374
Animals	1,162	1,729	1,038	1,247	1,061
Lightning	1,340	1,019	1,567	792	1,174
Electrical	1,052	679	683	461	895
Bad Connection	1,078	392	258	245	328
Unknown	1,152	1,031	1,075	939	1,461
Down Wire	476	1,132	877	1,080	1,015
Vehicle	398	300	220	252	301
Other Weather	328	1,211	711	553	1,008
Defective Equipmen	105	626	684	699	775
All Remaining Cause	285	368	506	573	1,619
System Totals	9,810	9,896	9,212	8,244	12,011

In comparison to the last five-year average, Tampa Electric experienced more outages in 2024, as compared to 2023. Outages caused primarily by animals, bad connection and lightning are lower in 2024 when compared to the five-year average. The other outages causes increased. Here is the listing of how the categories changed as compared to the five-year average:

- Animals decreased by 14.93 percent
- Bad Connection decreased by 28.73 percent
- Lightning decreased by 0.37 percent
- Defective Equipment increased by 34.13 percent
- Down Wire increased by 10.81 percent
- Electrical increased by 18.70 percent
- Other Weather increased by 32.25 percent
- Unknown increased by 29.09 percent
- Vegetation increased by 28.84 percent

- Vehicle increased by 2.31 percent
- All Remaining Causes increased by 141.57 percent

Tampa Electric currently tracks outage records in the company's Distribution Outage Database ("DOD") according to the date, duration, customer affected, cause, equipment-type, associated field reports, breaker operations, etc., and uses this information to track and report interdepartmental, intercompany, and external regulatory requests as required.

Tampa Electric continues reviewing system performance and related metrics on a daily basis. Primary areas of focus include incremental and year-to-date semi-weekly SAIDI, CAIDI and SAIFI performance for Transmission, Substation and Distribution, year-to-date MAIFIe and associated breaker operations, customer outages by system and service area and major unplanned outages. In addition, Tampa Electric reviews the status of de-energized underground cables, reclosers, online capacitor banks and streetlights previously identified as needing maintenance.

In 2024, Tampa Electric continued the company's increased focus on the priority of feeder restoration activities. One example of this priority is the review and report of lessons learned on feeder outages where the outage duration exceeded acceptable thresholds. This review and report are done semi-weekly in pursuit of continued improvements with response time.

In addition to reviewing semi-weekly performance as noted above, the company analyzes distribution circuit performance, including feeders represented on the three percent feeder list, through a number of different ongoing processes. These processes include tree trimming analysis and circuit analysis.

3) **Conclusion**

Tampa Electric's 2024 distribution "Adjusted" reliability indices showed a decline in all the reliability indices when compared to 2023 except for MAIFIe, attributable to Hurricane Helene and Milton, two major hurricanes that hit Florida in 2024

Generation Events

Tampa Electric did not experience any outages due to generation events that would have impacted Distribution Reliability. Because of this, there are no exclusions in the company's 2024 Annual Distribution Reliability Report related to generation outage events.

Transmission Events

1) **Transmission Outage Summary**

In 2024, there were 33 transmission outages that affected customers. As a result, there were 373,288 Customer Minutes of Interruption ("CMI") and 81,003 Customer Interruptions ("CI") excluded from the 2024 Annual Distribution Reliability Report per Rule 25-6.0455.

2) **Equipment Failure Outages**

There were four outages attributed to wood poles, static wires and splices, crossarm failures.

3) **Vehicle Collision Outages**

There were four outages due to vehicle collisions with poles and guy wire.

4) **Human Error Outages**

There was one outage due to human error.

5) **Vegetation Related Outages**

There were no outages due to vegetation.

6) **Animal Related Outages**

There were two outages related to animals.

7) Clearance Outages

There were no outages due to insufficient clearance.

8) Other and Weather Outages

There were five outages related to weather and other circumstances.

9) Transmission Outage Detail

69 kV Circuit

February 2024

Date: 2/12/2024 Circuit: 66051

Customers Affected: 5,092 SAIDI Impact: 0.73 (sec)

Discussion: Service was interrupted due to animal nest debris and weather in the area. The weather passed, nest debris removed, and the circuit was returned to service.

Event: Localized

March 2024

Date: 3/06/2024 Circuit: 66426

Customers Affected: 8,186 SAIDI Impact: 1.56 (sec)

Discussion: Service was interrupted when two crossarms failed. The insulators were replaced, and the circuit was returned to service.

Event: Localized

May 2024

Date: 5/14/2024 Circuit: 66652

Customers Affected: 1,906 SAIDI Impact: 0.134 (sec)

Discussion: Service was interrupted due to animal nest debris. The debris was cleared, and the circuit was returned to service.

Event: Localized

June 2024

Date: 6/03/2024 Circuit: 66832
Customers Affected: 1,830 SAIDI Impact: 0.145 (sec)
Discussion: Service was interrupted when a vehicle came in contact with anchors. The pole was replaced, and circuit was returned to service.
Event: Localized

Date: 6/28/2024 Circuit: 66091
Customers Affected: 9,750 SAIDI Impact: 3.54 (sec)
Discussion: Service was interrupted due to a switch failure. The switch was replaced, and the circuit was returned to service.
Event: Localized

Date: 6/29/2024 Circuit: 66838
Customers Affected: 5217 SAIDI Impact: 0.85 (sec)
Discussion: Service was interrupted when a vehicle came in contact with pole. The pole was replaced, and circuit was returned to service.
Event: Localized

July 2024

Date: 7/10/2024 Circuit: 66832
Customers Affected: 1,334 SAIDI Impact: 0.41 (sec)
Discussion: Service was interrupted with no identified cause. The circuit was returned to service.
Event: Localized

Date: 7/30/2024 Circuit: 66011
Customers Affected: 1,892 SAIDI Impact: 0.178 (sec)

Discussion: Service was interrupted due to weather in the area. The weather passed, and the circuit was returned to service.
Event: Localized

August 2024

Date: 8/3/2024 Circuit: 138005
Customers Affected: 30 SAIDI Impact: 0.273 (sec)
Discussion: Service was interrupted due lost high side. The crossarm was replaced, and the circuit was returned to service.
Event: Localized

Date: 8/13/2024 Circuit: 66840
Customers Affected: 2,752 SAIDI Impact: 1.62 (sec)
Discussion: Service was interrupted when a car hit pole on Lakeland Electric's side. The damage was repaired by Lakeland Electric, and circuit was returned to service.
Event: Localized

Date: 8/16/2024 Circuit: 66426
Customers Affected: 5,304 SAIDI Impact: 2.08 (sec)
Discussion: Service was interrupted due toa failed crossarm. The crossarm was replaced, and the circuit was returned to service.
Event: Localized

October 2024

Date: 10/29/2024 Circuit: 66001
Customers Affected: 9,093 SAIDI Impact: 1.46 (sec)
Discussion: Service was interrupted when a vehicle came in contact with anchors/guy wire. The guy wire was replaced, and circuit was returned to service.
Event: Localized

Date: 10/30/2024 Circuit: 66603

Customers Affected: 11,591 SAIDI Impact: 31.94 (sec)

Discussion: Service was interrupted when a distribution wire caught fire causing damage to the transmission pole. The pole was replaced, and circuit was returned to service.

Event: Localized

Date: 10/31/2024 Circuit: 66031

Customers Affected: 12,038 SAIDI Impact: 1.48 (sec)

Discussion: Service was interrupted with no identified cause. The circuit was returned to service.

Event: Localized

November 2024

Date: 11/11/2024 Circuit: 66039

Customers Affected: 11,021 SAIDI Impact: 1.31 (sec)

Discussion: Service was interrupted due to human error. The issue was resolved, and the circuit was returned to service.

Event: Localized

138 kV Circuit

There were no outages on the 138kV circuits in 2024.

230 kV Circuit

November 2024

Date: 11/23/2024 Circuit: 230603

Customers Affected: 97 SAIDI Impact: 0.45 (sec)

Discussion: Service was interrupted due conductor failure. The conductor was replaced, and the circuit was returned to service.

Event: Localized

.

Extreme Weather

Tampa Electric experienced three extreme weather events during 2024 which affected transmission customers in the company's service territory: Hurricanes Debby, Helene and Milton.

Other Distribution – Adjustments

In 2024, there were 6,742 Other Distribution outages that affected customers. A total of 13,944,817 CMI and 134,186 CI were excluded from the 2024 Annual Distribution Reliability Report per Rule 25-6.0455. All outages were attributed to planned events as noted within the 2024 Adjustments: Other Distribution Outage Events in Reliability Appendix B.

Distribution Substation

1) **Distribution Substation Adjustments**

In 2024, there were 44 Distribution Substation outages that affected customers. A total of 3,331,275 CMI and 53,183 CI were excluded from the 2024 Annual Distribution Reliability Report per Rule 25-6.0455. All outages were attributed to substation equipment as noted within the 2024 Adjustments: Substation Outage Events in Reliability Appendix B.

2) **Patterns and Trends – Distribution Substation Reliability Performance**

In 2024, Substation outages due to circuit breaker failures was the leading substation outage contributor to SAIDI (see Exhibit 1). Events such as a failed interrupter, hydraulic operator or severe damage in the high voltage compartment weigh in the decision to replace a circuit breaker. In addition to the cause of the failure being a reason for replacing the breaker, the age, condition, and lack of spare parts are other factors considered when replacement is necessary.

The second leading contributor to SAIDI in 2024 was substation outages due to circuit breaker mechanism mis-operation. Tampa Electric currently has a program in place to replace aging and problematic circuit breakers. Since 2008, the total number of 13-kV

circuit breakers that have been replaced through a 13-kV circuit breaker replacement program and failed circuit breakers is 441. In 2024, 46 circuit breakers and associated circuit protection relaying were replaced as part of the company's capital asset replacement program for failed circuit breakers.

The third leading substation outage contributor to SAIDI in 2024 was relay and control caused by two incidents with relay coordination. Tampa Electric has upgraded the relay and protection scheme to improve reliability and reduce future outages.

3) Process to Promote Substation Reliability

Tampa Electric's Substation Department utilizes the following processes and activities to determine the actions to promote substation reliability:

- Routine substation inspections
- Root cause analysis of outages
- Track and review of all substation outages

Tampa Electric findings support the following ongoing activities:

- Review of all mis-operation of circuit breakers
- Installation of animal protection in substations
- Install microprocessor-based relays for reclosing in all new construction and upgrade projects
- Replace station wide static under frequency relays with feeder-based microprocessor under frequency relays in all new construction projects
- Replacing 13-kV circuit breakers that have been identified as problem breakers
- Increased lightning withstand protection on Tampa Electric Large Autotransformers
- An improved standard of all bushings on all new transformers and circuit breakers
- Implementation of automatic bus restoration schemes in stations with multiple transformers and microprocessor-based relay protection schemes.

The tables and exhibits that follow provide the number of distribution substation inspections performed by year and the SAIDI Impact in minutes for distribution substation outages by cause. This information is used to gauge and track the substation reliability.

Table 1: Substation Inspections by Year

Substation Inspections		
Year	Distribution Substations	Transmission Substations
2020	373	164
2021	460	218
2022	411	196
2023	615	318
2024	524	414

Exhibit 1: 2024 Distribution Substation Outages

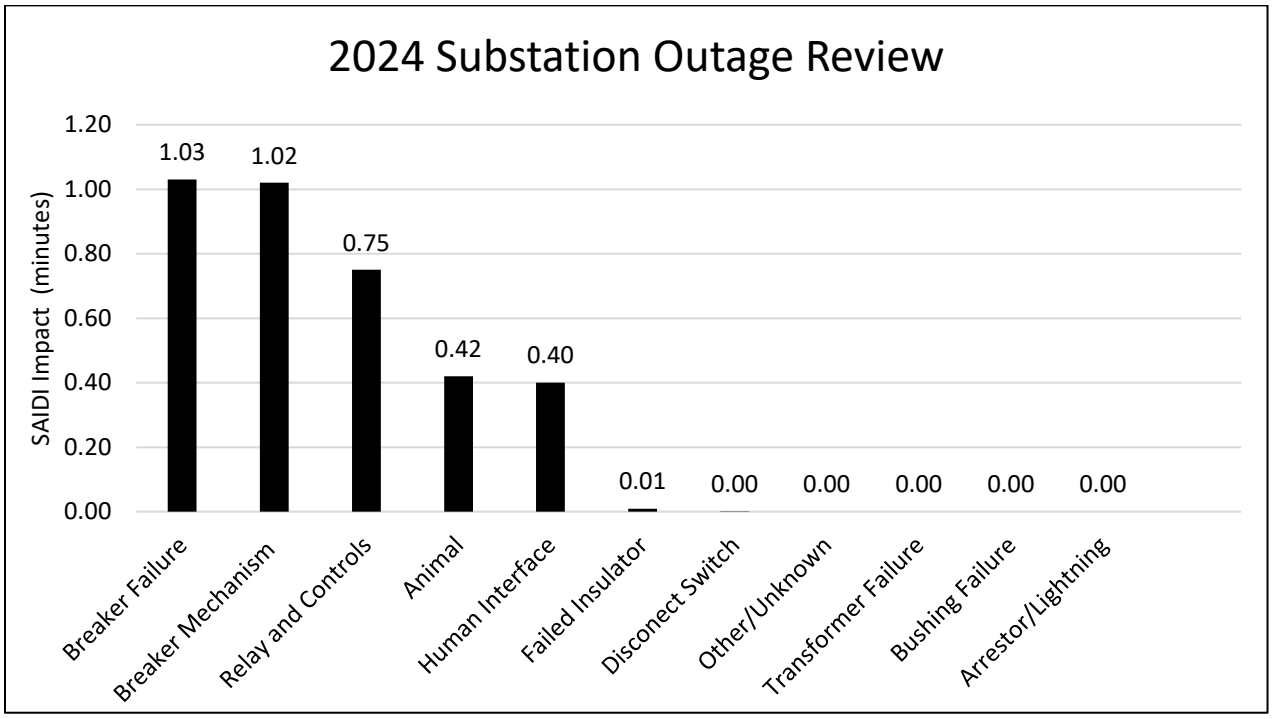

Exhibit 2: 2023 Distribution Substation Outages

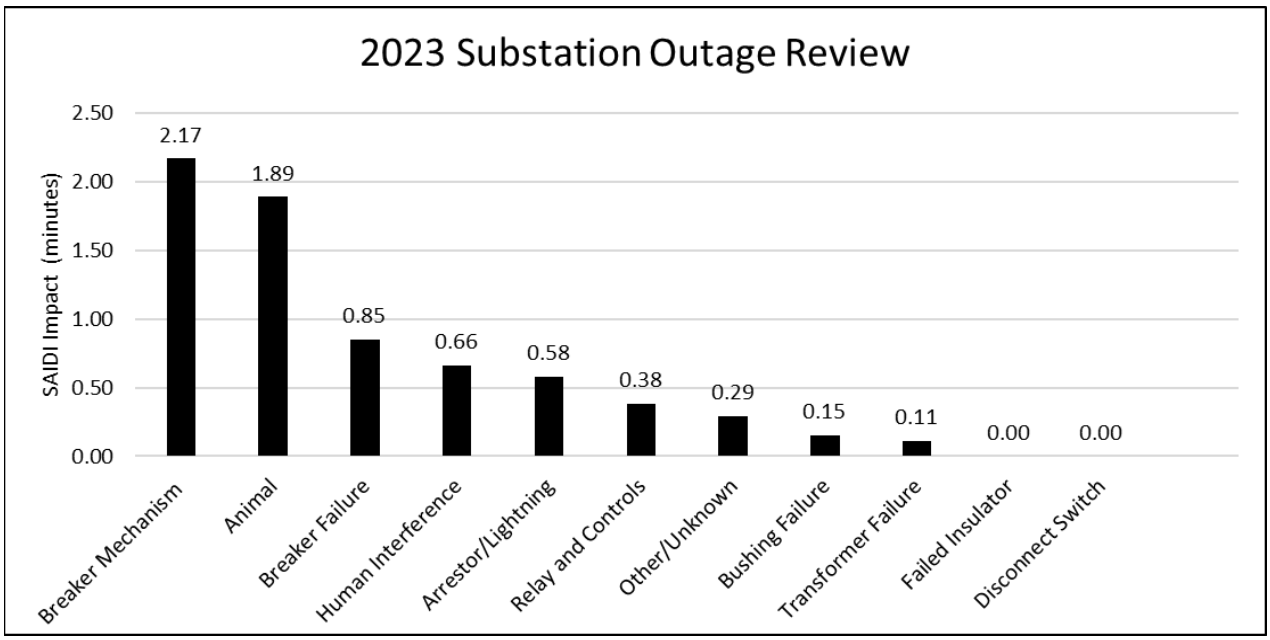

Exhibit 3: 2022 Distribution Substation Outages

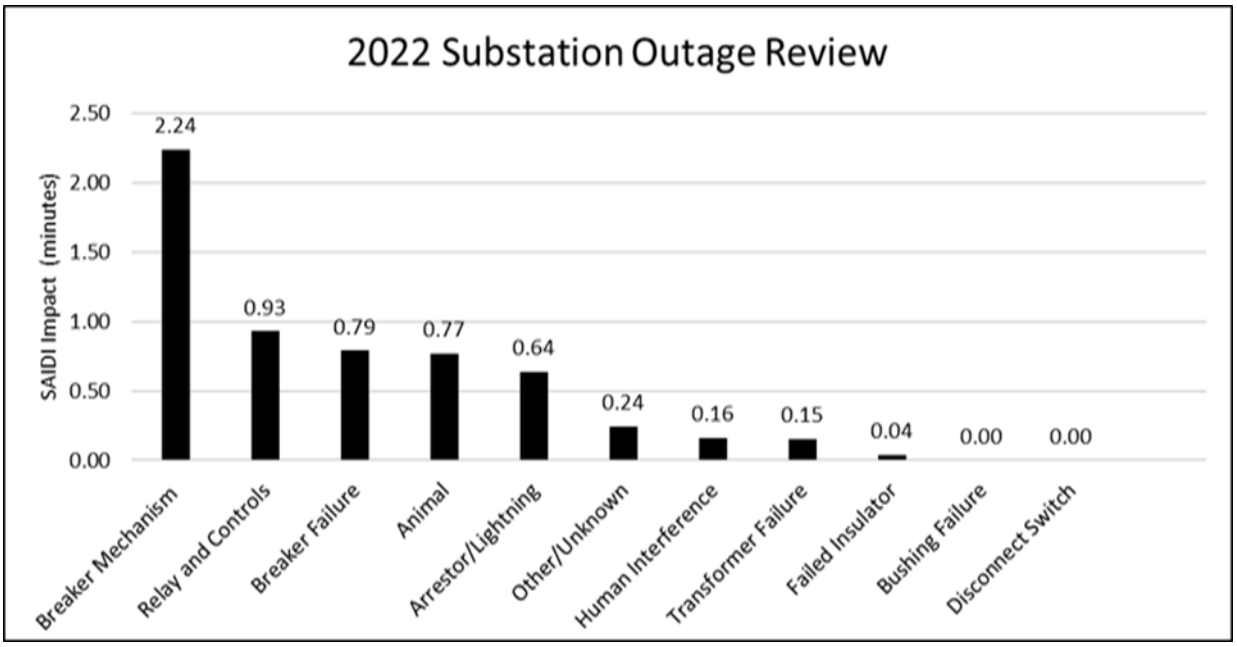

Exhibit 4: 2021 Distribution Substation Outages

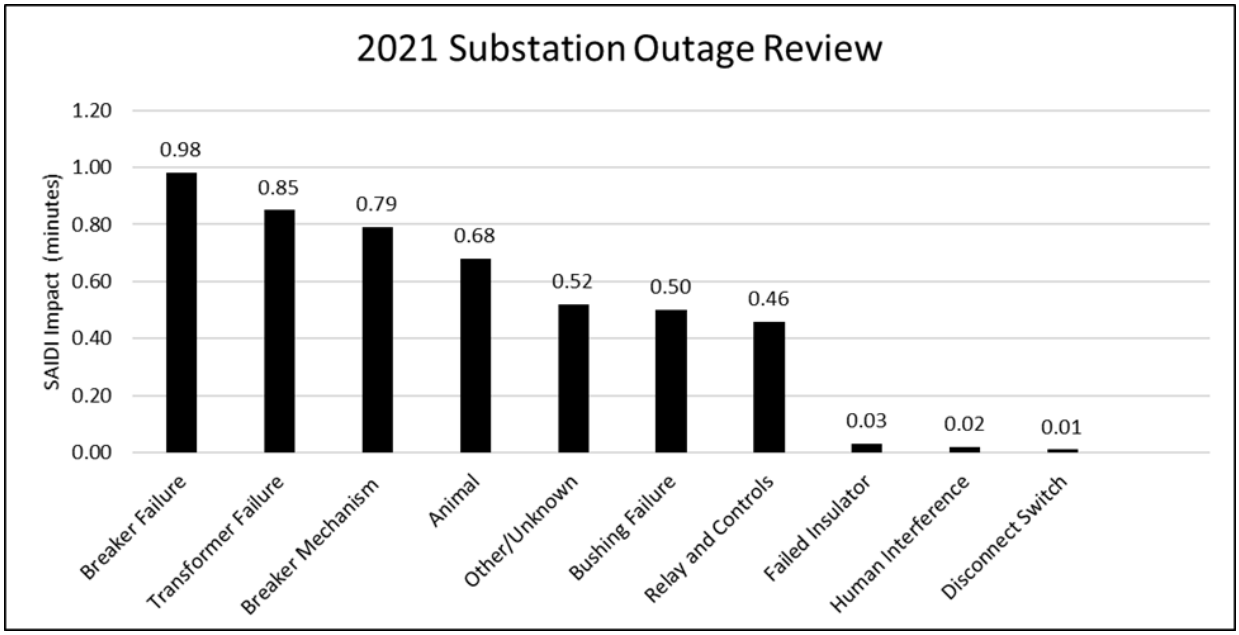

Exhibit 5: 2020 Distribution Substation Outages

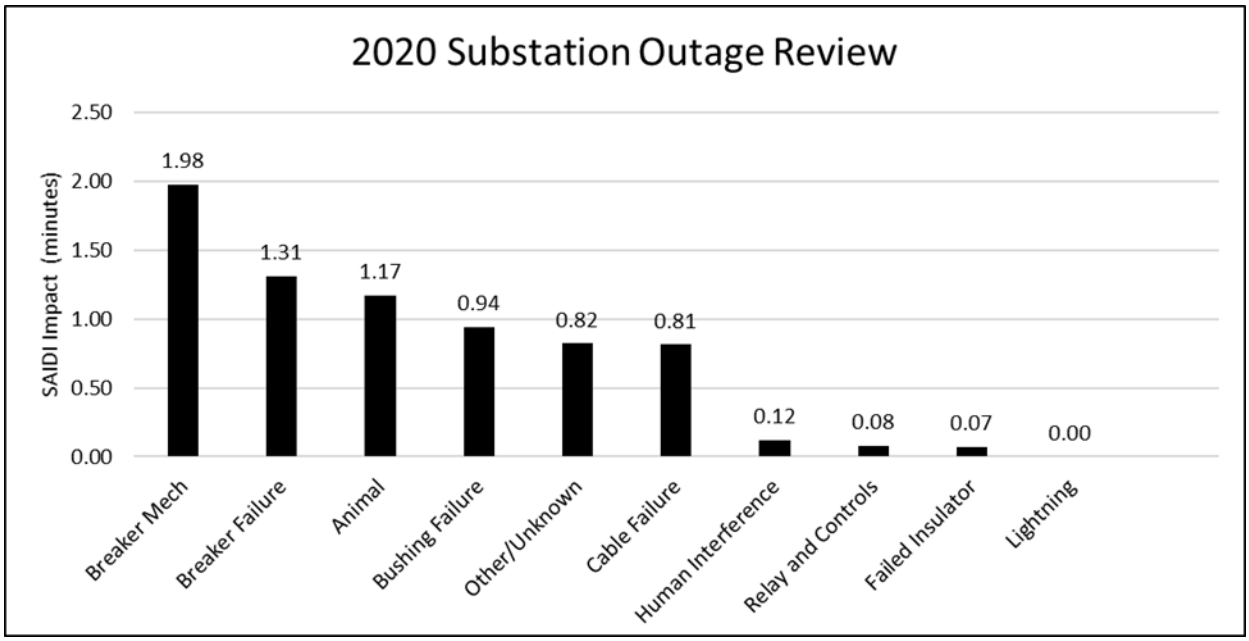

Exhibit 6: Substation Outages due to Breaker Failure

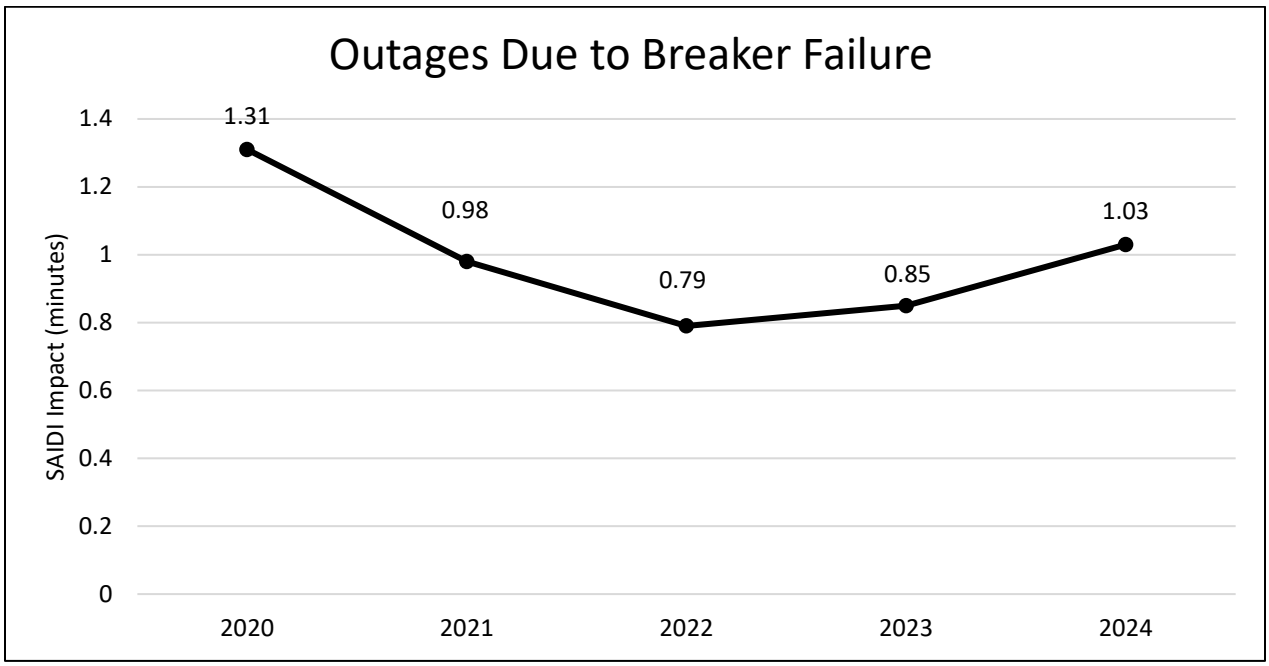

Exhibit 7: Substation Outages due to Breaker Mechanism

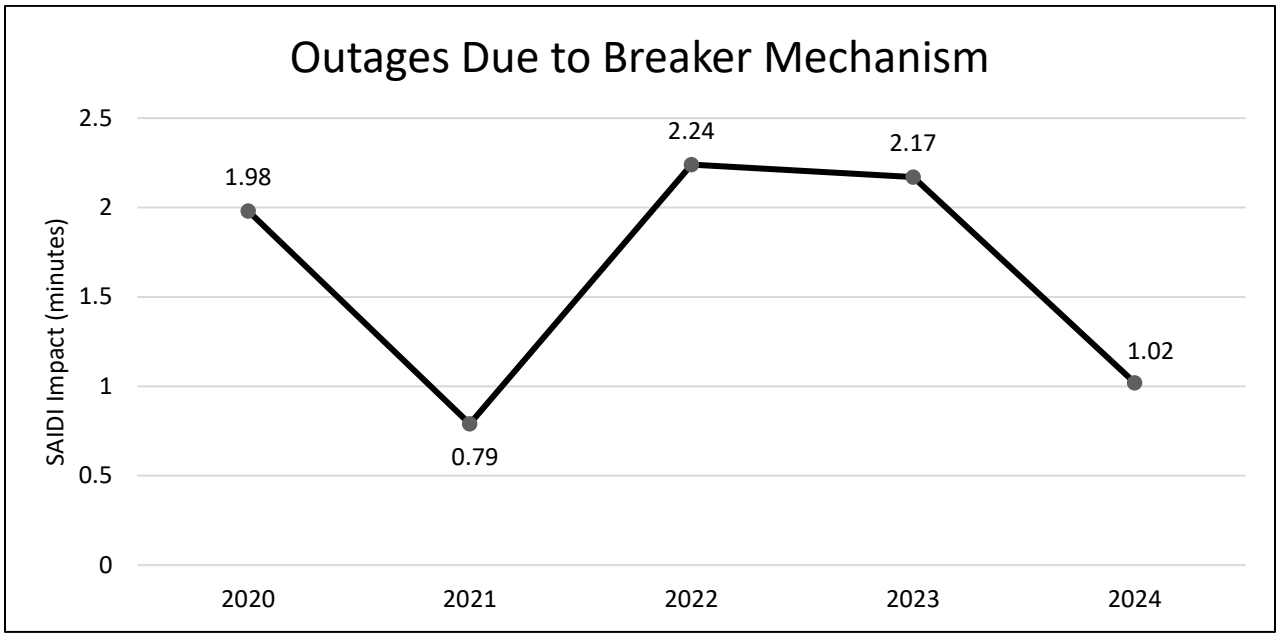

Exhibit 8: Substation Outages due to Relay and Controls

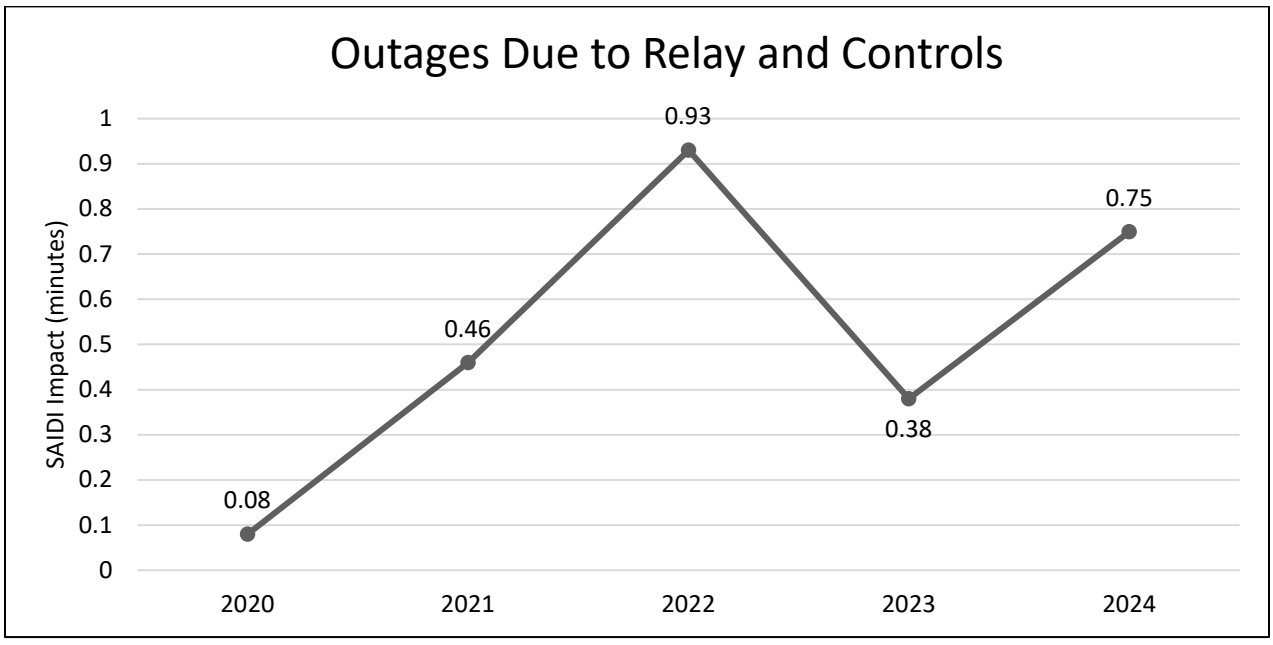

2024 Adjusted Distribution Reliability

1) Three Percent Feeder

In 2024, Tampa Electric identified 17 circuits that have been listed once before in the prior five years. These circuits include:

- Fowler Ave Circuit 13826
- Manhattan Circuit 13112
- Juneau Circuit 13418
- Ruskin Circuit 13817
- Wayne Road Circuit 13621
- Knights Circuit 13808
- Rhodine Road Circuit 13652
- Henderson Road Circuit 13873
- Del Webb Circuit 13440
- Lake Alfred Circuit 13118
- Madison Circuit 13170
- Pine Lake Circuit 13631
- Riverview Circuit 14023
- 12th Avenue Circuit 13436
- Blanton Circuit 13815
- Kirkland Road Circuit 13390
- Gallagher Road Circuit 13723

Actual events for Fowler Avenue 13826 included 13 circuit outages as reported. The company completed corrective activities on this circuit in 2024 by performing the following: replaced poles, transformers, and bad underground cable. In addition, the company conducted tree trimming on this circuit.

Actual events for Manhattan Circuit 13112 included three circuit outages as reported. The company completed corrective activities on this circuit in 2024 by performing the following: replaced transformers, a primary switch, and overhead conductor. In addition, the company conducted tree trimming on this circuit.

Actual events for Juneau Circuit 13418 included four circuit outages as reported. The company completed corrective activities on this circuit in 2024 by performing the following: replaced overhead conductor, replaced pole top insulator, and replaced transformers. In addition, the company conducted tree trimming on this circuit.

Actual events for Ruskin Circuit 13817 included six circuit outages as reported. The company completed corrective activities on this circuit in 2024 by performing the following: replaced transformers, refused capacitor bank fuses, and replaced poles. In addition, the company completed tree trimming on this circuit.

Actual events for Wayne Road Circuit 13621 included seven circuit outages as reported. The company completed corrective activities on this circuit in 2024 by performing the following: replaced poles, overhead conductor, and blown lightning arrestors. In addition, the company conducted tree trimming on the circuit.

Actual events for Knights Circuit 13808 included six circuit outages as reported. The company completed corrective activities on this circuit in 2024 by performing the following: conducted tree trimming on the circuit, replaced overhead primary conductor, transformers and poles.

Actual events for Rhodine Road Circuit 13652 included three circuit outages as reported. The company completed corrective activities on this circuit in 2024 by performing the following: replacing a primary switch de vining a transformer and conducting tree trimming on the circuit.

Actual events for Henderson Road Circuit 13873 included three circuit outages as reported. The company completed corrective activities on this circuit in 2024 by performing the following: replaced leaking transformers, and underground cable; as well as conducted tree trimming on the circuit.

Actual events for Del Webb Circuit 13440 included five circuit outages as reported. The company completed corrective activities on this circuit in 2024 by performing the following: replaced primary switch, lightning arrestors and poles. In addition, the company also conducted tree trimming.

Actual events for Lake Alfread Circuit 13118 included three circuit outages as reported. The company completed corrective activities on this circuit in 2024 by performing the following: replaced broken pole and underground cables as well as repair overhead conductors. In addition, the company also conducted tree trimming on this circuit.

Actual events for Madison Circuit 13170 included six circuit outages as reported. The company completed corrective activities on this circuit in 2024 by performing the following: replaced transformers and replaced primary line fuses.

Actual events for Pine Lake Circuit 13631 included four circuit outages as reported. The company completed corrective activities on this circuit in 2024 by performing the following: replaced transformers, and underground conductor as well as repaired overhead primary conductor. In addition, the company also performed tree trimming on the circuit.

Actual events for Riverview Circuit 14023 included six circuit outages as reported. The company completed corrective activities on this circuit in 2024 by performing the following: replaced pole, repaired overhead primary conductor, and conducted tree trimming on the circuit.

Actual events for 12th Avenue Circuit 13436 included five circuit outages as reported. The company completed corrective activities on this circuit in 2024 by performing the following: de-vined pole, repaired overhead primary conductor, and replaced burnt taps.

Actual events for Blanton Circuit 13815 included 11 circuit outages as reported. The company completed corrective activities on this circuit in 2024 by performing the following: replace transformers, overhead primary conductors, and poles.

Actual events for Kirkland Circuit 13390 included eight circuit outages as reported. The company completed corrective activities on this circuit in 2024 by performing the following: replaced transformers, repair overhead primary conductors, and replaced poles. In addition, the company conducted some tree trimming on the circuit.

Actual events for Gallagher Road Circuit 13723 included six circuit outages as reported. The company completed corrective activities on this circuit in 2024 by performing the following: repaired overhead primary conductor and replaced transformers and poles.

Other circuits identified in both “Actual” and “Adjusted” reports have had maintenance activities performed as noted on the Three Percent Feeder Reports, Form 102 – Part II – Actual and Form 103 – Part II – Adjusted. The company will continue to monitor circuit outage performance as part of its daily and ongoing review of system reliability and will respond accordingly.

Regional Reliability Indices

1) Summary

Table 3 below represents customers by service area for 2024. Dade City, Plant City and Winter Haven have the fewest customers and represent the most rural, lowest customer density per line mile in comparison to the other four Tampa Electric service areas. Actual reliability indices for the rural areas have varied from those of the most urban, densely

populated areas for this period. This is due to the greater distance travel for service restoration in rural areas.

Compared to 2023, SAIDI by service area increased in all areas except the Central service area as shown in Table 4 below. The 2024 SAIDI performance compared to the five-year average also increased for all service areas except for the Central, Western, and Winter Haven service areas. Actual results by service areas and year have varied for the five-year period.

Compared to 2023, CAIDI by service area decreased in Central and South Hillsborough service areas and increased in the other service areas as shown in Table 5 below. The 2024 CAIDI performance compared to the five-year average decreased for Central, Western and Winter Haven and increased in the other service areas. Actual results by service areas and year have varied for the five-year period.

Compared to 2023, SAIFI by service area increased in all service areas except for the Central service areas as shown in Table 6 below. The 2024 SAIFI performance compared to the five-year average increased for all service areas except for the Central service area. Actual results by service areas and year have varied for the five-year period.

Compared to 2023, MAIFIe by service area decreased in all service areas except for Dade City service area as shown in Table 7 below. The 2024 MAIFIe performance compared to the five-year average decreased in all service areas. Actual results by service areas and year have varied for the five-year period.

2) Regional Reliability Trends

Table 3 : Number of Customers by Service Area Per Year

	2020	2021	2022	2023	2024
Central	211,631	215,086	217,724	219,838	222,973
Dade City	15,604	15,873	16,246	16,928	17,949
Eastern	129,781	131,248	133,486	134,994	136,599
Plant City	63,954	64,369	65,198	66,261	67,754
South Hillsborough	96,568	101,875	107,101	110,875	114,875
Western	211,714	214,077	215,985	217,506	219,415
Winter Haven	80,016	81,794	84,575	86,931	90,430
System	**809,268**	**824,322**	**840,315**	**853,333**	**869,995**

Table 4 : SAIDI by Service Area Per Year

	2020	2021	2022	2023	2024
Central	57.67	63.81	40.66	54.72	47.02
Dade City	186.24	138.06	142.63	94.93	1,837.38
Eastern	55.72	64.67	57.06	50.81	82.21
Plant City	107.09	157.34	128.88	85.52	154.20
South Hillsborough	52.53	61.23	75.04	50.67	68.09
Western	71.00	76.51	70.24	46.64	62.08
Winter Haven	70.68	152.04	93.66	78.15	88.53
System	**67.90**	**84.51**	**69.40**	**57.27**	**108.74**

Table 5 : CAIDI by Service Area Per Year

	2020	2021	2022	2023	2024
Central	75.18	79.08	60.79	78.19	72.41
Dade City	83.38	68.43	57.15	87.99	649.94
Eastern	65.65	63.79	59.45	67.35	70.55
Plant City	71.07	83.68	70.85	67.51	95.01
South Hillsborough	54.80	56.70	69.83	62.84	62.23
Western	82.62	78.79	73.94	70.01	70.05
Winter Haven	68.48	129.33	68.49	66.08	67.35
System	**72.23**	**79.30**	**67.13**	**69.96**	**104.53**

Table 6 : SAIFI by Service Area Per Year

	2020	2021	2022	2023	2024
Central	0.77	0.81	0.67	0.70	0.65
Dade City	2.23	2.02	2.50	1.08	2.83
Eastern	0.85	1.01	0.96	0.75	1.17
Plant City	1.51	1.88	1.82	1.27	1.62
South Hillsborough	0.96	1.08	1.07	0.81	1.09
Western	0.86	0.97	0.95	0.67	0.89
Winter Haven	1.03	1.18	1.37	1.18	1.31
System	**0.94**	**1.07**	**1.03**	**0.82**	**1.04**

Table 7 : MAIFIe by Service Area Per Year

	2020	2021	2022	2023	2024
Central	6.37	5.37	5.47	5.37	4.34
Dade City	10.50	6.51	8.64	6.45	6.91
Eastern	6.41	5.96	7.10	6.45	6.30
Plant City	10.81	7.49	8.27	7.85	7.23
South Hillsborough	8.26	5.95	7.90	4.71	4.05
Western	7.75	7.56	8.59	7.30	5.90
Winter Haven	10.37	7.48	8.33	8.06	5.85
System	**7.78**	**6.50**	**7.40**	**6.43**	**5.44**

Table 8 : CEMI% by Service Area Per Year

	2020	2021	2022	2023	2024
Central	0.29%	0.12%	0.02%	0.06%	0.02%
Dade City	7.67%	0.09%	4.95%	0.72%	6.40%
Eastern	1.00%	1.09%	0.11%	0.05%	0.86%
Plant City	3.38%	2.32%	0.81%	0.64%	0.26%
South Hillsborough	2.92%	0.29%	0.28%	0.00%	0.02%
Western	0.33%	0.07%	0.29%	0.05%	0.00%
Winter Haven	0.47%	0.18%	1.64%	0.19%	0.18%
System	**1.13%**	**0.46%**	**0.46%**	**0.12%**	**0.31%**

Overhead – Underground Reliability

1) Five-Year Trends – Reliability Performance

Table 9 : Outages per Year

System Totals	2020	2021	2022	2023	2024
Number of Outages Events (N)	9,810	9,896	9,212	8,244	12,011
System Average Duration (L-Bar)	166.49	174.83	141.78	130.35	194.60
Average Restoration Time (CAIDI)	72.23	79.30	67.13	69.96	104.53

Overhead	2020	2021	2022	2023	2024
Number of Outages Events (N)	8,018	7,993	7,802	6,612	9,358
System Average Duration (L-Bar)	158.36	169.78	135.66	120.27	193.63
Average Restoration Time (CAIDI)	67.75	75.46	64.21	65.86	102.91

Underground	2020	2021	2022	2023	2024
Number of Outages Events (N)	1,792	1,903	1,410	1,632	2,653
System Average Duration (L-Bar)	202.88	196.05	175.66	171.18	198.02
Average Restoration Time (CAIDI)	110.27	108.54	106.75	107.41	121.59

Exhibit 9: Overhead to Underground Outage Duration

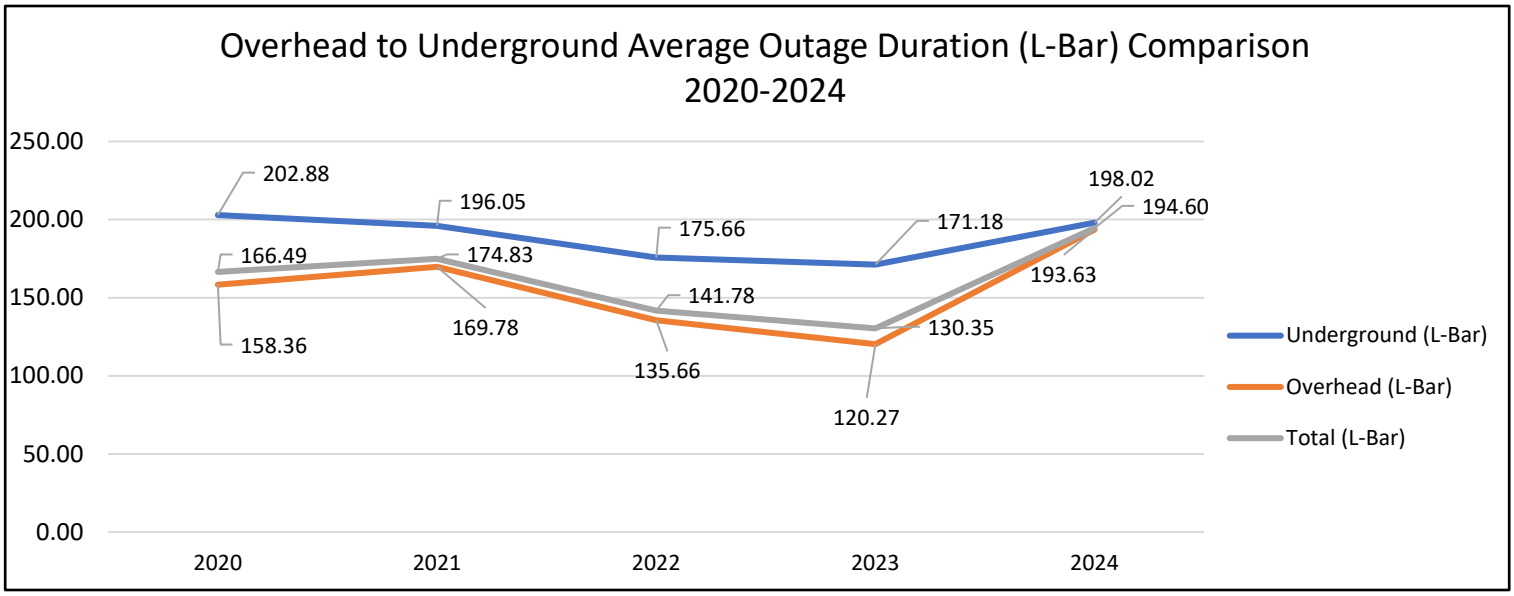

2) Tracking Overhead to Underground Reliability Performance

Tampa Electric tracks outage records in the company's DOD according to cause and equipment type. These equipment types are designed and associated with the overhead and underground systems. Reporting capability allows the company to track CMI, CI, Number of outages, Average Duration and CAIDI as referenced in Section C – Overhead to Underground in the Appendix. In addition, separate reporting was undertaken in order to align miles and customers for overhead and underground distribution.

The company tracks and reports MAIFIe by system and circuit. Interruption data is electronically captured, recorded and tracked at each individual distribution circuit breaker. As a result, a momentary interruption occurring down-line from the circuit breaker in which the circuit breaker does not operate is not able to be captured and reported.

The company currently measures CEMI-5 through a query that is run through the company's DMS. There is no option to run a query for overhead or underground systems. Therefore, the company is unable to provide CEMI-5 as previously requested by Commission Staff.

3) Underground Distribution System Conversions

Tampa Electric's Storm Protection Plan is converting overhead distribution laterals for extreme weather hardening within the company's Distribution Lateral Undergrounding Program. Updates for accomplishments within this program are provided in the company's Storm Protection Plan Annual Report that is provided to the Commission on June 1 of each year.

Reliability-Related Customer Complaints

In 2024, Tampa Electric experienced a decrease of eight formal service-related complaints as logged by the Florida Division of Consumer Affairs and noted in Exhibit 10. In comparison to the five-year average, overall formal complaints decreased by 18 percent in 2024. In addition, service-related complaints as tracked by the company and including FPSC Formal, Three-Day, Transfer-Connect, Warm Transfer and Executive Level increased 136 complaints in 2024 as noted in Exhibit 11 below. This increase was driven by 153 hurricane-related complaints. Those complaints aside, service-related complaints decreased by 17, which is 7 percent below the five-year average.

When comparing formal complaints lodged against the company to reliability performance over the last five years, the reliability performance has varied, and complaints have tracked accordingly, see Exhibits 12 and 13. The company's continued focus on activities such as vegetation management, circuit review activity and resulting line improvements and other maintenance activities will contribute toward minimizing service-related complaints in 2025 and beyond.

.

Tampa Electric's current process for responding to all service-related complaints includes the central intake and coordination of complaint resolution through the company's Quality Assurance Department and extends out to operations engineers who are responsible for the daily oversight of feeders in their respective service area. Operations engineers are involved in customer interactions, identifying needs and corrective measures and are responsible for coordination through to completion. Working through and responding to complaints at a region/service area level provides the company an opportunity to be aware of any trends that may occur for a given feeder or lateral.

In addition, the group of Operations Engineers and System Reliability meet monthly to review common areas of concern across the system and identifies opportunities for improvement.

Exhibit 10: Tampa Electric Formal Reliability Complaints Filed with the FPSC by Year

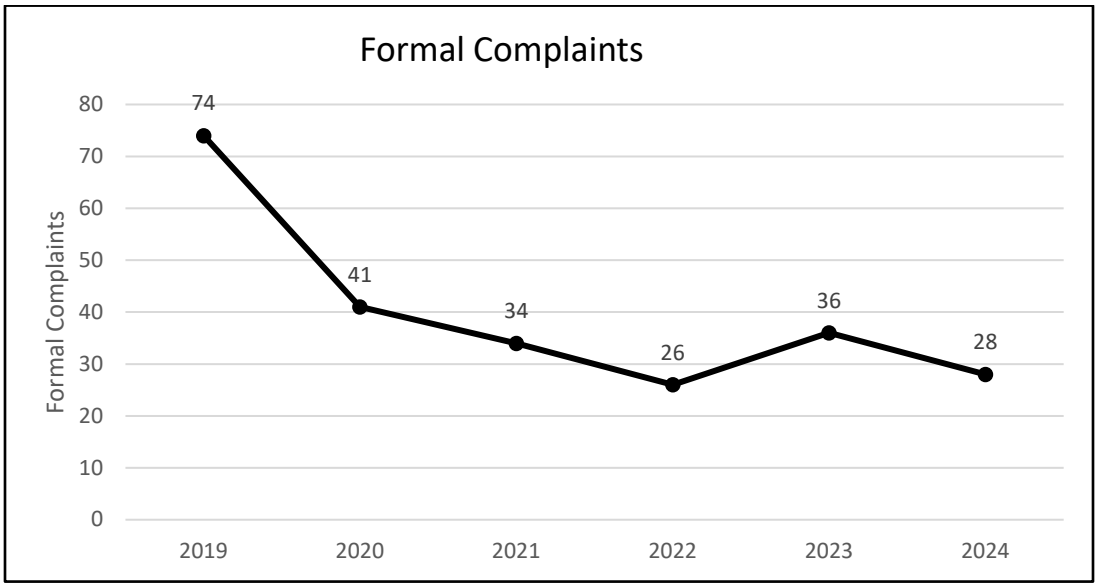

Exhibit 11: Tampa Electric Service Complaints by Year

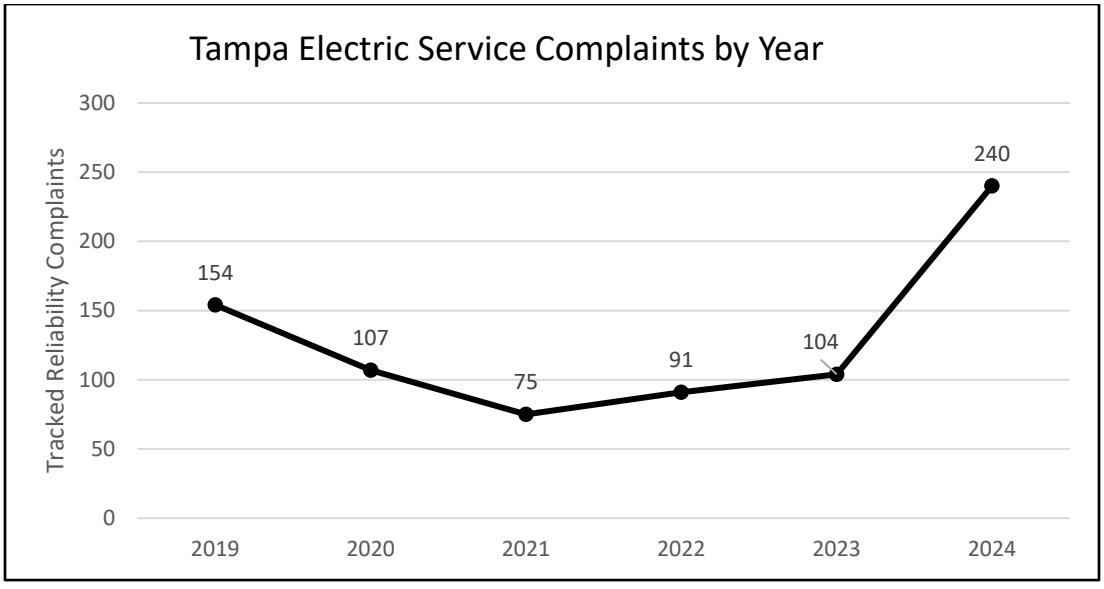

Exhibit 12: Formal Complaints vs. SAIDI by Year

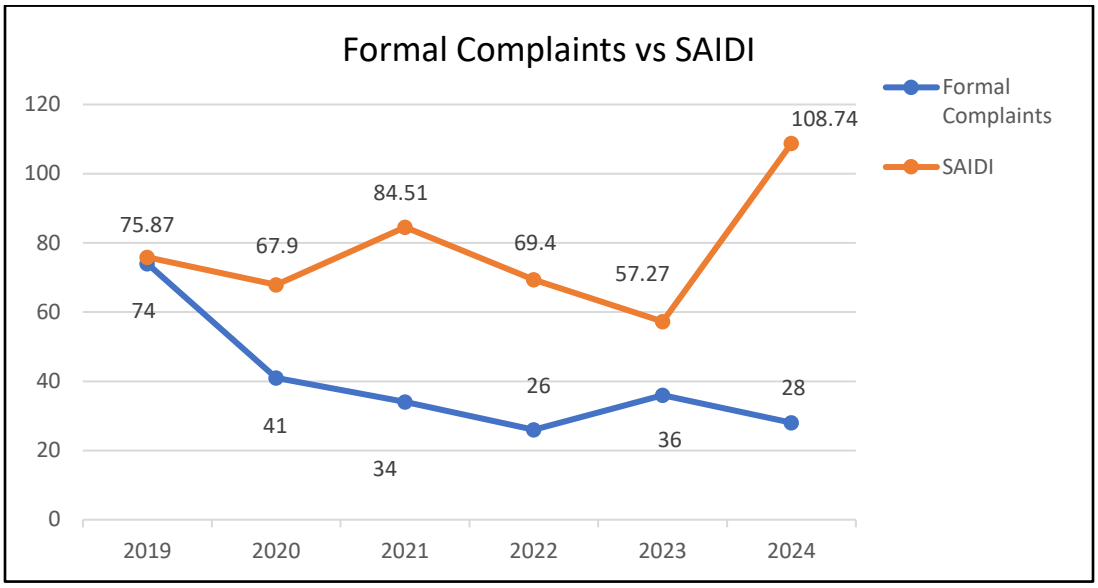

Exhibit 13: Formal Complaints vs. MAIFIe by Year

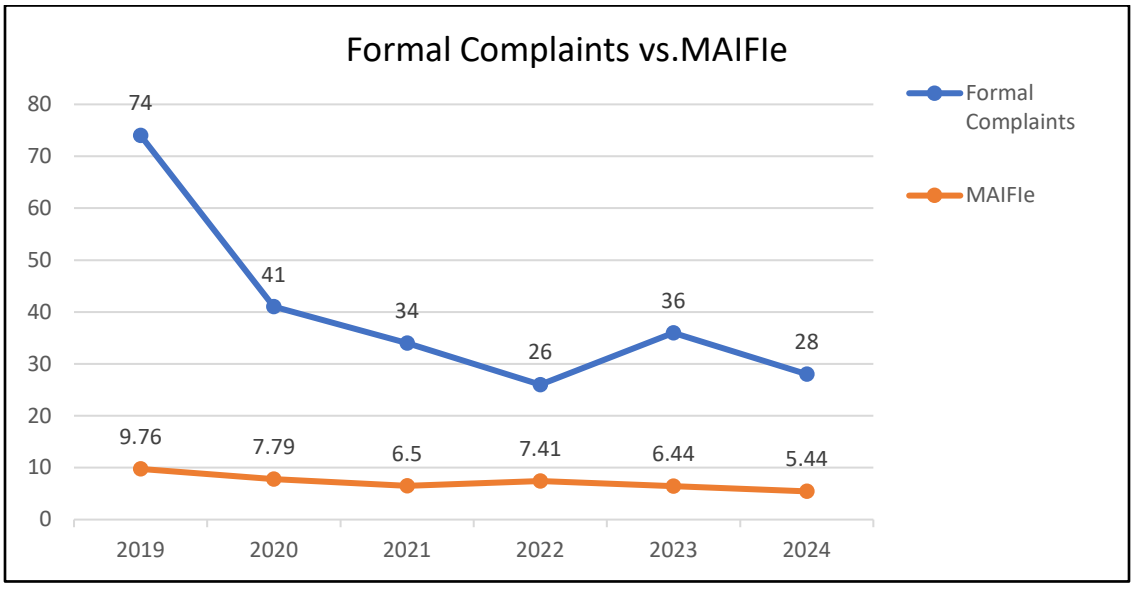

APPENDIX

2024

ANNUAL RELIABILITY PERFORMANCE REPORT

Reliability Appendix A

Form PSC/ECR 102-1(a)(8/06)

Primary Causes of Outage Events - Actual			
Utility Name: Tampa Electric			Year: 2024
Cause (a)	**Number of Outages Events (N)** (b)	**Average Duration (L-Bar)** (c)	**Average Restoration Time (CAIDI)** (d)
Planned Outage	7,414	184.17	334.55
Vegetation	3,648	323.57	196.28
Animals	1,073	92.21	59.64
Down Wire	1,177	266.45	253.32
Unknown	1,840	614.44	2,253.74
Lightning	1,210	161.47	104.93
Defective Equipment	852	311.76	216.86
Other Weather	10,665	2,186.93	1,827.41
Electrical	1,001	241.72	280.79
Vehicle	322	207.99	101.82
Bad Connection	376	481.90	1,523.28
Other	501	1,196.48	3,012.16
Substation Equipment	169	283.32	82.85
Human Interference	444	151.31	66.12
Fire	73	183.11	99.02
Transmission Equipment	15	229.50	141.95
Customer Owned Equipment	91	259.67	336.29
Unassigned	4,139	611.95	800.63
Total	35,010	904.07	1,192.84

Note: L-Bar and CAIDI are expressed in minutes.

Form 102 – Part II – Actual

FPSC Annual Report - 3 Percent Feeder List (Actual)

Primary Circuit Id. No. or Name (a)	Substation Origin (b)	Location (c)	Number of Customers				Circuit Outages "N" (h)	Avg. Duration "L-Bar" (i)	CAIDI (j)	Listed Last Year? (k)	Years in the Last 5 (l)	Action Completion Date (n)
			Residential (d)	Commercial (e)	Industrial (f)	Total (g)						
13826	FOWLER	Central	3	389	1,033	1,425	633	1,498.35	1,133.16	N	1	8/9 11/20 12/7 11/20 11/19 8/9 11/15 8/22 8/4 4/4 6/24 8/12 11/20 8/8 5/27
13112	MANHATTAN AV	Western	5	1,563	1,134	2,702	385	275.51	2,105.04	N	2	4/3 5/23 5/16 8/10 8/12 8/9 8/23 12/10 3/26 6/14 5/28 5/24 5/20 1/9 1/8 1/30 6/16 3/11 4/13 6/24 4/11 3/22 6/4 8/15 8/16 6/19 7/29 8/29 8/30 10/4 10/28 11/22 12/23 12/7 10/7 10/1 10/1 10/2
13418	JUNEAU	Central	3	1,251	219	1,473	190	543.56	2,812.21	N	1	1/5 1/10 3/21 3/21 4/2 4/25 4/25 5/3 6/20 6/21 6/22 8/1 9/3 9/28 9/29 10/23 10/25 10/25 10/28 11/5 11/6 11/11 12/7
13906	PEACH AV	Eastern	6	1,325	32	1,363	123	1,603.08	3,444.38	Y	1	1/11 1/25 2/15 2/23 2/274/3 4/10 4/10 6/5 6/5 6/22 7/2 7/14 7/20 7/22 8/6 8/6 8/7 8/19 8/22 8/28 9/4 9/11 9/14 9/22 9/27 9/29 10/2 10/2 10/910/9 10/21 10/26 10/28 10/29 11/9 11/1211/12 11/27 12/12 1/17 1/28
13039	BLOOMDLE	Eastern	1	936	123	1,060	98	1,459.93	6,729.40	N	0	1/17 3/6 12/12 10/30 9/14 8/6 5/14 7/12 8/1 4/3 12/16 11/13 10/1015/5 12/7 5/10 8/5
13170	MADISON AV	Eastern	1	1,025	1,030	2,056	77	1,240.13	3,816.34	N	0	12/9 4/30 6/28 8/1 7/29 7/25 9/9 9/22 6/49/4 1/29 6/3
13959	TERRACE	Plant City	10	1,097	0	1,107	75	1,172.11	929.18	N	0	1/29 3/14 7/22 9/30 1/18 6/17 10/22 7/18 8/4 1/1 9/28 9/27 2/21 2/20 2/18 1/9 1/25 2/20 2/22 6/14 6/15 3/20 4/4 4/15 5/3 4/2 4/22 7/11 8/7 5/3 4/15 4/9 5/3 11/5
13685	PEARSON RD	Eastern	6	1,304	0	1,310	54	995.91	1,590.82	N	0	9/27 6/11 8/28 6/12 3/184/10 4/15 8/7 8/16 1/9 9/16 10/2 6/18 2/84/8 4/22 8/12 5/10
13533	COOLIDGE	Western	1	345	1,408	1,754	53	1,169.62	549.63	N	0	1/30 1/30 2/8 2/12 4/18 5/14 6/17 10/23 11/5 11/26 12/10 12/29
13174	MADISON AV	Eastern	6	151	2,813	2,970	52	1,120.70	1,402.40	N	0	1/11 3/26 7/30 9/2
13709	BUCKHORN	Eastern	3	868	60	931	49	2,066.93	2,239.62	N	0	2/15 4/5 4/22 5/17 7/22 8/9 8/229/4 9/10 9/27 9/29 10/24 12/6
13817	RUSKIN	South Hillsborough	17	1,371	18	1,406	46	729.04	402.33	N	1	1/17 2/8 2/22 2/22 3/25 4/5 4/154/19 5/29 6/4 6/10 6/12 6/19 7/10 8/8 9/13 9/20 11/29
13621	WAYNE RD	Western	13	443	1	457	43	532.35	185.78	Y	1	1/22 3/19 5/29 6/24 6/28 6/29 7/17 7/21 7/22 9/4 10/2 10/6 11/8
13430	SAN ANTN	Dade City	34	952	47	1,033	41	1,066.73	905.67	N	0	1/19 1/19 1/25 1/31 2/14 4/3 4/46/5 7/22 7/24 8/2 8/2 8/4 8/5 8/68/6 8/6 8/12 8/22 8/28 8/30 9/139/25 10/29 10/30 11/4 11/7 11/25 12/10
13808	KNIGHTS	Plant City	64	987	25	1,076	41	1,250.88	246.19	N	1	1/2 1/15 2/9 2/25 3/6 3/19 3/20 3/26 3/283/28 4/3 4/7 4/9 4/17 4/17 4/19 4/23 4/26 4/26 4/30 5/1 5/10 6/3 6/4 6/5 6/11 6/14 6/15 6/15 6/18 7/10 7/15 7/16 7/17 7/18 7/23 7/26 7/29 7/31 8/3 8/7 8/15 8/18 8/20 8/21 8/22 8/24 8/29 8/29 9/9 9/10 9/13 9/19 9/25 10/7 10/22 10/26 10/27 11/3 11/5 11/5 11/11 11/12 11/12 11/13 11/14 11/14 11/15 11/15 11/1611/17 11/18 11/19 11/2912/4 12/9 12/1212/13 12/17 12/19 12/19122/30
13414	PLANT CITY	Plant City	6	812	212	1,030	41	776.67	692.82	N	0	3/18 3/21 4/3 4/11 4/11 4/11 4/25 5/15 5/22 6/3 6/29 7/15 9/5 9/5 9/25 10/10 10/2210/29 11/2 12/16 12/19
13027	TEMP.TER	Central	2	720	361	1,083	38	882.75	666.31	N	0	1/18 2/6 2/15 2/20 3/8 3/13 3/22 3/28 4/18 4/25 5/3 5/6 5/8 5/14 5/14 6/5 6/14 6/206/21 7/18 7/25 8/5 8/6 8/9 8/12 8/15 8/29 9/6 9/30 11/8 11/14 11/1 11/19 11/19 11/20 11/2311/25 12/6 12/11 12/16 12/20
13495	MADISON AV	Eastern	7	1,266	98	1,371	38	3,544.55	3,187.86	N	0	5/17 5/24 5/31 8/1 9/6 9/11 11/29 12/22
13777	MILLER MAC	South Hillsborough	15	897	152	1,064	38	602.74	2,224.19	N	0	4/12 4/12 4/124/15 5/2 5/8 5/8 5/12 5/27 6/10 6/11 6/12 6/17 6/18 6/22 7/87/18 7/24 8/27 9/6 9/6 10/3 10/23 11/15 12/2 12/4 12/5 12/5 12/10 12/23 12/26 12/27
13517	GEORGE ROAD	Western	1	349	986	1,336	37	951.42	1,764.83	N	0	1/21 2/16 2/26 3/8 3/13 4/18 4/23 4/24 5/14 6/1 7/23 7/29 8/8 8/28 9/17 9/17 9/23 10/7 10/29 11/4 11/411/8
13652	RHODINE	South Hillsborough	5	856	0	861	36	1,593.45	1,678.09	N	1	5/8 8/13 8/29 7/1 8/1
13873	HENDERSON RD	Western	0	806	173	979	36	434.66	913.90	N	1	9/20 5/1 4/12 6/30 7/10 6/28 4/27 10/5 9/4 4/27 4/23 1/23 5/17
13187	PINE LAKE	Central	3	803	441	1,247	35	1,561.83	1,363.24	N	0	1/17 3/7 4/15 4/24 4/29 5/7 5/17 5/17 5/17 5/21 5/21 5/23 6/14 7/1 7/12 7/24 8/12 8/15 8/23 8/23 8/28 9/19 11/1 12/5
13631	PINE LAKE	Central	2	1,048	281	1,331	35	384.26	973.83	N	0	4/10 5/16 6/13 7/22 7/22 8/20 9/16 10/10 10/25 11/20 11/25 12/12 12/21 12/27
13440	DEL WEBB	South Hillsborough	7	1,427	406	1,840	34	298.84	1,020.13	N	1	1/29 3/11 3/12 5/12 7/1 7/17 7/28 8/1 8/16 8/23 9/5 10/24 11/20 11/23
13118	LAKE ALFRED	Winter Haven	7	1,861	251	2,119	34	291.25	101.32	N	2	1/16 1/18 4/10 5/1 6/15 6/24 7/10 7/31 8/8 8/14 8/26 8/29 9/11 9/24 10/10 10/23 12/17
13815	BLANTON	Dade City	35	512	10	557	33	634.68	628.00	N	3	1/19 1/22 3/17 4/3 4/4 5/19 5/30 6/20 6/20 7/5 7/15 7/24 7/24 7/26 7/26 7/27 8/7 8/15 8/29 9/4 10/30 11/4 11/4 11/8 12/1 12/5 12/12 12/17 12/19
13041	BLOOMDLE	Eastern	3	1,378	8	1,389	33	1,951.07	865.23	N	0	3/13 3/20 3/22 3/28 4/9 4/15 4/17 4/30 5/8 5/29 6/3 8/1 8/9 8/15 8/16 8/19 8/31 9/3 9/5 9/9 9/18 9/25 9/25 10/7 10/21 10/28 11/12 12/5 12/18 12/19
13987	AAQ	Central	0	385	611	996	32	179.90	1,311.91	N	0	3/25 5/30 6/4 6/25 9/8 9/8 9/8 9/18 10/28
13390	KIRKLAND RD	Plant City	26	834	71	931	32	539.28	1,927.19	N	2	1/10 1/17 1/26 2/2 2/8 2/14 2/22 2/23 3/63/15 3/27 4/3 4/3 4/19 4/19 4/19 4/22 5/3 5/7 5/10 5/16 5/17 5/20 5/21 5/31 6/3 6/3 6/12 6/15 6/18 6/27 7/3 7/3 7/17 7/19 7/23 7/28 8/6 8/16 8/17 8/19 9/21 9/21 9/25 9/26 10/4 10/10 10/22 10/25 10/29 10/31 10/31 11/1 11/3 11/6 11/9 11/15 11/30 12/18 12/20

Form 102 – Part III – Actual

ANNUAL DISTRIBUTION RELIABILITY REPORT - 2024

Utility Name: Tampa Electric

SAIDI: System Average Interruption Duration Index		
= Sum of All Customer Minutes Interrupted (CMI)	3,677,146.82	**4,226.63**
Total number of Customers Served (C)	869,995	
CAIDI: System Average Interruption Duration Index		
= Sum of All Customer Minutes Interrupted (CMI)	3,677,146.82	**1,192.84**
Total number of Customer Interruptions (CI)	3,082,686	
SAIFI: System Average Interruption Frequency Index		
= Total number of Customer Interruptions (CI)	3,082,686	**3.54**
Total number of Customers Served (C)	869,995	
MAIFIe: Momentary Average Interruption Event		
= Sum of All Customer Momentary Interruption Events (CME)	8,213,428	**9.44**
Total number of Customers Served (C)	869,995	
L-Bar:		
= Minutes of Interruption	31,651,445	**904.07**
Total number of Outages	35,010	

District	C	CMI	CI	CME	CEMI-5
Central	222,973	693,491,886	630,562	1,685,990	6,896
Dade City	17,949	135,971,901	132,691	225,805	5,228
Eastern	136,599	846,738,007	527,792	1,511,725	6,329
Plant City	67,754	436,130,277	363,357	761,252	14,445
South Hillsborough	114,875	607,722,104	455,533	786,722	4,890
Western	219,415	759,437,991	706,346	2,437,673	4,841
Winter Haven	90,430	131,700,082	242,991	804,261	2,118
Unknown	0	65,954,574	23,414	0	0
System Total:	869,995	3,677,146,822	3,082,686	8,213,428	44,747

Form 102 – Part III continued – Actual

Service Reliability Indices - Actual					
Utility Name: Tampa Electric				Year: 2024	
District or Service Area (a)	**SAIDI**	**CAIDI**	**SAIFI**	**MAIFIe**	**CEMI-5%**
Central	3,110.20	1,099.80	2.83	7.56	3.09%
Dade City	7,575.46	1,024.73	7.39	12.58	29.13%
Eastern	6,198.71	1,604.30	3.86	11.07	4.63%
Plant City	6,436.96	1,200.28	5.36	11.24	21.32%
South Hillsborough	5,290.29	1,334.09	3.97	6.85	4.26%
Western	3,461.19	1,075.16	3.22	11.11	2.21%
Winter Haven	1,456.37	542.00	2.69	8.89	2.34%
Unknown	0	2,816.89	0	0	0.00%
System Total:	4,226.61	1,192.84	3.54	9.44	5.14%

Form PSC/ECR 102-3, Docket No. 20011351-EI, Rule 25-6.0455(c)

Note: L-Bar and CAIDI are expressed in minutes

Reliability Appendix B

Form PSC/ECR 102-1(b) (8/06)

Causes of Outage Events - Adjusted

Utility Name: Tampa Electric Year: 2024

Cause (a)	Number of Outages Events (N)	Average Duration (L-Bar)	Average Restoration Time (CAIDI)
1. Vegetation	2,374	182.46	107.91
2. Animals	1,061	90.54	59.66
3. Down Wire	1,015	173.52	81.50
4. Unknown	1,461	92.21	30.81
5. Lightning	1,174	155.55	101.65
6. Defective Equipment	775	228.80	103.84
7. Other Weather	1,008	580.76	326.64
8. Electrical	895	159.54	54.15
9. Vehicle	301	202.98	101.10
10. Bad Connection	328	260.54	102.56
11. All Remaining Causes	1,619	1,321.81	753.23
Total	12,011	194.60	104.53

Note: L-Bar and CAIDI are expressed in minutes.

Form 103 - PART II – Adjusted

FPSC Annual Report - 3 Percent Feeder List (Adjusted)

Primary Circuit Id. No. or Name (a)	Substation Origin (b)	Location (c)	Number of Customers				Circuit Outages "N" (h)	Avg. Duration "L-Bar" (i)	CAIDI (j)	Listed Last Year? (k)	Years in the Last 5 (l)	Action Completion Date (n)
			Residential (d)	Commercial (e)	Industrial (f)	Total (g)						
13170	MADISON AV	Eastern	1	1,025	1,030	2,056	71	61.00	54.82	N	1	4/30 6/4 6/28 7/25 7/29 8/1 9/9 9/22
13959	TERRACE	Plant City	10	1,097	0	1,107	41	41.94	22.27	N	0	1/29 3/14 7/22 9/30 1/18 6/17 10/22 7/18 8/4 1/1 9/28 9/27 2/21 2/20 2/18 1/9 1/25 2/20 2/22 6/14 6/15 3/20 4/4 4/15 5/3 4/2 4/22 7/11 8/7 5/3 4/15 4/9 5/3 11/5
13631	PINE LAKE	Central	2	1,048	281	1,331	35	115.18	33.33	Y	2	4/10 5/16 6/13 7/22 7/22 8/20 9/16 10/10 10/25 11/20 11/25 12/12 12/21 12/27
13430	SAN ANTN	Dade City	34	952	47	1,033	35	106.03	51.12	N	0	1/19 1/19 1/25 1/31 2/14 4/3 4/46/5 7/22 7/24 8/2 8/2 8/4 8/5 8/68/6 8/6 8/12 8/22 8/28 8/30 9/139/25 10/29 10/30 11/4 11/7 11/25 12/10
13777	MILLER MAC	South Hillsborough	15	897	152	1,064	29	273.08	93.32	N	0	4/12 4/12 4/124/15 5/2 5/8 5/8 5/12 5/27 6/10 6/11 6/12 6/17 6/18 6/22 7/87/18 7/24 8/27 9/6 9/6 10/3 10/23 11/15 12/2 12/4 12/5 12/5 12/10 12/23 12/26 12/27
13118	LAKE ALFRED	Winter Haven	7	1,861	251	2,119	29	44.38	15.29	N	2	1/19 1/22 3/17 4/3 4/4 5/19 5/30 6/20 6/20 7/5 7/15 7/24 7/24 7/26 7/26 7/27 8/7 8/15 8/29 9/4 10/30 11/4 11/4 11/8 12/1 12/5 12/12 12/17 12/19
13971	LUCERNE PARK	Winter Haven	2	1,266	1	1,269	28	76.80	35.67	N	0	1/20 1/27 2/24 4/15 11/7 11/17
14023	RIVERVEW	South Hillsborough	0	1,086	1	1,087	25	74.37	49.38	N	1	1/16 2/19 7/28 8/8 8/30 9/25 10/23 10/29 10/29 12/11 12/16 12/27 12/30 12/30
13436	12TH.AVE	Eastern	17	1,149	29	1,195	24	151.26	115.34	N	1	2/7 2/16 3/14 4/8 4/19 4/25 5/8 5/18 6/5 6/21 6/26 7/12 7/14 7/14 7/15 7/22 8/10 8/23 8/30 9/7 10/2 10/3 10/6 10/10 10/26 10/31 11/12 11/20 12/9 12/20 12/26
13112	MANHATTAN AV	Western	5	1,563	1,134	2,702	21	181.02	117.25	N	1	4/3 5/23 5/16 8/10 8/12 8/9 8/23 12/10 3/26 6/14 5/28 5/24 5/20 1/9 1/8 1/30 6/16 3/11 4/13 6/24 4/11 3/22 6/4 8/15 8/16 6/19 7/29 8/29 8/30 10/4 10/28 11/22 12/23 12/7 10/7 10/1 10/1 10/2
13815	BLANTON	Dade City	35	512	10	557	20	110.49	55.29	N	3	1/19 1/22 3/17 4/3 4/4 5/19 5/30 6/20 6/20 7/5 7/15 7/24 7/24 7/26 7/26 7/27 8/7 8/15 8/29 9/4 10/30 11/4 11/4 11/8 12/1 12/5 12/12 12/17 12/19
13668	HAMPTON	Plant City	4	1,696	2	1,702	20	107.20	17.50	N	0	2/2 4/2 5/1 5/15 6/7 8/16 9/5 10/8 10/21 11/6 11/13 11/13 12/9 12/13
13061	HIMES	Western	1	667	65	733	19	23.78	7.97	N	0	2/12 5/7 5/14 6/16 11/13 11/18 12/4 12/12 12/18 12/19
14012	GTE COLLIER	Central	10	352	1,034	1,396	18	169.31	36.06	N	0	1/2 1/5 2/20 2/22 3/13 3/23 3/26 4/5 4/29 6/3 7/19 7/24 8/12 8/13 8/29 9/5 9/13 9/13 10/3 10/5 10/10 10/27 11/11 11/15 11/27 12/10
13715	TAMPA PALMS	Central	0	70	3,191	3,261	17	83.20	51.71	N	0	2/3 3/21 5/24 6/4 7/22 7/26 8/25 10/28 11/5 11/12 12/5 12/28
13390	KIRKLAND RD	Plant City	26	834	71	931	16	187.86	34.17	N	1	1/10 1/17 1/26 2/2 2/8 2/14 2/22 2/23 3/63/15 3/27 4/3 4/3 4/19 4/19 4/19 4/22 5/3 5/7 5/10 5/16 5/17 5/20 5/21 5/31 6/3 6/3 6/12 6/15 6/18 6/27 7/3 7/3 7/17 7/19 7/23 7/28 8/6 8/16 8/17 8/19 9/21 9/21 9/25 9/26 10/4 10/10 10/22 10/25 10/29 10/31 10/31 11/1 11/3 11/6 11/9 11/15 11/30 12/18 12/20
13621	WAYNE RD	Western	13	443	1	457	16	53.89	7.33	N	0	1/22 3/19 5/29 6/24 6/28 6/29 7/17 7/21 7/22 9/4 10/2 10/6 11/8
13304	SUN CITY	South Hillsborough	0	1,893	153	2,046	15	73.08	16.36	N	0	1/21 1/21 1/22 1/25 2/3 3/19 6/21 10/23
13046	14TH ST	Central	7	1,313	76	1,396	14	144.89	16.83	N	0	1/2 1/4 1/14 2/28 3/6 4/24 4/25 5/7 6/18 6/24 6/25 7/30 8/23 8/27 8/29 9/4 9/4 9/9 9/17 9/18 9/23 10/10 11/3 11/8 11/8 11/8 11/10 11/18 11/20 12/9
14198	MASSARO	Eastern	0	8	114	122	14	100.69	73.43	N	0	1/23 2/15 3/14 6/11 8/7 8/28 9/20 9/23 11/18 12/30
13678	TURKEY FORD	Western	3	357	2,041	2,401	14	119.62	48.93	N	0	3/273/276/167/15
13330	DADE CTY	Dade City	24	1,344	279	1,647	13	139.30	18.60	N	0	3/1 3/21 4/3 4/3 4/3 4/3 4/5 4/18 7/1 7/6 7/11 8/6 8/14
13708	BUCKHORN	Eastern	1	875	1,032	1,908	13	159.77	53.38	N	0	3/6 3/6 3/21 4/10 4/12 5/4 5/9 7/16 9/4 10/6 10/26 11/13
13723	GALLAGHER RD	Plant City	11	435	7	453	13	200.92	94.62	N	1	1/9 1/16 2/21 3/6 3/6 3/6 3/6 3/6 3/23 4/3 4/4 4/9 4/17 6/1 6/10 8/10 8/19 8/28 9/5 9/19 9/23 10/3 10/8 10/16
14071	SUNLAKE	Western	3	1,607	1	1,611	13	166.65	44.80	N	0	2/27 3/4 4/12 5/6 5/7 7/3 11/6 11/8 11/23 12/24
13461	CLARKWILD	Eastern	36	700	3	739	12	118.41	54.66	N	0	1/19 3/2 3/28 4/4 5/7 5/8 5/11 5/15 5/28 6/2 6/16 6/21 6/22 6/27 6/27 7/18 8/13 8/22
13911	PEACH AV	Eastern	4	758	345	1,107	12	135.90	106.62	N	0	3/10 4/5:5/16 5/20 6/16 6/21 6/22 7/26:7/30 8/14 8/15 8/19 9/12 10/1 10/21 10/27 11/21 11/27 11/27 12/17
13685	PEARSON RD	Eastern	6	1,304	0	1,310	12	87.25	46.41	N	0	9/27 6/11 8/28 6/12 3/184/10 4/15 8/7 8/16 1/9 9/16 10/2 6/18 2/84/8 4/22 8/12 5/10
13983	CORONET	Plant City	12	812	0	824	12	150.92	68.34	N	0	1/26 2/9 2/26 4/1 4/3 4/30:5/8 5/17 7/15 7/20 8/26 9/13 10/8 10/28 11/13 12/16
13896	1ST ST	South Hillsborough	6	1,095	437	1,538	12	210.22	27.92	N	0	2/13 2/28 3/7 3/20 4/30 6/4 6/24 7/17 8/8 9/5 9/20 10/2:10/22 11/7 11/7 11/26 12/6
13117	LAKE ALFRED	Winter Haven	11	1,534	60	1,605	12	99.77	78.38	N	0	1/4 1/24 2/2 2/19 2/22 4/3 4/17 4/30 5/1 5/3 5/6 5/7 7/3 7/8 7/16 7/19 7/21 8/15 9/5 9/11 9/20 9/30 10/3 10/7 10/21 11/20 11/26 12/5 12/16

Form 103 - PART III – Adjusted

PART III
ANNUAL DISTRIBUTION RELIABILITY REPORT - 2024
Utility Name: Tampa Electric

SAIDI: System Average Interruption Duration Index
= Sum of All Customer Minutes Interrupted (CMI) / Total number of Customers Served (C)
94,604,966 / 869,995 = **108.74**

CAIDI: System Average Interruption Duration Index
= Sum of All Customer Minutes Interrupted (CMI) / Total number of Customer Interruptions (CI)
94,604,966 / 905,043 = **104.53**

SAIFI: System Average Interruption Frequency Index
= Total number of Customer Interruptions (CI) / Total number of Customers Served (C)
905,043 / 869,995 = **1.04**

MAIFIe: Momentary Average Interruption Event
= Sum of All Customer Momentary Interruption Events (CME) / Total number of Customers Served (C)
4,730,783 / 869,995 = **5.44**

L-Bar:
= Minutes of Interruption / Total number of Outages
2,337,304 / 12,011 = **194.60**

District	C	CMI	CI	CME	CEMI-5
Central	222,973	10,484,324	144,787	968,517	40
Dade City	17,949	32.979,139	50,742	124,003	1,149
Eastern	136,599	11,230,619	159,195	859,944	1,174
Plant City	67,754	10,447,915	109,969	489,944	179
South Hillsborough	114,875	7,822,120	125,699	464,722	26
Western	219,415	13,622,101	194,455	1,294,814	5
Winter Haven	90,430	8,006,067	118,867	528,839	165
Unknown	0	12,681	1,329	0	0
System Total:	869,995	94,604,966	905,043	4,730,783	2,738

Form 103 Part III continued Adjusted

Service Reliability Indices - Adjusted					
Utility Name: Tampa Electric				Year: 2024	
District or Service Area (a)	**SAIDI** (b)	**CAIDI** (c)	**SAIFI** (d)	**MAIFIe** (e)	**CEMI-5%** (f)
Central	47.02	72.41	0.65	4.34	0.02%
Dade City	1,837.38	649.94	2.83	6.91	6.40%
Eastern	82.21	70.55	1.17	6.30	0.86%
Plant City	154.20	95.01	1.62	7.23	0.26%
South Hillsborough	68.09	62.23	1.09	4.05	0.02%
Western	62.08	70.05	0.89	5.90	0.00%
Winter Haven	88.53	67.35	1.31	5.85	0.18%
Unknown	0.00	9.54	0.00	0.00	0.00%
System Total:	108.74	104.53	1.04	5.44	0.31%

Form PSC/ECR 102-3, Docket No. 20011351-EI, Rule 25-6.0455(c)

Note: L-Bar and CAIDI are expressed in minutes

Actual Data: CMI, CI and Documented Exclusions

2024	CMI		CI	
	Value	% of Actual	Value	% of Actual
Reported Actual Data	3,782,010,377	100.00%	3,300,353	100.00%
Documented Exclusions				
Planned Service Interruptions	13,944,817	0.37%	314,563	4.07%
Named Storm	3,587,052,044	94.85%	1,841,599	55.80%
Tornadoes	0	0.00%	0	0.00%
Ice on Lines	0	0.00%	0	0.00%
Planned Load Management Events	0	0.00%	0	0.00%
Generation/Transmission Events	3,704,563	0.10%	134,186	4.07%
Extreme Weather (EOC Activation/Fire)	0	0.00%	0	0.00%
Reported Adjusted Data	96,304,302	2.55%	918,574	27.83%

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Breaker	PLANNED OUTAGE	1/01/2024 22:17	40,128.00	1980
Transformer	PLANNED OUTAGE	1/02/2024 8:02	136.93	2
Transformer	PLANNED OUTAGE	1/02/2024 9:50	80.40	4
Transformer	PLANNED OUTAGE	1/03/2024 10:35	218.80	8
Transformer Bank	PLANNED OUTAGE	1/03/2024 8:56	45.78	1
Transformer	PLANNED OUTAGE	1/03/2024 13:41	287.87	34
PLF	PLANNED OUTAGE	1/03/2024 23:59	268.97	1
None	PLANNED OUTAGE	1/04/2024 9:39	274.00	6
Transformer	PLANNED OUTAGE	1/04/2024 10:52	1,035.50	10
PLF	PLANNED OUTAGE	1/04/2024 15:27	205.50	15
Transformer Bank	PLANNED OUTAGE	1/04/2024 9:35	802.80	6
Transformer	PLANNED OUTAGE	1/05/2024 8:41	1,336.20	12
Transformer	PLANNED OUTAGE	1/05/2024 15:20	14.55	1
PLF	PLANNED OUTAGE	1/06/2024 13:58	393.67	20
PLF	PLANNED OUTAGE	1/06/2024 16:10	106.30	6
Breaker	PLANNED OUTAGE	1/07/2024 22:02	37.72	1
Transformer	PLANNED OUTAGE	1/08/2024 9:17	239.05	3
Transformer	PLANNED OUTAGE	1/08/2024 11:15	75.45	3
Transformer	PLANNED OUTAGE	1/08/2024 9:38	4,004.37	11
Transformer	PLANNED OUTAGE	1/09/2024 8:53	481.20	8
Transformer	PLANNED OUTAGE	1/09/2024 9:14	211.47	4
UG Other	PLANNED OUTAGE	1/09/2024 13:35	13,767.60	924
Transformer	PLANNED OUTAGE	1/09/2024 14:29	59.50	7
Breaker	PLANNED OUTAGE	1/09/2024 14:30	8.00	1
None	PLANNED OUTAGE	1/09/2024 17:36	1,070.83	125
None	PLANNED OUTAGE	1/09/2024 17:36	8.57	1
None	PLANNED OUTAGE	1/09/2024 17:36	8.57	1
Breaker	PLANNED OUTAGE	1/09/2024 15:16	5,803.30	886
Breaker	PLANNED OUTAGE	1/09/2024 15:16	6.55	1
Breaker	PLANNED OUTAGE	1/09/2024 19:25	2,972.75	517
Breaker	PLANNED OUTAGE	1/09/2024 19:25	5.63	1
PLF	PLANNED OUTAGE	1/09/2024 19:56	240.27	17
Transformer	PLANNED OUTAGE	1/01/2024 0:30	2,579.70	18
Transformer	PLANNED OUTAGE	1/01/2024 15:20	266.00	5
Switch	PLANNED OUTAGE	1/02/2024 8:08	7.62	1
Transformer	PLANNED OUTAGE	1/02/2024 8:05	76.97	2
Transformer	PLANNED OUTAGE	1/02/2024 8:57	144.05	3
Transformer	PLANNED OUTAGE	1/02/2024 9:23	108.42	5
Transformer	PLANNED OUTAGE	1/02/2024 11:49	237.83	5
Transformer	PLANNED OUTAGE	1/02/2024 19:39	1,171.22	7
Breaker	PLANNED OUTAGE	1/03/2024 3:59	371.70	14

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	1/03/2024 11:05	159.83	5
PLF	PLANNED OUTAGE	1/04/2024 9:26	783.07	7
Transformer	PLANNED OUTAGE	1/04/2024 13:25	156.30	6
Transformer	PLANNED OUTAGE	1/04/2024 13:57	35.60	4
Transformer	PLANNED OUTAGE	1/04/2024 14:40	130.60	6
Switch	PLANNED OUTAGE	1/05/2024 7:56	235.60	2
Transformer	PLANNED OUTAGE	1/05/2024 8:30	2,419.07	8
Transformer	PLANNED OUTAGE	1/06/2024 8:16	115.52	1
PLF	PLANNED OUTAGE	1/08/2024 17:00	50.65	3
Transformer	PLANNED OUTAGE	1/08/2024 13:04	193.83	5
Transformer	PLANNED OUTAGE	1/08/2024 14:04	343.67	4
Transformer	PLANNED OUTAGE	1/09/2024 8:54	603.00	10
Transformer	PLANNED OUTAGE	1/09/2024 9:50	47.70	3
UG Other	PLANNED OUTAGE	1/09/2024 13:35	54.53	1
UG Other	PLANNED OUTAGE	1/09/2024 13:35	55.05	1
Transformer	PLANNED OUTAGE	1/09/2024 10:42	486.67	5
Transformer	PLANNED OUTAGE	1/09/2024 12:37	2,445.60	12
None	PLANNED OUTAGE	1/09/2024 17:36	8.57	1
None	PLANNED OUTAGE	1/09/2024 17:36	8.57	1
None	PLANNED OUTAGE	1/09/2024 17:36	8.57	1
None	PLANNED OUTAGE	1/09/2024 17:36	23.10	1
PLF	PLANNED OUTAGE	1/09/2024 16:22	364.17	95
Transformer	PLANNED OUTAGE	1/02/2024 1:11	386.25	9
Transformer	PLANNED OUTAGE	1/02/2024 2:18	99.07	4
Service point	PLANNED OUTAGE	1/02/2024 3:19	56.48	1
Transformer	PLANNED OUTAGE	1/02/2024 7:26	73.15	1
Switch	PLANNED OUTAGE	1/02/2024 8:08	1.62	1
OH Other	PLANNED OUTAGE	1/02/2024 14:41	115.37	1
PLF	PLANNED OUTAGE	1/02/2024 9:29	3,105.83	10
Transformer	PLANNED OUTAGE	1/03/2024 0:15	334.60	6
Breaker	PLANNED OUTAGE	1/03/2024 3:35	321.53	14
Transformer	PLANNED OUTAGE	1/03/2024 9:03	330.70	3
Transformer	PLANNED OUTAGE	1/03/2024 11:12	297.60	4
Recloser	PLANNED OUTAGE	1/04/2024 9:00	6,156.67	50
PLF	PLANNED OUTAGE	1/04/2024 18:42	4,006.50	15
Transformer	PLANNED OUTAGE	1/04/2024 21:02	2,058.90	6
PLF	PLANNED OUTAGE	1/05/2024 15:17	512.58	5
PLF	PLANNED OUTAGE	1/06/2024 22:38	136.95	9
Transformer Bank	PLANNED OUTAGE	1/06/2024 23:54	56.33	2
Transformer	PLANNED OUTAGE	1/07/2024 12:53	566.40	8
None	PLANNED OUTAGE	1/07/2024 13:38	261.47	4

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	1/08/2024 8:29	558.95	7
Breaker	PLANNED OUTAGE	1/08/2024 16:07	2,001.77	373
Breaker	PLANNED OUTAGE	1/08/2024 16:07	6.13	1
Breaker	PLANNED OUTAGE	1/08/2024 16:07	5.38	1
Transformer	PLANNED OUTAGE	1/08/2024 12:57	130.20	4
PLF	PLANNED OUTAGE	1/09/2024 8:57	41.50	1
None	PLANNED OUTAGE	1/09/2024 16:33	604.92	7
Breaker	PLANNED OUTAGE	1/09/2024 15:16	6.55	1
Breaker	PLANNED OUTAGE	1/09/2024 15:16	6.55	1
Breaker	PLANNED OUTAGE	1/09/2024 15:16	6.55	1
Breaker	PLANNED OUTAGE	1/09/2024 15:16	6.55	1
PLF	PLANNED OUTAGE	1/09/2024 22:53	17.17	1
PLF	PLANNED OUTAGE	1/09/2024 19:13	51,633.75	225
Transformer	PLANNED OUTAGE	1/10/2024 5:12	201.20	6
PLF	PLANNED OUTAGE	1/10/2024 0:50	1,205.30	6
Transformer	PLANNED OUTAGE	1/10/2024 3:00	220.88	1
Switch	PLANNED OUTAGE	1/10/2024 9:43	1,474.20	42
Transformer	PLANNED OUTAGE	1/10/2024 13:49	232.20	9
Transformer	PLANNED OUTAGE	1/10/2024 9:31	2,140.23	11
Primary Wire	PLANNED OUTAGE	1/10/2024 8:40	4,785.33	20
PLF	PLANNED OUTAGE	1/11/2024 8:47	4,236.67	31
Transformer	PLANNED OUTAGE	1/11/2024 10:08	1,855.50	9
PLF	PLANNED OUTAGE	1/11/2024 8:35	207.60	1
Transformer	PLANNED OUTAGE	1/11/2024 13:46	5,526.13	8
Transformer	PLANNED OUTAGE	1/12/2024 10:09	207.43	7
Primary Wire	PLANNED OUTAGE	1/12/2024 9:17	32.58	1
Transformer	PLANNED OUTAGE	1/12/2024 13:10	249.60	4
PLF	PLANNED OUTAGE	1/12/2024 13:05	1,146.82	13
Transformer	PLANNED OUTAGE	1/12/2024 18:35	428.80	8
Transformer	PLANNED OUTAGE	1/13/2024 18:21	233.40	9
Transformer	PLANNED OUTAGE	1/14/2024 19:44	108.53	16
Transformer	PLANNED OUTAGE	1/14/2024 22:50	139.15	11
Transformer	PLANNED OUTAGE	1/15/2024 9:36	331.10	3
Transformer	PLANNED OUTAGE	1/15/2024 9:41	51.60	4
Transformer Bank	PLANNED OUTAGE	1/15/2024 10:12	107.27	4
Breaker	PLANNED OUTAGE	1/15/2024 19:54	3,765.87	1228
Breaker	PLANNED OUTAGE	1/15/2024 19:54	3.33	1
Transformer	PLANNED OUTAGE	1/15/2024 23:21	78.05	7
Transformer	PLANNED OUTAGE	1/16/2024 8:36	99.75	9
Recloser	PLANNED OUTAGE	1/16/2024 14:35	596.95	3
Transformer	PLANNED OUTAGE	1/16/2024 19:25	341.37	2

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	1/17/2024 8:54	6,749.40	28
PLF	PLANNED OUTAGE	1/17/2024 9:31	45.33	10
Transformer Bank	PLANNED OUTAGE	1/17/2024 10:05	37.08	1
Transformer	PLANNED OUTAGE	1/17/2024 10:52	145.20	9
Breaker	PLANNED OUTAGE	1/09/2024 19:25	5.55	1
Breaker	PLANNED OUTAGE	1/09/2024 19:25	5.70	1
PLF	PLANNED OUTAGE	1/09/2024 18:56	762.50	3
PLF	PLANNED OUTAGE	1/10/2024 9:39	247.00	30
Primary Wire	PLANNED OUTAGE	1/10/2024 12:47	1,516.90	42
Transformer Bank	PLANNED OUTAGE	1/10/2024 10:59	1,282.80	8
Primary Wire	PLANNED OUTAGE	1/10/2024 12:00	6.33	2
Transformer	PLANNED OUTAGE	1/10/2024 10:33	101.20	1
PLF	PLANNED OUTAGE	1/11/2024 9:05	353.80	3
Transformer	PLANNED OUTAGE	1/11/2024 8:52	1,049.40	12
Transformer	PLANNED OUTAGE	1/11/2024 12:01	26.75	1
Transformer	PLANNED OUTAGE	1/11/2024 10:57	5,624.00	30
PLF	PLANNED OUTAGE	1/11/2024 9:55	293.83	1
Transformer	PLANNED OUTAGE	1/12/2024 0:18	476.67	11
Transformer	PLANNED OUTAGE	1/12/2024 10:16	161.20	6
Transformer	PLANNED OUTAGE	1/12/2024 12:10	105.65	1
Transformer	PLANNED OUTAGE	1/12/2024 12:34	719.17	5
Transformer	PLANNED OUTAGE	1/13/2024 16:19	153.57	1
Transformer	PLANNED OUTAGE	1/15/2024 9:40	116.30	3
Transformer	PLANNED OUTAGE	1/15/2024 12:41	30.10	2
Transformer	PLANNED OUTAGE	1/15/2024 10:12	112.60	3
Breaker	PLANNED OUTAGE	1/15/2024 19:54	3.62	1
Transformer	PLANNED OUTAGE	1/16/2024 8:46	188.67	4
Transformer	PLANNED OUTAGE	1/16/2024 9:33	38.80	6
Recloser	PLANNED OUTAGE	1/16/2024 11:21	1,623.33	974
Recloser	PLANNED OUTAGE	1/16/2024 14:16	3,698.07	17
Service point	PLANNED OUTAGE	1/16/2024 13:12	6.10	1
Transformer	PLANNED OUTAGE	1/16/2024 11:25	253.20	8
Transformer	PLANNED OUTAGE	1/16/2024 15:51	295.43	2
PLF	PLANNED OUTAGE	1/17/2024 9:31	60.45	13
PLF	PLANNED OUTAGE	1/17/2024 9:59	728.57	22
PLF	PLANNED OUTAGE	1/17/2024 12:11	13.00	2
Transformer	PLANNED OUTAGE	1/17/2024 12:25	45.27	2
Transformer	PLANNED OUTAGE	1/10/2024 7:53	168.12	7
Primary Wire	PLANNED OUTAGE	1/10/2024 9:05	1,374.45	51
Primary Wire	PLANNED OUTAGE	1/10/2024 9:05	4,010.58	149
Primary Wire	PLANNED OUTAGE	1/10/2024 10:42	1,444.20	12

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	1/10/2024 9:02	216.80	3
Transformer	PLANNED OUTAGE	1/10/2024 11:12	354.70	6
Switch	PLANNED OUTAGE	1/10/2024 11:43	209.07	7
Service point	PLANNED OUTAGE	1/10/2024 18:58	168.42	1
Transformer	PLANNED OUTAGE	1/11/2024 9:24	3,769.60	32
Transformer	PLANNED OUTAGE	1/11/2024 10:28	1,356.03	34
Transformer	PLANNED OUTAGE	1/11/2024 9:03	224.00	10
PLF	PLANNED OUTAGE	1/11/2024 9:08	117.37	1
Transformer	PLANNED OUTAGE	1/12/2024 10:12	2,056.60	13
Transformer Bank	PLANNED OUTAGE	1/12/2024 9:17	125.73	2
Transformer	PLANNED OUTAGE	1/12/2024 12:38	284.80	2
Transformer	PLANNED OUTAGE	1/13/2024 11:38	384.45	9
PLF	PLANNED OUTAGE	1/13/2024 21:41	88.43	2
Transformer	PLANNED OUTAGE	1/15/2024 10:26	165.80	4
Transformer	PLANNED OUTAGE	1/15/2024 11:42	112.13	4
Transformer	PLANNED OUTAGE	1/15/2024 12:10	98.65	3
Transformer Bank	PLANNED OUTAGE	1/12/2024 8:47	340.33	1
Transformer Bank	PLANNED OUTAGE	1/12/2024 8:47	345.70	1
Transformer	PLANNED OUTAGE	1/16/2024 8:24	115.32	11
Transformer	PLANNED OUTAGE	1/16/2024 12:57	854.93	7
PLF	PLANNED OUTAGE	1/16/2024 18:08	23.63	1
Transformer	PLANNED OUTAGE	1/17/2024 10:15	207.78	7
Service point	PLANNED OUTAGE	1/17/2024 11:21	5.45	1
Service point	PLANNED OUTAGE	1/17/2024 13:19	30.80	1
Transformer	PLANNED OUTAGE	1/17/2024 10:03	326.87	4
Transformer	PLANNED OUTAGE	1/17/2024 18:01	375.47	11
Transformer	PLANNED OUTAGE	1/17/2024 20:03	100.40	8
Transformer	PLANNED OUTAGE	1/18/2024 11:06	53.37	2
Transformer	PLANNED OUTAGE	1/18/2024 9:14	1,223.83	14
Switch	PLANNED OUTAGE	1/17/2024 9:00	3,739.25	15
Transformer Bank	PLANNED OUTAGE	1/17/2024 13:38	422.22	7
Breaker	PLANNED OUTAGE	1/17/2024 21:24	398.40	36
UG Other	PLANNED OUTAGE	1/18/2024 9:48	350.00	10
Transformer	PLANNED OUTAGE	1/18/2024 8:40	65.42	5
Transformer	PLANNED OUTAGE	1/18/2024 8:41	192.30	3
Transformer	PLANNED OUTAGE	1/18/2024 10:55	450.75	9
Transformer	PLANNED OUTAGE	1/18/2024 11:45	33.60	1
Transformer Bank	PLANNED OUTAGE	1/18/2024 10:46	271.42	5
Transformer	PLANNED OUTAGE	1/18/2024 23:41	34.27	2
Transformer	PLANNED OUTAGE	1/19/2024 1:43	334.83	5
Transformer	PLANNED OUTAGE	1/18/2024 15:28	1,820.43	13

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Breaker	PLANNED OUTAGE	1/19/2024 8:31	176.55	33
PLF	PLANNED OUTAGE	1/19/2024 9:53	64.85	1
Transformer	PLANNED OUTAGE	1/20/2024 0:51	146.18	7
Transformer	PLANNED OUTAGE	1/20/2024 23:46	256.48	11
Breaker	PLANNED OUTAGE	1/21/2024 9:51	16,576.17	1355
Transformer	PLANNED OUTAGE	1/22/2024 11:17	59.73	2
Transformer	PLANNED OUTAGE	1/22/2024 9:30	107.55	3
Transformer	PLANNED OUTAGE	1/22/2024 12:35	355.60	8
Transformer	PLANNED OUTAGE	1/22/2024 10:38	1,002.55	3
Transformer	PLANNED OUTAGE	1/23/2024 0:43	85.87	7
Transformer	PLANNED OUTAGE	1/23/2024 11:43	52.80	6
PLF	PLANNED OUTAGE	1/23/2024 12:23	3.90	1
Transformer	PLANNED OUTAGE	1/23/2024 14:07	1,267.20	9
Transformer	PLANNED OUTAGE	1/24/2024 10:55	79.85	3
PLF	PLANNED OUTAGE	1/24/2024 11:19	91.33	20
Transformer	PLANNED OUTAGE	1/24/2024 11:35	85.35	1
Transformer	PLANNED OUTAGE	1/24/2024 8:57	1,956.67	10
Transformer	PLANNED OUTAGE	1/24/2024 11:46	17.62	1
Transformer	PLANNED OUTAGE	1/24/2024 10:49	979.65	9
PLF	PLANNED OUTAGE	1/24/2024 21:44	526.33	2
Service point	PLANNED OUTAGE	1/17/2024 15:19	75.90	1
Transformer	PLANNED OUTAGE	1/18/2024 7:50	24.87	2
Transformer	PLANNED OUTAGE	1/18/2024 11:23	11.65	3
Transformer	PLANNED OUTAGE	1/18/2024 8:53	1,158.40	8
Transformer	PLANNED OUTAGE	1/18/2024 11:45	33.62	1
PLF	PLANNED OUTAGE	1/18/2024 18:14	713.50	3
Breaker	PLANNED OUTAGE	1/19/2024 8:31	3,766.80	774
Transformer	PLANNED OUTAGE	1/20/2024 0:31	64.75	5
PLF	PLANNED OUTAGE	1/20/2024 0:51	802.12	17
Transformer	PLANNED OUTAGE	1/20/2024 12:38	218.40	8
Breaker	PLANNED OUTAGE	1/21/2024 9:51	14.35	1
None	PLANNED OUTAGE	1/21/2024 13:47	883.58	23
None	PLANNED OUTAGE	1/21/2024 22:32	488.17	10
Transformer	PLANNED OUTAGE	1/22/2024 9:30	62.73	2
Transformer	PLANNED OUTAGE	1/22/2024 10:28	427.60	4
Transformer	PLANNED OUTAGE	1/22/2024 11:15	91.42	5
Transformer	PLANNED OUTAGE	1/22/2024 12:57	87.85	7
Transformer	PLANNED OUTAGE	1/22/2024 23:28	275.00	10
Transformer	PLANNED OUTAGE	1/23/2024 8:44	2,193.40	12
Transformer	PLANNED OUTAGE	1/23/2024 12:10	39.80	4
PLF	PLANNED OUTAGE	1/23/2024 18:33	1,654.47	13

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	1/24/2024 2:28	187.73	8
Transformer	PLANNED OUTAGE	1/24/2024 10:58	47.47	2
Transformer	PLANNED OUTAGE	1/24/2024 8:55	467.53	2
Transformer	PLANNED OUTAGE	1/24/2024 11:36	83.75	1
Transformer	PLANNED OUTAGE	1/24/2024 11:11	98.02	1
Transformer	PLANNED OUTAGE	1/24/2024 14:40	115.70	3
PLF	PLANNED OUTAGE	1/25/2024 11:37	28.70	2
Transformer	PLANNED OUTAGE	1/25/2024 11:34	69.85	1
Transformer	PLANNED OUTAGE	1/25/2024 12:09	45.37	1
Transformer	PLANNED OUTAGE	1/25/2024 12:35	255.10	6
None	PLANNED OUTAGE	1/25/2024 11:33	17.28	1
Transformer	PLANNED OUTAGE	1/25/2024 13:08	401.17	10
PLF	PLANNED OUTAGE	1/26/2024 1:55	140.62	11
PLF	PLANNED OUTAGE	1/26/2024 8:09	186.33	2
Transformer	PLANNED OUTAGE	1/26/2024 13:05	102.40	3
Transformer Bank	PLANNED OUTAGE	1/26/2024 19:15	197.52	7
Transformer	PLANNED OUTAGE	1/26/2024 17:14	55.80	4
Transformer	PLANNED OUTAGE	1/27/2024 10:50	23.55	3
None	PLANNED OUTAGE	1/27/2024 19:08	325.40	2
Transformer	PLANNED OUTAGE	1/28/2024 0:01	1,254.87	28
PLF	PLANNED OUTAGE	1/28/2024 11:08	232.07	1
Breaker	PLANNED OUTAGE	1/28/2024 14:19	9,889.00	1364
Breaker	PLANNED OUTAGE	1/28/2024 14:11	15.17	1
Breaker	PLANNED OUTAGE	1/28/2024 14:11	15.47	1
Transformer	PLANNED OUTAGE	1/29/2024 11:35	29.17	5
Transformer	PLANNED OUTAGE	1/29/2024 9:51	2,015.83	10
Transformer	PLANNED OUTAGE	1/29/2024 9:12	1,422.85	13
Transformer	PLANNED OUTAGE	1/29/2024 13:22	57.03	1
PLF	PLANNED OUTAGE	1/30/2024 2:27	41.60	16
Transformer	PLANNED OUTAGE	1/30/2024 9:04	478.17	5
Transformer	PLANNED OUTAGE	1/30/2024 9:16	696.85	7
Transformer	PLANNED OUTAGE	1/30/2024 8:47	693.40	4
Transformer	PLANNED OUTAGE	1/30/2024 11:03	556.50	5
PLF	PLANNED OUTAGE	1/30/2024 14:01	1,350.83	10
Transformer Bank	PLANNED OUTAGE	1/30/2024 11:41	80.73	1
Transformer	PLANNED OUTAGE	1/30/2024 17:14	880.00	10
Transformer	PLANNED OUTAGE	1/30/2024 19:51	1,789.25	17
Transformer	PLANNED OUTAGE	1/31/2024 10:01	24.18	1
Transformer	PLANNED OUTAGE	1/31/2024 9:59	237.15	9
PLF	PLANNED OUTAGE	1/31/2024 14:03	56.02	1
Transformer	PLANNED OUTAGE	2/01/2024 10:16	689.73	4

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	2/01/2024 16:05	19.27	17
Transformer	PLANNED OUTAGE	2/01/2024 20:47	473.20	6
Transformer	PLANNED OUTAGE	1/01/2024 2:06	1,272.40	12
Transformer	PLANNED OUTAGE	1/01/2024 0:03	3,120.83	10
Transformer	PLANNED OUTAGE	1/02/2024 11:05	179.87	4
Transformer	PLANNED OUTAGE	1/02/2024 9:14	435.90	6
Transformer Bank	PLANNED OUTAGE	1/02/2024 9:57	180.37	2
Transformer	PLANNED OUTAGE	1/02/2024 18:29	82.70	6
Transformer	PLANNED OUTAGE	1/03/2024 9:27	429.90	18
PLF	PLANNED OUTAGE	1/03/2024 11:01	225.92	1
PLF	PLANNED OUTAGE	1/04/2024 0:38	233.40	12
Transformer	PLANNED OUTAGE	1/04/2024 11:22	350.23	7
Transformer	PLANNED OUTAGE	1/04/2024 9:06	173.37	1
Transformer	PLANNED OUTAGE	1/04/2024 12:25	455.92	5
Transformer	PLANNED OUTAGE	1/04/2024 10:02	146.58	5
Transformer	PLANNED OUTAGE	1/04/2024 13:44	498.33	10
Transformer	PLANNED OUTAGE	1/05/2024 10:54	698.33	10
Recloser	PLANNED OUTAGE	1/05/2024 11:36	332.02	11
Breaker	PLANNED OUTAGE	1/07/2024 22:02	127,023.33	424
Switch	PLANNED OUTAGE	1/07/2024 22:27	2,364.98	289
Switch	PLANNED OUTAGE	1/07/2024 22:27	8.63	1
Transformer	PLANNED OUTAGE	1/08/2024 13:42	25.43	2
Transformer	PLANNED OUTAGE	1/08/2024 13:42	52.93	4
UG Other	PLANNED OUTAGE	1/09/2024 13:35	54.73	1
UG Other	PLANNED OUTAGE	1/09/2024 13:35	54.82	1
UG Other	PLANNED OUTAGE	1/09/2024 13:35	54.90	1
UG Other	PLANNED OUTAGE	1/09/2024 13:35	54.98	1
None	PLANNED OUTAGE	1/09/2024 7:57	345.65	1
None	PLANNED OUTAGE	1/09/2024 7:57	345.63	1
None	PLANNED OUTAGE	1/09/2024 6:51	50,377.07	124
Breaker	PLANNED OUTAGE	1/09/2024 14:30	9,072.00	1134
Breaker	PLANNED OUTAGE	1/09/2024 14:30	8.00	1
Breaker	PLANNED OUTAGE	1/09/2024 14:30	8.00	1
PLF	PLANNED OUTAGE	1/09/2024 15:46	354.57	22
Transformer	PLANNED OUTAGE	1/18/2024 9:24	499.80	4
Transformer	PLANNED OUTAGE	1/18/2024 11:23	112.73	1
Transformer	PLANNED OUTAGE	1/18/2024 11:33	138.45	3
Transformer	PLANNED OUTAGE	1/18/2024 11:45	46.10	1
Transformer	PLANNED OUTAGE	1/18/2024 11:45	33.63	1
PLF	PLANNED OUTAGE	1/18/2024 23:45	646.73	2
None	PLANNED OUTAGE	1/19/2024 4:27	1,364.13	13

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	1/19/2024 5:44	170.93	4
Transformer	PLANNED OUTAGE	1/19/2024 9:42	513.07	8
Transformer	PLANNED OUTAGE	1/22/2024 9:50	115.60	6
Transformer	PLANNED OUTAGE	1/22/2024 9:52	300.20	6
Transformer	PLANNED OUTAGE	1/22/2024 10:18	328.67	8
Transformer	PLANNED OUTAGE	1/22/2024 9:29	52.98	1
Transformer	PLANNED OUTAGE	1/22/2024 10:27	28.73	4
Transformer	PLANNED OUTAGE	1/22/2024 11:02	177.45	1
PLF	PLANNED OUTAGE	1/23/2024 8:51	108.33	25
Transformer	PLANNED OUTAGE	1/23/2024 11:00	800.08	5
Transformer	PLANNED OUTAGE	1/23/2024 14:09	235.75	5
Transformer	PLANNED OUTAGE	1/23/2024 11:49	1,437.60	9
Switch	PLANNED OUTAGE	1/22/2024 17:14	65.33	28
None	PLANNED OUTAGE	1/24/2024 9:07	1,667.60	24
Transformer	PLANNED OUTAGE	1/24/2024 9:43	61.53	2
Transformer	PLANNED OUTAGE	1/24/2024 10:15	38.80	1
Transformer Bank	PLANNED OUTAGE	1/24/2024 9:13	1,601.70	6
Transformer Bank	PLANNED OUTAGE	1/24/2024 9:57	193.37	1
Transformer	PLANNED OUTAGE	1/24/2024 10:07	107.25	11
Transformer	PLANNED OUTAGE	1/24/2024 11:19	863.60	6
Transformer	PLANNED OUTAGE	1/25/2024 9:16	255.40	4
Transformer	PLANNED OUTAGE	1/25/2024 10:59	352.65	3
Transformer	PLANNED OUTAGE	1/25/2024 9:29	1,252.77	7
Invalid	PLANNED OUTAGE	1/25/2024 13:36	338.33	14
Transformer	PLANNED OUTAGE	1/26/2024 23:25	23.60	2
Transformer	PLANNED OUTAGE	1/26/2024 23:42	90.92	5
PLF	PLANNED OUTAGE	1/25/2024 17:01	901.20	36
Transformer Bank	PLANNED OUTAGE	1/25/2024 20:45	178.88	1
PLF	PLANNED OUTAGE	1/26/2024 0:58	84.80	6
Transformer Bank	PLANNED OUTAGE	1/26/2024 4:14	76.73	4
Transformer	PLANNED OUTAGE	1/26/2024 12:51	427.20	4
Transformer	PLANNED OUTAGE	1/26/2024 22:17	995.55	9
Breaker	PLANNED OUTAGE	1/28/2024 14:11	15.35	1
Transformer	PLANNED OUTAGE	1/29/2024 14:59	201.50	3
Transformer	PLANNED OUTAGE	1/29/2024 9:29	938.58	7
Transformer	PLANNED OUTAGE	1/29/2024 12:30	481.70	6
Transformer	PLANNED OUTAGE	1/29/2024 16:52	5,128.33	10
Transformer	PLANNED OUTAGE	1/29/2024 16:45	91.05	9
PLF	PLANNED OUTAGE	1/29/2024 21:12	4,553.33	16
PLF	PLANNED OUTAGE	1/30/2024 2:33	48.00	16
Transformer	PLANNED OUTAGE	1/30/2024 9:11	568.83	10

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	1/30/2024 8:35	116.00	2
Transformer	PLANNED OUTAGE	1/30/2024 8:47	869.67	5
Transformer	PLANNED OUTAGE	1/30/2024 11:02	560.83	5
Transformer	PLANNED OUTAGE	1/30/2024 17:55	10.60	1
Transformer	PLANNED OUTAGE	1/30/2024 14:30	208.67	8
Transformer	PLANNED OUTAGE	1/31/2024 9:58	27.33	1
Transformer Bank	PLANNED OUTAGE	1/31/2024 10:52	480.35	13
PLF	PLANNED OUTAGE	1/31/2024 10:19	793.47	8
Transformer	PLANNED OUTAGE	1/31/2024 12:14	209.73	11
Transformer	PLANNED OUTAGE	1/31/2024 14:16	358.67	8
PLF	PLANNED OUTAGE	2/01/2024 9:56	129.95	1
PLF	PLANNED OUTAGE	2/01/2024 10:27	188.97	1
Transformer	PLANNED OUTAGE	2/01/2024 16:04	114.50	10
Transformer	PLANNED OUTAGE	2/01/2024 16:26	30.57	14
Transformer	PLANNED OUTAGE	2/01/2024 9:54	861.03	2
Transformer	PLANNED OUTAGE	2/02/2024 3:53	103.72	7
Transformer	PLANNED OUTAGE	2/02/2024 10:16	217.12	7
Transformer	PLANNED OUTAGE	2/02/2024 11:21	131.70	9
PLF	PLANNED OUTAGE	2/01/2024 21:14	594.00	2
TX Replaced (PM)	PLANNED OUTAGE	2/01/2024 0:13	880.55	1
PLF	PLANNED OUTAGE	2/02/2024 12:40	219.07	4
PLF	PLANNED OUTAGE	2/02/2024 12:56	1,449.45	27
Transformer	PLANNED OUTAGE	2/02/2024 13:28	226.10	6
Transformer	PLANNED OUTAGE	2/02/2024 8:49	315.35	1
Transformer	PLANNED OUTAGE	2/02/2024 14:45	66.77	1
Transformer Bank	PLANNED OUTAGE	2/03/2024 1:55	40.28	1
PLF	PLANNED OUTAGE	2/03/2024 0:13	29.80	6
Transformer	PLANNED OUTAGE	2/03/2024 14:29	312.27	8
Transformer	PLANNED OUTAGE	2/03/2024 19:26	250.37	7
Breaker	PLANNED OUTAGE	2/04/2024 12:29	3.67	1
Breaker	PLANNED OUTAGE	2/04/2024 12:45	18,425.50	430
PLF	PLANNED OUTAGE	2/04/2024 17:57	3,380.50	6
TX Replaced (PM)	PLANNED OUTAGE	2/05/2024 8:55	391.67	4
Transformer	PLANNED OUTAGE	2/05/2024 15:54	401.85	9
Transformer	PLANNED OUTAGE	2/05/2024 19:28	21.25	5
Transformer	PLANNED OUTAGE	2/05/2024 20:25	217.90	1
Transformer	PLANNED OUTAGE	2/05/2024 23:33	190.13	8
Transformer	PLANNED OUTAGE	2/06/2024 0:20	9.40	3
Transformer	PLANNED OUTAGE	2/06/2024 7:55	132.40	6
Transformer	PLANNED OUTAGE	2/06/2024 8:28	297.60	3
Transformer	PLANNED OUTAGE	2/06/2024 13:03	44.10	9

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	2/06/2024 10:57	764.10	6
Transformer	PLANNED OUTAGE	2/06/2024 10:34	309.87	1
Transformer	PLANNED OUTAGE	2/07/2024 1:06	94.17	5
PLF	PLANNED OUTAGE	2/06/2024 22:16	5,309.20	13
Transformer	PLANNED OUTAGE	2/07/2024 8:18	662.40	8
Service point	PLANNED OUTAGE	2/07/2024 12:08	75.68	1
Transformer	PLANNED OUTAGE	2/07/2024 12:59	373.80	3
Transformer	PLANNED OUTAGE	2/07/2024 17:06	875.73	8
Transformer	PLANNED OUTAGE	2/07/2024 20:44	84.32	1
PLF	PLANNED OUTAGE	2/08/2024 13:51	301.93	7
PLF	PLANNED OUTAGE	1/27/2024 20:08	26.60	1
Transformer	PLANNED OUTAGE	1/27/2024 20:14	705.30	6
Transformer Bank	PLANNED OUTAGE	1/27/2024 21:27	140.70	9
PLF	PLANNED OUTAGE	1/28/2024 9:42	2,242.90	6
Breaker	PLANNED OUTAGE	1/28/2024 14:11	15.57	1
PLF	PLANNED OUTAGE	1/28/2024 17:07	116.83	2
Transformer	PLANNED OUTAGE	1/28/2024 17:10	207.67	10
Transformer	PLANNED OUTAGE	1/29/2024 9:30	804.40	6
Transformer	PLANNED OUTAGE	1/29/2024 12:44	613.00	5
Transformer	PLANNED OUTAGE	1/29/2024 12:44	55.07	7
UG Other	PLANNED OUTAGE	1/29/2024 12:50	57.42	1
UG Other	PLANNED OUTAGE	1/30/2024 9:05	1,495.32	7
Transformer	PLANNED OUTAGE	1/30/2024 10:37	318.65	3
Transformer	PLANNED OUTAGE	1/31/2024 8:15	1,356.00	10
Transformer	PLANNED OUTAGE	1/31/2024 8:29	1,676.57	13
Transformer	PLANNED OUTAGE	1/31/2024 11:40	1,317.62	11
PLF	PLANNED OUTAGE	1/31/2024 18:15	452.13	2
Service point	PLANNED OUTAGE	1/31/2024 21:40	356.07	1
Transformer	PLANNED OUTAGE	2/01/2024 11:55	302.70	6
PLF	PLANNED OUTAGE	2/01/2024 11:57	176.75	1
Transformer	PLANNED OUTAGE	2/01/2024 13:34	212.67	5
Recloser	PLANNED OUTAGE	2/02/2024 10:41	1,089.40	12
PLF	PLANNED OUTAGE	2/02/2024 15:03	230.40	4
Transformer	PLANNED OUTAGE	2/02/2024 10:32	568.00	2
Transformer	PLANNED OUTAGE	2/03/2024 15:25	321.73	8
Transformer	PLANNED OUTAGE	2/03/2024 16:19	275.85	9
Breaker	PLANNED OUTAGE	2/04/2024 10:57	26,805.60	432
Breaker	PLANNED OUTAGE	2/04/2024 10:57	61.72	1
Breaker	PLANNED OUTAGE	2/04/2024 10:57	61.93	1
PLF	PLANNED OUTAGE	2/05/2024 8:33	1,968.30	27
PLF	PLANNED OUTAGE	2/05/2024 8:58	194.00	4

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	2/05/2024 10:35	225.90	9
Transformer	PLANNED OUTAGE	2/05/2024 9:28	29.75	3
None	PLANNED OUTAGE	1/09/2024 17:36	8.52	1
None	PLANNED OUTAGE	1/09/2024 17:36	8.52	1
None	PLANNED OUTAGE	1/09/2024 17:36	8.48	1
None	PLANNED OUTAGE	1/09/2024 17:36	8.57	1
Transformer	PLANNED OUTAGE	1/09/2024 20:47	715.30	3
Breaker	PLANNED OUTAGE	1/09/2024 19:25	5.75	1
Breaker	PLANNED OUTAGE	1/09/2024 19:25	5.80	1
Breaker	PLANNED OUTAGE	1/09/2024 19:25	5.87	1
PLF	PLANNED OUTAGE	1/09/2024 21:51	39.77	2
Primary Wire	PLANNED OUTAGE	1/09/2024 21:52	37.73	2
Transformer	PLANNED OUTAGE	1/09/2024 20:30	4,699.33	14
Transformer	PLANNED OUTAGE	1/09/2024 23:45	88.75	3
Transformer	PLANNED OUTAGE	1/10/2024 11:42	362.50	29
Transformer	PLANNED OUTAGE	1/10/2024 10:11	220.65	9
Transformer	PLANNED OUTAGE	1/10/2024 12:50	475.10	6
PLF	PLANNED OUTAGE	1/10/2024 12:56	38.25	9
PLF	PLANNED OUTAGE	1/10/2024 16:09	313.67	5
PLF	PLANNED OUTAGE	1/10/2024 11:39	397.60	1
PLF	PLANNED OUTAGE	1/11/2024 6:25	7.58	1
Transformer	PLANNED OUTAGE	1/11/2024 9:40	98.13	1
PLF	PLANNED OUTAGE	1/11/2024 8:47	956.78	7
Transformer	PLANNED OUTAGE	1/11/2024 13:59	191.00	15
Transformer	PLANNED OUTAGE	1/11/2024 10:42	325.10	6
Transformer	PLANNED OUTAGE	1/11/2024 11:15	564.30	9
Breaker	PLANNED OUTAGE	1/11/2024 7:08	479.43	1
Transformer	PLANNED OUTAGE	1/12/2024 10:37	59.03	7
Transformer	PLANNED OUTAGE	1/13/2024 14:44	41.30	1
Transformer	PLANNED OUTAGE	1/14/2024 3:04	219.90	6
Transformer	PLANNED OUTAGE	1/14/2024 17:50	117.72	7
Transformer	PLANNED OUTAGE	1/14/2024 18:08	545.42	7
Transformer	PLANNED OUTAGE	1/15/2024 8:54	292.93	8
Transformer	PLANNED OUTAGE	1/15/2024 10:09	53.60	8
Breaker	PLANNED OUTAGE	1/15/2024 19:54	3.50	1
Transformer Bank	PLANNED OUTAGE	1/16/2024 10:19	6.17	2
PLF	PLANNED OUTAGE	2/02/2024 12:56	4,776.30	87
Transformer	PLANNED OUTAGE	2/02/2024 11:23	403.08	7
Transformer Bank	PLANNED OUTAGE	2/03/2024 3:49	514.58	13
Transformer	PLANNED OUTAGE	2/03/2024 11:20	573.00	3
Transformer	PLANNED OUTAGE	2/03/2024 22:32	47.85	11

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	2/04/2024 3:25	79.60	3
Breaker	PLANNED OUTAGE	2/04/2024 12:29	1,558.33	425
PLF	PLANNED OUTAGE	2/04/2024 21:27	272.73	2
Transformer	PLANNED OUTAGE	2/05/2024 10:30	14.03	2
Transformer	PLANNED OUTAGE	2/05/2024 13:10	143.27	4
Breaker	PLANNED OUTAGE	2/05/2024 20:53	1,944.15	117
Transformer	PLANNED OUTAGE	2/06/2024 0:15	40.05	3
Transformer	PLANNED OUTAGE	2/06/2024 1:49	35.35	7
Transformer	PLANNED OUTAGE	2/06/2024 9:46	78.67	4
PLF	PLANNED OUTAGE	2/06/2024 11:40	28.60	4
Transformer	PLANNED OUTAGE	2/06/2024 12:17	130.35	9
Transformer	PLANNED OUTAGE	2/06/2024 9:42	68.17	1
Transformer	PLANNED OUTAGE	2/06/2024 12:37	633.67	10
PLF	PLANNED OUTAGE	2/06/2024 21:52	6,054.30	14
PLF	PLANNED OUTAGE	2/06/2024 13:10	624.55	1
Transformer	PLANNED OUTAGE	2/07/2024 9:59	582.53	17
Transformer	PLANNED OUTAGE	2/07/2024 8:21	157.07	8
Transformer	PLANNED OUTAGE	2/07/2024 12:03	735.75	9
PLF	PLANNED OUTAGE	2/07/2024 13:12	596.27	13
Transformer	PLANNED OUTAGE	2/07/2024 20:58	237.80	6
PLF	PLANNED OUTAGE	2/08/2024 12:13	4,725.83	53
PLF	PLANNED OUTAGE	2/08/2024 13:50	134.15	3
Transformer	PLANNED OUTAGE	2/08/2024 14:42	540.90	6
Transformer	PLANNED OUTAGE	2/08/2024 14:41	361.13	4
None	PLANNED OUTAGE	2/08/2024 19:57	512.42	5
PLF	PLANNED OUTAGE	2/08/2024 22:07	206.60	1
Transformer	PLANNED OUTAGE	2/09/2024 0:11	85.73	1
Transformer	PLANNED OUTAGE	2/09/2024 1:54	194.40	8
None	PLANNED OUTAGE	2/08/2024 16:22	62.33	2
Transformer	PLANNED OUTAGE	2/08/2024 23:45	28.07	2
Transformer	PLANNED OUTAGE	2/09/2024 1:16	12.10	1
Transformer	PLANNED OUTAGE	2/09/2024 9:46	73.60	8
Breaker	PLANNED OUTAGE	2/09/2024 18:27	70.75	1
Breaker	PLANNED OUTAGE	2/09/2024 18:27	67.22	1
Transformer	PLANNED OUTAGE	2/10/2024 0:51	107.25	13
Transformer	PLANNED OUTAGE	2/12/2024 11:04	399.20	8
Transformer	PLANNED OUTAGE	2/12/2024 11:13	17.92	1
Transformer	PLANNED OUTAGE	2/12/2024 9:24	671.40	9
Transformer	PLANNED OUTAGE	2/12/2024 23:24	227.73	8
Invalid	PLANNED OUTAGE	2/12/2024 22:26	18,183.00	1710
Invalid	PLANNED OUTAGE	2/12/2024 22:35	1.02	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	2/13/2024 2:14	74.50	3
PLF	PLANNED OUTAGE	2/13/2024 11:46	1,281.00	14
Transformer	PLANNED OUTAGE	2/13/2024 11:50	199.73	7
PLF	PLANNED OUTAGE	2/13/2024 13:20	29.58	25
None	PLANNED OUTAGE	2/14/2024 5:14	5,382.33	335
None	PLANNED OUTAGE	2/14/2024 5:14	18,630.80	991
Transformer Bank	PLANNED OUTAGE	2/14/2024 10:13	789.75	9
PLF	PLANNED OUTAGE	2/14/2024 12:00	198.33	20
PLF	PLANNED OUTAGE	2/14/2024 18:04	388.57	2
Transformer	PLANNED OUTAGE	2/05/2024 11:36	111.00	6
Transformer	PLANNED OUTAGE	2/05/2024 16:30	8.37	1
Breaker	PLANNED OUTAGE	2/05/2024 20:53	22,141.33	1520
Breaker	PLANNED OUTAGE	2/05/2024 20:53	14.42	1
Transformer	PLANNED OUTAGE	2/06/2024 8:41	18.22	1
PLF	PLANNED OUTAGE	2/06/2024 8:59	2,410.47	19
Transformer Bank	PLANNED OUTAGE	2/06/2024 8:28	217.53	4
Transformer	PLANNED OUTAGE	2/06/2024 8:30	295.00	3
Transformer	PLANNED OUTAGE	2/06/2024 9:06	538.13	4
Transformer	PLANNED OUTAGE	2/06/2024 23:22	65.13	1
Transformer	PLANNED OUTAGE	2/07/2024 0:14	30.08	1
Transformer	PLANNED OUTAGE	2/07/2024 0:19	83.00	5
Transformer	PLANNED OUTAGE	2/07/2024 10:35	239.58	5
Transformer	PLANNED OUTAGE	2/07/2024 10:57	26.30	3
Transformer	PLANNED OUTAGE	2/07/2024 12:01	27.85	1
Transformer	PLANNED OUTAGE	2/07/2024 10:51	612.43	2
PLF	PLANNED OUTAGE	2/08/2024 12:34	404.92	5
Transformer	PLANNED OUTAGE	2/09/2024 16:01	88.60	4
Breaker	PLANNED OUTAGE	2/09/2024 18:27	71.08	1
Transformer Bank	PLANNED OUTAGE	2/10/2024 6:45	655.67	2
Transformer	PLANNED OUTAGE	2/10/2024 8:11	552.30	7
Transformer	PLANNED OUTAGE	2/11/2024 20:53	1,103.00	10
PLF	PLANNED OUTAGE	2/09/2024 8:51	260.23	2
Transformer	PLANNED OUTAGE	2/10/2024 6:51	1,685.70	2
None	PLANNED OUTAGE	2/12/2024 9:01	1,940.40	28
Transformer	PLANNED OUTAGE	2/12/2024 9:36	43.33	13
Transformer	PLANNED OUTAGE	2/12/2024 13:15	103.70	2
Transformer	PLANNED OUTAGE	2/12/2024 13:20	263.10	6
PLF	PLANNED OUTAGE	2/12/2024 13:29	198.87	19
Transformer	PLANNED OUTAGE	2/15/2024 8:54	10.13	8
Transformer	PLANNED OUTAGE	2/15/2024 20:03	2,197.07	11
Transformer	PLANNED OUTAGE	2/15/2024 23:51	36.70	2

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	2/16/2024 8:26	599.53	17
Transformer	PLANNED OUTAGE	2/16/2024 9:14	651.40	4
Transformer	PLANNED OUTAGE	2/16/2024 12:48	232.33	1
Transformer Bank	PLANNED OUTAGE	2/16/2024 21:15	312.87	2
None	PLANNED OUTAGE	2/17/2024 1:51	765.00	6
Transformer Bank	PLANNED OUTAGE	2/17/2024 9:15	295.38	1
Transformer	PLANNED OUTAGE	2/17/2024 12:11	59.90	2
Transformer	PLANNED OUTAGE	2/19/2024 9:50	20.17	1
Transformer	PLANNED OUTAGE	2/19/2024 14:21	69.50	6
Transformer	PLANNED OUTAGE	2/19/2024 19:48	342.42	7
Breaker	PLANNED OUTAGE	2/19/2024 18:29	2.60	1
Transformer Bank	PLANNED OUTAGE	2/20/2024 0:08	92.27	4
PLF	PLANNED OUTAGE	2/20/2024 9:29	724.87	4
None	PLANNED OUTAGE	2/20/2024 13:56	281.70	2
PLF	PLANNED OUTAGE	2/20/2024 12:19	281.42	1
Transformer	PLANNED OUTAGE	2/21/2024 9:49	55.20	9
Transformer	PLANNED OUTAGE	2/22/2024 1:23	24.88	1
PLF	PLANNED OUTAGE	2/22/2024 9:17	47.33	2
Transformer	PLANNED OUTAGE	2/22/2024 11:12	128.27	8
Transformer	PLANNED OUTAGE	2/22/2024 11:52	1,109.30	6
Transformer	PLANNED OUTAGE	2/22/2024 17:12	100.00	2
Transformer	PLANNED OUTAGE	2/22/2024 20:01	1,872.57	11
PLF	PLANNED OUTAGE	2/23/2024 9:16	1.73	1
None	PLANNED OUTAGE	2/23/2024 10:30	24.57	1
PLF	PLANNED OUTAGE	2/23/2024 10:06	2.23	2
PLF	PLANNED OUTAGE	2/23/2024 11:15	4.40	2
Transformer	PLANNED OUTAGE	2/23/2024 17:05	77.20	12
Breaker	PLANNED OUTAGE	2/23/2024 20:19	654.93	32
Transformer	PLANNED OUTAGE	2/23/2024 18:02	157.57	2
Transformer	PLANNED OUTAGE	1/16/2024 10:26	31.97	2
Transformer	PLANNED OUTAGE	1/16/2024 9:26	451.33	5
Transformer	PLANNED OUTAGE	1/16/2024 12:08	168.00	5
Service point	PLANNED OUTAGE	1/16/2024 12:09	1.33	1
Service point	PLANNED OUTAGE	1/17/2024 4:22	16.43	1
TX Repaired (OH)	PLANNED OUTAGE	1/17/2024 4:40	1,160.17	5
Transformer	PLANNED OUTAGE	1/17/2024 10:46	153.30	3
Transformer	PLANNED OUTAGE	1/17/2024 11:05	23.30	2
Service point	PLANNED OUTAGE	1/17/2024 11:10	16.50	1
Transformer	PLANNED OUTAGE	1/17/2024 11:53	72.20	3
Transformer	PLANNED OUTAGE	1/17/2024 12:50	400.75	3
Transformer	PLANNED OUTAGE	1/17/2024 13:16	115.18	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	1/17/2024 15:05	93.75	9
Breaker	PLANNED OUTAGE	1/17/2024 21:24	9,262.80	837
Breaker	PLANNED OUTAGE	1/17/2024 21:24	11.30	1
Transformer	PLANNED OUTAGE	1/18/2024 10:33	48.03	2
Transformer	PLANNED OUTAGE	1/18/2024 10:09	183.27	4
Transformer	PLANNED OUTAGE	1/18/2024 8:19	214.10	2
Transformer	PLANNED OUTAGE	1/18/2024 8:37	1,281.00	14
Transformer	PLANNED OUTAGE	1/18/2024 15:46	238.30	6
PLF	PLANNED OUTAGE	1/18/2024 22:46	159.35	1
Transformer	PLANNED OUTAGE	1/19/2024 0:02	171.38	7
None	PLANNED OUTAGE	1/19/2024 9:56	139.03	43
Transformer	PLANNED OUTAGE	1/19/2024 21:17	63.63	2
Transformer	PLANNED OUTAGE	1/20/2024 9:13	24.75	1
PLF	PLANNED OUTAGE	1/21/2024 3:54	175.27	11
Transformer Bank	PLANNED OUTAGE	1/21/2024 17:55	445.67	1
Transformer	PLANNED OUTAGE	1/22/2024 11:52	484.90	3
Transformer	PLANNED OUTAGE	1/22/2024 11:54	226.00	6
Transformer	PLANNED OUTAGE	1/22/2024 11:56	52.07	2
Transformer	PLANNED OUTAGE	1/22/2024 19:21	36.48	1
Transformer	PLANNED OUTAGE	1/22/2024 19:58	41.80	2
Breaker	PLANNED OUTAGE	2/09/2024 18:27	67.35	1
Breaker	PLANNED OUTAGE	2/09/2024 18:27	67.15	1
Breaker	PLANNED OUTAGE	2/09/2024 18:27	70.88	1
PLF	PLANNED OUTAGE	2/12/2024 5:37	414.33	10
Transformer Bank	PLANNED OUTAGE	2/12/2024 10:49	153.50	6
Transformer	PLANNED OUTAGE	2/12/2024 11:51	21.18	1
Transformer	PLANNED OUTAGE	2/12/2024 9:26	1,066.67	5
Transformer	PLANNED OUTAGE	2/12/2024 13:25	704.70	6
Invalid	PLANNED OUTAGE	2/12/2024 22:26	366.63	34
PLF	PLANNED OUTAGE	2/13/2024 11:46	91.73	1
PLF	PLANNED OUTAGE	2/13/2024 11:46	1,006.50	11
Transformer	PLANNED OUTAGE	2/13/2024 13:10	297.80	6
TX Repaired (OH)	PLANNED OUTAGE	2/13/2024 19:35	3,270.27	8
Transformer	PLANNED OUTAGE	2/14/2024 4:10	109.20	4
None	PLANNED OUTAGE	2/14/2024 5:14	871.75	33
Transformer	PLANNED OUTAGE	2/14/2024 11:00	60.08	5
Transformer	PLANNED OUTAGE	2/14/2024 10:16	107.10	3
Transformer	PLANNED OUTAGE	2/14/2024 15:20	853.95	9
Transformer	PLANNED OUTAGE	2/24/2024 1:49	603.67	10
Transformer	PLANNED OUTAGE	2/25/2024 22:01	500.10	9
PLF	PLANNED OUTAGE	2/25/2024 18:26	324.50	2

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	2/26/2024 8:01	818.27	8
Transformer	PLANNED OUTAGE	2/26/2024 10:38	40.35	3
Transformer	PLANNED OUTAGE	2/26/2024 11:53	234.80	12
Transformer	PLANNED OUTAGE	2/26/2024 11:56	705.70	6
Transformer	PLANNED OUTAGE	2/26/2024 13:11	333.47	8
PLF	PLANNED OUTAGE	2/26/2024 21:40	153.73	4
PLF	PLANNED OUTAGE	2/27/2024 11:43	6.88	1
PLF	PLANNED OUTAGE	2/27/2024 11:23	299.33	4
Transformer Bank	PLANNED OUTAGE	2/27/2024 13:29	24.87	2
Transformer Bank	PLANNED OUTAGE	2/27/2024 10:51	344.52	1
Service point	PLANNED OUTAGE	2/27/2024 18:58	75.13	1
Transformer	PLANNED OUTAGE	2/27/2024 19:10	223.63	1
Transformer	PLANNED OUTAGE	2/27/2024 19:23	210.97	1
Transformer	PLANNED OUTAGE	2/28/2024 0:41	181.67	4
Transformer	PLANNED OUTAGE	2/28/2024 10:00	272.05	3
Transformer	PLANNED OUTAGE	2/28/2024 9:15	2,396.50	10
Transformer	PLANNED OUTAGE	2/28/2024 12:26	39.87	1
Transformer	PLANNED OUTAGE	2/29/2024 0:22	127.55	3
Transformer	PLANNED OUTAGE	2/29/2024 9:31	1,336.87	11
Transformer	PLANNED OUTAGE	2/29/2024 9:59	134.03	1
Transformer Bank	PLANNED OUTAGE	2/29/2024 19:05	30.93	1
Transformer	PLANNED OUTAGE	2/29/2024 23:38	14.95	1
Transformer	PLANNED OUTAGE	3/01/2024 8:38	541.75	11
PLF	PLANNED OUTAGE	3/02/2024 7:19	5,150.67	20
PLF	PLANNED OUTAGE	3/03/2024 9:12	944.88	49
None	PLANNED OUTAGE	3/03/2024 18:09	2,891.33	10
Primary Wire	PLANNED OUTAGE	3/03/2024 5:30	10,689.67	20
Transformer	PLANNED OUTAGE	3/02/2024 14:40	19.03	2
Transformer	PLANNED OUTAGE	3/02/2024 23:26	39.45	3
Transformer	PLANNED OUTAGE	3/02/2024 18:07	20.97	1
Transformer	PLANNED OUTAGE	1/22/2024 22:41	89.47	11
Transformer	PLANNED OUTAGE	1/22/2024 22:57	184.60	6
Primary Wire	PLANNED OUTAGE	1/23/2024 8:00	7,681.25	25
Transformer	PLANNED OUTAGE	1/23/2024 9:56	373.50	5
PLF	PLANNED OUTAGE	1/23/2024 9:15	106.82	17
PLF	PLANNED OUTAGE	1/23/2024 17:03	257.80	1
Transformer	PLANNED OUTAGE	1/24/2024 1:34	77.00	3
Transformer	PLANNED OUTAGE	1/24/2024 2:01	81.65	3
Transformer Bank	PLANNED OUTAGE	1/24/2024 18:17	197.43	1
Transformer	PLANNED OUTAGE	1/25/2024 8:47	33.30	3
Transformer	PLANNED OUTAGE	1/25/2024 10:30	20.15	3

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	1/25/2024 10:34	2.33	1
PLF	PLANNED OUTAGE	1/25/2024 10:47	3.17	2
PLF	PLANNED OUTAGE	1/25/2024 10:56	10.23	2
Transformer	PLANNED OUTAGE	1/26/2024 16:59	1,269.00	12
Transformer	PLANNED OUTAGE	1/27/2024 12:39	1,715.33	10
PLF	PLANNED OUTAGE	1/28/2024 1:54	8,249.15	39
Transformer	PLANNED OUTAGE	1/28/2024 14:06	69.17	10
Transformer	PLANNED OUTAGE	1/29/2024 11:11	902.50	15
Transformer	PLANNED OUTAGE	1/29/2024 14:52	1,185.60	16
Transformer	PLANNED OUTAGE	1/29/2024 15:23	152.00	10
PLF	PLANNED OUTAGE	1/29/2024 17:26	1,738.70	6
Transformer Bank	PLANNED OUTAGE	1/29/2024 16:06	2,179.00	6
Transformer Bank	PLANNED OUTAGE	1/30/2024 10:42	17.63	2
Transformer	PLANNED OUTAGE	1/30/2024 11:26	153.60	2
PLF	PLANNED OUTAGE	1/30/2024 11:48	462.50	2
PLF	PLANNED OUTAGE	1/31/2024 0:55	376.67	4
Transformer	PLANNED OUTAGE	1/31/2024 9:32	240.07	2
Transformer	PLANNED OUTAGE	1/31/2024 9:32	994.50	9
Transformer	PLANNED OUTAGE	1/31/2024 9:32	662.30	6
Transformer	PLANNED OUTAGE	2/01/2024 10:37	40.35	9
Transformer	PLANNED OUTAGE	2/01/2024 8:28	81.07	1
Transformer	PLANNED OUTAGE	2/01/2024 7:58	670.80	9
Transformer	PLANNED OUTAGE	2/13/2024 11:20	181.80	4
Transformer	PLANNED OUTAGE	2/13/2024 11:20	363.20	8
PLF	PLANNED OUTAGE	2/13/2024 11:46	96.02	1
PLF	PLANNED OUTAGE	2/13/2024 13:22	2,951.00	26
Breaker	PLANNED OUTAGE	2/13/2024 9:38	23,833.60	112
None	PLANNED OUTAGE	2/14/2024 5:14	788.83	2
None	PLANNED OUTAGE	2/14/2024 5:14	402.20	1
Breaker	PLANNED OUTAGE	2/14/2024 14:52	5.12	1
Transformer	PLANNED OUTAGE	2/14/2024 12:56	702.90	6
Transformer	PLANNED OUTAGE	2/14/2024 12:56	1,129.47	8
Transformer	PLANNED OUTAGE	2/15/2024 9:40	299.47	4
Transformer	PLANNED OUTAGE	2/15/2024 8:47	2,533.85	11
Transformer Bank	PLANNED OUTAGE	2/15/2024 12:27	76.80	4
Transformer	PLANNED OUTAGE	2/15/2024 9:31	407.28	7
Transformer Bank	PLANNED OUTAGE	2/15/2024 21:08	399.82	7
Transformer	PLANNED OUTAGE	2/15/2024 18:52	449.50	2
Transformer	PLANNED OUTAGE	2/16/2024 9:14	977.00	6
Transformer	PLANNED OUTAGE	2/16/2024 12:09	96.00	3
Breaker	PLANNED OUTAGE	2/18/2024 0:37	65,905.00	1050

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	2/18/2024 9:44	213.43	1
Transformer	PLANNED OUTAGE	2/18/2024 17:07	394.65	1
Pole	PLANNED OUTAGE	2/19/2024 8:56	323.63	1
Transformer	PLANNED OUTAGE	2/19/2024 10:02	325.27	14
Transformer	PLANNED OUTAGE	2/19/2024 7:48	16,187.40	102
Transformer	PLANNED OUTAGE	2/19/2024 10:24	229.83	2
PLF	PLANNED OUTAGE	2/19/2024 8:52	451.77	2
Breaker	PLANNED OUTAGE	2/14/2024 14:52	5.12	1
Transformer	PLANNED OUTAGE	2/15/2024 14:22	14.37	2
Transformer	PLANNED OUTAGE	2/15/2024 22:54	236.25	1
Transformer	PLANNED OUTAGE	2/16/2024 0:26	18.13	2
Transformer	PLANNED OUTAGE	2/16/2024 8:13	104.58	1
Transformer	PLANNED OUTAGE	2/16/2024 13:27	227.80	6
None	PLANNED OUTAGE	2/16/2024 17:22	338.17	5
Transformer	PLANNED OUTAGE	2/17/2024 2:10	156.17	5
Transformer	PLANNED OUTAGE	2/17/2024 11:58	96.27	4
Transformer	PLANNED OUTAGE	2/17/2024 22:53	29.45	3
Transformer	PLANNED OUTAGE	2/18/2024 2:14	372.02	13
Transformer	PLANNED OUTAGE	2/18/2024 23:54	89.10	3
Transformer	PLANNED OUTAGE	2/19/2024 0:38	51.95	3
Transformer	PLANNED OUTAGE	2/19/2024 4:22	1,154.57	19
Transformer	PLANNED OUTAGE	2/19/2024 11:07	575.85	3
Transformer	PLANNED OUTAGE	2/19/2024 12:20	51.37	2
Transformer Bank	PLANNED OUTAGE	2/19/2024 11:36	102.00	2
None	PLANNED OUTAGE	2/19/2024 19:47	171.92	5
Transformer	PLANNED OUTAGE	2/19/2024 23:54	13.77	1
Transformer	PLANNED OUTAGE	2/20/2024 0:32	25.18	1
PLF	PLANNED OUTAGE	2/20/2024 8:02	304.58	17
Transformer Bank	PLANNED OUTAGE	2/20/2024 9:36	818.88	7
None	PLANNED OUTAGE	2/20/2024 14:55	2,673.87	37
None	PLANNED OUTAGE	2/20/2024 15:02	64.80	1
Transformer Bank	PLANNED OUTAGE	2/20/2024 20:29	42.53	1
PLF	PLANNED OUTAGE	2/21/2024 10:04	81.15	1
Transformer	PLANNED OUTAGE	2/21/2024 12:56	197.73	8
Transformer Bank	PLANNED OUTAGE	2/22/2024 8:21	213.60	4
Transformer Bank	PLANNED OUTAGE	2/22/2024 6:35	99.45	1
Transformer	PLANNED OUTAGE	2/22/2024 11:53	127.60	8
None	PLANNED OUTAGE	2/22/2024 13:59	1,694.12	13
PLF	PLANNED OUTAGE	2/23/2024 9:53	2.13	2
None	PLANNED OUTAGE	3/02/2024 17:21	113.12	1
PLF	PLANNED OUTAGE	3/04/2024 8:45	166.40	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	3/04/2024 10:29	228.70	6
None	PLANNED OUTAGE	3/04/2024 7:52	1,728.00	20
Transformer	PLANNED OUTAGE	3/04/2024 20:43	199.23	1
Transformer	PLANNED OUTAGE	3/05/2024 8:20	380.40	18
Transformer Bank	PLANNED OUTAGE	3/05/2024 11:24	24.33	2
Transformer	PLANNED OUTAGE	3/05/2024 9:48	284.10	9
Transformer	PLANNED OUTAGE	3/05/2024 13:32	47.27	2
Switch	PLANNED OUTAGE	3/05/2024 14:05	347.50	30
Transformer	PLANNED OUTAGE	3/05/2024 16:12	55.60	3
None	PLANNED OUTAGE	3/05/2024 21:45	210.50	1
None	PLANNED OUTAGE	3/05/2024 21:24	4,162.80	18
Transformer	PLANNED OUTAGE	3/06/2024 10:52	86.37	2
Transformer	PLANNED OUTAGE	3/06/2024 12:08	13.82	1
Transformer	PLANNED OUTAGE	3/06/2024 10:56	189.45	3
Transformer	PLANNED OUTAGE	3/06/2024 10:59	86.77	1
Transformer	PLANNED OUTAGE	3/06/2024 8:22	222.75	15
Transformer	PLANNED OUTAGE	3/06/2024 9:18	507.30	2
Transformer	PLANNED OUTAGE	3/06/2024 13:40	40.80	2
PLF	PLANNED OUTAGE	3/06/2024 14:27	110.63	2
PLF	PLANNED OUTAGE	3/06/2024 15:17	3,062.93	8
Transformer Bank	PLANNED OUTAGE	3/06/2024 16:31	624.28	1
Transformer	PLANNED OUTAGE	3/07/2024 9:29	131.63	2
Transformer	PLANNED OUTAGE	3/07/2024 8:18	1,554.67	11
Transformer	PLANNED OUTAGE	3/07/2024 9:15	26.37	2
Transformer	PLANNED OUTAGE	3/07/2024 10:35	746.43	7
Transformer Bank	PLANNED OUTAGE	3/07/2024 10:35	539.80	2
Transformer	PLANNED OUTAGE	3/08/2024 9:05	285.03	17
Transformer	PLANNED OUTAGE	3/08/2024 14:44	72.30	2
Service - Crew	PLANNED OUTAGE	3/09/2024 13:52	79.87	1
Transformer	PLANNED OUTAGE	3/09/2024 20:40	7.73	1
Breaker	PLANNED OUTAGE	3/10/2024 0:45	8.95	1
PLF	PLANNED OUTAGE	3/10/2024 15:07	616.38	31
PLF	PLANNED OUTAGE	3/10/2024 13:42	14,875.90	39
Transformer Bank	PLANNED OUTAGE	3/11/2024 0:10	5,283.00	15
Transformer	PLANNED OUTAGE	3/11/2024 13:28	1,927.05	29
Primary Wire	PLANNED OUTAGE	3/12/2024 8:37	1,508.38	7
Transformer	PLANNED OUTAGE	3/12/2024 12:49	64.00	4
Transformer	PLANNED OUTAGE	3/12/2024 13:11	420.00	8
None	PLANNED OUTAGE	3/12/2024 17:16	608.53	8
Breaker	PLANNED OUTAGE	3/13/2024 0:03	11,969.10	806
Transformer	PLANNED OUTAGE	3/12/2024 22:22	768.83	5

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	3/13/2024 12:43	40.95	1
Transformer	PLANNED OUTAGE	3/13/2024 13:17	29.28	1
PLF	PLANNED OUTAGE	3/13/2024 20:29	58.20	3
Transformer	PLANNED OUTAGE	3/14/2024 8:07	2,902.65	9
Transformer	PLANNED OUTAGE	3/14/2024 10:48	1,074.30	9
PLF	PLANNED OUTAGE	3/14/2024 17:33	134.22	1
None	PLANNED OUTAGE	3/14/2024 18:25	125.37	2
PLF	PLANNED OUTAGE	3/14/2024 14:01	185.25	9
Transformer	PLANNED OUTAGE	3/15/2024 1:14	17.17	1
Transformer	PLANNED OUTAGE	3/15/2024 8:04	229.75	3
Transformer	PLANNED OUTAGE	3/15/2024 10:29	93.03	1
Transformer	PLANNED OUTAGE	3/16/2024 13:27	98.90	3
None	PLANNED OUTAGE	3/16/2024 16:43	1,368.30	6
None	PLANNED OUTAGE	3/17/2024 16:30	446.00	10
Transformer	PLANNED OUTAGE	3/18/2024 10:00	160.65	7
Transformer	PLANNED OUTAGE	3/18/2024 8:33	100.90	2
Transformer	PLANNED OUTAGE	3/19/2024 0:53	41.80	2
PLF	PLANNED OUTAGE	3/19/2024 8:26	240.65	1
PLF	PLANNED OUTAGE	2/01/2024 9:47	643.80	9
Transformer	PLANNED OUTAGE	2/02/2024 7:47	26.45	3
PLF	PLANNED OUTAGE	2/02/2024 9:28	7,608.75	75
PLF	PLANNED OUTAGE	2/02/2024 14:43	2,727.45	19
PLF	PLANNED OUTAGE	2/03/2024 0:18	53.20	8
Transformer Bank	PLANNED OUTAGE	2/03/2024 0:39	60.00	4
PLF	PLANNED OUTAGE	2/03/2024 1:09	239.20	16
PLF	PLANNED OUTAGE	2/03/2024 9:31	97.08	1
Service point	PLANNED OUTAGE	2/03/2024 11:06	18.40	1
Primary Wire	PLANNED OUTAGE	2/04/2024 12:45	1,366.07	4
Primary Wire	PLANNED OUTAGE	2/04/2024 14:22	490.23	2
PLF	PLANNED OUTAGE	2/04/2024 0:15	1,855.80	18
Breaker	PLANNED OUTAGE	2/04/2024 10:57	123.43	2
Transformer	PLANNED OUTAGE	2/05/2024 11:24	49.87	2
Transformer	PLANNED OUTAGE	2/05/2024 11:41	283.15	3
Transformer	PLANNED OUTAGE	2/05/2024 12:52	214.75	3
Transformer	PLANNED OUTAGE	2/05/2024 18:33	1,587.73	16
Transformer	PLANNED OUTAGE	2/05/2024 18:41	52.27	2
PLF	PLANNED OUTAGE	2/05/2024 19:09	826.80	13
Transformer	PLANNED OUTAGE	2/06/2024 2:07	268.00	8
PLF	PLANNED OUTAGE	2/06/2024 10:15	137.88	1
Transformer	PLANNED OUTAGE	2/06/2024 12:58	301.92	5
Transformer Bank	PLANNED OUTAGE	2/06/2024 14:52	2,173.80	6

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	2/07/2024 9:41	242.90	6
UG Other	PLANNED OUTAGE	2/07/2024 11:59	75.63	2
Transformer	PLANNED OUTAGE	2/07/2024 12:27	21.33	1
Transformer	PLANNED OUTAGE	2/07/2024 15:17	192.83	10
Transformer	PLANNED OUTAGE	2/08/2024 0:48	13.03	1
Transformer	PLANNED OUTAGE	2/08/2024 1:13	62.60	2
Transformer Bank	PLANNED OUTAGE	2/08/2024 9:08	69.23	2
None	PLANNED OUTAGE	2/08/2024 14:13	995.10	6
PLF	PLANNED OUTAGE	2/09/2024 9:36	45.25	1
Transformer	PLANNED OUTAGE	2/09/2024 10:14	27.30	2
Transformer	PLANNED OUTAGE	2/19/2024 13:58	182.72	1
Breaker	PLANNED OUTAGE	2/19/2024 18:29	20.80	8
Transformer	PLANNED OUTAGE	2/20/2024 8:32	839.40	9
Transformer	PLANNED OUTAGE	2/21/2024 11:55	104.67	4
Transformer	PLANNED OUTAGE	2/21/2024 10:53	117.80	3
Transformer	PLANNED OUTAGE	2/21/2024 10:59	749.67	10
Transformer Bank	PLANNED OUTAGE	2/21/2024 11:18	94.03	2
Transformer	PLANNED OUTAGE	2/21/2024 12:22	157.03	7
Transformer Bank	PLANNED OUTAGE	2/21/2024 18:43	886.90	3
Switch	PLANNED OUTAGE	2/21/2024 23:56	456.00	2
Transformer	PLANNED OUTAGE	2/22/2024 0:44	90.85	3
None	PLANNED OUTAGE	2/22/2024 11:31	672.30	81
Transformer	PLANNED OUTAGE	2/22/2024 8:04	1,707.45	9
Transformer	PLANNED OUTAGE	2/22/2024 9:34	100.20	1
Transformer	PLANNED OUTAGE	2/22/2024 11:21	311.33	8
Transformer	PLANNED OUTAGE	2/22/2024 10:22	597.85	11
Transformer	PLANNED OUTAGE	2/22/2024 11:50	938.83	5
None	PLANNED OUTAGE	2/23/2024 1:09	839.40	9
PLF	PLANNED OUTAGE	2/22/2024 22:11	800.65	3
Transformer	PLANNED OUTAGE	2/22/2024 12:17	131.20	8
Invalid	PLANNED OUTAGE	2/23/2024 13:36	312.65	3
Transformer	PLANNED OUTAGE	2/25/2024 20:22	23.53	2
Transformer	PLANNED OUTAGE	2/26/2024 10:46	184.43	11
Transformer	PLANNED OUTAGE	2/26/2024 11:22	96.33	5
Transformer	PLANNED OUTAGE	2/26/2024 11:23	32.37	2
Transformer	PLANNED OUTAGE	2/26/2024 12:24	43.92	1
Transformer	PLANNED OUTAGE	2/26/2024 11:58	104.27	4
Transformer	PLANNED OUTAGE	2/26/2024 12:33	31.60	4
Transformer	PLANNED OUTAGE	2/27/2024 8:52	783.47	8
Primary Wire	PLANNED OUTAGE	2/27/2024 9:10	1,027.22	11
None	PLANNED OUTAGE	2/27/2024 9:30	452.40	6

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Service point	PLANNED OUTAGE	2/27/2024 17:57	248.12	1
PLF	PLANNED OUTAGE	2/27/2024 19:10	14,967.15	47
Transformer	PLANNED OUTAGE	2/23/2024 9:59	27.60	2
Transformer	PLANNED OUTAGE	2/23/2024 10:07	1,146.17	10
Transformer	PLANNED OUTAGE	2/23/2024 15:27	6,851.70	23
None	PLANNED OUTAGE	2/23/2024 15:46	152.33	10
Breaker	PLANNED OUTAGE	2/23/2024 20:19	326.40	12
Service point	PLANNED OUTAGE	2/23/2024 21:38	59.65	1
Service point	PLANNED OUTAGE	2/24/2024 20:53	191.63	1
Transformer	PLANNED OUTAGE	2/25/2024 19:31	77.15	3
Transformer	PLANNED OUTAGE	2/25/2024 18:02	25.80	2
Transformer	PLANNED OUTAGE	2/25/2024 23:12	47.00	2
Transformer	PLANNED OUTAGE	2/26/2024 9:53	14.68	1
Transformer	PLANNED OUTAGE	2/26/2024 11:56	325.50	2
Transformer	PLANNED OUTAGE	2/26/2024 11:57	812.75	5
PLF	PLANNED OUTAGE	2/27/2024 11:43	130.78	19
PLF	PLANNED OUTAGE	2/27/2024 8:10	81.73	1
Transformer Bank	PLANNED OUTAGE	2/27/2024 8:32	524.87	2
None	PLANNED OUTAGE	2/27/2024 13:52	2,301.30	27
Transformer	PLANNED OUTAGE	2/27/2024 19:14	219.77	1
Transformer	PLANNED OUTAGE	2/27/2024 19:10	10,602.42	47
Transformer	PLANNED OUTAGE	2/28/2024 9:01	396.00	6
Transformer	PLANNED OUTAGE	2/28/2024 11:28	911.72	11
Transformer	PLANNED OUTAGE	2/28/2024 12:33	9.60	2
PLF	PLANNED OUTAGE	2/29/2024 0:51	925.80	12
Transformer	PLANNED OUTAGE	2/29/2024 9:16	439.35	9
Transformer	PLANNED OUTAGE	2/29/2024 9:31	729.00	6
Transformer	PLANNED OUTAGE	2/29/2024 13:19	258.00	3
Transformer	PLANNED OUTAGE	2/29/2024 10:07	88.73	4
Transformer	PLANNED OUTAGE	2/29/2024 10:07	470.53	4
Transformer	PLANNED OUTAGE	2/29/2024 12:34	245.20	4
Transformer	PLANNED OUTAGE	2/29/2024 19:32	406.00	24
Transformer	PLANNED OUTAGE	3/01/2024 0:11	27.77	1
Transformer Bank	PLANNED OUTAGE	3/01/2024 7:53	51.98	1
Transformer	PLANNED OUTAGE	3/01/2024 10:58	320.50	5
PLF	PLANNED OUTAGE	3/19/2024 10:06	317.82	1
None	PLANNED OUTAGE	3/20/2024 0:19	349.27	4
PLF	PLANNED OUTAGE	3/19/2024 8:26	431.68	1
Service - Crew	PLANNED OUTAGE	3/20/2024 18:59	104.97	1
None	PLANNED OUTAGE	3/21/2024 12:00	435.50	6
None	PLANNED OUTAGE	3/21/2024 17:27	557.42	5

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	3/21/2024 18:39	139.10	3
Transformer Bank	PLANNED OUTAGE	3/21/2024 23:56	16.55	1
Transformer	PLANNED OUTAGE	3/22/2024 9:20	986.15	11
Transformer	PLANNED OUTAGE	3/22/2024 9:34	245.87	8
Transformer	PLANNED OUTAGE	3/22/2024 10:58	25.70	6
PLF	PLANNED OUTAGE	3/22/2024 19:05	47.48	1
Transformer	PLANNED OUTAGE	3/22/2024 22:14	68.20	6
Transformer	PLANNED OUTAGE	3/23/2024 3:37	404.33	2
None	PLANNED OUTAGE	3/23/2024 10:37	9,381.25	1425
None	PLANNED OUTAGE	3/24/2024 17:02	5,136.00	1070
Transformer	PLANNED OUTAGE	3/25/2024 8:45	514.40	6
Transformer	PLANNED OUTAGE	3/25/2024 8:39	123.43	2
Transformer	PLANNED OUTAGE	3/25/2024 11:07	55.30	2
Transformer	PLANNED OUTAGE	3/25/2024 12:14	84.70	3
Transformer	PLANNED OUTAGE	3/26/2024 10:25	919.67	10
Transformer	PLANNED OUTAGE	3/26/2024 9:41	163.93	1
Transformer Bank	PLANNED OUTAGE	3/26/2024 20:33	175.55	1
PLF	PLANNED OUTAGE	3/27/2024 10:06	1,099.00	7
Transformer	PLANNED OUTAGE	3/27/2024 8:53	722.67	8
PLF	PLANNED OUTAGE	3/27/2024 9:56	19,029.65	53
Service point	PLANNED OUTAGE	3/27/2024 18:05	183.48	1
PLF	PLANNED OUTAGE	3/27/2024 20:50	6,274.95	99
Transformer	PLANNED OUTAGE	3/28/2024 10:38	102.67	4
Transformer	PLANNED OUTAGE	3/28/2024 10:35	93.48	1
None	PLANNED OUTAGE	3/28/2024 12:33	78.58	5
Transformer	PLANNED OUTAGE	3/28/2024 14:00	143.30	6
None	PLANNED OUTAGE	3/29/2024 8:35	902.20	4
PLF	PLANNED OUTAGE	2/09/2024 11:01	94.50	5
Breaker	PLANNED OUTAGE	2/09/2024 18:27	99,549.22	1543
Breaker	PLANNED OUTAGE	2/09/2024 18:27	70.27	1
Breaker	PLANNED OUTAGE	2/09/2024 18:27	67.15	1
Breaker	PLANNED OUTAGE	2/09/2024 18:27	70.52	1
PLF	PLANNED OUTAGE	2/10/2024 7:28	1,190.00	15
Transformer	PLANNED OUTAGE	2/12/2024 10:38	163.05	3
Transformer	PLANNED OUTAGE	2/12/2024 12:10	211.83	10
Transformer	PLANNED OUTAGE	2/12/2024 12:33	245.73	8
Transformer	PLANNED OUTAGE	2/12/2024 10:27	75.25	1
Transformer	PLANNED OUTAGE	2/12/2024 12:49	396.55	7
Invalid	PLANNED OUTAGE	2/12/2024 22:26	85.20	8
Transformer	PLANNED OUTAGE	2/13/2024 10:57	383.53	11
Transformer	PLANNED OUTAGE	2/13/2024 10:11	436.50	6

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	2/13/2024 13:27	243.00	10
Primary Wire	PLANNED OUTAGE	2/13/2024 9:24	9,255.47	64
Transformer	PLANNED OUTAGE	2/13/2024 10:59	90.72	1
PLF	PLANNED OUTAGE	2/13/2024 20:37	539.35	67
PLF	PLANNED OUTAGE	2/14/2024 0:00	17,880.60	34
Transformer	PLANNED OUTAGE	2/14/2024 11:00	47.53	4
Transformer Bank	PLANNED OUTAGE	2/14/2024 13:19	170.90	6
Transformer Bank	PLANNED OUTAGE	2/14/2024 13:22	33.60	1
Transformer	PLANNED OUTAGE	2/14/2024 9:43	2,185.00	12
Transformer	PLANNED OUTAGE	2/27/2024 19:10	224.57	1
Transformer	PLANNED OUTAGE	2/28/2024 10:18	322.42	5
Transformer	PLANNED OUTAGE	2/28/2024 8:32	3,542.73	11
Transformer	PLANNED OUTAGE	2/28/2024 10:48	107.37	2
Transformer	PLANNED OUTAGE	2/28/2024 14:07	1,512.00	20
Service point	PLANNED OUTAGE	2/28/2024 22:46	20.32	1
Transformer	PLANNED OUTAGE	2/29/2024 8:11	1,374.90	6
Transformer	PLANNED OUTAGE	2/29/2024 11:21	32.65	3
Transformer	PLANNED OUTAGE	2/29/2024 9:14	199.90	6
None	PLANNED OUTAGE	2/29/2024 15:51	689.53	4
Transformer	PLANNED OUTAGE	2/29/2024 16:24	1,249.20	6
Transformer	PLANNED OUTAGE	3/01/2024 14:39	161.63	13
Transformer	PLANNED OUTAGE	3/02/2024 1:41	25.97	1
Transformer	PLANNED OUTAGE	3/02/2024 2:16	30.53	2
Transformer	PLANNED OUTAGE	3/02/2024 0:39	181.20	18
PLF	PLANNED OUTAGE	3/02/2024 7:18	1,810.43	7
PLF	PLANNED OUTAGE	3/02/2024 7:19	257.52	1
Transformer	PLANNED OUTAGE	3/03/2024 4:44	423.73	7
PLF	PLANNED OUTAGE	3/03/2024 4:47	464.27	8
Transformer	PLANNED OUTAGE	3/02/2024 12:23	43.05	3
Transformer	PLANNED OUTAGE	3/02/2024 12:32	71.10	3
Transformer	PLANNED OUTAGE	3/04/2024 10:01	273.33	5
None	PLANNED OUTAGE	3/04/2024 14:31	1,077.30	14
Transformer	PLANNED OUTAGE	3/04/2024 8:22	938.00	12
Transformer	PLANNED OUTAGE	3/05/2024 11:26	62.20	3
Transformer	PLANNED OUTAGE	3/05/2024 8:48	1,069.80	9
Transformer	PLANNED OUTAGE	3/05/2024 9:01	13.55	1
None	PLANNED OUTAGE	3/05/2024 8:25	3,604.67	10
Transformer	PLANNED OUTAGE	3/05/2024 9:04	185.05	1
Transformer	PLANNED OUTAGE	3/05/2024 11:38	93.30	3
Transformer	PLANNED OUTAGE	3/05/2024 17:53	87.70	2
PLF	PLANNED OUTAGE	3/05/2024 18:10	1,776.20	4

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	3/06/2024 9:58	71.90	3
Transformer Bank	PLANNED OUTAGE	3/01/2024 12:35	198.53	8
Transformer	PLANNED OUTAGE	3/01/2024 21:20	20.52	1
PLF	PLANNED OUTAGE	3/03/2024 9:12	19.28	1
None	PLANNED OUTAGE	3/03/2024 20:45	61.62	1
None	PLANNED OUTAGE	3/03/2024 17:40	15,084.80	32
Transformer	PLANNED OUTAGE	3/02/2024 23:37	8.70	1
Transformer	PLANNED OUTAGE	3/02/2024 19:46	13.73	2
Transformer	PLANNED OUTAGE	3/02/2024 13:34	429.60	1
Transformer	PLANNED OUTAGE	3/04/2024 10:55	196.93	8
Transformer	PLANNED OUTAGE	3/04/2024 13:48	228.50	6
Transformer	PLANNED OUTAGE	3/04/2024 20:41	2,004.83	10
Transformer	PLANNED OUTAGE	3/05/2024 0:01	36.53	2
Transformer	PLANNED OUTAGE	3/05/2024 10:07	381.40	6
Transformer	PLANNED OUTAGE	3/05/2024 10:21	2,431.00	20
Service point	PLANNED OUTAGE	3/05/2024 13:39	16.72	1
Transformer	PLANNED OUTAGE	3/05/2024 15:21	289.10	3
PLF	PLANNED OUTAGE	3/05/2024 19:57	410.77	1
PLF	PLANNED OUTAGE	3/06/2024 0:28	558.70	37
Transformer	PLANNED OUTAGE	3/06/2024 10:52	38.07	2
PLF	PLANNED OUTAGE	3/06/2024 7:51	2,635.03	14
Transformer	PLANNED OUTAGE	3/06/2024 10:00	112.80	3
Transformer	PLANNED OUTAGE	3/06/2024 8:39	135.50	2
Transformer	PLANNED OUTAGE	3/06/2024 14:16	34.00	1
Transformer	PLANNED OUTAGE	3/06/2024 10:58	102.00	2
Transformer	PLANNED OUTAGE	3/06/2024 9:02	186.10	2
Transformer	PLANNED OUTAGE	3/06/2024 12:40	41.93	1
Transformer	PLANNED OUTAGE	3/06/2024 13:33	56.75	15
None	PLANNED OUTAGE	3/06/2024 21:06	56.93	4
Transformer	PLANNED OUTAGE	3/30/2024 18:56	77.20	3
Primary Wire	PLANNED OUTAGE	3/31/2024 18:46	272.20	1
PLF	PLANNED OUTAGE	4/01/2024 10:18	2,430.00	25
Breaker	PLANNED OUTAGE	4/01/2024 15:25	7.95	1
Transformer	PLANNED OUTAGE	4/01/2024 16:47	30.45	7
Transformer	PLANNED OUTAGE	4/01/2024 23:05	203.73	8
Transformer	PLANNED OUTAGE	4/01/2024 23:04	48.63	2
Primary Wire	PLANNED OUTAGE	4/02/2024 9:15	1,906.70	23
Transformer	PLANNED OUTAGE	4/02/2024 8:46	330.95	3
PLF	PLANNED OUTAGE	4/02/2024 12:31	1,564.15	7
Primary Wire	PLANNED OUTAGE	4/02/2024 10:24	564.25	5
PLF	PLANNED OUTAGE	4/02/2024 9:19	1,212.52	7

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	4/02/2024 14:45	60.32	1
Transformer	PLANNED OUTAGE	4/02/2024 18:21	13.27	2
Breaker	PLANNED OUTAGE	4/03/2024 13:24	3,154.00	760
Breaker	PLANNED OUTAGE	4/03/2024 13:24	1.07	1
Transformer	PLANNED OUTAGE	4/03/2024 14:34	2,399.47	8
Transformer	PLANNED OUTAGE	4/03/2024 13:50	196.35	3
None	PLANNED OUTAGE	4/04/2024 2:39	263.33	25
Transformer	PLANNED OUTAGE	4/04/2024 11:05	554.42	5
Transformer	PLANNED OUTAGE	4/04/2024 11:07	220.90	2
Transformer	PLANNED OUTAGE	4/04/2024 8:55	1,307.60	7
PLF	PLANNED OUTAGE	4/03/2024 17:01	3,231.33	37
PLF	PLANNED OUTAGE	4/04/2024 15:38	24.70	2
Primary Wire	PLANNED OUTAGE	4/04/2024 15:38	1,423.73	2
Transformer	PLANNED OUTAGE	4/04/2024 0:22	201.07	1
Transformer	PLANNED OUTAGE	4/05/2024 13:31	25.70	3
PLF	PLANNED OUTAGE	4/05/2024 20:29	199.57	1
UG Other	PLANNED OUTAGE	4/05/2024 21:21	33.40	4
Transformer	PLANNED OUTAGE	4/06/2024 13:19	388.27	8
PLF	PLANNED OUTAGE	4/06/2024 17:10	9,607.03	154
Transformer	PLANNED OUTAGE	4/07/2024 14:47	184.60	6
PLF	PLANNED OUTAGE	2/14/2024 9:42	4,040.05	21
Transformer	PLANNED OUTAGE	2/14/2024 12:56	1,136.67	8
Transformer	PLANNED OUTAGE	2/14/2024 16:19	388.60	6
Transformer	PLANNED OUTAGE	2/14/2024 22:47	311.15	3
Transformer	PLANNED OUTAGE	2/15/2024 0:09	54.80	4
Transformer	PLANNED OUTAGE	2/15/2024 8:54	34.10	2
Transformer	PLANNED OUTAGE	2/15/2024 9:04	945.58	7
Service point	PLANNED OUTAGE	2/15/2024 9:29	49.52	1
Transformer Bank	PLANNED OUTAGE	2/15/2024 16:35	141.30	6
Transformer	PLANNED OUTAGE	2/16/2024 1:52	107.60	4
Transformer	PLANNED OUTAGE	2/16/2024 3:19	150.93	4
Transformer	PLANNED OUTAGE	2/15/2024 8:52	4,314.50	10
None	PLANNED OUTAGE	2/16/2024 17:00	423.10	6
PLF	PLANNED OUTAGE	2/16/2024 17:13	247.75	3
None	PLANNED OUTAGE	2/16/2024 18:39	37.58	5
None	PLANNED OUTAGE	2/16/2024 18:39	43.75	5
Transformer	PLANNED OUTAGE	2/17/2024 4:35	105.23	7
Transformer	PLANNED OUTAGE	2/17/2024 3:38	75.33	4
Transformer	PLANNED OUTAGE	2/17/2024 4:07	110.60	6
Transformer	PLANNED OUTAGE	2/17/2024 14:52	9.98	1
Breaker	PLANNED OUTAGE	2/18/2024 0:37	4,660.77	74

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	2/18/2024 21:00	370.53	8
Transformer	PLANNED OUTAGE	2/19/2024 18:23	19.40	4
Breaker	PLANNED OUTAGE	2/19/2024 18:29	3,468.40	1334
Transformer	PLANNED OUTAGE	2/20/2024 1:06	87.90	3
Transformer	PLANNED OUTAGE	2/20/2024 1:39	35.70	3
Transformer	PLANNED OUTAGE	2/20/2024 2:00	31.87	2
Transformer	PLANNED OUTAGE	2/19/2024 8:56	5,827.50	15
Transformer	PLANNED OUTAGE	2/20/2024 9:00	736.95	9
PLF	PLANNED OUTAGE	2/20/2024 9:41	803.27	2
Transformer	PLANNED OUTAGE	3/06/2024 8:56	56.85	1
Transformer	PLANNED OUTAGE	3/06/2024 14:10	107.33	5
None	PLANNED OUTAGE	3/06/2024 12:59	1,224.17	25
Transformer	PLANNED OUTAGE	3/06/2024 13:25	69.03	2
Transformer	PLANNED OUTAGE	3/06/2024 11:33	115.42	5
None	PLANNED OUTAGE	3/06/2024 19:12	221.67	4
PLF	PLANNED OUTAGE	3/06/2024 19:54	265.58	1
Transformer	PLANNED OUTAGE	3/06/2024 20:08	301.82	1
Transformer	PLANNED OUTAGE	3/07/2024 11:40	97.93	2
None	PLANNED OUTAGE	3/07/2024 9:43	343.73	2
Transformer	PLANNED OUTAGE	3/07/2024 16:28	2,055.60	6
Transformer	PLANNED OUTAGE	3/08/2024 14:45	38.60	3
Transformer	PLANNED OUTAGE	3/08/2024 23:20	117.80	2
Transformer	PLANNED OUTAGE	3/09/2024 1:16	118.13	1
Breaker	PLANNED OUTAGE	3/10/2024 0:45	11,146.67	1216
Transformer	PLANNED OUTAGE	3/11/2024 15:00	171.40	4
Transformer	PLANNED OUTAGE	3/11/2024 13:22	551.20	6
Transformer	PLANNED OUTAGE	3/11/2024 23:28	219.47	2
Transformer	PLANNED OUTAGE	3/12/2024 7:55	405.50	5
PLF	PLANNED OUTAGE	3/12/2024 12:55	342.93	16
Transformer	PLANNED OUTAGE	3/12/2024 10:32	673.20	8
Transformer	PLANNED OUTAGE	3/13/2024 8:52	584.80	8
Transformer	PLANNED OUTAGE	3/13/2024 10:04	210.92	5
Transformer Bank	PLANNED OUTAGE	3/13/2024 23:20	27.70	1
Transformer	PLANNED OUTAGE	3/14/2024 6:00	44.22	1
Service point	PLANNED OUTAGE	3/14/2024 17:32	126.42	1
Transformer	PLANNED OUTAGE	3/15/2024 15:36	119.40	2
Transformer Bank	PLANNED OUTAGE	3/15/2024 17:37	2,092.57	13
Switch	PLANNED OUTAGE	3/16/2024 2:31	6,023.90	177
Breaker	PLANNED OUTAGE	4/07/2024 19:41	10,094.75	149
Transformer	PLANNED OUTAGE	4/08/2024 9:34	615.87	8
Transformer	PLANNED OUTAGE	4/08/2024 11:57	2,006.12	13

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Invalid	PLANNED OUTAGE	4/08/2024 22:04	216.93	2
Breaker	PLANNED OUTAGE	4/09/2024 5:18	58.30	1
Transformer	PLANNED OUTAGE	4/09/2024 8:31	382.42	5
Transformer	PLANNED OUTAGE	4/09/2024 9:21	36.62	1
Transformer	PLANNED OUTAGE	4/09/2024 10:46	185.85	1
Transformer	PLANNED OUTAGE	4/09/2024 12:51	59.33	1
Transformer	PLANNED OUTAGE	4/09/2024 12:51	295.42	5
Transformer	PLANNED OUTAGE	4/09/2024 13:21	33.95	1
Transformer	PLANNED OUTAGE	4/09/2024 10:55	296.22	1
Transformer	PLANNED OUTAGE	4/10/2024 8:21	1,161.40	12
Transformer	PLANNED OUTAGE	4/10/2024 10:15	25.98	1
Service point	PLANNED OUTAGE	4/10/2024 12:29	27.33	1
Transformer	PLANNED OUTAGE	4/10/2024 13:47	59.00	3
Transformer	PLANNED OUTAGE	4/10/2024 14:12	131.75	5
PLF	PLANNED OUTAGE	4/11/2024 9:31	904.00	48
Transformer	PLANNED OUTAGE	4/11/2024 9:42	50.63	2
Transformer	PLANNED OUTAGE	4/11/2024 9:47	396.85	3
Breaker	PLANNED OUTAGE	4/11/2024 13:09	11,972.53	1112
PLF	PLANNED OUTAGE	4/11/2024 17:20	107.65	3
PLF	PLANNED OUTAGE	4/11/2024 19:31	1,034.75	15
PLF	PLANNED OUTAGE	4/11/2024 15:10	787.03	2
Transformer	PLANNED OUTAGE	4/11/2024 20:27	683.60	3
Transformer Bank	PLANNED OUTAGE	4/12/2024 10:13	143.72	1
Transformer Bank	PLANNED OUTAGE	4/12/2024 20:40	60.78	1
Transformer	PLANNED OUTAGE	4/13/2024 12:23	129.93	4
Transformer	PLANNED OUTAGE	4/14/2024 12:37	21.98	1
Transformer	PLANNED OUTAGE	4/15/2024 5:12	14.23	1
Transformer	PLANNED OUTAGE	4/15/2024 8:49	320.20	4
Transformer	PLANNED OUTAGE	4/15/2024 9:25	552.93	22
Transformer	PLANNED OUTAGE	3/07/2024 8:31	528.33	5
Transformer	PLANNED OUTAGE	3/07/2024 9:29	32.20	1
Transformer	PLANNED OUTAGE	3/07/2024 10:31	258.53	7
Transformer	PLANNED OUTAGE	3/07/2024 8:30	244.80	6
Transformer	PLANNED OUTAGE	3/07/2024 9:44	759.20	8
PLF	PLANNED OUTAGE	3/07/2024 14:54	63.43	1
None	PLANNED OUTAGE	3/07/2024 17:40	1,357.75	15
Transformer	PLANNED OUTAGE	3/07/2024 23:30	146.15	1
Transformer Bank	PLANNED OUTAGE	3/09/2024 13:41	44.35	3
Service - Crew	PLANNED OUTAGE	3/09/2024 13:48	83.55	1
Service - Crew	PLANNED OUTAGE	3/09/2024 13:51	1.00	1
Breaker	PLANNED OUTAGE	3/10/2024 0:45	9.37	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	3/10/2024 20:46	33.00	3
PLF	PLANNED OUTAGE	3/11/2024 0:28	2,412.90	7
Transformer	PLANNED OUTAGE	3/11/2024 10:28	534.80	4
Transformer	PLANNED OUTAGE	3/11/2024 18:17	11.30	3
Transformer	PLANNED OUTAGE	3/11/2024 21:37	153.45	1
Transformer	PLANNED OUTAGE	3/12/2024 13:59	65.20	6
Transformer	PLANNED OUTAGE	3/13/2024 1:43	110.13	4
Primary Wire	PLANNED OUTAGE	3/13/2024 8:44	1,077.50	15
Transformer	PLANNED OUTAGE	3/13/2024 13:00	1,285.48	17
None	PLANNED OUTAGE	3/13/2024 13:27	75.60	8
PLF	PLANNED OUTAGE	3/13/2024 19:32	123.35	1
Transformer	PLANNED OUTAGE	3/14/2024 9:37	97.67	5
PLF	PLANNED OUTAGE	3/14/2024 9:04	678.90	3
PLF	PLANNED OUTAGE	3/14/2024 10:21	117.58	1
Service point	PLANNED OUTAGE	3/14/2024 17:34	133.03	1
PLF	PLANNED OUTAGE	3/16/2024 8:03	479.75	5
Transformer	PLANNED OUTAGE	3/16/2024 12:53	37.83	2
Switch	PLANNED OUTAGE	3/16/2024 23:02	22,444.80	167
Primary Wire	PLANNED OUTAGE	3/17/2024 7:59	690.73	2
Transformer	PLANNED OUTAGE	3/18/2024 0:44	187.60	3
None	PLANNED OUTAGE	3/18/2024 8:31	823.50	5
Transformer Bank	PLANNED OUTAGE	2/20/2024 10:04	560.97	2
Transformer Bank	PLANNED OUTAGE	2/21/2024 8:14	740.90	6
Transformer Bank	PLANNED OUTAGE	2/21/2024 10:42	117.48	7
Transformer	PLANNED OUTAGE	2/21/2024 13:35	146.80	6
PLF	PLANNED OUTAGE	2/22/2024 0:29	152.23	1
Transformer	PLANNED OUTAGE	2/21/2024 16:27	557.50	6
Switch	PLANNED OUTAGE	2/21/2024 19:17	387.67	20
Transformer	PLANNED OUTAGE	2/22/2024 9:23	602.80	6
Transformer	PLANNED OUTAGE	2/22/2024 9:36	143.60	8
PLF	PLANNED OUTAGE	2/22/2024 12:14	66.65	1
Transformer Bank	PLANNED OUTAGE	2/22/2024 12:32	21.17	5
Transformer	PLANNED OUTAGE	2/22/2024 20:22	260.00	8
Service point	PLANNED OUTAGE	2/22/2024 20:37	27.88	1
Invalid	PLANNED OUTAGE	2/22/2024 19:14	45.48	1
Transformer	PLANNED OUTAGE	2/23/2024 16:17	15.40	2
PLF	PLANNED OUTAGE	2/25/2024 11:13	1,359.62	97
Transformer	PLANNED OUTAGE	2/23/2024 16:29	7,543.60	12
PLF	PLANNED OUTAGE	2/23/2024 14:50	1,342.97	2
PLF	PLANNED OUTAGE	2/23/2024 12:59	1,485.90	6
Transformer	PLANNED OUTAGE	2/26/2024 9:55	28.45	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	2/26/2024 10:22	35.87	1
None	PLANNED OUTAGE	2/26/2024 10:32	151.70	6
Transformer	PLANNED OUTAGE	2/26/2024 10:02	110.17	5
None	PLANNED OUTAGE	2/26/2024 17:02	209.58	5
Transformer	PLANNED OUTAGE	2/26/2024 8:55	436.60	4
Transformer	PLANNED OUTAGE	2/27/2024 13:46	263.25	9
Transformer	PLANNED OUTAGE	2/27/2024 9:40	42.78	1
Transformer	PLANNED OUTAGE	2/27/2024 8:57	39,521.52	47
Transformer	PLANNED OUTAGE	2/27/2024 8:57	39,488.62	47
Transformer	PLANNED OUTAGE	2/28/2024 9:06	1,528.67	10
None	PLANNED OUTAGE	2/28/2024 12:05	884.00	20
Transformer	PLANNED OUTAGE	2/28/2024 9:12	321.30	2
Transformer	PLANNED OUTAGE	2/28/2024 9:55	760.70	3
Transformer	PLANNED OUTAGE	4/15/2024 12:28	73.55	3
Transformer	PLANNED OUTAGE	4/15/2024 14:50	138.97	22
Transformer	PLANNED OUTAGE	4/15/2024 22:41	34.00	3
Transformer	PLANNED OUTAGE	4/16/2024 10:43	171.78	1
Transformer	PLANNED OUTAGE	4/16/2024 13:56	99.93	2
Transformer	PLANNED OUTAGE	4/16/2024 10:00	18.00	1
Transformer	PLANNED OUTAGE	4/16/2024 10:03	365.55	3
Transformer Bank	PLANNED OUTAGE	4/17/2024 8:34	199.37	2
Transformer	PLANNED OUTAGE	4/17/2024 8:45	193.33	4
Transformer	PLANNED OUTAGE	4/17/2024 12:16	14.70	6
Transformer	PLANNED OUTAGE	4/17/2024 12:25	31.97	1
Transformer	PLANNED OUTAGE	4/17/2024 12:45	125.88	7
Transformer	PLANNED OUTAGE	4/17/2024 14:36	195.20	6
Transformer	PLANNED OUTAGE	4/17/2024 12:00	461.63	2
Transformer	PLANNED OUTAGE	4/18/2024 2:45	191.73	8
Breaker	PLANNED OUTAGE	4/17/2024 15:28	4.03	1
Transformer	PLANNED OUTAGE	4/18/2024 9:58	83.05	3
Transformer	PLANNED OUTAGE	4/18/2024 10:32	106.35	3
None	PLANNED OUTAGE	4/18/2024 11:05	1,805.15	457
Switch	PLANNED OUTAGE	4/18/2024 13:49	66.50	1
Service point	PLANNED OUTAGE	4/18/2024 17:56	192.33	1
PLF	PLANNED OUTAGE	4/19/2024 9:07	40.68	1
Service point	PLANNED OUTAGE	4/19/2024 10:36	38.93	1
PLF	PLANNED OUTAGE	4/19/2024 14:18	256.25	15
Transformer	PLANNED OUTAGE	4/19/2024 23:13	74.97	1
Transformer	PLANNED OUTAGE	4/19/2024 23:13	375.17	5
PLF	PLANNED OUTAGE	4/20/2024 14:49	64.30	2
OCR, Sec.	PLANNED OUTAGE	4/21/2024 1:29	8,197.80	52

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	4/21/2024 23:42	8.33	4
Transformer	PLANNED OUTAGE	4/22/2024 13:33	325.90	6
Transformer	PLANNED OUTAGE	4/22/2024 11:26	611.25	15
Transformer	PLANNED OUTAGE	4/22/2024 14:28	197.05	7
Service - Crew	PLANNED OUTAGE	4/22/2024 17:18	190.52	1
Transformer	PLANNED OUTAGE	3/15/2024 23:44	83.33	5
Transformer	PLANNED OUTAGE	3/16/2024 0:10	46.23	2
Transformer Bank	PLANNED OUTAGE	3/16/2024 1:40	36.90	2
None	PLANNED OUTAGE	3/17/2024 14:00	3,204.60	14
Primary Wire	PLANNED OUTAGE	3/18/2024 18:41	25.77	2
Transformer	PLANNED OUTAGE	3/19/2024 13:18	503.62	11
Transformer	PLANNED OUTAGE	3/19/2024 9:26	2,618.00	7
Transformer	PLANNED OUTAGE	3/19/2024 10:35	82.13	1
Transformer	PLANNED OUTAGE	3/20/2024 3:27	14.65	1
Transformer	PLANNED OUTAGE	3/20/2024 10:11	443.80	7
Transformer	PLANNED OUTAGE	3/20/2024 9:41	1,300.00	12
Transformer	PLANNED OUTAGE	3/20/2024 17:12	17.15	1
PLF	PLANNED OUTAGE	3/22/2024 7:38	401.92	5
PLF	PLANNED OUTAGE	3/22/2024 7:38	542.83	10
PLF	PLANNED OUTAGE	3/22/2024 13:33	31.20	4
PLF	PLANNED OUTAGE	3/23/2024 10:43	671.53	28
PLF	PLANNED OUTAGE	3/23/2024 10:43	831.33	29
Transformer Bank	PLANNED OUTAGE	3/23/2024 17:50	395.73	4
Transformer Bank	PLANNED OUTAGE	3/24/2024 22:15	111.72	1
Breaker	PLANNED OUTAGE	3/25/2024 12:06	17.68	1
Breaker	PLANNED OUTAGE	3/25/2024 12:06	17.93	1
Breaker	PLANNED OUTAGE	3/25/2024 12:16	281.45	39
Breaker	PLANNED OUTAGE	3/25/2024 12:16	549.73	76
Breaker	PLANNED OUTAGE	3/25/2024 12:16	15.10	2
Service point	PLANNED OUTAGE	3/25/2024 22:52	33.88	1
Service point	PLANNED OUTAGE	3/25/2024 22:52	77.13	1
Transformer	PLANNED OUTAGE	3/26/2024 11:10	151.73	8
Transformer	PLANNED OUTAGE	3/26/2024 11:27	75.08	1
Transformer	PLANNED OUTAGE	3/26/2024 10:51	77.37	1
Service point	PLANNED OUTAGE	3/26/2024 22:18	13.35	1
PLF	PLANNED OUTAGE	3/27/2024 8:27	259.47	14
Transformer	PLANNED OUTAGE	3/27/2024 8:44	615.83	5
Primary Wire	PLANNED OUTAGE	3/27/2024 8:57	1,670.42	5
Transformer	PLANNED OUTAGE	3/18/2024 10:17	369.80	3
Transformer	PLANNED OUTAGE	3/18/2024 8:33	366.10	3
Transformer	PLANNED OUTAGE	3/18/2024 10:57	413.63	2

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	3/19/2024 9:03	1,136.00	16
None	PLANNED OUTAGE	3/19/2024 16:16	41.20	4
PLF	PLANNED OUTAGE	3/19/2024 8:27	9,026.85	21
Transformer	PLANNED OUTAGE	3/20/2024 10:13	410.33	10
PLF	PLANNED OUTAGE	3/20/2024 13:02	11.70	1
Transformer	PLANNED OUTAGE	3/20/2024 14:52	407.50	6
Transformer	PLANNED OUTAGE	3/20/2024 18:06	27.13	2
Transformer	PLANNED OUTAGE	3/21/2024 9:19	1,346.00	20
Transformer	PLANNED OUTAGE	3/21/2024 9:57	20.15	3
Transformer	PLANNED OUTAGE	3/21/2024 23:12	57.93	1
Transformer	PLANNED OUTAGE	3/22/2024 10:58	4.28	1
PLF	PLANNED OUTAGE	3/22/2024 19:31	4,206.93	68
Transformer	PLANNED OUTAGE	3/22/2024 21:59	33.07	8
None	PLANNED OUTAGE	3/23/2024 10:37	6.52	1
PLF	PLANNED OUTAGE	3/23/2024 22:50	1,568.77	38
Transformer	PLANNED OUTAGE	3/24/2024 0:46	75.20	2
Transformer	PLANNED OUTAGE	3/24/2024 15:37	80.70	9
Transformer	PLANNED OUTAGE	3/25/2024 10:24	21.30	1
PLF	PLANNED OUTAGE	3/25/2024 12:06	30.00	2
Breaker	PLANNED OUTAGE	3/25/2024 12:06	3,948.00	840
Transformer	PLANNED OUTAGE	3/25/2024 11:12	102.85	1
Transformer	PLANNED OUTAGE	3/25/2024 18:10	993.73	8
Transformer	PLANNED OUTAGE	3/26/2024 11:27	309.65	3
Transformer	PLANNED OUTAGE	3/26/2024 14:04	39.87	8
Service point	PLANNED OUTAGE	3/26/2024 17:53	107.20	1
PLF	PLANNED OUTAGE	3/27/2024 7:21	229.37	7
Transformer	PLANNED OUTAGE	3/27/2024 11:12	1,008.60	12
Transformer Bank	PLANNED OUTAGE	3/27/2024 8:24	93.67	1
PLF	PLANNED OUTAGE	3/27/2024 9:08	679.10	3
Transformer	PLANNED OUTAGE	3/27/2024 15:20	184.62	11
PLF	PLANNED OUTAGE	2/28/2024 15:38	647.83	23
Transformer	PLANNED OUTAGE	2/29/2024 15:09	35.50	6
Transformer Bank	PLANNED OUTAGE	3/01/2024 6:25	103.23	2
Transformer	PLANNED OUTAGE	3/01/2024 12:53	619.17	10
Transformer	PLANNED OUTAGE	3/01/2024 8:46	280.77	1
Transformer Bank	PLANNED OUTAGE	3/01/2024 12:26	66.23	2
Transformer	PLANNED OUTAGE	3/01/2024 13:03	714.67	10
Transformer	PLANNED OUTAGE	3/01/2024 23:12	246.60	18
Transformer	PLANNED OUTAGE	3/01/2024 22:45	73.87	4
Transformer	PLANNED OUTAGE	3/02/2024 3:39	49.20	4
Transformer	PLANNED OUTAGE	3/02/2024 2:48	102.33	5

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	3/03/2024 17:43	514.20	6
None	PLANNED OUTAGE	3/03/2024 18:25	2,763.83	7
PLF	PLANNED OUTAGE	3/03/2024 22:19	204.02	1
Transformer	PLANNED OUTAGE	3/02/2024 23:45	60.00	3
Transformer	PLANNED OUTAGE	3/03/2024 0:06	41.30	3
Transformer	PLANNED OUTAGE	3/04/2024 9:47	133.90	3
Transformer	PLANNED OUTAGE	3/04/2024 13:11	159.25	7
PLF	PLANNED OUTAGE	3/04/2024 13:13	69.73	8
Transformer Bank	PLANNED OUTAGE	3/04/2024 8:41	552.65	3
OH Other	PLANNED OUTAGE	3/05/2024 8:59	335.87	2
Service point	PLANNED OUTAGE	3/05/2024 11:51	53.12	1
PLF	PLANNED OUTAGE	3/06/2024 0:16	1,635.60	72
PLF	PLANNED OUTAGE	3/06/2024 1:11	1,197.72	47
PLF	PLANNED OUTAGE	3/06/2024 5:02	318.73	7
PLF	PLANNED OUTAGE	3/06/2024 14:19	91.73	8
PLF	PLANNED OUTAGE	3/06/2024 17:56	1,042.80	4
Transformer Bank	PLANNED OUTAGE	4/23/2024 8:52	84.53	2
Transformer	PLANNED OUTAGE	4/23/2024 11:13	359.33	1
PLF	PLANNED OUTAGE	4/23/2024 17:25	397.10	33
Transformer Bank	PLANNED OUTAGE	4/23/2024 23:34	109.40	2
Transformer	PLANNED OUTAGE	4/24/2024 1:23	82.73	1
Transformer	PLANNED OUTAGE	4/24/2024 9:51	5,908.27	64
Transformer	PLANNED OUTAGE	4/24/2024 8:27	2,724.00	10
Transformer	PLANNED OUTAGE	4/24/2024 13:34	116.40	4
Transformer	PLANNED OUTAGE	4/24/2024 14:26	61.27	2
PLF	PLANNED OUTAGE	4/24/2024 20:38	173.60	4
Breaker	PLANNED OUTAGE	4/23/2024 9:33	10.98	1
Breaker	PLANNED OUTAGE	4/23/2024 9:33	11.33	1
Breaker	PLANNED OUTAGE	4/23/2024 9:33	11.47	1
Transformer	PLANNED OUTAGE	4/25/2024 11:09	132.47	4
Transformer	PLANNED OUTAGE	4/25/2024 9:50	27.20	8
Transformer	PLANNED OUTAGE	4/25/2024 9:58	346.80	8
PLF	PLANNED OUTAGE	4/25/2024 9:29	178.08	1
Transformer	PLANNED OUTAGE	4/25/2024 9:36	3,313.75	11
PLF	PLANNED OUTAGE	4/25/2024 17:58	393.90	18
Transformer Bank	PLANNED OUTAGE	4/26/2024 9:13	32.22	1
Transformer	PLANNED OUTAGE	4/26/2024 10:37	266.60	3
Primary Wire	PLANNED OUTAGE	4/26/2024 12:02	11.73	2
Transformer	PLANNED OUTAGE	4/27/2024 13:45	15.67	4
Transformer	PLANNED OUTAGE	4/27/2024 20:06	64.33	5
Breaker	PLANNED OUTAGE	4/27/2024 20:34	66,998.75	1209

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Breaker	PLANNED OUTAGE	4/27/2024 20:34	5,934.42	85
Transformer	PLANNED OUTAGE	4/28/2024 13:58	9.40	3
Transformer Bank	PLANNED OUTAGE	4/28/2024 15:27	57.40	4
Transformer	PLANNED OUTAGE	4/29/2024 11:47	500.03	7
Transformer	PLANNED OUTAGE	4/29/2024 18:58	1,448.00	8
PLF	PLANNED OUTAGE	4/30/2024 9:19	784.80	27
Transformer	PLANNED OUTAGE	4/30/2024 9:28	17.57	1
Transformer	PLANNED OUTAGE	4/30/2024 12:09	337.75	7
Transformer	PLANNED OUTAGE	3/07/2024 10:08	52.23	2
Transformer	PLANNED OUTAGE	3/07/2024 10:12	75.07	4
Transformer	PLANNED OUTAGE	3/07/2024 10:30	105.20	4
Transformer	PLANNED OUTAGE	3/07/2024 13:51	36.22	1
PLF	PLANNED OUTAGE	3/07/2024 9:45	6,000.83	19
Transformer	PLANNED OUTAGE	3/07/2024 13:12	307.05	9
Transformer	PLANNED OUTAGE	3/07/2024 22:00	1,288.13	4
Transformer	PLANNED OUTAGE	3/08/2024 9:13	1,030.50	9
Transformer Bank	PLANNED OUTAGE	3/08/2024 9:20	26.25	5
Transformer	PLANNED OUTAGE	3/08/2024 14:43	64.73	2
Transformer	PLANNED OUTAGE	3/09/2024 21:13	1,810.75	5
Transformer	PLANNED OUTAGE	3/09/2024 21:05	991.43	7
Transformer Bank	PLANNED OUTAGE	3/10/2024 8:55	405.82	13
Transformer	PLANNED OUTAGE	3/10/2024 20:57	17.27	1
Transformer	PLANNED OUTAGE	3/10/2024 21:57	20.05	3
Transformer	PLANNED OUTAGE	3/11/2024 0:45	72.42	5
Transformer	PLANNED OUTAGE	3/11/2024 9:11	1,248.60	9
Transformer	PLANNED OUTAGE	3/12/2024 9:16	196.33	4
Transformer	PLANNED OUTAGE	3/12/2024 9:22	755.00	10
Transformer Bank	PLANNED OUTAGE	3/12/2024 14:42	152.57	2
PLF	PLANNED OUTAGE	3/12/2024 13:33	5,738.75	75
PLF	PLANNED OUTAGE	3/12/2024 18:27	526.37	1
Transformer	PLANNED OUTAGE	3/12/2024 9:11	5,672.40	9
Transformer	PLANNED OUTAGE	3/13/2024 9:00	202.60	2
Transformer	PLANNED OUTAGE	3/13/2024 13:57	236.13	8
Transformer Bank	PLANNED OUTAGE	3/13/2024 23:05	24.27	8
None	PLANNED OUTAGE	3/14/2024 0:03	540.75	5
Transformer	PLANNED OUTAGE	3/14/2024 0:58	114.23	2
Transformer	PLANNED OUTAGE	3/14/2024 8:48	243.30	2
Transformer	PLANNED OUTAGE	3/14/2024 8:56	225.00	4
Transformer Bank	PLANNED OUTAGE	3/15/2024 7:35	93.93	4
Invalid	PLANNED OUTAGE	3/15/2024 22:42	70.88	1
Transformer Bank	PLANNED OUTAGE	3/15/2024 15:45	244.00	2

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	3/27/2024 10:06	1,610.38	23
PLF	PLANNED OUTAGE	3/27/2024 9:08	29.05	1
Switch	PLANNED OUTAGE	3/27/2024 10:52	163.05	1
Transformer	PLANNED OUTAGE	3/27/2024 11:44	282.45	9
PLF	PLANNED OUTAGE	3/27/2024 20:01	414.95	43
Transformer	PLANNED OUTAGE	3/28/2024 6:21	34.50	3
None	PLANNED OUTAGE	3/28/2024 11:53	114.47	4
Transformer	PLANNED OUTAGE	3/28/2024 10:39	1,829.80	12
Primary Wire	PLANNED OUTAGE	3/28/2024 13:37	459.25	5
None	PLANNED OUTAGE	3/30/2024 14:13	238.58	7
PLF	PLANNED OUTAGE	3/31/2024 16:46	85.77	2
PLF	PLANNED OUTAGE	4/01/2024 7:06	705.90	13
Transformer	PLANNED OUTAGE	4/01/2024 9:52	235.27	4
Transformer	PLANNED OUTAGE	4/01/2024 20:40	2,235.60	4
PLF	PLANNED OUTAGE	4/02/2024 8:47	436.50	3
Transformer	PLANNED OUTAGE	4/02/2024 8:54	418.20	4
Transformer	PLANNED OUTAGE	4/02/2024 11:40	280.37	2
Switch	PLANNED OUTAGE	4/02/2024 9:54	461.20	2
Transformer	PLANNED OUTAGE	4/02/2024 10:04	216.32	1
Transformer	PLANNED OUTAGE	4/02/2024 10:05	93.35	1
Transformer	PLANNED OUTAGE	4/03/2024 14:22	11.47	8
Service point	PLANNED OUTAGE	4/03/2024 12:39	7.60	1
Transformer	PLANNED OUTAGE	4/03/2024 15:07	336.58	7
None	PLANNED OUTAGE	4/04/2024 4:04	272.80	11
PLF	PLANNED OUTAGE	4/04/2024 1:45	752.87	4
None	PLANNED OUTAGE	4/04/2024 2:15	285.20	2
PLF	PLANNED OUTAGE	4/04/2024 11:06	329.15	3
PLF	PLANNED OUTAGE	4/04/2024 11:18	259.73	2
Transformer	PLANNED OUTAGE	4/04/2024 11:54	106.47	2
Transformer Bank	PLANNED OUTAGE	4/04/2024 6:29	350.95	1
PLF	PLANNED OUTAGE	3/27/2024 9:57	20,054.53	56
Transformer	PLANNED OUTAGE	3/28/2024 10:04	317.73	8
Transformer	PLANNED OUTAGE	3/28/2024 10:44	634.53	8
Transformer	PLANNED OUTAGE	3/28/2024 12:36	213.60	4
Transformer	PLANNED OUTAGE	3/28/2024 12:05	119.67	4
Transformer	PLANNED OUTAGE	3/28/2024 12:27	140.90	3
PLF	PLANNED OUTAGE	3/29/2024 0:16	312.75	9
Transformer	PLANNED OUTAGE	4/01/2024 10:03	158.38	13
Transformer	PLANNED OUTAGE	4/01/2024 9:27	700.80	4
None	PLANNED OUTAGE	4/01/2024 13:45	131.40	3
Breaker	PLANNED OUTAGE	4/01/2024 15:25	8,869.00	1086

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Invalid	PLANNED OUTAGE	4/01/2024 18:46	76.40	4
PLF	PLANNED OUTAGE	4/01/2024 22:43	3,805.43	47
Transformer	PLANNED OUTAGE	4/02/2024 9:52	143.53	4
Transformer	PLANNED OUTAGE	4/02/2024 10:24	105.45	3
PLF	PLANNED OUTAGE	4/02/2024 8:21	197.97	1
Transformer	PLANNED OUTAGE	4/02/2024 9:13	736.93	8
Transformer	PLANNED OUTAGE	4/02/2024 12:35	11.48	1
None	PLANNED OUTAGE	4/02/2024 10:31	715.47	8
Transformer	PLANNED OUTAGE	4/02/2024 15:31	200.33	2
Transformer	PLANNED OUTAGE	4/02/2024 19:30	44.67	2
Transformer	PLANNED OUTAGE	4/02/2024 20:19	18.05	1
Transformer	PLANNED OUTAGE	4/03/2024 0:22	49.67	2
Transformer	PLANNED OUTAGE	4/03/2024 8:52	85.50	9
Breaker	PLANNED OUTAGE	4/03/2024 13:24	4.15	1
Transformer	PLANNED OUTAGE	4/03/2024 12:32	50.50	6
Invalid	PLANNED OUTAGE	4/03/2024 14:36	2,167.97	1
PLF	PLANNED OUTAGE	4/03/2024 12:24	836.85	7
None	PLANNED OUTAGE	4/04/2024 0:11	2,881.50	255
None	PLANNED OUTAGE	4/04/2024 4:02	738.00	27
UG Other	PLANNED OUTAGE	4/04/2024 7:23	29,151.85	273
Transformer	PLANNED OUTAGE	4/30/2024 13:45	76.85	3
None	PLANNED OUTAGE	4/30/2024 17:51	250.43	11
Transformer	PLANNED OUTAGE	5/01/2024 9:00	578.08	7
Breaker	PLANNED OUTAGE	5/01/2024 11:36	4.27	1
Transformer	PLANNED OUTAGE	5/01/2024 13:21	527.70	9
Breaker	PLANNED OUTAGE	5/01/2024 11:36	4.27	1
Breaker	PLANNED OUTAGE	5/01/2024 11:36	4.27	1
PLF	PLANNED OUTAGE	5/02/2024 6:08	211.87	7
Transformer	PLANNED OUTAGE	5/02/2024 10:03	140.67	8
Transformer	PLANNED OUTAGE	5/02/2024 10:53	331.83	11
PLF	PLANNED OUTAGE	5/02/2024 10:56	11.85	3
Transformer	PLANNED OUTAGE	5/02/2024 11:42	154.27	8
Transformer	PLANNED OUTAGE	5/02/2024 12:12	25.20	1
Transformer	PLANNED OUTAGE	5/02/2024 16:11	141.40	12
PLF	PLANNED OUTAGE	5/03/2024 12:25	159.63	2
Invalid	PLANNED OUTAGE	5/03/2024 19:31	18.80	6
Transformer	PLANNED OUTAGE	5/05/2024 15:29	66.47	4
Transformer	PLANNED OUTAGE	5/04/2024 20:37	221.13	4
Transformer	PLANNED OUTAGE	5/04/2024 19:38	11.97	1
Transformer	PLANNED OUTAGE	5/05/2024 22:21	7,792.80	12
Transformer	PLANNED OUTAGE	5/06/2024 10:11	143.20	4

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	5/06/2024 8:02	92.70	2
Transformer	PLANNED OUTAGE	5/06/2024 10:58	63.30	3
Transformer	PLANNED OUTAGE	5/06/2024 8:59	54.00	2
Transformer	PLANNED OUTAGE	5/06/2024 13:26	20.87	4
Transformer	PLANNED OUTAGE	5/06/2024 11:23	2,635.95	9
Transformer	PLANNED OUTAGE	5/06/2024 18:11	952.40	3
PLF	PLANNED OUTAGE	5/06/2024 22:18	1,544.50	30
Transformer	PLANNED OUTAGE	5/07/2024 2:30	51.90	2
Transformer	PLANNED OUTAGE	5/06/2024 19:03	555.27	1
Transformer	PLANNED OUTAGE	5/07/2024 8:37	26.67	1
Transformer	PLANNED OUTAGE	5/07/2024 9:21	136.27	4
Transformer	PLANNED OUTAGE	5/07/2024 10:09	514.50	7
Transformer	PLANNED OUTAGE	3/16/2024 7:17	317.87	1
Transformer	PLANNED OUTAGE	3/16/2024 12:26	24.25	1
Transformer	PLANNED OUTAGE	3/17/2024 15:24	145.40	12
Transformer	PLANNED OUTAGE	3/17/2024 16:18	309.83	10
None	PLANNED OUTAGE	3/17/2024 16:30	251.17	10
Transformer	PLANNED OUTAGE	3/18/2024 8:31	809.67	5
Transformer	PLANNED OUTAGE	3/18/2024 11:31	1,336.68	23
Transformer	PLANNED OUTAGE	3/18/2024 11:34	522.60	6
Transformer	PLANNED OUTAGE	3/18/2024 11:32	374.33	5
PLF	PLANNED OUTAGE	3/18/2024 12:29	115.27	13
Transformer	PLANNED OUTAGE	3/19/2024 9:29	36.65	1
Transformer	PLANNED OUTAGE	3/19/2024 11:20	91.50	9
PLF	PLANNED OUTAGE	3/20/2024 8:34	469.43	1
Breaker	PLANNED OUTAGE	3/20/2024 8:05	366.33	1
Transformer	PLANNED OUTAGE	3/21/2024 9:57	677.37	7
Transformer	PLANNED OUTAGE	3/21/2024 10:38	2,460.18	19
PLF	PLANNED OUTAGE	3/21/2024 10:46	4,131.67	50
Primary Wire	PLANNED OUTAGE	3/21/2024 9:00	7,658.30	26
Transformer	PLANNED OUTAGE	3/21/2024 12:24	68.87	2
Transformer	PLANNED OUTAGE	3/21/2024 16:54	89.85	3
Transformer Bank	PLANNED OUTAGE	3/21/2024 18:49	116.47	4
None	PLANNED OUTAGE	3/21/2024 21:15	433.07	8
Transformer	PLANNED OUTAGE	3/21/2024 21:52	25.37	1
Transformer	PLANNED OUTAGE	3/21/2024 8:27	128.12	1
Transformer	PLANNED OUTAGE	3/22/2024 11:46	55.07	1
Transformer	PLANNED OUTAGE	3/22/2024 10:55	145.80	6
Transformer	PLANNED OUTAGE	3/22/2024 22:30	1,032.67	8
Transformer	PLANNED OUTAGE	3/25/2024 9:42	54.20	2
Transformer	PLANNED OUTAGE	3/25/2024 10:07	831.87	8

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	3/25/2024 16:39	1,691.67	28
Transformer	PLANNED OUTAGE	3/26/2024 9:38	167.60	2
Transformer	PLANNED OUTAGE	3/26/2024 9:39	29.45	1
Breaker	PLANNED OUTAGE	3/26/2024 10:05	64,963.65	2657
Transformer	PLANNED OUTAGE	4/05/2024 3:21	170.40	4
Transformer	PLANNED OUTAGE	4/05/2024 4:36	42.87	2
Primary Wire	PLANNED OUTAGE	4/05/2024 9:14	3,587.77	37
Transformer Bank	PLANNED OUTAGE	4/05/2024 9:07	621.50	6
Transformer	PLANNED OUTAGE	4/05/2024 9:16	1,096.78	7
Transformer	PLANNED OUTAGE	4/05/2024 9:54	84.35	1
Transformer	PLANNED OUTAGE	4/05/2024 13:17	57.27	1
Transformer	PLANNED OUTAGE	4/06/2024 18:30	118.50	3
Transformer	PLANNED OUTAGE	4/08/2024 11:15	24.35	1
Transformer	PLANNED OUTAGE	4/08/2024 11:16	493.73	8
Transformer	PLANNED OUTAGE	4/08/2024 11:24	24.77	2
Transformer	PLANNED OUTAGE	4/09/2024 1:29	201.30	11
Transformer	PLANNED OUTAGE	4/08/2024 23:43	105.90	2
Transformer	PLANNED OUTAGE	4/09/2024 9:36	698.25	9
Transformer	PLANNED OUTAGE	4/09/2024 9:49	180.55	3
Transformer	PLANNED OUTAGE	4/09/2024 10:14	159.17	5
Transformer	PLANNED OUTAGE	4/09/2024 11:50	349.73	8
Transformer	PLANNED OUTAGE	4/09/2024 13:40	49.77	1
Transformer	PLANNED OUTAGE	4/09/2024 18:14	589.67	10
Transformer	PLANNED OUTAGE	4/10/2024 9:28	1,969.45	7
Transformer	PLANNED OUTAGE	4/10/2024 13:06	191.70	2
Transformer	PLANNED OUTAGE	4/10/2024 10:12	58.00	1
Transformer	PLANNED OUTAGE	4/10/2024 11:13	93.60	2
None	PLANNED OUTAGE	4/11/2024 12:38	2,893.15	39
Breaker	PLANNED OUTAGE	4/11/2024 13:44	838.67	85
Transformer	PLANNED OUTAGE	4/11/2024 10:43	50.40	2
Transformer	PLANNED OUTAGE	4/11/2024 23:29	633.60	11
Transformer	PLANNED OUTAGE	4/11/2024 18:41	2,943.30	6
Transformer	PLANNED OUTAGE	4/11/2024 23:54	345.20	8
Transformer	PLANNED OUTAGE	4/11/2024 21:00	349.48	1
Transformer	PLANNED OUTAGE	4/12/2024 13:31	246.67	10
Transformer	PLANNED OUTAGE	4/04/2024 14:29	145.40	12
Transformer	PLANNED OUTAGE	4/04/2024 15:15	6,291.00	81
Transformer	PLANNED OUTAGE	4/04/2024 17:38	345.45	7
Transformer	PLANNED OUTAGE	4/05/2024 10:35	2.45	1
Transformer Bank	PLANNED OUTAGE	4/05/2024 11:44	213.50	3
Transformer	PLANNED OUTAGE	4/06/2024 18:07	2,325.33	8

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Invalid	PLANNED OUTAGE	4/06/2024 7:15	1,093.37	2
Transformer	PLANNED OUTAGE	4/08/2024 10:36	120.17	5
Transformer	PLANNED OUTAGE	4/08/2024 12:36	473.60	8
Transformer	PLANNED OUTAGE	4/08/2024 14:14	1,695.17	10
Transformer	PLANNED OUTAGE	4/08/2024 21:37	195.07	4
Breaker	PLANNED OUTAGE	4/09/2024 5:18	11,893.20	204
Transformer	PLANNED OUTAGE	4/09/2024 10:48	530.60	12
Transformer	PLANNED OUTAGE	4/09/2024 6:12	436.83	2
PLF	PLANNED OUTAGE	4/09/2024 10:59	60.65	1
None	PLANNED OUTAGE	4/09/2024 8:56	706.10	3
Transformer	PLANNED OUTAGE	4/09/2024 12:27	452.20	7
Transformer	PLANNED OUTAGE	4/09/2024 11:38	183.90	2
Transformer Bank	PLANNED OUTAGE	4/09/2024 17:42	1,796.20	6
Transformer	PLANNED OUTAGE	4/10/2024 0:50	55.25	1
Transformer	PLANNED OUTAGE	4/10/2024 12:15	28.75	5
Transformer	PLANNED OUTAGE	4/10/2024 12:47	87.33	4
Primary Wire	PLANNED OUTAGE	4/10/2024 11:53	1,347.42	19
Transformer	PLANNED OUTAGE	4/10/2024 13:47	55.43	2
PLF	PLANNED OUTAGE	4/10/2024 17:51	198.67	5
Transformer Bank	PLANNED OUTAGE	4/10/2024 16:54	138.80	1
Transformer	PLANNED OUTAGE	4/11/2024 9:10	34.83	2
Transformer	PLANNED OUTAGE	4/11/2024 8:33	141.62	1
Transformer	PLANNED OUTAGE	4/11/2024 10:51	838.50	15
PLF	PLANNED OUTAGE	4/11/2024 16:24	774.20	3
PLF	PLANNED OUTAGE	4/11/2024 17:18	3,025.25	15
Transformer	PLANNED OUTAGE	4/11/2024 21:09	340.07	1
Transformer	PLANNED OUTAGE	4/12/2024 6:18	269.27	7
Transformer	PLANNED OUTAGE	5/07/2024 10:31	204.87	4
Transformer	PLANNED OUTAGE	5/07/2024 11:25	258.00	10
Switch	PLANNED OUTAGE	5/07/2024 9:31	866.35	3
Transformer	PLANNED OUTAGE	5/08/2024 0:06	45.90	3
Transformer	PLANNED OUTAGE	5/08/2024 0:48	148.57	2
None	PLANNED OUTAGE	5/08/2024 10:02	301.07	8
Transformer	PLANNED OUTAGE	5/08/2024 9:41	301.90	2
None	PLANNED OUTAGE	5/08/2024 10:00	685.50	2
Switch	PLANNED OUTAGE	5/08/2024 21:47	144.77	2
PLF	PLANNED OUTAGE	5/08/2024 22:32	123.10	3
Transformer	PLANNED OUTAGE	5/09/2024 0:55	293.10	9
Transformer	PLANNED OUTAGE	5/09/2024 9:46	185.53	4
Transformer	PLANNED OUTAGE	5/09/2024 10:42	500.20	4
PLF	PLANNED OUTAGE	5/09/2024 8:32	8,261.20	24

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	5/09/2024 10:38	806.00	3
Transformer	PLANNED OUTAGE	5/10/2024 8:46	1,087.60	8
Transformer	PLANNED OUTAGE	5/10/2024 9:00	281.50	3
Transformer	PLANNED OUTAGE	5/10/2024 9:45	748.50	5
Transformer	PLANNED OUTAGE	5/11/2024 12:45	48.03	2
Transformer	PLANNED OUTAGE	5/11/2024 13:21	51.82	1
Transformer	PLANNED OUTAGE	5/12/2024 3:28	13.93	1
PLF	PLANNED OUTAGE	5/12/2024 7:44	1,924.00	78
Breaker	PLANNED OUTAGE	5/12/2024 13:17	325.95	1
Breaker	PLANNED OUTAGE	5/12/2024 13:17	321,925.00	978
Breaker	PLANNED OUTAGE	5/12/2024 13:17	329.17	1
Breaker	PLANNED OUTAGE	5/10/2024 15:39	2.80	1
Breaker	PLANNED OUTAGE	5/10/2024 15:39	2.80	1
Breaker	PLANNED OUTAGE	5/10/2024 15:39	2.80	1
Breaker	PLANNED OUTAGE	5/10/2024 15:39	2.80	1
Transformer	PLANNED OUTAGE	5/13/2024 8:53	747.47	8
None	PLANNED OUTAGE	5/13/2024 13:09	163.10	2
None	PLANNED OUTAGE	5/13/2024 13:11	447.70	6
Transformer	PLANNED OUTAGE	5/13/2024 9:48	139.17	5
Transformer	PLANNED OUTAGE	5/14/2024 10:33	120.47	4
Transformer	PLANNED OUTAGE	3/26/2024 11:26	87.90	3
Transformer	PLANNED OUTAGE	3/26/2024 12:10	131.50	6
Transformer	PLANNED OUTAGE	3/27/2024 11:08	41.22	1
PLF	PLANNED OUTAGE	3/27/2024 11:24	999.73	46
Switch	PLANNED OUTAGE	3/27/2024 10:58	297.18	1
PLF	PLANNED OUTAGE	3/27/2024 18:38	829.88	29
Transformer	PLANNED OUTAGE	3/27/2024 19:24	2,843.80	12
PLF	PLANNED OUTAGE	3/28/2024 10:16	131.25	21
Transformer	PLANNED OUTAGE	3/28/2024 12:38	42.30	9
None	PLANNED OUTAGE	3/28/2024 13:11	839.00	12
Transformer	PLANNED OUTAGE	3/28/2024 11:29	206.92	5
Transformer	PLANNED OUTAGE	3/28/2024 13:31	56.90	3
Transformer	PLANNED OUTAGE	3/28/2024 23:44	31.10	3
Transformer	PLANNED OUTAGE	3/29/2024 17:42	572.10	6
Transformer	PLANNED OUTAGE	3/30/2024 18:04	49.35	3
Transformer	PLANNED OUTAGE	3/30/2024 18:46	25.87	1
Transformer	PLANNED OUTAGE	3/31/2024 3:15	22.80	1
Transformer	PLANNED OUTAGE	3/31/2024 12:21	118.20	4
Breaker	PLANNED OUTAGE	4/01/2024 15:25	8.10	1
Transformer	PLANNED OUTAGE	4/01/2024 9:17	989.00	5
Transformer	PLANNED OUTAGE	4/02/2024 10:19	1,133.80	12

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	4/02/2024 11:20	37.20	2
PLF	PLANNED OUTAGE	4/02/2024 11:00	883.92	5
Transformer	PLANNED OUTAGE	4/02/2024 15:39	2,791.03	37
PLF	PLANNED OUTAGE	4/02/2024 23:12	18.02	1
Transformer	PLANNED OUTAGE	4/03/2024 10:17	651.00	6
Breaker	PLANNED OUTAGE	4/04/2024 0:11	10.28	1
Breaker	PLANNED OUTAGE	4/04/2024 0:11	22,983.45	1239
Transformer	PLANNED OUTAGE	4/04/2024 8:43	276.13	2
Transformer Bank	PLANNED OUTAGE	4/04/2024 9:50	43.00	3
Transformer	PLANNED OUTAGE	5/14/2024 9:03	43.50	3
PLF	PLANNED OUTAGE	5/14/2024 8:42	226.70	2
Transformer	PLANNED OUTAGE	5/14/2024 10:48	391.15	3
Transformer	PLANNED OUTAGE	5/14/2024 18:03	23.53	2
Transformer Bank	PLANNED OUTAGE	5/14/2024 18:25	3,191.60	8
Transformer	PLANNED OUTAGE	5/15/2024 7:34	81.60	6
PLF	PLANNED OUTAGE	5/15/2024 8:51	1,114.33	5
Transformer	PLANNED OUTAGE	5/16/2024 7:24	32.75	5
PLF	PLANNED OUTAGE	5/16/2024 8:01	382.32	29
Transformer Bank	PLANNED OUTAGE	5/15/2024 17:49	760.33	2
Transformer	PLANNED OUTAGE	5/16/2024 10:43	90.25	3
Transformer	PLANNED OUTAGE	5/16/2024 10:57	75.60	7
Transformer	PLANNED OUTAGE	5/16/2024 10:03	127.73	4
Transformer	PLANNED OUTAGE	5/16/2024 8:22	403.65	9
None	PLANNED OUTAGE	5/16/2024 8:56	197.90	2
PLF	PLANNED OUTAGE	5/16/2024 9:24	101.45	1
Transformer	PLANNED OUTAGE	5/16/2024 11:39	55.25	3
Service point	PLANNED OUTAGE	5/16/2024 12:03	123.65	1
Switch	PLANNED OUTAGE	5/17/2024 11:55	13.40	1
Transformer	PLANNED OUTAGE	5/17/2024 14:02	10.97	1
Transformer	PLANNED OUTAGE	5/17/2024 14:45	28.27	8
None	PLANNED OUTAGE	5/17/2024 22:50	407.20	4
Secondary Wire	PLANNED OUTAGE	5/18/2024 16:02	7,719.30	27
Breaker	PLANNED OUTAGE	5/19/2024 2:05	7,797.30	1659
PLF	PLANNED OUTAGE	5/20/2024 7:35	67.13	2
Transformer	PLANNED OUTAGE	5/20/2024 9:09	21.48	1
Transformer	PLANNED OUTAGE	5/20/2024 9:45	439.50	5
Transformer	PLANNED OUTAGE	5/20/2024 11:55	49.75	3
Transformer	PLANNED OUTAGE	5/20/2024 12:52	144.40	6
Transformer Bank	PLANNED OUTAGE	5/20/2024 17:15	319.05	1
Transformer Bank	PLANNED OUTAGE	5/21/2024 6:30	2,976.00	6
Transformer	PLANNED OUTAGE	5/21/2024 9:07	512.40	9

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	5/21/2024 10:02	62.65	3
Transformer	PLANNED OUTAGE	4/12/2024 14:04	208.65	9
Transformer	PLANNED OUTAGE	4/13/2024 8:56	816.67	10
Transformer	PLANNED OUTAGE	4/13/2024 21:12	138.90	9
PLF	PLANNED OUTAGE	4/14/2024 9:25	301.97	1
PLF	PLANNED OUTAGE	4/14/2024 9:49	181.23	1
PLF	PLANNED OUTAGE	4/14/2024 9:56	190.30	1
Transformer	PLANNED OUTAGE	4/15/2024 9:40	127.15	3
Transformer	PLANNED OUTAGE	4/15/2024 10:08	194.95	3
Transformer	PLANNED OUTAGE	4/15/2024 10:08	584.60	37
Transformer	PLANNED OUTAGE	4/15/2024 10:33	1,260.00	42
Transformer	PLANNED OUTAGE	4/15/2024 9:11	1,635.78	7
Transformer	PLANNED OUTAGE	4/15/2024 13:37	22.67	1
Transformer	PLANNED OUTAGE	4/15/2024 12:05	91.82	1
Transformer	PLANNED OUTAGE	4/15/2024 12:19	696.90	9
Transformer Bank	PLANNED OUTAGE	4/15/2024 12:39	863.70	9
Transformer	PLANNED OUTAGE	4/16/2024 7:48	1,192.00	15
Transformer	PLANNED OUTAGE	4/16/2024 8:17	51.08	1
Transformer	PLANNED OUTAGE	4/16/2024 8:25	42.87	1
Transformer	PLANNED OUTAGE	4/16/2024 8:12	1,153.47	8
Transformer	PLANNED OUTAGE	4/16/2024 12:06	373.25	5
Transformer	PLANNED OUTAGE	4/16/2024 12:29	338.47	4
Transformer	PLANNED OUTAGE	4/16/2024 7:51	212.33	10
Transformer	PLANNED OUTAGE	4/16/2024 11:39	2,618.20	13
Transformer	PLANNED OUTAGE	4/16/2024 9:24	614.33	2
Transformer	PLANNED OUTAGE	4/16/2024 14:41	97.07	2
Transformer Bank	PLANNED OUTAGE	4/16/2024 22:30	21.20	1
Transformer	PLANNED OUTAGE	4/16/2024 22:11	128.08	1
Transformer Bank	PLANNED OUTAGE	4/17/2024 2:01	184.95	1
PLF	PLANNED OUTAGE	4/16/2024 22:58	265.55	1
Transformer	PLANNED OUTAGE	4/17/2024 10:47	97.47	4
Transformer	PLANNED OUTAGE	4/17/2024 11:26	77.33	4
Transformer	PLANNED OUTAGE	4/17/2024 8:28	2,709.58	7
Transformer	PLANNED OUTAGE	4/17/2024 12:27	162.60	3
None	PLANNED OUTAGE	4/12/2024 10:22	462.53	8
Transformer	PLANNED OUTAGE	4/12/2024 11:55	417.50	6
Transformer	PLANNED OUTAGE	4/12/2024 13:19	52.50	5
Transformer	PLANNED OUTAGE	4/12/2024 19:51	130.50	6
None	PLANNED OUTAGE	4/13/2024 10:36	4.33	1
Primary Wire	PLANNED OUTAGE	4/13/2024 12:18	42.83	2
Transformer	PLANNED OUTAGE	4/14/2024 3:35	238.95	9

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Primary Wire	PLANNED OUTAGE	4/14/2024 8:05	468.20	2
Transformer	PLANNED OUTAGE	4/14/2024 19:21	7,779.75	15
Transformer	PLANNED OUTAGE	4/15/2024 10:33	1,229.35	23
Transformer	PLANNED OUTAGE	4/15/2024 11:49	216.10	2
Transformer	PLANNED OUTAGE	4/15/2024 10:15	605.40	6
Transformer	PLANNED OUTAGE	4/15/2024 13:36	54.80	2
Transformer	PLANNED OUTAGE	4/15/2024 14:13	525.20	6
Transformer	PLANNED OUTAGE	4/15/2024 12:13	1,231.33	10
Transformer	PLANNED OUTAGE	4/15/2024 17:36	3,712.50	22
Transformer	PLANNED OUTAGE	4/16/2024 9:14	490.60	2
Transformer	PLANNED OUTAGE	4/16/2024 9:15	979.47	4
Transformer	PLANNED OUTAGE	4/16/2024 12:04	35.73	1
Transformer	PLANNED OUTAGE	4/16/2024 8:17	803.20	4
Transformer	PLANNED OUTAGE	4/16/2024 9:06	801.40	2
Transformer	PLANNED OUTAGE	4/16/2024 15:53	73.15	7
Transformer	PLANNED OUTAGE	4/16/2024 18:07	124.10	3
Transformer	PLANNED OUTAGE	4/17/2024 8:40	419.50	5
Transformer	PLANNED OUTAGE	4/17/2024 9:04	426.00	5
Transformer	PLANNED OUTAGE	4/17/2024 12:03	572.25	9
Transformer	PLANNED OUTAGE	4/17/2024 12:03	437.10	6
Transformer	PLANNED OUTAGE	4/17/2024 12:52	250.00	10
PLF	PLANNED OUTAGE	4/17/2024 9:44	209.02	1
Breaker	PLANNED OUTAGE	4/17/2024 15:28	3,129.87	776
Transformer	PLANNED OUTAGE	4/17/2024 19:21	153.20	3
Breaker	PLANNED OUTAGE	4/17/2024 15:28	4.03	1
Transformer	PLANNED OUTAGE	4/18/2024 9:51	129.33	5
Transformer	PLANNED OUTAGE	4/04/2024 12:28	235.07	4
Transformer	PLANNED OUTAGE	4/04/2024 11:02	646.50	9
Transformer	PLANNED OUTAGE	4/03/2024 14:24	1,253.87	8
PLF	PLANNED OUTAGE	4/03/2024 16:31	2,976.67	4
PLF	PLANNED OUTAGE	4/04/2024 21:52	274.10	2
Transformer	PLANNED OUTAGE	4/05/2024 0:46	5.20	2
Transformer	PLANNED OUTAGE	4/05/2024 13:42	1,007.63	38
Transformer	PLANNED OUTAGE	4/05/2024 14:53	125.07	2
Transformer	PLANNED OUTAGE	4/05/2024 17:58	74.13	1
Transformer	PLANNED OUTAGE	4/06/2024 2:53	25.17	1
None	PLANNED OUTAGE	4/06/2024 14:04	699.20	6
Transformer	PLANNED OUTAGE	4/06/2024 17:07	54.00	12
Transformer	PLANNED OUTAGE	4/07/2024 14:11	126.80	3
Transformer	PLANNED OUTAGE	4/08/2024 9:49	85.75	3
Transformer	PLANNED OUTAGE	4/08/2024 14:38	118.83	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	4/08/2024 12:58	768.35	11
Transformer	PLANNED OUTAGE	4/09/2024 10:53	425.40	9
Transformer	PLANNED OUTAGE	4/09/2024 10:29	148.07	2
Transformer	PLANNED OUTAGE	4/09/2024 8:57	470.25	9
Transformer	PLANNED OUTAGE	4/09/2024 8:46	218.83	5
Transformer	PLANNED OUTAGE	4/09/2024 13:17	338.13	16
Transformer	PLANNED OUTAGE	4/09/2024 13:18	8.28	1
Transformer	PLANNED OUTAGE	4/09/2024 11:09	1,957.80	13
Transformer	PLANNED OUTAGE	4/09/2024 14:08	24.37	17
Transformer Bank	PLANNED OUTAGE	4/09/2024 14:56	22.67	4
Transformer	PLANNED OUTAGE	4/09/2024 21:24	131.37	7
Transformer	PLANNED OUTAGE	4/10/2024 11:08	65.30	3
Transformer	PLANNED OUTAGE	4/10/2024 13:17	147.23	7
Service point	PLANNED OUTAGE	4/10/2024 12:29	27.72	1
Transformer	PLANNED OUTAGE	4/10/2024 8:47	1,258.67	10
Transformer	PLANNED OUTAGE	4/10/2024 11:05	1,261.52	7
Transformer	PLANNED OUTAGE	4/10/2024 21:56	305.67	4
None	PLANNED OUTAGE	4/11/2024 9:12	507.60	9
Transformer	PLANNED OUTAGE	4/17/2024 12:34	33.80	3
Transformer	PLANNED OUTAGE	4/17/2024 13:35	121.10	2
Transformer	PLANNED OUTAGE	4/17/2024 14:14	67.60	3
Breaker	PLANNED OUTAGE	4/17/2024 15:28	4.03	1
Breaker	PLANNED OUTAGE	4/17/2024 15:28	4.03	1
Breaker	PLANNED OUTAGE	4/17/2024 15:28	4.03	1
Breaker	PLANNED OUTAGE	4/17/2024 15:28	4.03	1
PLF	PLANNED OUTAGE	4/18/2024 8:54	2,117.85	21
Transformer Bank	PLANNED OUTAGE	4/18/2024 9:04	691.20	9
None	PLANNED OUTAGE	4/18/2024 11:05	7.40	1
Transformer	PLANNED OUTAGE	4/18/2024 8:37	57.80	3
Primary Wire	PLANNED OUTAGE	4/18/2024 11:15	924.92	11
Service point	PLANNED OUTAGE	4/18/2024 17:51	227.80	1
Transformer Bank	PLANNED OUTAGE	4/19/2024 9:07	3,819.15	9
PLF	PLANNED OUTAGE	4/19/2024 15:43	1,636.10	6
PLF	PLANNED OUTAGE	4/20/2024 18:45	208.60	4
None	PLANNED OUTAGE	4/20/2024 18:27	1,626.70	6
PLF	PLANNED OUTAGE	4/21/2024 3:11	163.65	3
Service point	PLANNED OUTAGE	4/22/2024 2:16	12.12	1
Transformer	PLANNED OUTAGE	4/22/2024 4:00	189.58	5
Secondary Wire	PLANNED OUTAGE	4/22/2024 16:37	593.43	1
Transformer Bank	PLANNED OUTAGE	4/22/2024 9:22	126.23	2
Transformer	PLANNED OUTAGE	4/23/2024 10:47	226.73	4

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	4/23/2024 9:03	168.57	1
Transformer	PLANNED OUTAGE	4/23/2024 12:09	320.23	2
Transformer	PLANNED OUTAGE	4/23/2024 8:29	3,398.33	10
Transformer	PLANNED OUTAGE	4/24/2024 8:31	378.90	3
Transformer	PLANNED OUTAGE	4/24/2024 11:04	129.87	4
Transformer	PLANNED OUTAGE	4/24/2024 8:42	465.70	6
Transformer	PLANNED OUTAGE	4/24/2024 13:45	3.32	1
Transformer	PLANNED OUTAGE	4/25/2024 0:10	52.50	2
Transformer	PLANNED OUTAGE	4/25/2024 1:02	82.00	4
Transformer	PLANNED OUTAGE	4/25/2024 9:05	178.27	4
Transformer	PLANNED OUTAGE	5/21/2024 10:14	414.27	8
Transformer	PLANNED OUTAGE	5/21/2024 11:29	370.10	3
Primary Wire	PLANNED OUTAGE	5/21/2024 9:09	6,793.20	24
Transformer Bank	PLANNED OUTAGE	5/21/2024 8:21	3,334.05	9
PLF	PLANNED OUTAGE	5/21/2024 21:40	2,213.75	21
Transformer	PLANNED OUTAGE	5/22/2024 8:50	296.45	21
Transformer	PLANNED OUTAGE	5/22/2024 9:19	56.90	3
Transformer	PLANNED OUTAGE	5/22/2024 8:08	421.10	2
None	PLANNED OUTAGE	5/22/2024 8:51	321.35	1
Transformer	PLANNED OUTAGE	5/22/2024 13:32	887.50	5
PLF	PLANNED OUTAGE	5/22/2024 16:13	2,541.93	52
Transformer Bank	PLANNED OUTAGE	5/22/2024 18:14	26.60	1
Transformer	PLANNED OUTAGE	5/22/2024 23:09	128.35	1
Transformer	PLANNED OUTAGE	5/22/2024 18:09	1,232.23	2
Transformer	PLANNED OUTAGE	5/23/2024 7:32	92.40	4
Transformer	PLANNED OUTAGE	5/23/2024 8:50	101.43	1
Transformer Bank	PLANNED OUTAGE	5/23/2024 11:27	225.53	4
Transformer Bank	PLANNED OUTAGE	5/23/2024 21:01	19.07	1
Transformer	PLANNED OUTAGE	5/24/2024 3:51	103.50	3
PLF	PLANNED OUTAGE	5/24/2024 8:56	933.25	15
None	PLANNED OUTAGE	5/25/2024 1:24	345.60	9
Transformer	PLANNED OUTAGE	5/25/2024 9:13	1,745.50	6
Transformer	PLANNED OUTAGE	5/27/2024 13:37	15.60	4
Transformer	PLANNED OUTAGE	5/28/2024 8:09	554.70	6
Transformer	PLANNED OUTAGE	5/28/2024 9:43	580.23	13
Transformer	PLANNED OUTAGE	5/28/2024 9:12	115.25	3
None	PLANNED OUTAGE	5/28/2024 10:27	116.32	1
Transformer	PLANNED OUTAGE	5/28/2024 11:42	253.20	9
Breaker	PLANNED OUTAGE	5/29/2024 6:57	1.77	1
Breaker	PLANNED OUTAGE	5/29/2024 8:12	1,076.67	95
None	PLANNED OUTAGE	5/29/2024 10:47	131.93	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	4/18/2024 10:32	125.20	6
Transformer	PLANNED OUTAGE	4/18/2024 10:43	100.23	2
Transformer	PLANNED OUTAGE	4/18/2024 11:48	502.95	7
None	PLANNED OUTAGE	4/18/2024 18:44	650.27	8
Breaker	PLANNED OUTAGE	4/18/2024 21:44	14,887.47	1642
PLF	PLANNED OUTAGE	4/18/2024 22:05	808.35	3
Primary Wire	PLANNED OUTAGE	4/19/2024 9:37	795.20	12
Transformer	PLANNED OUTAGE	4/19/2024 9:10	412.40	12
PLF	PLANNED OUTAGE	4/19/2024 12:44	121.33	5
Transformer	PLANNED OUTAGE	4/19/2024 23:13	74.98	1
Recloser	PLANNED OUTAGE	4/20/2024 5:43	1,226.25	27
Transformer	PLANNED OUTAGE	4/20/2024 17:38	238.50	10
Transformer	PLANNED OUTAGE	4/20/2024 20:59	20.55	3
Transformer	PLANNED OUTAGE	4/20/2024 22:58	373.73	8
OCR, Sec.	PLANNED OUTAGE	4/21/2024 1:29	315.73	2
Transformer	PLANNED OUTAGE	4/22/2024 0:12	25.53	4
None	PLANNED OUTAGE	4/22/2024 8:42	8.02	1
Transformer Bank	PLANNED OUTAGE	4/22/2024 11:06	38.92	1
Transformer	PLANNED OUTAGE	4/22/2024 13:12	34.37	2
PLF	PLANNED OUTAGE	4/22/2024 16:10	1,194.15	19
Breaker	PLANNED OUTAGE	4/23/2024 9:33	10,571.17	1190
Transformer	PLANNED OUTAGE	4/23/2024 8:45	122.88	1
Transformer	PLANNED OUTAGE	4/24/2024 0:31	132.73	4
Transformer	PLANNED OUTAGE	4/24/2024 9:51	739.33	8
Transformer	PLANNED OUTAGE	4/24/2024 9:54	309.45	3
Transformer	PLANNED OUTAGE	4/24/2024 13:24	24.80	2
Transformer	PLANNED OUTAGE	4/24/2024 11:33	966.50	6
Breaker	PLANNED OUTAGE	4/23/2024 9:33	11.40	1
Transformer	PLANNED OUTAGE	4/23/2024 8:47	1,453.20	12
Transformer	PLANNED OUTAGE	4/25/2024 8:31	911.52	7
Transformer	PLANNED OUTAGE	4/25/2024 9:50	64.27	8
Transformer	PLANNED OUTAGE	4/25/2024 9:35	515.33	2
PLF	PLANNED OUTAGE	4/25/2024 10:09	603.93	4
PLF	PLANNED OUTAGE	4/11/2024 10:11	349.65	9
Transformer	PLANNED OUTAGE	4/11/2024 8:26	278.12	11
Transformer	PLANNED OUTAGE	4/11/2024 8:54	1,224.00	16
Transformer	PLANNED OUTAGE	4/11/2024 9:47	21.57	1
PLF	PLANNED OUTAGE	4/11/2024 9:42	1,448.83	10
Transformer	PLANNED OUTAGE	4/11/2024 9:16	41.07	14
Transformer Bank	PLANNED OUTAGE	4/11/2024 15:47	390.87	2
Transformer	PLANNED OUTAGE	4/11/2024 21:53	268.40	6

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	4/12/2024 5:30	29.83	10
Service - Crew	PLANNED OUTAGE	4/12/2024 2:55	3,377.10	9
PLF	PLANNED OUTAGE	4/12/2024 8:57	99.93	1
Transformer	PLANNED OUTAGE	4/12/2024 10:06	95.33	1
Transformer	PLANNED OUTAGE	4/12/2024 15:35	130.70	3
Transformer	PLANNED OUTAGE	4/12/2024 13:06	409.45	3
PLF	PLANNED OUTAGE	4/12/2024 14:11	176.90	3
None	PLANNED OUTAGE	4/13/2024 10:31	1,163.90	309
Transformer	PLANNED OUTAGE	4/14/2024 13:42	87.95	3
Primary Wire	PLANNED OUTAGE	4/14/2024 23:39	9,523.62	41
Transformer	PLANNED OUTAGE	4/15/2024 4:43	42.80	2
Transformer	PLANNED OUTAGE	4/15/2024 11:29	807.90	3
Transformer	PLANNED OUTAGE	4/15/2024 8:38	100.67	8
Transformer	PLANNED OUTAGE	4/15/2024 10:52	11.07	8
Transformer	PLANNED OUTAGE	4/15/2024 10:56	196.67	8
Service point	PLANNED OUTAGE	4/15/2024 14:26	13.37	1
Transformer	PLANNED OUTAGE	4/15/2024 14:28	28.90	1
Transformer	PLANNED OUTAGE	4/15/2024 23:10	9.55	1
Transformer	PLANNED OUTAGE	4/15/2024 23:11	40.37	2
Service point	PLANNED OUTAGE	4/15/2024 23:47	79.40	1
Transformer Bank	PLANNED OUTAGE	4/16/2024 9:05	78.47	1
Transformer	PLANNED OUTAGE	4/16/2024 10:52	83.53	4
Transformer	PLANNED OUTAGE	4/16/2024 13:04	68.13	7
Transformer Bank	PLANNED OUTAGE	4/16/2024 8:40	353.67	1
None	PLANNED OUTAGE	4/16/2024 18:14	871.27	4
Transformer	PLANNED OUTAGE	5/29/2024 8:40	112.25	3
Transformer	PLANNED OUTAGE	5/29/2024 9:52	68.22	1
Transformer Bank	PLANNED OUTAGE	5/29/2024 10:42	662.67	8
Transformer	PLANNED OUTAGE	5/29/2024 9:22	375.82	1
Transformer	PLANNED OUTAGE	5/29/2024 12:04	2,318.50	5
Transformer	PLANNED OUTAGE	5/29/2024 7:46	3,363.03	7
Transformer	PLANNED OUTAGE	5/30/2024 9:58	343.07	4
Transformer	PLANNED OUTAGE	5/30/2024 10:39	69.67	4
Transformer	PLANNED OUTAGE	5/30/2024 10:56	33.17	2
Transformer	PLANNED OUTAGE	5/30/2024 8:28	148.70	6
Transformer	PLANNED OUTAGE	5/30/2024 9:29	544.50	10
Transformer	PLANNED OUTAGE	5/30/2024 9:31	119.90	11
Transformer Bank	PLANNED OUTAGE	5/30/2024 9:45	217.33	1
PLF	PLANNED OUTAGE	5/30/2024 10:22	5,455.63	22
Breaker	PLANNED OUTAGE	5/30/2024 9:58	226.62	1
Transformer	PLANNED OUTAGE	5/30/2024 11:29	146.40	6

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer Bank	PLANNED OUTAGE	5/30/2024 15:14	177.47	8
Transformer	PLANNED OUTAGE	5/30/2024 18:28	407.20	6
Transformer	PLANNED OUTAGE	5/30/2024 15:39	3,557.43	41
Switch	PLANNED OUTAGE	5/30/2024 15:38	53,056.40	184
PLF	PLANNED OUTAGE	5/31/2024 3:07	644.25	9
Transformer	PLANNED OUTAGE	5/31/2024 8:30	56.70	6
PLF	PLANNED OUTAGE	5/31/2024 13:11	314.27	8
Transformer	PLANNED OUTAGE	5/31/2024 10:15	1,211.55	9
Transformer	PLANNED OUTAGE	5/31/2024 16:55	256.08	7
Transformer Bank	PLANNED OUTAGE	5/31/2024 14:44	700.50	2
None	PLANNED OUTAGE	6/01/2024 8:54	3,769.33	22
None	PLANNED OUTAGE	6/01/2024 8:48	6,755.77	38
Transformer Bank	PLANNED OUTAGE	6/01/2024 14:28	168.60	2
Breaker	PLANNED OUTAGE	6/01/2024 16:10	12,313.60	1536
Transformer	PLANNED OUTAGE	6/01/2024 23:18	10.33	1
Transformer	PLANNED OUTAGE	6/02/2024 15:56	62.83	5
Transformer	PLANNED OUTAGE	6/02/2024 16:40	72.87	4
Transformer	PLANNED OUTAGE	4/25/2024 8:43	2,962.30	33
Transformer	PLANNED OUTAGE	4/25/2024 10:27	137.10	9
Transformer	PLANNED OUTAGE	4/25/2024 10:13	2,082.40	8
Transformer	PLANNED OUTAGE	4/25/2024 10:53	129.00	1
Transformer	PLANNED OUTAGE	4/25/2024 10:47	1,352.50	10
Transformer	PLANNED OUTAGE	4/26/2024 1:36	18.62	1
Transformer	PLANNED OUTAGE	4/26/2024 12:48	57.50	3
Transformer	PLANNED OUTAGE	4/26/2024 13:16	63.00	3
Transformer	PLANNED OUTAGE	4/26/2024 13:45	22.93	1
Transformer	PLANNED OUTAGE	4/26/2024 23:36	161.55	9
Transformer	PLANNED OUTAGE	4/27/2024 0:07	130.10	3
Transformer	PLANNED OUTAGE	4/27/2024 18:37	140.67	5
Breaker	PLANNED OUTAGE	4/27/2024 20:34	5,488.45	17
Transformer	PLANNED OUTAGE	4/27/2024 19:57	567.35	3
Transformer	PLANNED OUTAGE	4/28/2024 20:25	1.00	1
Transformer	PLANNED OUTAGE	4/29/2024 11:32	5,885.32	13
Transformer	PLANNED OUTAGE	4/29/2024 10:23	284.70	6
Transformer	PLANNED OUTAGE	4/30/2024 10:05	228.53	16
Transformer	PLANNED OUTAGE	4/30/2024 8:57	212.80	6
Transformer	PLANNED OUTAGE	4/30/2024 13:51	43.52	1
Transformer Bank	PLANNED OUTAGE	4/30/2024 14:41	118.00	5
Transformer	PLANNED OUTAGE	4/30/2024 9:18	371.45	1
Transformer	PLANNED OUTAGE	4/30/2024 15:01	117.20	6
Transformer	PLANNED OUTAGE	4/30/2024 21:47	49.20	6

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	4/30/2024 21:35	834.63	7
Transformer	PLANNED OUTAGE	5/01/2024 9:47	51.33	4
Transformer Bank	PLANNED OUTAGE	5/01/2024 12:36	211.75	3
PLF	PLANNED OUTAGE	5/01/2024 10:35	101.95	1
Transformer	PLANNED OUTAGE	5/01/2024 14:02	163.90	11
Transformer	PLANNED OUTAGE	5/01/2024 13:22	195.75	3
Transformer	PLANNED OUTAGE	5/01/2024 14:15	141.80	4
None	PLANNED OUTAGE	5/02/2024 3:18	312.60	6
None	PLANNED OUTAGE	5/02/2024 1:31	667.20	8
Transformer	PLANNED OUTAGE	4/16/2024 21:16	27.02	1
Transformer	PLANNED OUTAGE	4/17/2024 10:13	77.65	3
Transformer	PLANNED OUTAGE	4/17/2024 10:28	95.20	3
Transformer	PLANNED OUTAGE	4/17/2024 11:20	218.67	8
Transformer	PLANNED OUTAGE	4/17/2024 13:50	44.93	1
Transformer	PLANNED OUTAGE	4/17/2024 13:53	68.70	3
Transformer Bank	PLANNED OUTAGE	4/17/2024 13:56	369.00	6
Transformer	PLANNED OUTAGE	4/17/2024 9:53	582.20	6
Transformer	PLANNED OUTAGE	4/17/2024 17:14	600.60	9
None	PLANNED OUTAGE	4/17/2024 22:10	1,152.50	6
Transformer	PLANNED OUTAGE	4/18/2024 1:22	65.22	1
None	PLANNED OUTAGE	4/18/2024 9:58	88.08	1
None	PLANNED OUTAGE	4/18/2024 9:58	3,479.23	91
None	PLANNED OUTAGE	4/18/2024 10:41	3,757.60	84
Transformer	PLANNED OUTAGE	4/18/2024 10:11	231.60	8
Transformer	PLANNED OUTAGE	4/18/2024 8:36	2,691.33	8
PLF	PLANNED OUTAGE	4/19/2024 14:18	267.73	16
Transformer Bank	PLANNED OUTAGE	4/20/2024 0:26	79.45	3
Transformer	PLANNED OUTAGE	4/20/2024 0:27	204.67	8
OH Other	PLANNED OUTAGE	4/20/2024 5:52	7,364.00	1315
OCR, Sec.	PLANNED OUTAGE	4/21/2024 1:29	315.30	2
OCR, Sec.	PLANNED OUTAGE	4/21/2024 1:29	8,921.73	553
OCR, Sec.	PLANNED OUTAGE	4/21/2024 1:29	13,062.82	83
PLF	PLANNED OUTAGE	4/21/2024 17:02	4,074.90	34
Transformer	PLANNED OUTAGE	4/21/2024 19:49	1,396.20	9
None	PLANNED OUTAGE	4/22/2024 10:19	895.77	11
PLF	PLANNED OUTAGE	4/23/2024 1:19	9,044.00	40
Service point	PLANNED OUTAGE	4/23/2024 4:50	16.50	1
Transformer	PLANNED OUTAGE	4/23/2024 1:19	1,367.60	6
Transformer	PLANNED OUTAGE	4/23/2024 11:48	7.03	1
Transformer Bank	PLANNED OUTAGE	4/23/2024 9:30	11.60	2
Transformer	PLANNED OUTAGE	4/23/2024 9:39	609.60	2

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Primary Wire	PLANNED OUTAGE	4/24/2024 9:09	126.47	4
Transformer	PLANNED OUTAGE	4/25/2024 10:47	427.90	6
PLF	PLANNED OUTAGE	4/25/2024 17:58	153.18	7
Transformer	PLANNED OUTAGE	4/25/2024 19:49	108.87	23
Transformer	PLANNED OUTAGE	4/26/2024 12:34	156.67	2
Transformer	PLANNED OUTAGE	4/26/2024 12:18	398.80	4
Transformer	PLANNED OUTAGE	4/26/2024 22:16	101.55	3
Primary Wire	PLANNED OUTAGE	4/27/2024 19:57	585.00	3
Transformer	PLANNED OUTAGE	4/27/2024 20:12	813.07	8
Breaker	PLANNED OUTAGE	4/27/2024 20:34	69.83	1
Breaker	PLANNED OUTAGE	4/27/2024 20:34	16,783.87	52
Transformer	PLANNED OUTAGE	4/29/2024 8:48	1,629.33	16
Transformer	PLANNED OUTAGE	4/29/2024 17:32	165.92	11
Transformer	PLANNED OUTAGE	4/29/2024 23:40	164.43	2
Transformer	PLANNED OUTAGE	4/30/2024 9:42	2,735.25	7
Transformer	PLANNED OUTAGE	4/30/2024 11:35	107.55	9
Transformer	PLANNED OUTAGE	4/30/2024 10:04	61.13	2
Transformer	PLANNED OUTAGE	4/30/2024 11:01	105.07	2
Transformer	PLANNED OUTAGE	4/30/2024 10:11	293.60	6
PLF	PLANNED OUTAGE	4/30/2024 16:32	492.77	2
Transformer	PLANNED OUTAGE	5/01/2024 0:20	12.58	1
Transformer	PLANNED OUTAGE	5/01/2024 10:06	116.10	3
Breaker	PLANNED OUTAGE	5/01/2024 11:36	7,765.33	1820
Breaker	PLANNED OUTAGE	5/01/2024 11:36	4.27	1
Transformer Bank	PLANNED OUTAGE	5/01/2024 16:03	16.70	2
Transformer	PLANNED OUTAGE	5/01/2024 19:09	18.97	1
Breaker	PLANNED OUTAGE	5/01/2024 11:36	4.27	1
Breaker	PLANNED OUTAGE	5/01/2024 11:36	4.27	1
PLF	PLANNED OUTAGE	5/02/2024 9:16	76.80	12
Transformer	PLANNED OUTAGE	5/02/2024 8:01	1,107.20	12
Primary Wire	PLANNED OUTAGE	5/02/2024 8:28	1,965.15	11
Transformer	PLANNED OUTAGE	5/02/2024 11:32	100.53	4
Transformer	PLANNED OUTAGE	5/02/2024 13:56	29.40	2
Transformer	PLANNED OUTAGE	5/03/2024 5:39	431.55	7
Breaker	PLANNED OUTAGE	5/01/2024 11:36	4.27	1
None	PLANNED OUTAGE	5/02/2024 8:04	63.90	9
Transformer	PLANNED OUTAGE	5/02/2024 10:10	32.98	1
None	PLANNED OUTAGE	5/02/2024 9:46	8,248.53	37
Transformer	PLANNED OUTAGE	5/02/2024 9:52	115.90	3
Transformer	PLANNED OUTAGE	5/02/2024 21:05	222.40	12
Transformer	PLANNED OUTAGE	5/03/2024 13:41	28.40	6

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	5/03/2024 14:07	1,381.67	10
Transformer	PLANNED OUTAGE	5/05/2024 14:44	99.65	3
Breaker	PLANNED OUTAGE	5/04/2024 22:19	9,640.63	523
Transformer	PLANNED OUTAGE	5/04/2024 23:18	891.83	10
PLF	PLANNED OUTAGE	5/06/2024 8:37	66.43	1
Transformer	PLANNED OUTAGE	5/06/2024 8:58	214.60	4
Transformer	PLANNED OUTAGE	5/06/2024 17:32	33.53	2
Transformer	PLANNED OUTAGE	5/06/2024 17:37	35.30	3
Breaker	PLANNED OUTAGE	5/04/2024 22:19	18.42	1
PLF	PLANNED OUTAGE	5/07/2024 9:37	97.23	1
Transformer	PLANNED OUTAGE	5/07/2024 9:46	105.33	2
Transformer Bank	PLANNED OUTAGE	5/07/2024 10:01	22.42	5
Transformer	PLANNED OUTAGE	5/07/2024 10:07	50.43	1
Transformer	PLANNED OUTAGE	5/07/2024 13:47	155.17	2
Transformer	PLANNED OUTAGE	5/07/2024 12:02	199.80	1
Transformer Bank	PLANNED OUTAGE	5/07/2024 21:59	1,699.00	15
Transformer Bank	PLANNED OUTAGE	5/08/2024 6:33	141.00	6
Transformer	PLANNED OUTAGE	5/08/2024 9:56	864.80	6
Transformer	PLANNED OUTAGE	5/08/2024 14:27	70.13	4
Transformer	PLANNED OUTAGE	5/08/2024 16:37	486.80	6
Transformer	PLANNED OUTAGE	5/09/2024 10:52	20.65	3
Transformer	PLANNED OUTAGE	5/09/2024 10:59	104.25	3
Transformer	PLANNED OUTAGE	5/09/2024 10:48	6.15	3
Transformer	PLANNED OUTAGE	5/09/2024 10:50	3.00	3
Transformer	PLANNED OUTAGE	5/09/2024 10:39	311.20	6
Transformer	PLANNED OUTAGE	5/10/2024 3:11	1,447.50	10
Primary Wire	PLANNED OUTAGE	4/24/2024 9:10	267.58	13
Transformer Bank	PLANNED OUTAGE	4/24/2024 9:17	1,043.33	10
Transformer	PLANNED OUTAGE	4/24/2024 12:05	189.00	9
Transformer	PLANNED OUTAGE	4/24/2024 12:28	31.48	1
Transformer	PLANNED OUTAGE	4/24/2024 12:11	785.57	2
Breaker	PLANNED OUTAGE	4/23/2024 9:33	11.12	1
Breaker	PLANNED OUTAGE	4/23/2024 9:33	11.18	1
Breaker	PLANNED OUTAGE	4/23/2024 9:33	11.23	1
Breaker	PLANNED OUTAGE	4/23/2024 9:33	11.30	1
Transformer	PLANNED OUTAGE	4/25/2024 8:41	641.33	16
Transformer	PLANNED OUTAGE	4/25/2024 9:06	491.93	2
None	PLANNED OUTAGE	4/25/2024 16:10	61.08	1
Transformer	PLANNED OUTAGE	4/26/2024 10:05	678.33	11
Transformer	PLANNED OUTAGE	4/26/2024 10:12	57.83	2
Transformer	PLANNED OUTAGE	4/26/2024 12:17	1,682.00	8

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Primary Wire	PLANNED OUTAGE	4/26/2024 12:08	379.53	2
PLF	PLANNED OUTAGE	4/27/2024 11:12	6,522.13	28
Transformer	PLANNED OUTAGE	4/27/2024 16:49	23.47	8
Primary Wire	PLANNED OUTAGE	4/27/2024 22:52	59.85	3
PLF	PLANNED OUTAGE	4/27/2024 23:00	379.02	1
PLF	PLANNED OUTAGE	4/27/2024 23:00	1,131.15	3
UG Other	PLANNED OUTAGE	4/27/2024 8:07	463.23	1
PLF	PLANNED OUTAGE	4/29/2024 8:23	673.45	3
Transformer	PLANNED OUTAGE	4/29/2024 14:39	75.23	1
Transformer	PLANNED OUTAGE	4/29/2024 11:38	1,660.27	8
PLF	PLANNED OUTAGE	4/29/2024 19:34	235.03	1
Transformer	PLANNED OUTAGE	4/29/2024 21:13	306.40	12
Transformer	PLANNED OUTAGE	4/29/2024 22:33	78.25	3
Service point	PLANNED OUTAGE	4/30/2024 8:41	217.37	1
Transformer	PLANNED OUTAGE	4/30/2024 9:37	278.60	1
Transformer	PLANNED OUTAGE	4/30/2024 15:37	126.70	7
Service point	PLANNED OUTAGE	4/30/2024 20:02	18.50	1
Transformer	PLANNED OUTAGE	5/01/2024 9:08	306.80	8
Transformer Bank	PLANNED OUTAGE	6/03/2024 9:09	787.77	2
None	PLANNED OUTAGE	6/03/2024 20:30	9.83	1
None	PLANNED OUTAGE	6/03/2024 20:30	8.60	1
PLF	PLANNED OUTAGE	6/04/2024 8:21	7.50	1
Transformer	PLANNED OUTAGE	6/04/2024 10:19	54.67	2
Transformer	PLANNED OUTAGE	6/04/2024 10:59	794.80	8
PLF	PLANNED OUTAGE	6/04/2024 13:47	908.42	11
None	PLANNED OUTAGE	6/04/2024 16:53	803.60	8
None	PLANNED OUTAGE	6/04/2024 0:55	10,669.28	7
Transformer	PLANNED OUTAGE	6/04/2024 20:03	1,403.20	6
Transformer	PLANNED OUTAGE	6/04/2024 22:05	355.95	3
PLF	PLANNED OUTAGE	6/05/2024 6:10	149.05	3
Transformer	PLANNED OUTAGE	6/05/2024 10:24	143.67	4
Transformer	PLANNED OUTAGE	6/05/2024 10:45	55.60	2
Service point	PLANNED OUTAGE	6/05/2024 12:17	13.35	1
Transformer	PLANNED OUTAGE	6/05/2024 13:12	96.67	5
PLF	PLANNED OUTAGE	6/05/2024 13:50	27.77	2
None	PLANNED OUTAGE	6/05/2024 11:15	208.42	5
Transformer Bank	PLANNED OUTAGE	6/05/2024 8:49	541.80	2
Switch	PLANNED OUTAGE	6/05/2024 15:19	111.90	1
Transformer	PLANNED OUTAGE	6/06/2024 0:04	50.52	1
Transformer	PLANNED OUTAGE	6/06/2024 11:59	116.43	7
None	PLANNED OUTAGE	6/06/2024 8:58	9,896.25	65

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	6/06/2024 8:56	1,549.42	5
Transformer	PLANNED OUTAGE	6/07/2024 8:59	356.00	4
Transformer	PLANNED OUTAGE	6/07/2024 11:31	1,092.70	6
Transformer	PLANNED OUTAGE	6/07/2024 14:29	31.12	1
Transformer	PLANNED OUTAGE	6/07/2024 18:43	36.53	2
Transformer	PLANNED OUTAGE	6/07/2024 19:32	441.20	8
Transformer	PLANNED OUTAGE	6/08/2024 0:16	55.35	3
Transformer	PLANNED OUTAGE	6/08/2024 11:58	79.50	3
Breaker	PLANNED OUTAGE	6/09/2024 4:18	9.93	1
None	PLANNED OUTAGE	5/03/2024 12:44	149.27	4
Transformer	PLANNED OUTAGE	5/03/2024 12:22	246.30	2
Transformer	PLANNED OUTAGE	5/04/2024 5:33	32.37	1
None	PLANNED OUTAGE	5/05/2024 23:02	413.60	12
Invalid	PLANNED OUTAGE	5/04/2024 8:16	480.63	1
Transformer	PLANNED OUTAGE	5/06/2024 10:42	202.80	9
PLF	PLANNED OUTAGE	5/06/2024 10:03	256.27	1
Transformer	PLANNED OUTAGE	5/06/2024 11:20	144.55	1
PLF	PLANNED OUTAGE	5/06/2024 19:35	1,340.73	52
Transformer	PLANNED OUTAGE	5/06/2024 19:00	1,117.07	2
Switch	PLANNED OUTAGE	5/06/2024 12:06	14,400.00	300
Primary Wire	PLANNED OUTAGE	5/07/2024 9:17	820.00	25
Transformer	PLANNED OUTAGE	5/07/2024 9:19	21.83	10
Transformer	PLANNED OUTAGE	5/07/2024 10:28	125.00	5
Breaker	PLANNED OUTAGE	4/07/2024 19:41	6,864.00	156
Transformer	PLANNED OUTAGE	5/07/2024 13:30	501.75	15
Transformer	PLANNED OUTAGE	5/07/2024 11:12	143.42	5
PLF	PLANNED OUTAGE	5/07/2024 10:11	142.92	1
Transformer	PLANNED OUTAGE	5/08/2024 10:22	519.03	2
Transformer	PLANNED OUTAGE	5/08/2024 8:37	147.43	1
Transformer	PLANNED OUTAGE	5/08/2024 10:10	136.47	4
Transformer	PLANNED OUTAGE	5/08/2024 11:15	470.47	4
Transformer	PLANNED OUTAGE	5/08/2024 9:41	295.00	2
Transformer	PLANNED OUTAGE	5/08/2024 14:52	32.13	1
Transformer	PLANNED OUTAGE	5/08/2024 18:04	177.00	9
Transformer	PLANNED OUTAGE	5/08/2024 19:28	21.82	7
Transformer	PLANNED OUTAGE	5/08/2024 21:46	2,143.83	10
Transformer Bank	PLANNED OUTAGE	5/09/2024 5:05	160.92	1
Transformer	PLANNED OUTAGE	5/09/2024 9:42	128.10	3
Transformer	PLANNED OUTAGE	5/09/2024 9:33	393.15	3
Transformer	PLANNED OUTAGE	5/09/2024 11:27	562.92	7
None	PLANNED OUTAGE	5/09/2024 16:20	188.87	2

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	5/09/2024 18:33	311.70	1
Transformer Bank	PLANNED OUTAGE	5/10/2024 12:19	32.80	3
Transformer	PLANNED OUTAGE	5/10/2024 11:00	928.20	7
Breaker	PLANNED OUTAGE	5/10/2024 15:39	6,566.00	2345
PLF	PLANNED OUTAGE	5/12/2024 7:44	176.72	1
Breaker	PLANNED OUTAGE	5/10/2024 15:39	2.80	1
Breaker	PLANNED OUTAGE	5/10/2024 15:39	2.80	1
Breaker	PLANNED OUTAGE	5/10/2024 15:39	2.80	1
Breaker	PLANNED OUTAGE	5/10/2024 15:39	2.80	1
Transformer	PLANNED OUTAGE	5/13/2024 8:55	172.17	5
Transformer	PLANNED OUTAGE	5/13/2024 9:56	508.57	11
Transformer	PLANNED OUTAGE	5/13/2024 10:22	20.55	1
Transformer	PLANNED OUTAGE	5/13/2024 11:46	5.93	2
Transformer	PLANNED OUTAGE	5/13/2024 12:28	191.92	7
Transformer	PLANNED OUTAGE	5/13/2024 12:30	103.25	3
None	PLANNED OUTAGE	5/14/2024 9:20	2,986.67	40
Transformer	PLANNED OUTAGE	5/14/2024 10:02	190.25	5
Transformer	PLANNED OUTAGE	5/14/2024 10:12	23.47	4
Transformer	PLANNED OUTAGE	5/14/2024 9:46	76.15	3
PLF	PLANNED OUTAGE	5/14/2024 9:06	6,433.20	24
Transformer	PLANNED OUTAGE	5/14/2024 14:03	25.07	2
Transformer Bank	PLANNED OUTAGE	5/14/2024 10:59	148.40	7
Transformer Bank	PLANNED OUTAGE	5/14/2024 10:59	244.65	1
Transformer	PLANNED OUTAGE	5/14/2024 11:24	1,095.25	5
Transformer	PLANNED OUTAGE	5/14/2024 21:43	439.75	15
PLF	PLANNED OUTAGE	5/15/2024 8:22	21.90	3
Transformer	PLANNED OUTAGE	5/15/2024 11:00	206.27	7
PLF	PLANNED OUTAGE	5/15/2024 11:07	378.00	108
Transformer	PLANNED OUTAGE	5/15/2024 13:05	134.40	9
PLF	PLANNED OUTAGE	5/15/2024 16:06	1,904.12	19
PLF	PLANNED OUTAGE	5/15/2024 16:13	187.23	2
Transformer	PLANNED OUTAGE	5/15/2024 9:13	2,538.00	8
Transformer	PLANNED OUTAGE	5/15/2024 17:10	2,125.30	6
Service point	PLANNED OUTAGE	5/16/2024 8:56	20.88	1
Transformer	PLANNED OUTAGE	5/01/2024 9:29	215.83	7
PLF	PLANNED OUTAGE	5/01/2024 11:36	238.80	1
Transformer	PLANNED OUTAGE	5/01/2024 18:03	34.42	1
Transformer	PLANNED OUTAGE	5/01/2024 18:12	183.98	7
Transformer	PLANNED OUTAGE	5/01/2024 18:23	97.90	3
Breaker	PLANNED OUTAGE	5/01/2024 11:36	4.27	1
None	PLANNED OUTAGE	5/02/2024 5:25	213.70	3

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
None	PLANNED OUTAGE	5/02/2024 8:44	47.25	1
Transformer	PLANNED OUTAGE	5/02/2024 9:34	56.60	12
Transformer	PLANNED OUTAGE	5/02/2024 10:44	110.20	3
Transformer	PLANNED OUTAGE	5/03/2024 8:59	95.80	4
PLF	PLANNED OUTAGE	5/03/2024 12:36	474.45	9
PLF	PLANNED OUTAGE	5/03/2024 12:36	374.83	10
Transformer	PLANNED OUTAGE	5/03/2024 21:47	712.07	11
None	PLANNED OUTAGE	5/04/2024 0:31	667.53	4
None	PLANNED OUTAGE	5/05/2024 16:40	2,763.33	8
PLF	PLANNED OUTAGE	5/05/2024 23:02	84.27	1
Transformer	PLANNED OUTAGE	5/05/2024 7:00	1,806.13	16
Transformer	PLANNED OUTAGE	5/06/2024 10:40	367.60	6
Transformer	PLANNED OUTAGE	5/06/2024 9:06	1,550.33	5
PLF	PLANNED OUTAGE	5/06/2024 20:32	183.52	7
Service point	PLANNED OUTAGE	5/07/2024 0:28	72.63	1
Switch	PLANNED OUTAGE	4/07/2024 19:41	15,264.00	53
Transformer	PLANNED OUTAGE	5/07/2024 16:54	810.93	8
PLF	PLANNED OUTAGE	5/07/2024 16:04	2,466.80	3
Transformer	PLANNED OUTAGE	5/08/2024 9:25	74.35	1
Transformer	PLANNED OUTAGE	5/08/2024 10:49	128.37	2
Transformer	PLANNED OUTAGE	5/08/2024 10:57	61.85	3
Transformer	PLANNED OUTAGE	5/08/2024 13:32	23.30	1
Transformer	PLANNED OUTAGE	5/08/2024 10:38	177.05	3
PLF	PLANNED OUTAGE	5/08/2024 18:23	2,253.10	6
Transformer	PLANNED OUTAGE	5/08/2024 19:02	8.53	4
Transformer Bank	PLANNED OUTAGE	5/08/2024 22:12	722.80	12
None	PLANNED OUTAGE	5/09/2024 1:12	449.53	4
Transformer	PLANNED OUTAGE	5/16/2024 10:02	31.85	3
Transformer	PLANNED OUTAGE	5/16/2024 11:32	159.48	7
Transformer	PLANNED OUTAGE	5/16/2024 17:57	148.50	9
None	PLANNED OUTAGE	5/16/2024 18:19	81.67	4
Transformer	PLANNED OUTAGE	5/17/2024 9:31	108.85	3
Transformer	PLANNED OUTAGE	5/17/2024 16:35	1,440.67	8
PLF	PLANNED OUTAGE	5/18/2024 2:22	11,613.15	197
Transformer	PLANNED OUTAGE	5/19/2024 17:04	191.48	1
Transformer	PLANNED OUTAGE	5/20/2024 9:20	166.77	2
Transformer	PLANNED OUTAGE	5/20/2024 18:38	122.07	2
Transformer	PLANNED OUTAGE	5/21/2024 9:21	200.67	10
Transformer	PLANNED OUTAGE	5/21/2024 9:42	585.27	2
Transformer	PLANNED OUTAGE	5/21/2024 9:50	80.85	1
Transformer	PLANNED OUTAGE	5/21/2024 9:50	81.30	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	5/21/2024 14:14	41.37	34
Transformer	PLANNED OUTAGE	5/22/2024 10:45	349.80	11
Transformer	PLANNED OUTAGE	5/22/2024 11:17	145.20	11
Transformer	PLANNED OUTAGE	5/22/2024 12:32	512.75	7
Transformer Bank	PLANNED OUTAGE	5/22/2024 11:14	77.50	1
Service point	PLANNED OUTAGE	5/22/2024 7:51	308.97	1
Primary Wire	PLANNED OUTAGE	5/22/2024 15:50	4,136.93	152
Transformer	PLANNED OUTAGE	5/23/2024 0:16	331.45	1
Transformer Bank	PLANNED OUTAGE	5/22/2024 17:36	7,320.13	14
Transformer	PLANNED OUTAGE	5/23/2024 8:46	67.78	7
Transformer Bank	PLANNED OUTAGE	5/23/2024 8:54	967.08	5
Transformer	PLANNED OUTAGE	5/23/2024 12:01	55.00	6
PLF	PLANNED OUTAGE	5/23/2024 10:08	196.35	1
Transformer Bank	PLANNED OUTAGE	5/23/2024 18:05	32.45	3
PLF	PLANNED OUTAGE	5/24/2024 9:56	2.93	2
Transformer	PLANNED OUTAGE	5/24/2024 12:52	412.50	11
PLF	PLANNED OUTAGE	5/25/2024 15:07	762.00	15
Invalid	PLANNED OUTAGE	5/25/2024 15:57	1,306.53	8
Breaker	PLANNED OUTAGE	6/09/2024 8:18	8,325.05	393
Breaker	PLANNED OUTAGE	6/09/2024 8:18	170.27	8
Transformer	PLANNED OUTAGE	6/09/2024 12:23	155.73	4
Transformer	PLANNED OUTAGE	6/09/2024 13:49	48.00	1
Breaker	PLANNED OUTAGE	6/09/2024 20:02	1.43	1
Breaker	PLANNED OUTAGE	6/09/2024 20:02	1.02	1
Breaker	PLANNED OUTAGE	6/09/2024 20:02	1.43	1
Breaker	PLANNED OUTAGE	6/09/2024 20:02	1.53	1
Breaker	PLANNED OUTAGE	6/09/2024 20:02	1.60	1
PLF	PLANNED OUTAGE	6/10/2024 9:55	325.97	22
Transformer	PLANNED OUTAGE	6/10/2024 10:02	1,156.13	13
Transformer	PLANNED OUTAGE	6/10/2024 16:45	52.73	4
Transformer Bank	PLANNED OUTAGE	6/10/2024 18:00	741.65	13
Breaker	PLANNED OUTAGE	6/10/2024 21:58	46.40	1
Breaker	PLANNED OUTAGE	6/10/2024 21:58	46.72	1
None	PLANNED OUTAGE	6/10/2024 20:30	443.43	2
Breaker	PLANNED OUTAGE	6/11/2024 0:20	6,154.00	1448
Breaker	PLANNED OUTAGE	6/11/2024 0:20	3.77	1
None	PLANNED OUTAGE	6/11/2024 1:55	1,105.50	134
None	PLANNED OUTAGE	6/11/2024 2:23	15,302.55	153
Transformer	PLANNED OUTAGE	6/11/2024 8:41	51.45	1
Transformer	PLANNED OUTAGE	6/11/2024 9:41	158.93	8
Service point	PLANNED OUTAGE	6/11/2024 8:54	5,478.55	21

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Breaker	PLANNED OUTAGE	6/11/2024 15:46	8.47	1
Breaker	PLANNED OUTAGE	6/11/2024 15:46	9.17	1
Breaker	PLANNED OUTAGE	6/11/2024 15:46	9.13	1
Breaker	PLANNED OUTAGE	6/11/2024 19:05	13.27	1
Breaker	PLANNED OUTAGE	6/11/2024 19:05	13.43	1
Breaker	PLANNED OUTAGE	6/11/2024 18:27	4.12	1
Breaker	PLANNED OUTAGE	6/11/2024 18:27	4.30	1
PLF	PLANNED OUTAGE	6/12/2024 0:00	263.23	1
None	PLANNED OUTAGE	6/12/2024 3:12	337.08	5
Breaker	PLANNED OUTAGE	6/12/2024 11:22	11.82	1
Breaker	PLANNED OUTAGE	6/12/2024 11:24	5.97	1
PLF	PLANNED OUTAGE	5/10/2024 8:27	42.70	1
Transformer	PLANNED OUTAGE	5/10/2024 9:05	433.60	6
Transformer	PLANNED OUTAGE	5/10/2024 10:45	141.17	5
Transformer	PLANNED OUTAGE	5/10/2024 10:14	237.97	1
Transformer	PLANNED OUTAGE	5/11/2024 13:15	69.70	3
Transformer	PLANNED OUTAGE	5/12/2024 3:28	74.40	2
Transformer	PLANNED OUTAGE	5/12/2024 14:20	124.43	2
Breaker	PLANNED OUTAGE	5/12/2024 13:17	1,656.38	29
Breaker	PLANNED OUTAGE	5/12/2024 13:17	329.17	1
Breaker	PLANNED OUTAGE	5/10/2024 15:39	2.80	1
Breaker	PLANNED OUTAGE	5/10/2024 15:39	2.80	1
Breaker	PLANNED OUTAGE	5/10/2024 15:39	2.80	1
Breaker	PLANNED OUTAGE	5/10/2024 15:39	2.80	1
Transformer	PLANNED OUTAGE	5/13/2024 8:45	143.80	3
Transformer	PLANNED OUTAGE	5/13/2024 8:56	70.53	2
None	PLANNED OUTAGE	5/13/2024 13:09	163.03	2
Transformer	PLANNED OUTAGE	5/13/2024 11:40	247.20	4
Transformer	PLANNED OUTAGE	5/13/2024 10:22	550.80	2
None	PLANNED OUTAGE	5/13/2024 15:08	45.20	2
PLF	PLANNED OUTAGE	5/14/2024 8:42	2,262.67	20
Transformer	PLANNED OUTAGE	5/14/2024 9:11	76.67	4
Transformer	PLANNED OUTAGE	5/14/2024 10:01	96.08	5
Transformer	PLANNED OUTAGE	5/14/2024 10:48	188.85	9
Transformer	PLANNED OUTAGE	5/14/2024 7:14	2,489.67	11
Transformer	PLANNED OUTAGE	5/14/2024 8:46	118.60	4
PLF	PLANNED OUTAGE	5/14/2024 8:42	3,941.23	38
PLF	PLANNED OUTAGE	5/14/2024 10:34	21.30	18
PLF	PLANNED OUTAGE	5/14/2024 14:56	80.97	2
Transformer	PLANNED OUTAGE	5/14/2024 20:30	204.93	1
Transformer	PLANNED OUTAGE	5/15/2024 7:34	93.05	3

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	5/15/2024 10:42	115.13	4
Transformer	PLANNED OUTAGE	5/16/2024 2:22	551.20	16
PLF	PLANNED OUTAGE	5/14/2024 11:32	304.33	4
Transformer	PLANNED OUTAGE	5/09/2024 9:04	137.30	6
Transformer Bank	PLANNED OUTAGE	5/09/2024 9:10	160.93	2
Transformer	PLANNED OUTAGE	5/09/2024 10:08	93.47	2
PLF	PLANNED OUTAGE	5/09/2024 8:17	4,615.33	28
Transformer	PLANNED OUTAGE	5/09/2024 8:37	8.47	2
Transformer	PLANNED OUTAGE	5/09/2024 10:57	1,002.52	7
PLF	PLANNED OUTAGE	5/09/2024 11:15	206.20	4
None	PLANNED OUTAGE	5/09/2024 13:56	70.43	2
Transformer	PLANNED OUTAGE	5/09/2024 14:48	155.28	7
Transformer	PLANNED OUTAGE	5/10/2024 0:11	1,435.75	15
PLF	PLANNED OUTAGE	5/10/2024 9:09	3,687.05	37
Transformer	PLANNED OUTAGE	5/10/2024 9:17	751.25	15
Transformer	PLANNED OUTAGE	5/10/2024 9:23	319.37	1
Transformer	PLANNED OUTAGE	5/11/2024 1:29	30.37	2
Invalid	PLANNED OUTAGE	5/11/2024 7:34	310.20	1
Transformer	PLANNED OUTAGE	5/11/2024 15:25	44.60	6
Breaker	PLANNED OUTAGE	5/12/2024 13:17	328.98	1
Breaker	PLANNED OUTAGE	5/12/2024 13:17	329.17	1
Breaker	PLANNED OUTAGE	5/10/2024 15:39	2.80	1
Breaker	PLANNED OUTAGE	5/10/2024 15:39	2.80	1
Breaker	PLANNED OUTAGE	5/10/2024 15:39	2.80	1
Breaker	PLANNED OUTAGE	5/10/2024 15:39	2.80	1
Breaker	PLANNED OUTAGE	5/10/2024 15:39	2.80	1
Breaker	PLANNED OUTAGE	5/10/2024 15:39	2.80	1
Breaker	PLANNED OUTAGE	5/10/2024 15:39	2.80	1
Transformer	PLANNED OUTAGE	5/13/2024 13:18	56.33	1
Transformer	PLANNED OUTAGE	5/13/2024 13:18	23.25	3
Transformer	PLANNED OUTAGE	5/13/2024 11:35	359.60	4
Transformer	PLANNED OUTAGE	5/13/2024 9:44	90.60	3
None	PLANNED OUTAGE	5/13/2024 15:08	45.27	2
Transformer	PLANNED OUTAGE	5/13/2024 11:49	296.02	1
Transformer Bank	PLANNED OUTAGE	5/13/2024 18:12	626.60	2
Primary Wire	PLANNED OUTAGE	5/13/2024 23:45	794.03	7
Transformer	PLANNED OUTAGE	5/25/2024 17:23	256.52	1
Transformer	PLANNED OUTAGE	5/27/2024 0:32	17.13	2
Transformer	PLANNED OUTAGE	5/28/2024 10:08	21.25	1
Transformer	PLANNED OUTAGE	5/28/2024 10:47	121.25	5
None	PLANNED OUTAGE	5/28/2024 15:33	3,631.50	90

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	5/29/2024 7:59	58.80	1
Transformer	PLANNED OUTAGE	5/29/2024 9:58	808.13	8
Transformer	PLANNED OUTAGE	5/29/2024 10:22	174.33	5
Transformer	PLANNED OUTAGE	5/29/2024 22:41	128.37	1
Transformer	PLANNED OUTAGE	5/30/2024 1:01	201.60	6
Transformer	PLANNED OUTAGE	5/30/2024 7:55	453.33	10
Transformer	PLANNED OUTAGE	5/30/2024 10:06	25.67	7
PLF	PLANNED OUTAGE	5/30/2024 10:08	44.42	1
Transformer	PLANNED OUTAGE	5/30/2024 8:48	1,493.73	8
Transformer	PLANNED OUTAGE	5/30/2024 8:57	2,207.33	8
Transformer	PLANNED OUTAGE	5/30/2024 9:00	254.20	3
Transformer	PLANNED OUTAGE	5/30/2024 18:10	4,226.77	17
Transformer	PLANNED OUTAGE	5/30/2024 19:21	1,448.08	5
Transformer	PLANNED OUTAGE	5/31/2024 9:26	85.20	4
Transformer	PLANNED OUTAGE	5/31/2024 9:34	192.90	6
Transformer Bank	PLANNED OUTAGE	5/31/2024 22:32	778.00	20
PLF	PLANNED OUTAGE	5/31/2024 16:48	715.65	3
Breaker	PLANNED OUTAGE	6/01/2024 8:23	32.23	1
Breaker	PLANNED OUTAGE	6/01/2024 8:23	23.35	1
Breaker	PLANNED OUTAGE	6/01/2024 8:23	22.82	1
Breaker	PLANNED OUTAGE	6/01/2024 16:10	8.45	1
Transformer	PLANNED OUTAGE	6/01/2024 15:16	381.80	2
Transformer	PLANNED OUTAGE	6/02/2024 23:35	40.10	2
Transformer	PLANNED OUTAGE	6/03/2024 0:11	14.30	1
Breaker	PLANNED OUTAGE	6/12/2024 13:28	5,408.00	832
Transformer	PLANNED OUTAGE	6/12/2024 12:55	123.55	3
None	PLANNED OUTAGE	6/12/2024 14:53	509.30	3
None	PLANNED OUTAGE	6/12/2024 16:56	1,805.07	14
Breaker	PLANNED OUTAGE	6/12/2024 16:09	24.70	1
Breaker	PLANNED OUTAGE	6/12/2024 16:09	24.95	1
Transformer	PLANNED OUTAGE	6/12/2024 21:17	273.33	10
Transformer	PLANNED OUTAGE	6/13/2024 8:17	201.38	1
Transformer	PLANNED OUTAGE	6/13/2024 10:21	119.60	13
Transformer	PLANNED OUTAGE	6/13/2024 9:09	831.83	5
Transformer	PLANNED OUTAGE	6/13/2024 13:52	24.77	1
Breaker	PLANNED OUTAGE	6/13/2024 13:57	191.70	81
Transformer	PLANNED OUTAGE	6/13/2024 13:09	1,021.80	9
Transformer	PLANNED OUTAGE	6/13/2024 17:11	229.45	13
Transformer	PLANNED OUTAGE	6/13/2024 23:05	215.68	1
Transformer	PLANNED OUTAGE	6/14/2024 11:58	1,074.75	9
Transformer Bank	PLANNED OUTAGE	6/14/2024 10:38	243.70	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	6/14/2024 10:06	916.95	9
PLF	PLANNED OUTAGE	6/14/2024 17:09	326.60	4
Invalid	PLANNED OUTAGE	6/14/2024 22:43	155.10	11
Transformer	PLANNED OUTAGE	6/15/2024 13:47	46.75	3
Transformer	PLANNED OUTAGE	6/15/2024 18:24	72.17	2
None	PLANNED OUTAGE	6/16/2024 15:49	124.00	6
Transformer Bank	PLANNED OUTAGE	6/17/2024 11:14	276.87	4
Transformer	PLANNED OUTAGE	6/17/2024 13:07	1,225.90	13
Transformer	PLANNED OUTAGE	6/17/2024 14:13	160.47	2
PLF	PLANNED OUTAGE	6/17/2024 17:23	282.10	14
Transformer	PLANNED OUTAGE	6/18/2024 5:24	82.65	3
Transformer	PLANNED OUTAGE	6/18/2024 6:58	226.73	1
Transformer	PLANNED OUTAGE	6/18/2024 16:14	87.75	3
Transformer	PLANNED OUTAGE	6/19/2024 8:17	104.30	3
Transformer	PLANNED OUTAGE	6/19/2024 10:38	86.00	8
None	PLANNED OUTAGE	6/19/2024 9:17	95.37	1
PLF	PLANNED OUTAGE	5/15/2024 16:36	9,283.08	95
Transformer	PLANNED OUTAGE	5/16/2024 10:43	195.87	4
Transformer	PLANNED OUTAGE	5/16/2024 10:25	44.20	2
Transformer	PLANNED OUTAGE	5/16/2024 7:48	788.30	6
Transformer	PLANNED OUTAGE	5/16/2024 11:39	141.95	3
Transformer	PLANNED OUTAGE	5/16/2024 12:03	490.27	4
Transformer Bank	PLANNED OUTAGE	5/16/2024 18:11	1,572.75	5
Transformer Bank	PLANNED OUTAGE	5/16/2024 19:19	930.03	2
PLF	PLANNED OUTAGE	5/17/2024 11:38	60.55	7
Transformer	PLANNED OUTAGE	5/17/2024 12:04	35.87	1
Transformer	PLANNED OUTAGE	5/17/2024 14:27	23.33	2
Transformer	PLANNED OUTAGE	5/17/2024 23:26	291.17	5
Transformer	PLANNED OUTAGE	5/17/2024 21:32	1,675.50	9
Transformer	PLANNED OUTAGE	5/18/2024 8:52	618.08	5
Transformer	PLANNED OUTAGE	5/19/2024 2:08	455.20	4
PLF	PLANNED OUTAGE	5/20/2024 6:38	89.10	2
Transformer	PLANNED OUTAGE	5/20/2024 9:09	88.40	8
Transformer	PLANNED OUTAGE	5/20/2024 10:33	202.85	3
Transformer Bank	PLANNED OUTAGE	5/20/2024 11:43	173.00	4
Transformer	PLANNED OUTAGE	5/20/2024 12:52	381.38	7
Transformer	PLANNED OUTAGE	5/20/2024 16:21	174.93	8
PLF	PLANNED OUTAGE	5/20/2024 17:47	120.03	1
Transformer Bank	PLANNED OUTAGE	5/20/2024 19:48	245.45	1
Transformer	PLANNED OUTAGE	5/21/2024 0:46	72.40	3
Transformer	PLANNED OUTAGE	5/21/2024 8:50	348.13	7

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	5/21/2024 9:09	2.68	1
Transformer	PLANNED OUTAGE	5/21/2024 10:08	9.00	2
Transformer Bank	PLANNED OUTAGE	5/21/2024 9:38	180.12	1
Transformer	PLANNED OUTAGE	5/21/2024 8:12	89.07	1
PLF	PLANNED OUTAGE	5/21/2024 15:43	206.00	15
Transformer	PLANNED OUTAGE	5/22/2024 10:18	157.60	6
PLF	PLANNED OUTAGE	5/22/2024 9:02	12.22	1
PLF	PLANNED OUTAGE	5/22/2024 9:23	118.08	1
Transformer	PLANNED OUTAGE	5/14/2024 11:11	150.00	5
Transformer	PLANNED OUTAGE	5/14/2024 10:04	64.10	2
Transformer	PLANNED OUTAGE	5/14/2024 10:04	116.75	5
PLF	PLANNED OUTAGE	5/14/2024 10:14	982.68	7
Transformer	PLANNED OUTAGE	5/14/2024 7:58	545.30	2
Transformer	PLANNED OUTAGE	5/14/2024 8:31	2,444.33	20
Transformer	PLANNED OUTAGE	5/14/2024 16:28	122.10	9
PLF	PLANNED OUTAGE	5/14/2024 15:23	249.45	1
Transformer	PLANNED OUTAGE	5/14/2024 15:27	208.83	5
Transformer	PLANNED OUTAGE	5/14/2024 19:14	238.27	8
Transformer Bank	PLANNED OUTAGE	5/14/2024 15:28	575.92	5
Transformer Bank	PLANNED OUTAGE	5/14/2024 18:25	766.60	2
Transformer Bank	PLANNED OUTAGE	5/14/2024 18:33	421.52	1
Transformer	PLANNED OUTAGE	5/15/2024 9:40	10.15	7
Transformer	PLANNED OUTAGE	5/15/2024 9:41	1,845.25	11
None	PLANNED OUTAGE	5/16/2024 8:56	197.53	2
PLF	PLANNED OUTAGE	5/16/2024 8:57	1,027.35	9
Transformer	PLANNED OUTAGE	5/16/2024 9:13	425.55	9
PLF	PLANNED OUTAGE	5/16/2024 9:13	876.00	16
Transformer	PLANNED OUTAGE	5/16/2024 8:06	208.80	2
Transformer	PLANNED OUTAGE	5/16/2024 16:15	385.75	5
Transformer	PLANNED OUTAGE	5/17/2024 3:14	50.57	2
Transformer	PLANNED OUTAGE	5/17/2024 3:57	16.25	1
Transformer	PLANNED OUTAGE	5/17/2024 4:22	13.77	1
PLF	PLANNED OUTAGE	5/17/2024 10:21	72.42	1
Transformer	PLANNED OUTAGE	5/17/2024 10:21	128.30	2
Transformer	PLANNED OUTAGE	5/18/2024 7:50	87.85	1
Transformer Bank	PLANNED OUTAGE	5/20/2024 10:55	56.10	1
Transformer	PLANNED OUTAGE	5/20/2024 10:09	406.65	9
Transformer Bank	PLANNED OUTAGE	5/20/2024 11:09	67.03	2
Transformer	PLANNED OUTAGE	5/20/2024 13:20	51.00	4
Transformer	PLANNED OUTAGE	5/21/2024 1:36	51.13	2
Transformer	PLANNED OUTAGE	6/03/2024 4:05	106.30	6

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer Bank	PLANNED OUTAGE	6/03/2024 4:42	651.00	15
Transformer	PLANNED OUTAGE	6/03/2024 9:41	371.17	5
Transformer	PLANNED OUTAGE	6/03/2024 10:04	148.83	5
PLF	PLANNED OUTAGE	6/04/2024 4:11	1,925.23	14
Transformer	PLANNED OUTAGE	6/04/2024 7:34	1,785.17	10
Transformer Bank	PLANNED OUTAGE	6/04/2024 9:33	168.60	18
Transformer	PLANNED OUTAGE	6/04/2024 9:35	900.80	6
Transformer	PLANNED OUTAGE	6/04/2024 8:27	3,685.97	14
PLF	PLANNED OUTAGE	6/04/2024 8:31	243.90	1
None	PLANNED OUTAGE	6/04/2024 11:20	1,955.50	6
None	PLANNED OUTAGE	6/04/2024 16:53	2,310.35	23
Transformer	PLANNED OUTAGE	6/04/2024 16:26	637.60	4
Transformer	PLANNED OUTAGE	6/04/2024 20:24	214.73	1
Transformer	PLANNED OUTAGE	6/05/2024 2:15	259.57	13
Transformer	PLANNED OUTAGE	6/05/2024 9:22	819.60	8
Transformer	PLANNED OUTAGE	6/05/2024 9:36	618.92	7
PLF	PLANNED OUTAGE	6/05/2024 10:02	95.50	10
PLF	PLANNED OUTAGE	6/05/2024 9:39	292.27	1
PLF	PLANNED OUTAGE	6/05/2024 15:02	2,259.25	21
Transformer Bank	PLANNED OUTAGE	6/05/2024 22:51	299.73	4
PLF	PLANNED OUTAGE	6/06/2024 9:37	14.35	1
PLF	PLANNED OUTAGE	6/06/2024 9:37	13.72	1
None	PLANNED OUTAGE	6/06/2024 9:33	117.77	1
Transformer Bank	PLANNED OUTAGE	6/06/2024 9:29	159.93	1
None	PLANNED OUTAGE	6/06/2024 13:06	72.67	4
Transformer	PLANNED OUTAGE	6/06/2024 15:24	100.50	3
Transformer	PLANNED OUTAGE	6/06/2024 20:44	120.37	2
Transformer	PLANNED OUTAGE	6/06/2024 21:01	109.32	7
Transformer	PLANNED OUTAGE	6/07/2024 9:28	922.95	3
None	PLANNED OUTAGE	6/07/2024 16:33	2,063.40	181
Transformer	PLANNED OUTAGE	6/07/2024 16:57	362.83	10
Transformer Bank	PLANNED OUTAGE	6/07/2024 20:58	1,092.27	8
Transformer	PLANNED OUTAGE	5/21/2024 8:19	56.85	3
Transformer	PLANNED OUTAGE	5/21/2024 7:33	215.17	2
Transformer	PLANNED OUTAGE	5/21/2024 11:05	103.67	4
Transformer Bank	PLANNED OUTAGE	5/21/2024 9:36	165.85	3
Transformer	PLANNED OUTAGE	5/21/2024 13:37	2,884.33	34
Transformer Bank	PLANNED OUTAGE	5/21/2024 17:24	250.82	1
Transformer	PLANNED OUTAGE	5/22/2024 2:11	1,628.40	6
Transformer	PLANNED OUTAGE	5/22/2024 9:28	24.10	1
Transformer	PLANNED OUTAGE	5/22/2024 9:33	75.07	4

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	5/22/2024 12:36	135.47	8
PLF	PLANNED OUTAGE	5/22/2024 9:24	301.35	1
Transformer	PLANNED OUTAGE	5/22/2024 9:55	185.62	1
PLF	PLANNED OUTAGE	5/22/2024 18:57	1,031.33	52
Transformer Bank	PLANNED OUTAGE	5/22/2024 18:18	308.10	2
Transformer	PLANNED OUTAGE	5/23/2024 6:27	101.50	5
Transformer	PLANNED OUTAGE	5/23/2024 6:36	220.20	6
Transformer Bank	PLANNED OUTAGE	5/23/2024 9:23	134.87	4
Transformer Bank	PLANNED OUTAGE	5/23/2024 10:05	305.60	4
Transformer	PLANNED OUTAGE	5/23/2024 13:06	483.30	6
Transformer	PLANNED OUTAGE	5/24/2024 8:59	1,323.58	7
None	PLANNED OUTAGE	5/24/2024 23:52	75.83	2
Transformer	PLANNED OUTAGE	5/24/2024 21:13	605.40	12
Transformer	PLANNED OUTAGE	5/25/2024 12:57	91.87	2
PLF	PLANNED OUTAGE	5/25/2024 17:26	2,923.25	15
Transformer	PLANNED OUTAGE	5/25/2024 18:32	113.05	7
PLF	PLANNED OUTAGE	5/26/2024 9:35	973.50	30
None	PLANNED OUTAGE	5/28/2024 9:30	183.83	5
PLF	PLANNED OUTAGE	5/28/2024 11:45	13.17	1
PLF	PLANNED OUTAGE	5/28/2024 17:22	1,108.25	39
Transformer	PLANNED OUTAGE	5/29/2024 0:04	43.20	2
Transformer	PLANNED OUTAGE	5/29/2024 0:38	9.72	1
Transformer	PLANNED OUTAGE	5/29/2024 8:53	5,690.18	17
PLF	PLANNED OUTAGE	5/29/2024 9:05	5,787.43	58
Transformer	PLANNED OUTAGE	6/19/2024 8:43	1,082.25	9
Transformer	PLANNED OUTAGE	6/19/2024 13:16	317.00	4
Transformer	PLANNED OUTAGE	6/20/2024 8:07	105.07	4
Transformer	PLANNED OUTAGE	6/20/2024 23:29	126.00	8
Transformer	PLANNED OUTAGE	6/21/2024 8:25	237.42	37
Transformer	PLANNED OUTAGE	6/21/2024 9:08	109.60	4
PLF	PLANNED OUTAGE	6/21/2024 8:40	1,176.92	5
Transformer	PLANNED OUTAGE	6/21/2024 13:16	30.80	2
Invalid	PLANNED OUTAGE	6/22/2024 9:11	6,105.63	1918
Invalid	PLANNED OUTAGE	6/22/2024 9:11	2.90	1
Invalid	PLANNED OUTAGE	6/22/2024 9:11	3.48	1
Transformer	PLANNED OUTAGE	6/22/2024 13:24	179.87	4
Breaker	PLANNED OUTAGE	6/22/2024 20:35	115.05	1
Service point	PLANNED OUTAGE	6/23/2024 3:45	10.85	1
PLF	PLANNED OUTAGE	6/23/2024 11:37	139.38	1
Transformer	PLANNED OUTAGE	6/24/2024 9:38	290.80	12
Transformer	PLANNED OUTAGE	6/24/2024 9:17	375.60	6

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
None	PLANNED OUTAGE	6/21/2024 7:28	1,828.20	3
Transformer Bank	PLANNED OUTAGE	6/24/2024 12:25	153.90	1
Breaker	PLANNED OUTAGE	6/24/2024 16:20	1,404.15	851
Breaker	PLANNED OUTAGE	6/24/2024 21:33	13.87	1
Switch	PLANNED OUTAGE	6/24/2024 19:29	407.60	6
Breaker	PLANNED OUTAGE	6/25/2024 9:05	4,601.57	518
Breaker	PLANNED OUTAGE	6/25/2024 9:05	10.92	1
Breaker	PLANNED OUTAGE	6/25/2024 10:33	10,427.87	397
Transformer	PLANNED OUTAGE	6/25/2024 9:36	215.27	2
Breaker	PLANNED OUTAGE	6/25/2024 14:27	112.02	11
Transformer	PLANNED OUTAGE	6/25/2024 13:51	79.22	1
Transformer	PLANNED OUTAGE	6/25/2024 17:20	309.87	8
Transformer	PLANNED OUTAGE	6/25/2024 19:06	156.75	5
Transformer	PLANNED OUTAGE	6/26/2024 2:02	850.20	6
Transformer Bank	PLANNED OUTAGE	6/25/2024 7:34	3,537.45	7
Transformer	PLANNED OUTAGE	6/26/2024 9:54	72.68	7
Transformer	PLANNED OUTAGE	5/22/2024 11:49	140.30	6
Transformer	PLANNED OUTAGE	5/22/2024 11:42	265.08	5
Service point	PLANNED OUTAGE	5/22/2024 13:45	76.92	1
Primary Wire	PLANNED OUTAGE	5/22/2024 15:50	28.08	1
Transformer	PLANNED OUTAGE	5/23/2024 1:15	163.68	7
Primary Wire	PLANNED OUTAGE	5/22/2024 20:10	3,883.00	10
Transformer	PLANNED OUTAGE	5/23/2024 8:47	621.60	6
PLF	PLANNED OUTAGE	5/23/2024 8:30	2,861.25	21
Transformer	PLANNED OUTAGE	5/23/2024 20:43	251.70	9
PLF	PLANNED OUTAGE	5/23/2024 23:06	653.40	2
Transformer	PLANNED OUTAGE	5/24/2024 13:07	255.00	6
Transformer	PLANNED OUTAGE	5/24/2024 13:50	395.33	10
Transformer	PLANNED OUTAGE	5/24/2024 15:40	249.10	6
PLF	PLANNED OUTAGE	5/24/2024 23:16	2,536.83	62
PLF	PLANNED OUTAGE	5/25/2024 21:14	47.75	3
None	PLANNED OUTAGE	5/26/2024 2:22	759.73	8
Transformer	PLANNED OUTAGE	5/26/2024 23:49	67.55	3
Invalid	PLANNED OUTAGE	5/27/2024 21:25	739.38	11
Transformer	PLANNED OUTAGE	5/28/2024 8:09	524.52	11
Transformer	PLANNED OUTAGE	5/28/2024 11:12	205.35	9
Transformer	PLANNED OUTAGE	5/28/2024 9:56	457.67	10
None	PLANNED OUTAGE	5/28/2024 10:10	902.67	8
Transformer Bank	PLANNED OUTAGE	5/28/2024 10:19	185.78	1
PLF	PLANNED OUTAGE	5/28/2024 14:30	652.08	25
PLF	PLANNED OUTAGE	5/28/2024 17:38	139.40	12

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	5/29/2024 1:06	6.02	1
Breaker	PLANNED OUTAGE	5/29/2024 8:12	11.33	1
Transformer	PLANNED OUTAGE	5/29/2024 10:46	175.20	8
None	PLANNED OUTAGE	5/29/2024 10:47	659.33	5
Transformer	PLANNED OUTAGE	5/29/2024 9:27	96.58	5
Transformer	PLANNED OUTAGE	5/29/2024 9:36	424.23	13
Transformer Bank	PLANNED OUTAGE	5/29/2024 7:08	404.50	1
None	PLANNED OUTAGE	6/07/2024 16:33	8,660.53	47
Transformer	PLANNED OUTAGE	6/07/2024 17:57	179.00	5
Transformer	PLANNED OUTAGE	6/07/2024 18:20	243.90	9
Transformer Bank	PLANNED OUTAGE	6/08/2024 0:50	184.10	1
Transformer	PLANNED OUTAGE	6/08/2024 11:03	3,256.00	15
Transformer	PLANNED OUTAGE	6/08/2024 14:48	85.87	7
None	PLANNED OUTAGE	6/08/2024 16:47	431.73	16
Transformer	PLANNED OUTAGE	6/08/2024 14:42	286.40	8
Transformer	PLANNED OUTAGE	6/08/2024 23:55	904.80	8
None	PLANNED OUTAGE	6/08/2024 23:07	5,043.27	28
Transformer	PLANNED OUTAGE	6/09/2024 0:59	295.80	6
Breaker	PLANNED OUTAGE	6/09/2024 4:18	9.03	1
Breaker	PLANNED OUTAGE	6/09/2024 4:45	28.43	2
Transformer	PLANNED OUTAGE	6/09/2024 13:16	96.33	4
Transformer	PLANNED OUTAGE	6/09/2024 13:33	229.00	12
Transformer Bank	PLANNED OUTAGE	6/09/2024 13:41	276.90	6
Transformer	PLANNED OUTAGE	6/09/2024 14:03	249.43	14
Transformer	PLANNED OUTAGE	6/09/2024 19:42	52.40	1
Breaker	PLANNED OUTAGE	6/09/2024 20:02	1,217.85	1059
Breaker	PLANNED OUTAGE	6/09/2024 20:02	2.25	1
Breaker	PLANNED OUTAGE	6/09/2024 20:02	1.68	1
Breaker	PLANNED OUTAGE	6/09/2024 20:02	1.87	1
Breaker	PLANNED OUTAGE	6/09/2024 20:02	1.20	1
Breaker	PLANNED OUTAGE	6/09/2024 20:02	1.33	1
Breaker	PLANNED OUTAGE	6/09/2024 20:02	1.72	1
Service point	PLANNED OUTAGE	6/09/2024 20:58	14.50	1
PLF	PLANNED OUTAGE	6/09/2024 22:57	11,748.87	59
Transformer Bank	PLANNED OUTAGE	6/10/2024 6:18	212.55	1
PLF	PLANNED OUTAGE	6/10/2024 12:54	2,562.15	19
Transformer	PLANNED OUTAGE	6/10/2024 20:21	146.07	4
Transformer	PLANNED OUTAGE	6/10/2024 14:53	411.30	6
PLF	PLANNED OUTAGE	6/10/2024 19:18	3,070.72	19
PLF	PLANNED OUTAGE	6/10/2024 19:18	362.77	2
PLF	PLANNED OUTAGE	5/29/2024 9:05	7,145.25	63

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	5/29/2024 11:18	18.13	1
Transformer	PLANNED OUTAGE	5/29/2024 8:33	75.77	1
Transformer	PLANNED OUTAGE	5/29/2024 11:37	229.50	10
PLF	PLANNED OUTAGE	5/29/2024 16:26	90.90	1
Transformer	PLANNED OUTAGE	5/30/2024 10:23	40.57	2
Transformer	PLANNED OUTAGE	5/30/2024 9:29	480.53	8
Transformer	PLANNED OUTAGE	5/30/2024 8:53	118.27	2
Transformer	PLANNED OUTAGE	5/30/2024 9:05	201.33	8
Transformer	PLANNED OUTAGE	5/30/2024 9:17	132.60	3
PLF	PLANNED OUTAGE	5/30/2024 9:24	362.80	8
Transformer	PLANNED OUTAGE	5/30/2024 9:56	317.80	2
Breaker	PLANNED OUTAGE	5/30/2024 9:58	76,823.05	339
Breaker	PLANNED OUTAGE	5/30/2024 9:58	226.63	1
Breaker	PLANNED OUTAGE	5/30/2024 9:58	226.62	1
PLF	PLANNED OUTAGE	5/30/2024 18:47	408.45	9
Transformer	PLANNED OUTAGE	5/31/2024 11:14	5.77	1
PLF	PLANNED OUTAGE	5/31/2024 14:45	284.07	4
PLF	PLANNED OUTAGE	5/31/2024 14:58	1,958.97	34
Transformer	PLANNED OUTAGE	5/31/2024 14:48	553.50	15
PLF	PLANNED OUTAGE	5/31/2024 14:45	2,337.67	10
PLF	PLANNED OUTAGE	5/31/2024 14:45	1,435.25	5
Transformer	PLANNED OUTAGE	6/01/2024 10:03	82.67	5
Transformer	PLANNED OUTAGE	6/01/2024 14:59	1.48	1
PLF	PLANNED OUTAGE	6/01/2024 10:03	182.00	1
Transformer	PLANNED OUTAGE	6/01/2024 12:47	22.70	2
Transformer Bank	PLANNED OUTAGE	6/01/2024 16:53	2,451.15	9
Transformer	PLANNED OUTAGE	6/02/2024 6:49	96.72	1
Transformer	PLANNED OUTAGE	6/03/2024 10:17	134.67	5
Transformer	PLANNED OUTAGE	6/03/2024 10:02	112.93	4
Transformer	PLANNED OUTAGE	6/03/2024 10:52	96.35	3
Transformer	PLANNED OUTAGE	6/03/2024 10:49	90.85	3
PLF	PLANNED OUTAGE	6/03/2024 9:37	1,139.00	6
None	PLANNED OUTAGE	6/03/2024 13:11	111.33	1
Transformer	PLANNED OUTAGE	6/26/2024 11:46	42.40	2
Transformer	PLANNED OUTAGE	6/26/2024 17:00	613.07	11
PLF	PLANNED OUTAGE	6/26/2024 23:21	2,240.73	61
Transformer	PLANNED OUTAGE	6/27/2024 0:54	23.50	1
Transformer	PLANNED OUTAGE	6/27/2024 10:19	103.60	2
Transformer	PLANNED OUTAGE	6/27/2024 7:33	601.90	3
Transformer Bank	PLANNED OUTAGE	6/27/2024 10:04	28.90	1
Transformer	PLANNED OUTAGE	6/27/2024 11:28	39.73	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
None	PLANNED OUTAGE	6/27/2024 11:43	388.93	4
Transformer	PLANNED OUTAGE	6/27/2024 11:19	715.20	4
PLF	PLANNED OUTAGE	6/27/2024 18:51	152.33	2
Breaker	PLANNED OUTAGE	6/27/2024 18:05	4,036.20	651
Breaker	PLANNED OUTAGE	6/27/2024 18:05	6.20	1
PLF	PLANNED OUTAGE	6/28/2024 9:30	127.75	73
Transformer	PLANNED OUTAGE	6/28/2024 7:48	1,197.67	10
Invalid	PLANNED OUTAGE	6/28/2024 18:06	74.08	1
Transformer	PLANNED OUTAGE	6/29/2024 7:47	4,100.07	11
PLF	PLANNED OUTAGE	6/29/2024 22:05	295.18	1
Transformer	PLANNED OUTAGE	6/30/2024 16:38	414.67	4
Transformer	PLANNED OUTAGE	7/01/2024 9:43	275.25	9
Transformer	PLANNED OUTAGE	6/28/2024 8:43	5,696.27	8
Switch	PLANNED OUTAGE	6/28/2024 18:50	15,321.83	161
Transformer	PLANNED OUTAGE	7/01/2024 7:59	889.13	4
PLF	PLANNED OUTAGE	7/01/2024 13:44	231.00	11
PLF	PLANNED OUTAGE	7/01/2024 16:59	978.83	10
Breaker	PLANNED OUTAGE	7/01/2024 14:48	57.40	1
PLF	PLANNED OUTAGE	7/01/2024 21:21	146.23	1
Transformer	PLANNED OUTAGE	7/02/2024 9:28	206.55	3
Service point	PLANNED OUTAGE	5/29/2024 11:49	29.97	1
Transformer	PLANNED OUTAGE	5/29/2024 12:24	37.87	2
Transformer	PLANNED OUTAGE	5/29/2024 10:33	1,361.97	7
Transformer	PLANNED OUTAGE	5/29/2024 17:24	59.85	9
Transformer	PLANNED OUTAGE	5/29/2024 9:23	1,443.20	4
Transformer Bank	PLANNED OUTAGE	5/29/2024 17:18	738.10	6
None	PLANNED OUTAGE	5/29/2024 18:53	4,630.40	32
Breaker	PLANNED OUTAGE	5/30/2024 9:58	6,822.40	492
Transformer	PLANNED OUTAGE	5/30/2024 10:09	208.20	3
Transformer	PLANNED OUTAGE	5/30/2024 9:31	382.73	4
Transformer	PLANNED OUTAGE	5/30/2024 9:32	136.05	3
Transformer	PLANNED OUTAGE	5/30/2024 9:52	231.50	3
Transformer	PLANNED OUTAGE	5/30/2024 11:03	95.33	5
Transformer	PLANNED OUTAGE	5/30/2024 11:28	462.92	5
None	PLANNED OUTAGE	5/30/2024 15:37	273.27	4
Transformer	PLANNED OUTAGE	5/30/2024 18:39	671.17	10
Transformer	PLANNED OUTAGE	5/31/2024 7:20	98.03	2
Transformer	PLANNED OUTAGE	5/31/2024 8:54	126.47	4
PLF	PLANNED OUTAGE	5/31/2024 9:18	208.50	3
Transformer	PLANNED OUTAGE	5/31/2024 13:52	163.60	6
PLF	PLANNED OUTAGE	5/31/2024 14:45	70.98	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
None	PLANNED OUTAGE	5/31/2024 11:31	259.58	7
Transformer Bank	PLANNED OUTAGE	5/31/2024 9:27	309.50	1
Breaker	PLANNED OUTAGE	5/31/2024 16:48	880.40	284
Breaker	PLANNED OUTAGE	6/01/2024 8:23	34,556.10	1509
Breaker	PLANNED OUTAGE	6/01/2024 16:10	7.92	1
Transformer	PLANNED OUTAGE	6/02/2024 0:29	159.00	5
TX Replaced (OH)	PLANNED OUTAGE	6/02/2024 10:31	1,787.90	6
Transformer	PLANNED OUTAGE	6/03/2024 8:26	1,303.32	11
None	PLANNED OUTAGE	6/03/2024 20:30	9,944.57	1378
None	PLANNED OUTAGE	6/03/2024 20:30	9.90	1
Transformer	PLANNED OUTAGE	6/04/2024 9:41	110.10	2
None	PLANNED OUTAGE	6/04/2024 10:26	1,788.33	5
Transformer	PLANNED OUTAGE	6/10/2024 19:54	262.40	3
Breaker	PLANNED OUTAGE	6/10/2024 21:58	108,893.50	2346
Breaker	PLANNED OUTAGE	6/11/2024 0:33	33.60	18
Breaker	PLANNED OUTAGE	6/11/2024 0:20	4.22	1
Transformer	PLANNED OUTAGE	6/11/2024 9:44	580.13	4
Transformer	PLANNED OUTAGE	6/11/2024 10:45	624.07	4
PLF	PLANNED OUTAGE	6/11/2024 16:15	2,523.87	46
Transformer	PLANNED OUTAGE	6/11/2024 16:21	89.50	5
Breaker	PLANNED OUTAGE	6/11/2024 15:46	9.32	1
Breaker	PLANNED OUTAGE	6/11/2024 15:46	8.83	1
Breaker	PLANNED OUTAGE	6/11/2024 15:46	9.05	1
Breaker	PLANNED OUTAGE	6/11/2024 15:46	8.43	1
PLF	PLANNED OUTAGE	6/11/2024 16:13	4,099.50	27
Breaker	PLANNED OUTAGE	6/11/2024 19:05	21,800.00	1635
Breaker	PLANNED OUTAGE	6/11/2024 18:27	4.38	1
Breaker	PLANNED OUTAGE	6/11/2024 18:27	4.48	1
Breaker	PLANNED OUTAGE	6/11/2024 18:27	4.57	1
PLF	PLANNED OUTAGE	6/11/2024 17:35	130.15	19
Transformer	PLANNED OUTAGE	6/11/2024 19:37	172.23	2
Breaker	PLANNED OUTAGE	6/11/2024 22:50	29,583.95	1639
PLF	PLANNED OUTAGE	6/11/2024 21:12	54.10	3
PLF	PLANNED OUTAGE	6/12/2024 3:57	2,629.00	132
PLF	PLANNED OUTAGE	6/12/2024 11:56	1,330.43	2
PLF	PLANNED OUTAGE	6/12/2024 9:51	272.10	18
PLF	PLANNED OUTAGE	6/12/2024 13:02	32.60	6
Transformer	PLANNED OUTAGE	6/12/2024 10:09	616.73	4
Transformer	PLANNED OUTAGE	6/12/2024 11:23	642.58	11
Transformer	PLANNED OUTAGE	6/12/2024 11:26	874.20	12
None	PLANNED OUTAGE	6/12/2024 11:10	159,174.45	471

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
None	PLANNED OUTAGE	6/12/2024 11:10	342.53	1
None	PLANNED OUTAGE	6/12/2024 11:10	342.53	1
Transformer	PLANNED OUTAGE	6/13/2024 8:27	268.92	7
Transformer	PLANNED OUTAGE	6/13/2024 13:21	9.02	1
Transformer	PLANNED OUTAGE	6/13/2024 20:17	12.65	3
None	PLANNED OUTAGE	6/03/2024 20:30	9.95	1
None	PLANNED OUTAGE	6/03/2024 20:30	8.95	1
None	PLANNED OUTAGE	6/03/2024 20:30	9.95	1
Transformer	PLANNED OUTAGE	6/03/2024 18:59	312.80	2
Transformer	PLANNED OUTAGE	6/04/2024 9:02	324.40	8
Transformer	PLANNED OUTAGE	6/04/2024 9:04	24.87	1
Transformer	PLANNED OUTAGE	6/04/2024 9:08	108.55	1
Transformer	PLANNED OUTAGE	6/05/2024 0:24	126.82	7
Transformer	PLANNED OUTAGE	6/05/2024 8:27	240.75	5
Transformer	PLANNED OUTAGE	6/05/2024 9:18	7.08	5
Transformer	PLANNED OUTAGE	6/05/2024 13:34	68.05	3
Transformer	PLANNED OUTAGE	6/05/2024 19:15	504.13	8
Transformer	PLANNED OUTAGE	6/05/2024 19:38	191.55	1
Transformer	PLANNED OUTAGE	6/06/2024 20:59	11.65	1
Transformer	PLANNED OUTAGE	6/06/2024 17:27	52.30	3
Transformer	PLANNED OUTAGE	6/06/2024 23:26	30.30	2
Transformer Bank	PLANNED OUTAGE	6/07/2024 6:13	503.73	4
Transformer	PLANNED OUTAGE	6/07/2024 8:54	178.80	3
Transformer	PLANNED OUTAGE	6/07/2024 12:38	32.93	2
Transformer	PLANNED OUTAGE	6/08/2024 1:11	135.75	3
Transformer	PLANNED OUTAGE	6/08/2024 0:42	12.35	3
Transformer Bank	PLANNED OUTAGE	6/08/2024 12:17	134.83	1
Transformer	PLANNED OUTAGE	6/08/2024 12:39	356.40	12
Transformer	PLANNED OUTAGE	6/08/2024 12:45	126.20	3
Transformer	PLANNED OUTAGE	6/08/2024 12:55	583.20	8
Transformer	PLANNED OUTAGE	6/08/2024 17:49	174.00	4
Breaker	PLANNED OUTAGE	6/09/2024 3:43	48,681.15	639
Breaker	PLANNED OUTAGE	6/09/2024 3:43	76.18	1
Breaker	PLANNED OUTAGE	6/09/2024 8:18	21.10	1
Breaker	PLANNED OUTAGE	6/09/2024 8:18	21.27	1
Transformer	PLANNED OUTAGE	6/13/2024 18:40	309.10	3
None	PLANNED OUTAGE	6/13/2024 23:39	88.20	9
PLF	PLANNED OUTAGE	6/14/2024 9:09	21.03	2
Transformer	PLANNED OUTAGE	6/14/2024 8:48	873.80	4
Transformer	PLANNED OUTAGE	6/14/2024 9:25	723.58	5
PLF	PLANNED OUTAGE	6/14/2024 14:46	980.80	3

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer Bank	PLANNED OUTAGE	6/14/2024 23:47	112.43	2
PLF	PLANNED OUTAGE	6/15/2024 16:07	63.43	2
Transformer	PLANNED OUTAGE	6/16/2024 12:39	38.67	5
PLF	PLANNED OUTAGE	6/14/2024 22:43	578.75	1
Transformer Bank	PLANNED OUTAGE	6/14/2024 15:38	2,134.40	3
Transformer	PLANNED OUTAGE	6/14/2024 21:48	679.75	1
Transformer Bank	PLANNED OUTAGE	6/17/2024 11:28	245.73	2
Transformer	PLANNED OUTAGE	6/17/2024 10:06	175.62	1
Transformer Bank	PLANNED OUTAGE	6/17/2024 13:18	170.60	1
PLF	PLANNED OUTAGE	6/17/2024 9:44	1,686.50	5
Switch	PLANNED OUTAGE	6/17/2024 21:25	404.43	2
Transformer	PLANNED OUTAGE	6/18/2024 1:55	17.32	1
PLF	PLANNED OUTAGE	6/17/2024 4:14	1,075.80	12
Transformer Bank	PLANNED OUTAGE	6/18/2024 6:16	619.33	10
Transformer	PLANNED OUTAGE	6/18/2024 8:32	69.65	7
PLF	PLANNED OUTAGE	6/18/2024 8:35	3,941.60	13
None	PLANNED OUTAGE	6/18/2024 16:37	899.50	6
Transformer	PLANNED OUTAGE	6/18/2024 20:30	513.68	7
Transformer Bank	PLANNED OUTAGE	6/18/2024 21:09	53.53	2
None	PLANNED OUTAGE	6/18/2024 8:27	23,089.62	49
Transformer	PLANNED OUTAGE	6/19/2024 9:14	458.40	8
Transformer	PLANNED OUTAGE	6/19/2024 9:20	639.92	7
PLF	PLANNED OUTAGE	6/19/2024 9:49	618.20	11
Transformer	PLANNED OUTAGE	6/19/2024 10:17	161.33	8
Transformer	PLANNED OUTAGE	6/19/2024 11:59	125.25	5
PLF	PLANNED OUTAGE	6/19/2024 12:40	96.15	1
Transformer	PLANNED OUTAGE	6/19/2024 15:59	1,028.33	10
PLF	PLANNED OUTAGE	7/02/2024 8:23	7,953.75	25
PLF	PLANNED OUTAGE	7/02/2024 9:24	188.03	1
Breaker	PLANNED OUTAGE	7/02/2024 14:19	7.78	1
Breaker	PLANNED OUTAGE	7/02/2024 14:19	10.13	1
Transformer	PLANNED OUTAGE	7/02/2024 17:45	2,742.13	16
Transformer	PLANNED OUTAGE	7/02/2024 15:19	289.50	1
PLF	PLANNED OUTAGE	7/02/2024 19:57	262.77	2
Transformer	PLANNED OUTAGE	7/03/2024 14:01	424.05	3
PLF	PLANNED OUTAGE	7/03/2024 10:42	432.00	2
Breaker	PLANNED OUTAGE	7/04/2024 17:04	25,845.05	1507
Breaker	PLANNED OUTAGE	7/04/2024 17:04	10.38	1
Transformer	PLANNED OUTAGE	7/04/2024 23:36	935.57	17
Transformer	PLANNED OUTAGE	7/05/2024 10:16	32.03	2
None	PLANNED OUTAGE	7/05/2024 9:52	454.67	11

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
None	PLANNED OUTAGE	7/05/2024 11:49	637.73	8
Transformer Bank	PLANNED OUTAGE	7/05/2024 13:31	119.70	9
Breaker	PLANNED OUTAGE	7/06/2024 14:11	80.47	1
Transformer	PLANNED OUTAGE	7/05/2024 8:52	247.45	3
Transformer	PLANNED OUTAGE	7/08/2024 10:53	35.37	1
Transformer	PLANNED OUTAGE	7/08/2024 9:50	127.13	2
Transformer	PLANNED OUTAGE	7/08/2024 9:40	50.23	2
None	PLANNED OUTAGE	7/08/2024 9:48	578.93	8
None	PLANNED OUTAGE	7/08/2024 9:50	722.33	4
Transformer	PLANNED OUTAGE	7/08/2024 10:29	164.03	7
Transformer Bank	PLANNED OUTAGE	7/09/2024 2:21	447.70	6
PLF	PLANNED OUTAGE	7/09/2024 9:17	522.73	2
Transformer	PLANNED OUTAGE	7/09/2024 10:35	1,103.70	6
Transformer	PLANNED OUTAGE	7/09/2024 9:14	408.40	2
Transformer	PLANNED OUTAGE	7/09/2024 14:36	37.05	3
PLF	PLANNED OUTAGE	7/09/2024 18:12	42.17	1
PLF	PLANNED OUTAGE	7/10/2024 9:09	398.10	3
Transformer	PLANNED OUTAGE	7/10/2024 12:11	258.93	4
PLF	PLANNED OUTAGE	6/04/2024 13:47	87.97	1
Transformer	PLANNED OUTAGE	6/04/2024 17:57	239.93	4
None	PLANNED OUTAGE	6/05/2024 0:55	589.28	7
Transformer	PLANNED OUTAGE	6/05/2024 1:00	110.80	6
Transformer	PLANNED OUTAGE	6/05/2024 1:30	57.87	2
Transformer	PLANNED OUTAGE	6/04/2024 10:18	658.92	1
None	PLANNED OUTAGE	6/05/2024 10:32	269.27	7
PLF	PLANNED OUTAGE	6/05/2024 9:39	2,940.83	10
Transformer	PLANNED OUTAGE	6/05/2024 13:16	45.60	3
Transformer	PLANNED OUTAGE	6/05/2024 12:44	111.57	1
Transformer	PLANNED OUTAGE	6/05/2024 11:22	52.80	2
PLF	PLANNED OUTAGE	6/05/2024 15:17	43.97	1
None	PLANNED OUTAGE	6/05/2024 18:45	733.30	6
Transformer	PLANNED OUTAGE	6/06/2024 1:50	453.80	12
Transformer	PLANNED OUTAGE	6/06/2024 2:42	382.80	11
Transformer Bank	PLANNED OUTAGE	6/06/2024 7:37	67.17	2
PLF	PLANNED OUTAGE	6/06/2024 9:07	697.67	26
Transformer	PLANNED OUTAGE	6/06/2024 10:32	128.40	4
Transformer	PLANNED OUTAGE	6/06/2024 11:11	66.80	4
PLF	PLANNED OUTAGE	6/06/2024 12:35	67.93	4
Transformer	PLANNED OUTAGE	6/06/2024 8:14	1,116.15	7
Transformer	PLANNED OUTAGE	6/06/2024 11:30	202.65	9
Transformer	PLANNED OUTAGE	6/06/2024 16:50	67.07	2

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	6/06/2024 19:46	47.40	4
Transformer	PLANNED OUTAGE	6/07/2024 4:02	3,431.72	19
Transformer	PLANNED OUTAGE	6/07/2024 9:24	1,110.40	16
Transformer	PLANNED OUTAGE	6/08/2024 15:05	574.27	4
Breaker	PLANNED OUTAGE	6/09/2024 4:18	5,903.33	644
Breaker	PLANNED OUTAGE	6/09/2024 8:18	14,871.75	711
Transformer	PLANNED OUTAGE	6/09/2024 13:14	21.17	1
Transformer	PLANNED OUTAGE	6/09/2024 14:38	121.07	8
Breaker	PLANNED OUTAGE	6/09/2024 20:02	1.77	1
Breaker	PLANNED OUTAGE	6/09/2024 20:02	1.28	1
Breaker	PLANNED OUTAGE	6/09/2024 8:18	21.37	1
Breaker	PLANNED OUTAGE	6/09/2024 8:18	21.50	1
Breaker	PLANNED OUTAGE	6/09/2024 20:02	1.08	1
Breaker	PLANNED OUTAGE	6/09/2024 20:02	1.57	1
Breaker	PLANNED OUTAGE	6/09/2024 20:02	1.73	1
Breaker	PLANNED OUTAGE	6/09/2024 20:02	1.88	1
Breaker	PLANNED OUTAGE	6/09/2024 20:02	11,574.25	691
Transformer	PLANNED OUTAGE	6/09/2024 17:40	325.42	11
Transformer	PLANNED OUTAGE	6/10/2024 8:27	56.15	1
Transformer	PLANNED OUTAGE	6/10/2024 11:57	189.70	7
Transformer	PLANNED OUTAGE	6/10/2024 13:45	116.75	5
None	PLANNED OUTAGE	6/10/2024 16:46	1,341.47	8
PLF	PLANNED OUTAGE	6/11/2024 8:39	663.60	3
Transformer Bank	PLANNED OUTAGE	6/11/2024 11:08	135.27	1
Transformer	PLANNED OUTAGE	6/11/2024 12:18	200.13	8
Breaker	PLANNED OUTAGE	6/11/2024 15:46	16,790.25	1835
Breaker	PLANNED OUTAGE	6/11/2024 18:27	6,505.15	1389
Breaker	PLANNED OUTAGE	6/11/2024 18:27	4.82	1
Breaker	PLANNED OUTAGE	6/11/2024 18:27	3.93	1
PLF	PLANNED OUTAGE	6/11/2024 21:48	3,961.33	40
Breaker	PLANNED OUTAGE	6/12/2024 2:49	24,257.20	1639
PLF	PLANNED OUTAGE	6/11/2024 23:25	9,525.33	32
Transformer Bank	PLANNED OUTAGE	6/12/2024 3:20	224.00	15
Transformer	PLANNED OUTAGE	6/12/2024 3:59	369.17	10
Transformer Bank	PLANNED OUTAGE	6/12/2024 3:20	62.80	4
Breaker	PLANNED OUTAGE	6/12/2024 11:22	11,777.70	1419
Breaker	PLANNED OUTAGE	6/12/2024 11:22	11.63	1
Breaker	PLANNED OUTAGE	6/12/2024 11:22	11.68	1
Breaker	PLANNED OUTAGE	6/12/2024 11:22	11.73	1
PLF	PLANNED OUTAGE	6/12/2024 14:08	483.00	20
Transformer	PLANNED OUTAGE	6/12/2024 9:40	783.08	5

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Breaker	PLANNED OUTAGE	6/12/2024 16:09	13,725.00	1525
Breaker	PLANNED OUTAGE	6/12/2024 16:09	24.55	1
Transformer	PLANNED OUTAGE	6/12/2024 23:54	1,869.83	13
Transformer	PLANNED OUTAGE	6/20/2024 8:38	185.15	7
Transformer	PLANNED OUTAGE	6/20/2024 8:48	1,023.20	12
None	PLANNED OUTAGE	6/20/2024 10:52	1,139.77	31
None	PLANNED OUTAGE	6/20/2024 10:18	1,130.60	6
Transformer	PLANNED OUTAGE	6/20/2024 14:32	124.80	6
Transformer	PLANNED OUTAGE	6/20/2024 10:15	257.85	9
Transformer Bank	PLANNED OUTAGE	6/20/2024 13:36	262.17	2
Transformer	PLANNED OUTAGE	6/20/2024 17:44	64.40	2
None	PLANNED OUTAGE	6/21/2024 10:16	33.70	1
Transformer	PLANNED OUTAGE	6/21/2024 10:32	288.20	12
Transformer	PLANNED OUTAGE	6/21/2024 8:09	268.33	4
Transformer	PLANNED OUTAGE	6/21/2024 13:52	137.87	4
Transformer	PLANNED OUTAGE	6/21/2024 14:37	53.50	3
OH Other	PLANNED OUTAGE	6/21/2024 9:38	418.75	1
UG Other	PLANNED OUTAGE	6/21/2024 9:38	376.40	1
Breaker	PLANNED OUTAGE	6/21/2024 19:37	15,742.10	242
Breaker	PLANNED OUTAGE	6/21/2024 19:37	21,446.25	387
None	PLANNED OUTAGE	6/21/2024 17:00	652.00	10
Transformer	PLANNED OUTAGE	6/22/2024 5:18	106.75	7
Transformer	PLANNED OUTAGE	6/22/2024 4:36	152.20	6
Transformer	PLANNED OUTAGE	6/22/2024 9:00	37.05	3
Invalid	PLANNED OUTAGE	6/22/2024 9:11	3.42	1
Invalid	PLANNED OUTAGE	6/22/2024 9:11	3.22	1
UG Other	PLANNED OUTAGE	6/22/2024 10:20	4,339.87	11
None	PLANNED OUTAGE	6/22/2024 15:55	263.73	23
None	PLANNED OUTAGE	6/22/2024 16:19	16,516.93	733
PLF	PLANNED OUTAGE	6/22/2024 18:01	71.87	1
Service point	PLANNED OUTAGE	6/22/2024 18:27	52.33	1
Breaker	PLANNED OUTAGE	6/22/2024 20:35	139,022.80	1211
Breaker	PLANNED OUTAGE	6/22/2024 20:35	115.05	1
Transformer	PLANNED OUTAGE	6/23/2024 2:54	109.20	12
PLF	PLANNED OUTAGE	6/23/2024 11:55	322.00	3
PLF	PLANNED OUTAGE	6/23/2024 9:20	279.53	1
PLF	PLANNED OUTAGE	6/23/2024 10:10	227.12	1
Breaker	PLANNED OUTAGE	6/09/2024 20:02	1.17	1
Breaker	PLANNED OUTAGE	6/09/2024 20:02	1.32	1
Breaker	PLANNED OUTAGE	6/09/2024 20:02	1.88	1
Transformer	PLANNED OUTAGE	6/09/2024 20:14	11.22	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	6/10/2024 3:38	83.47	2
Transformer	PLANNED OUTAGE	6/07/2024 8:19	630.73	4
Transformer	PLANNED OUTAGE	6/10/2024 9:45	131.20	4
Service point	PLANNED OUTAGE	6/10/2024 16:43	12.70	1
None	PLANNED OUTAGE	6/10/2024 16:40	1,039.50	6
Transformer	PLANNED OUTAGE	6/10/2024 13:05	1,575.23	7
Transformer	PLANNED OUTAGE	6/10/2024 20:57	71.65	3
Transformer	PLANNED OUTAGE	6/10/2024 22:08	112.35	3
Breaker	PLANNED OUTAGE	6/10/2024 21:58	46.28	1
Breaker	PLANNED OUTAGE	6/10/2024 21:58	46.62	1
None	PLANNED OUTAGE	6/10/2024 20:30	665.75	3
Breaker	PLANNED OUTAGE	6/11/2024 0:33	42.87	4
Breaker	PLANNED OUTAGE	6/11/2024 0:20	4.67	1
Breaker	PLANNED OUTAGE	6/11/2024 0:33	22.00	12
None	PLANNED OUTAGE	6/11/2024 2:23	10,798.33	110
Transformer	PLANNED OUTAGE	6/11/2024 8:45	765.48	13
PLF	PLANNED OUTAGE	6/11/2024 8:43	1,062.53	13
Breaker	PLANNED OUTAGE	6/11/2024 15:46	8.82	1
Breaker	PLANNED OUTAGE	6/11/2024 15:46	9.28	1
Breaker	PLANNED OUTAGE	6/11/2024 19:05	13.35	1
Breaker	PLANNED OUTAGE	6/11/2024 19:05	13.53	1
Breaker	PLANNED OUTAGE	6/11/2024 18:27	4.02	1
Breaker	PLANNED OUTAGE	6/11/2024 18:27	4.20	1
PLF	PLANNED OUTAGE	6/11/2024 19:26	416.80	4
PLF	PLANNED OUTAGE	6/12/2024 0:15	248.18	1
Transformer	PLANNED OUTAGE	6/12/2024 9:36	488.33	5
Breaker	PLANNED OUTAGE	6/12/2024 11:22	11.78	1
Breaker	PLANNED OUTAGE	6/12/2024 11:22	11.88	1
Switch	PLANNED OUTAGE	6/12/2024 11:48	701.92	5
Transformer	PLANNED OUTAGE	6/12/2024 13:30	193.80	4
None	PLANNED OUTAGE	7/10/2024 19:22	290.85	9
Transformer	PLANNED OUTAGE	7/10/2024 21:27	136.25	3
None	PLANNED OUTAGE	7/10/2024 20:18	131.37	1
None	PLANNED OUTAGE	7/10/2024 23:49	1,641.60	18
Transformer	PLANNED OUTAGE	7/11/2024 8:05	1,068.50	6
Transformer	PLANNED OUTAGE	7/11/2024 13:41	628.33	4
Transformer Bank	PLANNED OUTAGE	7/11/2024 17:06	308.67	5
Transformer	PLANNED OUTAGE	7/11/2024 20:23	1,892.75	15
Transformer	PLANNED OUTAGE	7/11/2024 19:16	1,184.08	5
Primary Wire	PLANNED OUTAGE	7/12/2024 1:46	1,315.40	3
Transformer Bank	PLANNED OUTAGE	7/11/2024 18:23	386.67	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	7/12/2024 11:59	510.33	4
PLF	PLANNED OUTAGE	7/12/2024 8:49	446.60	3
Service point	PLANNED OUTAGE	7/12/2024 22:57	59.07	1
Transformer Bank	PLANNED OUTAGE	7/12/2024 21:08	989.50	10
Transformer	PLANNED OUTAGE	7/13/2024 15:48	62.50	6
Transformer	PLANNED OUTAGE	7/13/2024 21:55	113.00	2
Transformer	PLANNED OUTAGE	7/14/2024 19:27	1,303.50	10
Transformer	PLANNED OUTAGE	7/14/2024 20:37	59.63	1
Transformer	PLANNED OUTAGE	7/15/2024 12:46	4.42	1
PLF	PLANNED OUTAGE	7/15/2024 16:50	102.43	2
Transformer	PLANNED OUTAGE	7/15/2024 13:50	134.25	1
Transformer	PLANNED OUTAGE	7/16/2024 4:35	38.40	1
Breaker	PLANNED OUTAGE	7/15/2024 18:36	10.45	1
Breaker	PLANNED OUTAGE	7/15/2024 18:36	10.67	1
None	PLANNED OUTAGE	7/16/2024 11:30	3.77	1
Transformer	PLANNED OUTAGE	7/16/2024 7:29	538.40	6
None	PLANNED OUTAGE	7/12/2024 23:02	424.67	1
PLF	PLANNED OUTAGE	7/12/2024 10:09	953.80	2
Transformer	PLANNED OUTAGE	7/14/2024 21:47	786.75	5
Transformer	PLANNED OUTAGE	7/14/2024 22:07	710.03	7
Service point	PLANNED OUTAGE	7/16/2024 21:22	90.77	1
PLF	PLANNED OUTAGE	7/17/2024 4:24	2,772.00	168
Transformer Bank	PLANNED OUTAGE	6/13/2024 0:09	840.45	13
Transformer	PLANNED OUTAGE	6/12/2024 8:55	3,104.15	7
Transformer	PLANNED OUTAGE	6/13/2024 20:18	1,370.00	8
Transformer	PLANNED OUTAGE	6/13/2024 15:14	1,261.60	6
PLF	PLANNED OUTAGE	6/13/2024 7:48	230.72	1
None	PLANNED OUTAGE	6/14/2024 11:17	561.90	18
Breaker	PLANNED OUTAGE	6/14/2024 10:20	365.20	44
Transformer	PLANNED OUTAGE	6/14/2024 12:09	373.45	3
Transformer	PLANNED OUTAGE	6/14/2024 9:08	93.77	2
None	PLANNED OUTAGE	6/14/2024 15:36	357.40	6
Transformer	PLANNED OUTAGE	6/14/2024 20:58	2,344.80	6
Transformer	PLANNED OUTAGE	6/15/2024 1:59	913.80	6
Transformer	PLANNED OUTAGE	6/15/2024 1:59	174.22	1
PLF	PLANNED OUTAGE	6/15/2024 12:32	100.77	2
Transformer	PLANNED OUTAGE	6/15/2024 16:59	170.50	3
Transformer	PLANNED OUTAGE	6/15/2024 18:23	254.80	7
Transformer	PLANNED OUTAGE	6/16/2024 18:12	318.80	8
Primary Wire	PLANNED OUTAGE	6/16/2024 18:36	214.17	2
Transformer Bank	PLANNED OUTAGE	6/16/2024 18:45	556.10	3

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	6/16/2024 23:02	32.40	12
Breaker	PLANNED OUTAGE	6/17/2024 6:46	46,105.33	916
Breaker	PLANNED OUTAGE	6/17/2024 6:46	45,571.80	906
Transformer	PLANNED OUTAGE	6/17/2024 9:00	73.88	1
Transformer	PLANNED OUTAGE	6/17/2024 9:27	249.17	10
Transformer	PLANNED OUTAGE	6/17/2024 10:34	17.80	1
Transformer	PLANNED OUTAGE	6/17/2024 8:34	41.25	9
Transformer	PLANNED OUTAGE	6/17/2024 16:27	55.50	5
PLF	PLANNED OUTAGE	6/17/2024 16:37	257.60	4
Transformer	PLANNED OUTAGE	6/17/2024 14:08	352.40	4
Transformer	PLANNED OUTAGE	6/17/2024 17:57	57.27	2
Transformer	PLANNED OUTAGE	6/17/2024 15:06	3,342.17	10
Transformer	PLANNED OUTAGE	6/18/2024 4:10	40.92	1
Transformer	PLANNED OUTAGE	6/18/2024 4:10	40.20	1
Transformer Bank	PLANNED OUTAGE	6/18/2024 9:06	609.73	4
Transformer Bank	PLANNED OUTAGE	6/18/2024 11:47	1,802.73	7
Switch	PLANNED OUTAGE	6/18/2024 14:29	5,068.50	155
None	PLANNED OUTAGE	6/19/2024 1:52	1,079.75	21
None	PLANNED OUTAGE	6/19/2024 1:52	174.67	4
Transformer	PLANNED OUTAGE	6/19/2024 4:46	176.75	5
None	PLANNED OUTAGE	6/19/2024 13:17	1,091.77	14
PLF	PLANNED OUTAGE	6/19/2024 13:32	371.00	6
PLF	PLANNED OUTAGE	6/19/2024 13:32	923.20	16
Transformer	PLANNED OUTAGE	6/20/2024 2:50	318.50	10
Transformer	PLANNED OUTAGE	6/20/2024 8:59	1,269.00	10
Transformer	PLANNED OUTAGE	6/20/2024 9:13	309.50	5
Transformer	PLANNED OUTAGE	6/20/2024 9:22	675.90	9
Transformer	PLANNED OUTAGE	6/20/2024 11:07	511.35	3
Transformer	PLANNED OUTAGE	6/20/2024 11:21	975.80	4
Transformer Bank	PLANNED OUTAGE	6/20/2024 19:39	54.22	1
PLF	PLANNED OUTAGE	6/21/2024 9:15	533.00	41
PLF	PLANNED OUTAGE	6/21/2024 9:15	547.40	46
Transformer	PLANNED OUTAGE	6/21/2024 12:32	89.50	3
Transformer	PLANNED OUTAGE	6/22/2024 6:30	417.07	32
Invalid	PLANNED OUTAGE	6/22/2024 9:11	3.08	1
Invalid	PLANNED OUTAGE	6/22/2024 9:11	3.20	1
Invalid	PLANNED OUTAGE	6/22/2024 9:11	3.62	1
Invalid	PLANNED OUTAGE	6/22/2024 9:11	2.80	1
Invalid	PLANNED OUTAGE	6/22/2024 9:11	3.02	1
Invalid	PLANNED OUTAGE	6/22/2024 9:11	3.43	1
Breaker	PLANNED OUTAGE	6/22/2024 20:35	120.18	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Breaker	PLANNED OUTAGE	6/22/2024 20:35	120.23	1
Transformer Bank	PLANNED OUTAGE	6/22/2024 16:25	1,005.83	5
Transformer	PLANNED OUTAGE	6/23/2024 4:37	85.17	5
Transformer	PLANNED OUTAGE	6/22/2024 22:35	3,683.85	9
Breaker	PLANNED OUTAGE	6/24/2024 14:55	3,317.33	311
Breaker	PLANNED OUTAGE	6/24/2024 14:55	15.73	1
Transformer	PLANNED OUTAGE	7/17/2024 10:58	58.15	3
Transformer Bank	PLANNED OUTAGE	7/17/2024 8:31	50.03	1
Transformer	PLANNED OUTAGE	7/17/2024 9:54	206.98	11
Breaker	PLANNED OUTAGE	7/17/2024 16:49	22.68	1
Transformer	PLANNED OUTAGE	7/17/2024 18:33	59.50	7
Transformer Bank	PLANNED OUTAGE	7/17/2024 19:50	101.37	2
Transformer Bank	PLANNED OUTAGE	7/17/2024 21:46	79.50	2
PLF	PLANNED OUTAGE	7/17/2024 16:12	12,793.40	47
Pole	PLANNED OUTAGE	7/17/2024 6:00	1,975.33	10
Transformer	PLANNED OUTAGE	7/18/2024 8:35	441.13	4
Transformer Bank	PLANNED OUTAGE	7/18/2024 11:25	61.97	2
Transformer	PLANNED OUTAGE	7/18/2024 9:56	452.00	6
Transformer	PLANNED OUTAGE	7/18/2024 11:10	23.80	3
Breaker	PLANNED OUTAGE	7/14/2024 17:36	167,946.00	1217
Transformer	PLANNED OUTAGE	7/19/2024 8:03	224.82	7
Transformer	PLANNED OUTAGE	7/19/2024 8:47	682.40	8
Invalid	PLANNED OUTAGE	7/19/2024 9:23	64.37	1
UG Other	PLANNED OUTAGE	7/19/2024 17:57	864.53	4
Switch	PLANNED OUTAGE	7/19/2024 21:33	160.33	10
Transformer	PLANNED OUTAGE	7/20/2024 4:09	242.20	6
PLF	PLANNED OUTAGE	7/20/2024 8:43	258.60	1
Transformer	PLANNED OUTAGE	7/20/2024 23:20	152.33	2
Transformer	PLANNED OUTAGE	7/22/2024 9:34	395.30	6
Transformer	PLANNED OUTAGE	7/22/2024 11:24	55.80	1
Transformer	PLANNED OUTAGE	7/22/2024 21:00	300.00	8
PLF	PLANNED OUTAGE	7/22/2024 22:53	4,953.73	53
Transformer	PLANNED OUTAGE	7/23/2024 1:16	15.23	2
Transformer	PLANNED OUTAGE	7/23/2024 9:58	32.80	2
Transformer	PLANNED OUTAGE	7/23/2024 9:37	79.48	1
Transformer	PLANNED OUTAGE	6/12/2024 11:27	66.93	2
Transformer Bank	PLANNED OUTAGE	6/12/2024 14:28	119.40	2
Transformer	PLANNED OUTAGE	6/12/2024 17:08	366.60	12
Breaker	PLANNED OUTAGE	6/12/2024 16:09	24.62	1
Breaker	PLANNED OUTAGE	6/12/2024 16:09	24.87	1
PLF	PLANNED OUTAGE	6/12/2024 17:08	588.08	5

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	6/13/2024 8:43	229.80	1
Breaker	PLANNED OUTAGE	6/13/2024 13:57	197.87	2
Transformer	PLANNED OUTAGE	6/14/2024 7:25	23.93	4
PLF	PLANNED OUTAGE	6/14/2024 11:58	295.00	2
Transformer	PLANNED OUTAGE	6/14/2024 11:24	587.93	4
Primary Wire	PLANNED OUTAGE	6/14/2024 16:36	130.05	3
Transformer Bank	PLANNED OUTAGE	6/15/2024 23:23	143.65	3
Transformer	PLANNED OUTAGE	6/15/2024 23:00	7,635.83	25
Transformer	PLANNED OUTAGE	6/16/2024 12:16	66.53	4
Transformer	PLANNED OUTAGE	6/16/2024 13:25	744.50	6
Transformer	PLANNED OUTAGE	6/16/2024 16:35	117.20	2
Transformer	PLANNED OUTAGE	6/17/2024 13:02	152.80	8
Transformer	PLANNED OUTAGE	6/17/2024 9:18	1,304.92	5
Primary Wire	PLANNED OUTAGE	6/17/2024 22:10	818.35	13
Transformer	PLANNED OUTAGE	6/18/2024 3:53	2,271.73	16
Transformer	PLANNED OUTAGE	6/18/2024 10:14	836.53	16
Transformer	PLANNED OUTAGE	6/18/2024 9:54	497.65	37
PLF	PLANNED OUTAGE	6/18/2024 13:58	2,326.40	32
Transformer Bank	PLANNED OUTAGE	6/18/2024 16:33	95.50	2
Transformer	PLANNED OUTAGE	6/18/2024 20:26	118.50	10
Transformer	PLANNED OUTAGE	6/19/2024 11:27	249.47	8
None	PLANNED OUTAGE	6/19/2024 8:47	505.33	5
Transformer	PLANNED OUTAGE	6/19/2024 10:42	51.83	1
Transformer	PLANNED OUTAGE	6/19/2024 11:00	175.07	8
Transformer	PLANNED OUTAGE	6/19/2024 8:17	2,224.32	37
Transformer	PLANNED OUTAGE	6/19/2024 17:06	245.10	6
None	PLANNED OUTAGE	6/19/2024 20:38	1,040.60	86
Transformer Bank	PLANNED OUTAGE	6/24/2024 12:45	368.58	5
Transformer	PLANNED OUTAGE	6/24/2024 12:51	498.60	4
Transformer	PLANNED OUTAGE	6/24/2024 17:56	278.00	12
Breaker	PLANNED OUTAGE	6/24/2024 21:33	7,359.42	1879
Transformer	PLANNED OUTAGE	6/25/2024 9:25	419.00	5
Transformer	PLANNED OUTAGE	6/25/2024 9:32	1,096.92	5
Transformer	PLANNED OUTAGE	6/25/2024 18:01	135.80	7
Transformer	PLANNED OUTAGE	6/25/2024 17:03	56.57	1
Transformer	PLANNED OUTAGE	6/25/2024 18:29	143.58	5
Transformer	PLANNED OUTAGE	6/26/2024 11:15	18.65	1
Transformer	PLANNED OUTAGE	6/27/2024 8:52	684.53	8
Transformer	PLANNED OUTAGE	6/28/2024 0:22	350.25	5
Transformer	PLANNED OUTAGE	6/28/2024 2:12	326.67	8
PLF	PLANNED OUTAGE	6/28/2024 8:41	120.13	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	6/28/2024 9:24	1,767.33	5
Transformer	PLANNED OUTAGE	6/29/2024 13:06	191.60	8
Primary Wire	PLANNED OUTAGE	6/29/2024 15:08	3,896.60	12
PLF	PLANNED OUTAGE	6/29/2024 17:56	10,774.40	37
Transformer	PLANNED OUTAGE	6/29/2024 18:17	481.75	3
Transformer	PLANNED OUTAGE	6/29/2024 17:56	502.60	6
Transformer	PLANNED OUTAGE	6/29/2024 17:56	674.27	8
Breaker	PLANNED OUTAGE	6/30/2024 16:10	9,161.93	212
Breaker	PLANNED OUTAGE	6/30/2024 16:10	3,084.23	134
Breaker	PLANNED OUTAGE	6/30/2024 16:10	2,133.50	51
PLF	PLANNED OUTAGE	6/30/2024 19:14	89.67	4
Transformer	PLANNED OUTAGE	6/30/2024 20:17	143.50	6
PLF	PLANNED OUTAGE	6/30/2024 18:04	461.33	32
PLF	PLANNED OUTAGE	7/01/2024 0:41	257.33	8
Transformer	PLANNED OUTAGE	7/01/2024 0:43	154.33	5
PLF	PLANNED OUTAGE	7/01/2024 0:41	94.15	3
PLF	PLANNED OUTAGE	6/28/2024 6:16	38,889.60	36
Transformer	PLANNED OUTAGE	7/01/2024 10:57	755.58	5
Switch	PLANNED OUTAGE	7/23/2024 10:17	219.15	1
Transformer	PLANNED OUTAGE	7/23/2024 19:47	127.53	4
Switch	PLANNED OUTAGE	7/23/2024 21:40	14,971.95	343
Breaker	PLANNED OUTAGE	7/24/2024 1:00	12,540.00	1100
None	PLANNED OUTAGE	7/24/2024 4:39	10,013.57	431
PLF	PLANNED OUTAGE	7/24/2024 4:39	1,089.42	17
Transformer	PLANNED OUTAGE	7/24/2024 9:53	338.30	6
PLF	PLANNED OUTAGE	7/24/2024 10:07	67.75	1
PLF	PLANNED OUTAGE	7/24/2024 10:29	1,076.40	69
Transformer	PLANNED OUTAGE	7/24/2024 14:02	111.08	5
Transformer	PLANNED OUTAGE	7/24/2024 13:28	362.17	10
Transformer	PLANNED OUTAGE	7/24/2024 11:43	24.38	1
Transformer	PLANNED OUTAGE	7/24/2024 8:44	691.80	3
Transformer Bank	PLANNED OUTAGE	7/25/2024 9:44	126.55	1
PLF	PLANNED OUTAGE	7/25/2024 9:59	107.22	1
Transformer Bank	PLANNED OUTAGE	7/25/2024 13:32	28.28	1
None	PLANNED OUTAGE	7/25/2024 11:08	286.17	5
None	PLANNED OUTAGE	7/25/2024 20:22	390.58	5
Primary Wire	PLANNED OUTAGE	7/26/2024 1:13	396.47	2
PLF	PLANNED OUTAGE	7/26/2024 8:53	1,192.30	3
PLF	PLANNED OUTAGE	7/26/2024 8:06	151.90	1
Transformer	PLANNED OUTAGE	7/26/2024 8:42	1,381.50	10
Transformer	PLANNED OUTAGE	7/26/2024 8:45	789.70	3

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
None	PLANNED OUTAGE	7/26/2024 15:56	1.72	1
OH Other	PLANNED OUTAGE	7/26/2024 17:31	105.35	1
Breaker	PLANNED OUTAGE	7/27/2024 3:27	9.30	1
Breaker	PLANNED OUTAGE	7/27/2024 3:27	9.30	1
Breaker	PLANNED OUTAGE	7/27/2024 3:27	9.30	1
Transformer	PLANNED OUTAGE	7/27/2024 10:09	122.30	3
Transformer	PLANNED OUTAGE	7/27/2024 10:55	91.08	1
PLF	PLANNED OUTAGE	7/28/2024 10:29	258.85	1
Transformer	PLANNED OUTAGE	7/28/2024 13:35	236.83	5
Transformer	PLANNED OUTAGE	6/20/2024 0:01	51.05	1
Transformer	PLANNED OUTAGE	6/20/2024 2:03	186.60	4
Transformer	PLANNED OUTAGE	6/20/2024 9:39	288.17	10
Transformer Bank	PLANNED OUTAGE	6/20/2024 17:57	99.20	3
Transformer	PLANNED OUTAGE	6/20/2024 23:33	83.53	4
Transformer	PLANNED OUTAGE	6/21/2024 9:07	211.87	8
PLF	PLANNED OUTAGE	6/21/2024 9:04	445.10	6
PLF	PLANNED OUTAGE	6/21/2024 9:41	10,874.30	37
Transformer	PLANNED OUTAGE	6/21/2024 10:31	1,016.40	9
PLF	PLANNED OUTAGE	6/21/2024 13:48	227.27	4
Transformer Bank	PLANNED OUTAGE	6/21/2024 9:49	132.92	1
PLF	PLANNED OUTAGE	6/22/2024 1:53	1,210.97	17
UG Other	PLANNED OUTAGE	6/22/2024 10:20	2,731.20	36
Invalid	PLANNED OUTAGE	6/22/2024 9:11	3.72	1
Invalid	PLANNED OUTAGE	6/22/2024 9:11	3.10	1
Invalid	PLANNED OUTAGE	6/22/2024 9:11	3.27	1
Invalid	PLANNED OUTAGE	6/22/2024 9:11	3.18	1
UG Other	PLANNED OUTAGE	6/22/2024 10:20	5,135.43	13
Transformer	PLANNED OUTAGE	6/22/2024 14:59	389.40	11
Breaker	PLANNED OUTAGE	6/22/2024 20:35	115.05	1
Breaker	PLANNED OUTAGE	6/22/2024 20:35	120.15	1
Transformer	PLANNED OUTAGE	6/23/2024 2:15	364.90	6
Transformer	PLANNED OUTAGE	6/23/2024 4:04	632.40	9
PLF	PLANNED OUTAGE	6/23/2024 10:49	190.67	8
PLF	PLANNED OUTAGE	6/23/2024 11:12	164.98	1
Transformer	PLANNED OUTAGE	6/24/2024 10:26	63.37	2
Transformer	PLANNED OUTAGE	6/24/2024 11:20	70.43	2
Transformer	PLANNED OUTAGE	6/24/2024 11:57	87.43	2
Transformer	PLANNED OUTAGE	6/24/2024 12:40	80.95	3
Transformer	PLANNED OUTAGE	6/24/2024 11:05	672.80	6
Breaker	PLANNED OUTAGE	6/24/2024 21:33	13.87	1
Breaker	PLANNED OUTAGE	6/24/2024 21:33	13.87	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	6/25/2024 8:14	39.83	2
Transformer	PLANNED OUTAGE	6/25/2024 9:05	255.30	6
Transformer	PLANNED OUTAGE	6/23/2024 11:23	1,792.53	16
Transformer	PLANNED OUTAGE	6/23/2024 11:32	103.27	1
Transformer	PLANNED OUTAGE	6/24/2024 0:30	83.67	5
Transformer	PLANNED OUTAGE	6/24/2024 1:18	16.28	1
Transformer	PLANNED OUTAGE	6/23/2024 11:09	2,684.47	4
PLF	PLANNED OUTAGE	6/22/2024 23:13	993.73	1
Transformer Bank	PLANNED OUTAGE	6/24/2024 8:37	348.93	1
PLF	PLANNED OUTAGE	6/24/2024 14:14	207.73	41
Transformer Bank	PLANNED OUTAGE	6/24/2024 10:16	118.22	1
Breaker	PLANNED OUTAGE	6/24/2024 21:45	17.47	8
PLF	PLANNED OUTAGE	6/25/2024 0:14	507.92	23
Breaker	PLANNED OUTAGE	6/25/2024 9:05	10.45	1
Breaker	PLANNED OUTAGE	6/25/2024 9:05	10.70	1
Breaker	PLANNED OUTAGE	6/25/2024 9:05	10.92	1
Switch	PLANNED OUTAGE	6/25/2024 11:26	6,174.60	251
Switch	PLANNED OUTAGE	6/25/2024 11:26	24.83	1
Transformer	PLANNED OUTAGE	6/25/2024 8:25	523.48	7
Breaker	PLANNED OUTAGE	6/25/2024 14:27	10.45	1
Breaker	PLANNED OUTAGE	6/25/2024 14:27	10.60	1
Breaker	PLANNED OUTAGE	6/25/2024 14:27	10.70	1
Breaker	PLANNED OUTAGE	6/25/2024 14:27	10.82	1
Transformer	PLANNED OUTAGE	6/25/2024 20:28	222.30	9
Transformer	PLANNED OUTAGE	6/25/2024 21:30	67.00	5
PLF	PLANNED OUTAGE	6/26/2024 9:58	16.70	2
Transformer	PLANNED OUTAGE	6/26/2024 10:30	124.12	11
PLF	PLANNED OUTAGE	6/26/2024 10:42	673.60	8
Transformer	PLANNED OUTAGE	6/26/2024 8:37	1,010.27	8
PLF	PLANNED OUTAGE	6/26/2024 8:39	2,597.00	7
Transformer	PLANNED OUTAGE	6/26/2024 10:59	705.13	7
PLF	PLANNED OUTAGE	6/26/2024 14:45	423.73	16
Transformer	PLANNED OUTAGE	6/27/2024 17:17	62.40	4
None	PLANNED OUTAGE	6/27/2024 14:42	269.00	5
Transformer	PLANNED OUTAGE	6/27/2024 14:47	84.35	3
PLF	PLANNED OUTAGE	7/01/2024 17:03	1,147.25	15
PLF	PLANNED OUTAGE	7/01/2024 17:01	577.80	6
Transformer	PLANNED OUTAGE	7/02/2024 11:23	98.67	5
Primary Wire	PLANNED OUTAGE	7/02/2024 9:54	244.98	1
Transformer	PLANNED OUTAGE	7/02/2024 12:57	383.08	5
Breaker	PLANNED OUTAGE	7/02/2024 14:19	9,594.00	1230

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Breaker	PLANNED OUTAGE	7/02/2024 14:19	7.78	1
Breaker	PLANNED OUTAGE	7/02/2024 14:19	7.78	1
Transformer Bank	PLANNED OUTAGE	7/02/2024 11:01	157.73	2
Transformer	PLANNED OUTAGE	7/03/2024 5:14	40.70	3
PLF	PLANNED OUTAGE	7/03/2024 10:50	193.67	2
Transformer	PLANNED OUTAGE	7/03/2024 12:15	740.33	5
Service point	PLANNED OUTAGE	7/03/2024 16:24	105.87	1
Transformer	PLANNED OUTAGE	7/04/2024 10:24	283.48	1
Transformer	PLANNED OUTAGE	7/04/2024 15:54	128.93	8
Transformer	PLANNED OUTAGE	7/05/2024 5:11	33.17	5
Transformer	PLANNED OUTAGE	7/05/2024 2:39	183.73	8
Transformer	PLANNED OUTAGE	7/05/2024 3:05	94.20	4
Transformer	PLANNED OUTAGE	7/05/2024 8:35	425.48	7
Service point	PLANNED OUTAGE	7/05/2024 11:32	121.53	1
Transformer	PLANNED OUTAGE	7/06/2024 6:16	18.15	1
None	PLANNED OUTAGE	7/06/2024 21:47	3,298.50	45
Transformer	PLANNED OUTAGE	7/07/2024 2:21	7.35	7
Transformer Bank	PLANNED OUTAGE	7/07/2024 12:33	51.30	1
Transformer	PLANNED OUTAGE	7/08/2024 10:23	224.00	2
Transformer	PLANNED OUTAGE	7/08/2024 13:06	283.33	10
Transformer	PLANNED OUTAGE	7/08/2024 21:08	245.40	9
None	PLANNED OUTAGE	7/08/2024 22:23	233.40	4
Primary Wire	PLANNED OUTAGE	7/08/2024 23:10	2,969.63	14
None	PLANNED OUTAGE	7/09/2024 5:05	113.45	3
PLF	PLANNED OUTAGE	7/09/2024 6:19	162.33	20
Invalid	PLANNED OUTAGE	7/09/2024 8:39	9,624.87	118
Transformer	PLANNED OUTAGE	7/09/2024 9:06	4,554.60	18
None	PLANNED OUTAGE	7/28/2024 17:13	433,008.90	1341
None	PLANNED OUTAGE	7/28/2024 17:13	323.65	1
None	PLANNED OUTAGE	7/29/2024 2:56	154.70	1
Breaker	PLANNED OUTAGE	7/29/2024 6:54	18,664.80	924
Breaker	PLANNED OUTAGE	7/29/2024 6:54	20.43	1
Transformer	PLANNED OUTAGE	7/29/2024 10:29	86.00	5
Transformer	PLANNED OUTAGE	7/29/2024 9:56	256.00	8
Transformer	PLANNED OUTAGE	7/29/2024 11:05	267.60	12
Transformer	PLANNED OUTAGE	7/29/2024 10:03	1,389.75	9
Transformer	PLANNED OUTAGE	7/29/2024 13:09	899.10	9
Transformer	PLANNED OUTAGE	7/29/2024 15:53	385.87	8
Transformer	PLANNED OUTAGE	7/29/2024 14:38	434.20	2
Transformer	PLANNED OUTAGE	7/29/2024 20:34	8.47	1
Transformer	PLANNED OUTAGE	7/30/2024 2:51	227.33	11

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
None	PLANNED OUTAGE	7/30/2024 9:08	760.08	7
Transformer	PLANNED OUTAGE	7/30/2024 9:32	71.73	4
Transformer	PLANNED OUTAGE	7/30/2024 10:00	243.60	8
Transformer	PLANNED OUTAGE	7/30/2024 10:57	1,243.67	7
Transformer	PLANNED OUTAGE	7/30/2024 11:10	47.73	4
Transformer Bank	PLANNED OUTAGE	7/30/2024 11:37	41.28	1
Transformer	PLANNED OUTAGE	7/30/2024 11:48	64.50	2
None	PLANNED OUTAGE	7/30/2024 10:48	581.23	2
PLF	PLANNED OUTAGE	7/30/2024 14:31	281.73	8
PLF	PLANNED OUTAGE	7/30/2024 22:08	1,044.20	138
Service point	PLANNED OUTAGE	7/30/2024 22:52	29.08	1
Switch	PLANNED OUTAGE	7/30/2024 22:41	161.70	1
Transformer	PLANNED OUTAGE	7/31/2024 7:16	76.57	1
Invalid	PLANNED OUTAGE	7/31/2024 6:18	323.87	8
Transformer Bank	PLANNED OUTAGE	7/31/2024 11:55	1,278.90	7
Transformer	PLANNED OUTAGE	7/31/2024 11:34	131.60	6
Transformer	PLANNED OUTAGE	7/31/2024 10:24	125.42	7
Transformer	PLANNED OUTAGE	7/31/2024 9:25	1,264.95	9
Transformer	PLANNED OUTAGE	6/27/2024 22:41	55.37	2
Transformer	PLANNED OUTAGE	6/27/2024 23:10	25.08	1
Breaker	PLANNED OUTAGE	6/27/2024 18:05	6.20	1
Breaker	PLANNED OUTAGE	6/27/2024 18:05	6.20	1
Breaker	PLANNED OUTAGE	6/27/2024 18:05	6.20	1
Transformer	PLANNED OUTAGE	6/28/2024 6:40	42.67	2
Transformer	PLANNED OUTAGE	6/28/2024 13:41	203.58	5
Transformer	PLANNED OUTAGE	6/28/2024 8:50	1,152.27	8
Transformer	PLANNED OUTAGE	6/28/2024 14:22	295.90	6
PLF	PLANNED OUTAGE	6/28/2024 22:06	111.42	7
Transformer	PLANNED OUTAGE	6/29/2024 7:39	28.05	11
PLF	PLANNED OUTAGE	6/29/2024 8:03	276.53	8
Transformer	PLANNED OUTAGE	6/29/2024 5:30	73.77	2
Transformer	PLANNED OUTAGE	6/29/2024 13:08	309.70	3
PLF	PLANNED OUTAGE	6/29/2024 9:07	6,803.87	22
Transformer	PLANNED OUTAGE	6/29/2024 15:21	127.35	9
PLF	PLANNED OUTAGE	6/29/2024 21:24	426.27	1
Primary Wire	PLANNED OUTAGE	6/30/2024 20:40	482.80	8
Transformer	PLANNED OUTAGE	7/01/2024 7:59	2,527.00	10
Breaker	PLANNED OUTAGE	7/01/2024 14:46	59.75	1
Breaker	PLANNED OUTAGE	7/01/2024 14:48	57.85	1
Breaker	PLANNED OUTAGE	7/01/2024 14:48	57.62	1
PLF	PLANNED OUTAGE	7/01/2024 19:27	155.72	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	7/01/2024 23:34	190.27	4
Breaker	PLANNED OUTAGE	6/25/2024 9:05	10.92	1
Transformer	PLANNED OUTAGE	6/25/2024 10:00	130.90	2
Transformer	PLANNED OUTAGE	6/25/2024 8:26	51.33	2
Transformer	PLANNED OUTAGE	6/25/2024 8:39	647.73	8
Transformer	PLANNED OUTAGE	6/25/2024 8:34	2,516.60	12
Breaker	PLANNED OUTAGE	6/25/2024 14:27	3,253.17	655
Breaker	PLANNED OUTAGE	6/25/2024 14:27	10.90	1
Breaker	PLANNED OUTAGE	6/25/2024 14:27	12.55	1
Transformer	PLANNED OUTAGE	6/25/2024 15:02	42.32	1
Transformer	PLANNED OUTAGE	6/25/2024 18:51	18.52	1
Transformer	PLANNED OUTAGE	6/25/2024 20:15	74.30	3
PLF	PLANNED OUTAGE	6/25/2024 9:01	2,319.68	7
Transformer	PLANNED OUTAGE	6/26/2024 9:01	846.65	7
None	PLANNED OUTAGE	6/26/2024 10:36	7,358.40	32
PLF	PLANNED OUTAGE	6/26/2024 9:00	349.55	1
Transformer	PLANNED OUTAGE	6/27/2024 0:04	311.97	2
PLF	PLANNED OUTAGE	6/26/2024 6:58	655.20	18
Transformer	PLANNED OUTAGE	6/26/2024 7:13	1,216.13	7
PLF	PLANNED OUTAGE	6/27/2024 7:35	135.90	1
Transformer	PLANNED OUTAGE	6/27/2024 9:01	172.93	1
Transformer	PLANNED OUTAGE	6/27/2024 10:02	28.45	1
Transformer	PLANNED OUTAGE	6/27/2024 11:38	792.50	10
Transformer	PLANNED OUTAGE	6/27/2024 15:19	202.20	6
Breaker	PLANNED OUTAGE	6/27/2024 18:05	6.20	1
Breaker	PLANNED OUTAGE	6/27/2024 18:05	6.20	1
Invalid	PLANNED OUTAGE	6/28/2024 9:22	150.77	1
Transformer	PLANNED OUTAGE	6/28/2024 12:40	173.70	3
Transformer	PLANNED OUTAGE	6/29/2024 13:07	242.40	6
PLF	PLANNED OUTAGE	7/31/2024 14:32	3,417.60	48
Transformer	PLANNED OUTAGE	7/31/2024 12:52	179.47	2
PLF	PLANNED OUTAGE	7/31/2024 17:23	104.40	4
Transformer	PLANNED OUTAGE	8/01/2024 3:05	2,302.07	14
Transformer	PLANNED OUTAGE	8/01/2024 8:04	36.43	1
Transformer	PLANNED OUTAGE	8/01/2024 7:39	246.00	6
PLF	PLANNED OUTAGE	8/01/2024 11:06	176.12	1
Transformer	PLANNED OUTAGE	8/01/2024 14:27	68.67	5
None	PLANNED OUTAGE	8/01/2024 12:18	624.00	13
Transformer	PLANNED OUTAGE	8/01/2024 6:18	3,865.33	10
PLF	PLANNED OUTAGE	8/01/2024 9:10	844.60	4
Transformer	PLANNED OUTAGE	8/01/2024 15:14	643.07	8

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Primary Wire	PLANNED OUTAGE	8/01/2024 13:27	890.50	5
Transformer Bank	PLANNED OUTAGE	8/02/2024 17:21	141.32	1
PLF	PLANNED OUTAGE	8/03/2024 1:00	676.40	3
Breaker	PLANNED OUTAGE	8/03/2024 15:04	29,645.25	2115
Breaker	PLANNED OUTAGE	8/03/2024 15:04	13.85	1
Breaker	PLANNED OUTAGE	8/03/2024 19:04	6,739.32	281
Transformer	PLANNED OUTAGE	8/04/2024 1:00	21.50	2
Breaker	PLANNED OUTAGE	8/02/2024 12:53	3,802.33	1870
PLF	PLANNED OUTAGE	7/09/2024 18:29	1,054.67	28
Transformer Bank	PLANNED OUTAGE	7/09/2024 21:41	751.47	4
None	PLANNED OUTAGE	7/09/2024 19:40	2,174.80	8
Transformer	PLANNED OUTAGE	7/10/2024 9:39	1,257.60	12
Transformer	PLANNED OUTAGE	7/10/2024 9:45	296.80	2
Transformer	PLANNED OUTAGE	7/10/2024 8:39	3,219.30	9
Transformer	PLANNED OUTAGE	7/10/2024 11:28	749.58	7
Transformer	PLANNED OUTAGE	7/10/2024 15:11	314.80	8
Transformer	PLANNED OUTAGE	7/10/2024 22:01	13.87	2
Transformer	PLANNED OUTAGE	7/10/2024 13:54	131.13	4
Transformer	PLANNED OUTAGE	7/11/2024 9:10	379.08	5
Transformer	PLANNED OUTAGE	7/11/2024 16:48	1,442.12	7
Switch	PLANNED OUTAGE	7/12/2024 1:46	70,566.60	1079
PLF	PLANNED OUTAGE	7/11/2024 23:46	798.43	17
PLF	PLANNED OUTAGE	7/11/2024 7:22	38,897.00	97
Transformer	PLANNED OUTAGE	7/12/2024 6:12	73.23	2
Transformer Bank	PLANNED OUTAGE	7/12/2024 5:54	457.00	3
Transformer	PLANNED OUTAGE	7/12/2024 10:26	1,093.70	6
Transformer	PLANNED OUTAGE	7/12/2024 16:19	447.33	4
Invalid	PLANNED OUTAGE	7/12/2024 21:16	675.40	22
Invalid	PLANNED OUTAGE	7/12/2024 21:16	422.70	3
Invalid	PLANNED OUTAGE	7/12/2024 21:16	658.58	5
Transformer	PLANNED OUTAGE	7/12/2024 22:40	200.45	3
PLF	PLANNED OUTAGE	7/13/2024 10:34	343.63	1
Transformer	PLANNED OUTAGE	7/13/2024 20:04	328.40	3
Breaker	PLANNED OUTAGE	7/14/2024 19:37	31.30	1
Breaker	PLANNED OUTAGE	7/14/2024 19:37	2,059.17	175
Transformer Bank	PLANNED OUTAGE	7/14/2024 16:00	23.67	2
Transformer	PLANNED OUTAGE	7/15/2024 12:02	1,824.50	10
Transformer	PLANNED OUTAGE	7/02/2024 4:00	66.47	2
Transformer	PLANNED OUTAGE	7/02/2024 10:25	1,307.75	15
Breaker	PLANNED OUTAGE	7/02/2024 14:19	10.23	1
Breaker	PLANNED OUTAGE	7/02/2024 14:19	10.28	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Breaker	PLANNED OUTAGE	7/02/2024 14:19	12.07	1
Breaker	PLANNED OUTAGE	7/02/2024 14:19	12.12	1
Transformer	PLANNED OUTAGE	7/02/2024 16:09	45.33	4
Transformer	PLANNED OUTAGE	7/02/2024 10:01	418.58	5
Transformer	PLANNED OUTAGE	7/02/2024 13:20	114.55	1
Transformer Bank	PLANNED OUTAGE	7/02/2024 15:19	917.10	3
Transformer	PLANNED OUTAGE	7/03/2024 8:59	6,390.52	43
None	PLANNED OUTAGE	7/03/2024 10:47	356.13	8
Transformer	PLANNED OUTAGE	7/03/2024 10:51	163.13	4
None	PLANNED OUTAGE	7/05/2024 9:43	2,053.67	20
Invalid	PLANNED OUTAGE	7/05/2024 9:49	226.27	2
Transformer	PLANNED OUTAGE	7/05/2024 13:19	77.45	1
Transformer	PLANNED OUTAGE	7/05/2024 13:46	300.80	8
Transformer Bank	PLANNED OUTAGE	7/06/2024 12:00	32.67	4
None	PLANNED OUTAGE	7/06/2024 12:21	102.62	1
Transformer	PLANNED OUTAGE	7/06/2024 13:08	71.20	2
Transformer Bank	PLANNED OUTAGE	7/07/2024 13:22	207.83	5
Transformer	PLANNED OUTAGE	7/07/2024 13:03	144.67	7
Transformer	PLANNED OUTAGE	7/07/2024 13:57	100.90	6
Transformer	PLANNED OUTAGE	7/07/2024 19:27	96.30	2
PLF	PLANNED OUTAGE	7/07/2024 23:53	2,374.17	10
PLF	PLANNED OUTAGE	7/08/2024 3:52	25.83	10
PLF	PLANNED OUTAGE	7/08/2024 3:51	43.83	10
PLF	PLANNED OUTAGE	7/08/2024 10:04	114.45	3
Transformer	PLANNED OUTAGE	7/08/2024 12:15	45.67	4
None	PLANNED OUTAGE	7/09/2024 1:41	178.30	3
Transformer	PLANNED OUTAGE	7/09/2024 10:38	150.60	18
Transformer	PLANNED OUTAGE	7/09/2024 8:45	2,726.80	8
None	PLANNED OUTAGE	7/09/2024 10:55	1,133.07	14
Transformer	PLANNED OUTAGE	6/30/2024 12:33	12.53	1
None	PLANNED OUTAGE	6/30/2024 17:53	823.08	5
None	PLANNED OUTAGE	7/01/2024 0:17	1,836.00	27
Transformer	PLANNED OUTAGE	7/01/2024 0:41	936.10	3
Transformer Bank	PLANNED OUTAGE	6/28/2024 14:13	576.87	1
Service point	PLANNED OUTAGE	7/01/2024 12:35	5.80	1
Transformer	PLANNED OUTAGE	7/01/2024 11:35	119.98	1
Breaker	PLANNED OUTAGE	7/01/2024 14:48	73,837.87	1276
Breaker	PLANNED OUTAGE	7/01/2024 14:48	57.48	1
PLF	PLANNED OUTAGE	7/01/2024 21:21	291.37	2
Transformer	PLANNED OUTAGE	7/02/2024 4:45	36.85	1
Transformer	PLANNED OUTAGE	7/01/2024 10:38	605.87	4

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer Bank	PLANNED OUTAGE	7/01/2024 15:57	551.17	1
Transformer	PLANNED OUTAGE	7/02/2024 8:49	6,209.33	16
PLF	PLANNED OUTAGE	7/02/2024 9:21	253.18	1
Breaker	PLANNED OUTAGE	7/02/2024 14:19	7.78	1
Breaker	PLANNED OUTAGE	7/02/2024 14:19	10.18	1
Transformer	PLANNED OUTAGE	7/02/2024 10:38	99.73	1
None	PLANNED OUTAGE	7/03/2024 0:31	652.80	4
Transformer	PLANNED OUTAGE	7/03/2024 5:48	157.10	6
Transformer	PLANNED OUTAGE	7/03/2024 8:49	108.35	1
Transformer	PLANNED OUTAGE	7/03/2024 12:40	122.33	1
Transformer	PLANNED OUTAGE	7/03/2024 13:03	690.90	6
PLF	PLANNED OUTAGE	7/04/2024 0:03	334.67	8
Transformer	PLANNED OUTAGE	7/04/2024 6:28	234.93	4
Transformer	PLANNED OUTAGE	7/04/2024 12:47	177.68	7
Breaker	PLANNED OUTAGE	7/04/2024 17:04	1,736.73	436
PLF	PLANNED OUTAGE	7/05/2024 10:56	805.70	42
PLF	PLANNED OUTAGE	7/05/2024 9:07	124.28	1
Transformer	PLANNED OUTAGE	7/05/2024 10:28	20.40	1
Transformer	PLANNED OUTAGE	7/05/2024 12:54	430.10	11
Transformer	PLANNED OUTAGE	7/05/2024 22:19	267.28	7
None	PLANNED OUTAGE	7/15/2024 11:50	1,761.15	59
Transformer	PLANNED OUTAGE	7/15/2024 18:55	648.50	10
Transformer Bank	PLANNED OUTAGE	7/15/2024 22:41	107.07	2
PLF	PLANNED OUTAGE	7/16/2024 7:17	185.10	18
Breaker	PLANNED OUTAGE	7/15/2024 18:36	10.80	1
Transformer	PLANNED OUTAGE	7/16/2024 11:40	11.07	8
PLF	PLANNED OUTAGE	7/16/2024 9:23	92.93	4
Breaker	PLANNED OUTAGE	7/14/2024 22:20	7,899.63	881
Transformer	PLANNED OUTAGE	7/16/2024 12:47	662.10	9
Transformer	PLANNED OUTAGE	7/16/2024 12:51	816.00	9
Transformer	PLANNED OUTAGE	7/16/2024 8:29	3,318.90	9
Transformer	PLANNED OUTAGE	7/16/2024 9:50	217.57	2
Transformer	PLANNED OUTAGE	7/16/2024 10:55	2,004.00	8
Service point	PLANNED OUTAGE	7/16/2024 17:18	180.35	1
Transformer	PLANNED OUTAGE	7/16/2024 23:18	271.20	6
Transformer	PLANNED OUTAGE	7/17/2024 0:11	115.53	1
None	PLANNED OUTAGE	7/17/2024 0:16	358.98	7
Transformer	PLANNED OUTAGE	7/16/2024 20:02	2,017.20	6
Transformer	PLANNED OUTAGE	7/17/2024 8:49	180.08	1
Transformer	PLANNED OUTAGE	7/17/2024 9:13	502.25	5
PLF	PLANNED OUTAGE	7/17/2024 17:20	30.77	13

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	7/18/2024 8:43	5,589.07	16
Transformer	PLANNED OUTAGE	7/18/2024 11:58	373.47	4
Transformer	PLANNED OUTAGE	7/18/2024 11:18	74.00	6
Transformer	PLANNED OUTAGE	7/18/2024 16:39	347.83	10
Transformer Bank	PLANNED OUTAGE	7/19/2024 12:17	49.97	2
PLF	PLANNED OUTAGE	7/19/2024 9:02	964.05	3
Transformer	PLANNED OUTAGE	7/19/2024 10:59	109.20	7
Transformer	PLANNED OUTAGE	7/19/2024 13:40	29.25	3
Transformer	PLANNED OUTAGE	7/19/2024 20:36	42.17	5
PLF	PLANNED OUTAGE	7/19/2024 18:33	282.50	25
None	PLANNED OUTAGE	7/20/2024 0:44	23,020.55	53
Transformer	PLANNED OUTAGE	7/20/2024 11:47	55.30	7
Service - Crew	PLANNED OUTAGE	7/20/2024 14:11	841.50	6
Invalid	PLANNED OUTAGE	7/20/2024 21:16	747.20	3
PLF	PLANNED OUTAGE	7/21/2024 23:58	5,354.43	187
Transformer	PLANNED OUTAGE	7/22/2024 10:31	217.25	11
Transformer	PLANNED OUTAGE	7/22/2024 8:32	134.93	2
Transformer	PLANNED OUTAGE	7/22/2024 8:39	932.20	12
Transformer	PLANNED OUTAGE	7/22/2024 10:48	168.45	9
Transformer	PLANNED OUTAGE	7/22/2024 13:15	138.35	3
Transformer	PLANNED OUTAGE	7/22/2024 11:38	419.83	11
Transformer	PLANNED OUTAGE	7/22/2024 8:31	740.75	3
Transformer	PLANNED OUTAGE	7/22/2024 10:59	697.55	7
PLF	PLANNED OUTAGE	7/22/2024 19:36	275.60	24
Transformer	PLANNED OUTAGE	7/23/2024 1:35	56.00	8
Transformer	PLANNED OUTAGE	7/23/2024 8:36	398.90	6
Transformer	PLANNED OUTAGE	7/23/2024 8:39	178.93	1
Transformer	PLANNED OUTAGE	7/23/2024 15:35	104.40	2
OH Other	PLANNED OUTAGE	7/23/2024 18:37	12,107.53	1882
OH Other	PLANNED OUTAGE	7/23/2024 18:37	6.43	1
OH Other	PLANNED OUTAGE	7/23/2024 18:37	6.43	1
Breaker	PLANNED OUTAGE	7/23/2024 23:09	3,081.25	125
None	PLANNED OUTAGE	7/24/2024 6:56	409.83	10
PLF	PLANNED OUTAGE	7/24/2024 9:26	585.35	69
Transformer	PLANNED OUTAGE	7/24/2024 9:10	307.17	5
Transformer	PLANNED OUTAGE	7/24/2024 9:27	44.43	1
Transformer	PLANNED OUTAGE	7/24/2024 10:51	360.30	6
Transformer	PLANNED OUTAGE	7/24/2024 12:32	184.30	2
Transformer	PLANNED OUTAGE	7/24/2024 12:37	532.50	5
Transformer	PLANNED OUTAGE	7/24/2024 10:44	116.98	1
Transformer Bank	PLANNED OUTAGE	7/24/2024 14:03	409.67	4

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	7/24/2024 16:08	458.80	6
PLF	PLANNED OUTAGE	7/24/2024 21:17	223.33	10
Transformer Bank	PLANNED OUTAGE	7/25/2024 6:20	220.03	7
Transformer Bank	PLANNED OUTAGE	7/09/2024 13:50	237.65	7
None	PLANNED OUTAGE	7/09/2024 20:44	657.80	11
None	PLANNED OUTAGE	7/10/2024 16:54	230.33	10
None	PLANNED OUTAGE	7/10/2024 23:49	733.33	8
Transformer	PLANNED OUTAGE	7/11/2024 14:37	325.27	7
Transformer	PLANNED OUTAGE	7/11/2024 13:20	443.73	4
Service point	PLANNED OUTAGE	7/11/2024 17:26	153.00	1
Transformer	PLANNED OUTAGE	7/11/2024 13:10	3,910.33	10
Transformer	PLANNED OUTAGE	7/12/2024 1:57	298.95	9
Switch	PLANNED OUTAGE	7/13/2024 8:59	3,219.50	10
Transformer	PLANNED OUTAGE	7/13/2024 7:30	47.20	2
Transformer Bank	PLANNED OUTAGE	7/13/2024 12:22	54.40	1
None	PLANNED OUTAGE	7/13/2024 12:55	171.15	9
PLF	PLANNED OUTAGE	7/14/2024 21:16	36,248.33	260
Transformer Bank	PLANNED OUTAGE	7/15/2024 1:57	488.03	11
Transformer	PLANNED OUTAGE	7/15/2024 10:59	116.45	3
Transformer	PLANNED OUTAGE	7/15/2024 16:56	257.10	9
PLF	PLANNED OUTAGE	7/15/2024 12:49	139.65	1
Transformer	PLANNED OUTAGE	7/15/2024 19:39	62.18	7
PLF	PLANNED OUTAGE	7/15/2024 23:48	499.50	5
PLF	PLANNED OUTAGE	7/16/2024 0:47	86.83	10
Transformer Bank	PLANNED OUTAGE	7/15/2024 7:42	247.92	1
PLF	PLANNED OUTAGE	7/16/2024 10:01	32.75	3
Transformer	PLANNED OUTAGE	7/16/2024 12:05	452.33	10
Transformer	PLANNED OUTAGE	7/16/2024 16:04	65.53	1
Transformer	PLANNED OUTAGE	7/16/2024 17:43	22.10	2
Transformer	PLANNED OUTAGE	7/16/2024 20:50	106.20	6
Pole	PLANNED OUTAGE	7/17/2024 4:35	14,046.93	52
Transformer	PLANNED OUTAGE	7/17/2024 12:28	2,581.40	12
PLF	PLANNED OUTAGE	7/17/2024 9:57	1,118.83	7
Transformer	PLANNED OUTAGE	7/17/2024 9:59	24.13	1
Transformer	PLANNED OUTAGE	7/17/2024 10:00	389.95	3
Transformer	PLANNED OUTAGE	7/17/2024 20:09	288.28	7
Transformer	PLANNED OUTAGE	7/06/2024 14:08	182.00	8
Transformer	PLANNED OUTAGE	7/07/2024 21:30	79.50	3
Transformer	PLANNED OUTAGE	7/07/2024 3:17	11,420.40	307
Transformer	PLANNED OUTAGE	7/08/2024 13:25	152.75	3
PLF	PLANNED OUTAGE	7/09/2024 0:24	662.00	8

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
None	PLANNED OUTAGE	7/09/2024 2:58	959.67	10
Transformer	PLANNED OUTAGE	7/09/2024 12:54	51.60	4
None	PLANNED OUTAGE	7/09/2024 11:10	187.52	1
Transformer	PLANNED OUTAGE	7/09/2024 14:34	13.82	1
Transformer	PLANNED OUTAGE	7/09/2024 12:35	1,906.40	6
Transformer	PLANNED OUTAGE	7/09/2024 21:21	177.90	2
Transformer	PLANNED OUTAGE	7/09/2024 23:40	70.00	6
Transformer	PLANNED OUTAGE	7/10/2024 9:59	326.90	6
Transformer	PLANNED OUTAGE	7/10/2024 11:49	768.37	7
PLF	PLANNED OUTAGE	7/11/2024 9:53	105.70	7
Transformer	PLANNED OUTAGE	7/11/2024 8:32	267.40	4
Transformer	PLANNED OUTAGE	7/11/2024 8:55	2,694.93	8
Transformer	PLANNED OUTAGE	7/11/2024 16:02	350.27	8
Transformer	PLANNED OUTAGE	7/12/2024 5:19	34.73	2
Transformer	PLANNED OUTAGE	7/12/2024 8:24	1,039.80	6
Transformer	PLANNED OUTAGE	7/12/2024 9:55	376.43	2
Breaker	PLANNED OUTAGE	7/12/2024 17:00	3,318.18	757
Transformer Bank	PLANNED OUTAGE	7/12/2024 17:34	120.10	2
Transformer	PLANNED OUTAGE	7/13/2024 14:07	265.88	7
Transformer	PLANNED OUTAGE	7/13/2024 16:40	116.20	3
Transformer	PLANNED OUTAGE	7/15/2024 8:11	919.10	6
Transformer	PLANNED OUTAGE	7/15/2024 12:00	22.53	1
Transformer	PLANNED OUTAGE	7/15/2024 10:00	331.75	1
PLF	PLANNED OUTAGE	7/15/2024 12:00	197.38	1
Transformer	PLANNED OUTAGE	7/25/2024 10:09	129.13	4
Transformer Bank	PLANNED OUTAGE	7/25/2024 10:20	87.87	2
Transformer	PLANNED OUTAGE	7/25/2024 10:58	524.20	12
Transformer	PLANNED OUTAGE	7/25/2024 13:30	294.67	20
Transformer	PLANNED OUTAGE	7/25/2024 10:23	130.93	4
Transformer Bank	PLANNED OUTAGE	7/25/2024 10:26	2,284.35	9
Transformer	PLANNED OUTAGE	7/25/2024 12:54	13.47	4
Transformer	PLANNED OUTAGE	7/25/2024 15:17	31.23	2
Transformer	PLANNED OUTAGE	7/26/2024 4:24	33.00	5
Transformer	PLANNED OUTAGE	7/25/2024 12:48	613.52	1
Transformer	PLANNED OUTAGE	7/25/2024 12:48	3,067.58	5
Transformer	PLANNED OUTAGE	7/26/2024 14:11	125.30	3
Transformer	PLANNED OUTAGE	7/26/2024 16:19	52.25	5
Transformer Bank	PLANNED OUTAGE	7/26/2024 20:38	37.00	1
Transformer	PLANNED OUTAGE	7/26/2024 21:04	193.70	6
Breaker	PLANNED OUTAGE	7/27/2024 3:27	9.30	1
Breaker	PLANNED OUTAGE	7/27/2024 3:27	9.30	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Breaker	PLANNED OUTAGE	7/27/2024 3:27	9.30	1
Breaker	PLANNED OUTAGE	7/28/2024 16:32	17,554.50	1410
Breaker	PLANNED OUTAGE	7/28/2024 16:32	24.90	2
None	PLANNED OUTAGE	7/28/2024 23:29	510.80	3
None	PLANNED OUTAGE	7/28/2024 17:49	703,217.18	1343
Transformer	PLANNED OUTAGE	7/29/2024 8:45	245.00	6
Transformer	PLANNED OUTAGE	7/29/2024 8:50	284.43	7
PLF	PLANNED OUTAGE	7/29/2024 10:07	152.98	1
PLF	PLANNED OUTAGE	7/29/2024 12:40	4.22	1
Transformer Bank	PLANNED OUTAGE	7/29/2024 13:29	227.55	3
Transformer Bank	PLANNED OUTAGE	7/29/2024 14:46	35.10	3
Transformer	PLANNED OUTAGE	7/30/2024 8:35	1,730.05	7
Transformer	PLANNED OUTAGE	7/30/2024 10:57	247.20	9
Transformer Bank	PLANNED OUTAGE	7/30/2024 9:32	20.80	2
Transformer Bank	PLANNED OUTAGE	7/30/2024 13:07	75.47	1
None	PLANNED OUTAGE	7/30/2024 12:22	332.50	7
Transformer	PLANNED OUTAGE	7/17/2024 16:56	1,490.80	8
Breaker	PLANNED OUTAGE	7/17/2024 21:45	649.00	44
Breaker	PLANNED OUTAGE	7/17/2024 21:45	4,789.60	48
Breaker	PLANNED OUTAGE	7/17/2024 23:17	103.35	13
Transformer Bank	PLANNED OUTAGE	7/18/2024 7:31	138.40	4
Transformer	PLANNED OUTAGE	7/18/2024 10:27	99.32	1
Transformer	PLANNED OUTAGE	7/18/2024 10:37	596.60	3
Transformer	PLANNED OUTAGE	7/18/2024 10:58	464.87	2
Transformer	PLANNED OUTAGE	7/18/2024 16:48	1,560.30	6
PLF	PLANNED OUTAGE	7/18/2024 17:31	337.85	1
Transformer Bank	PLANNED OUTAGE	7/18/2024 18:18	506.85	1
PLF	PLANNED OUTAGE	7/18/2024 8:43	6,874.70	49
Transformer Bank	PLANNED OUTAGE	7/19/2024 12:59	589.87	4
Breaker	PLANNED OUTAGE	7/20/2024 18:39	98,630.00	1050
Breaker	PLANNED OUTAGE	7/20/2024 18:39	93.22	1
Transformer	PLANNED OUTAGE	7/20/2024 18:59	3,720.50	15
Transformer Bank	PLANNED OUTAGE	7/21/2024 13:34	119.27	2
Invalid	PLANNED OUTAGE	7/22/2024 6:08	430.23	1
Transformer	PLANNED OUTAGE	7/22/2024 17:24	76.93	8
Transformer	PLANNED OUTAGE	7/22/2024 9:47	1,284.38	7
Transformer	PLANNED OUTAGE	7/23/2024 9:00	134.38	11
PLF	PLANNED OUTAGE	7/23/2024 9:14	367.30	6
Transformer	PLANNED OUTAGE	7/23/2024 11:08	130.30	6
Transformer	PLANNED OUTAGE	7/23/2024 13:02	141.87	2
Transformer	PLANNED OUTAGE	7/23/2024 8:42	1,115.73	4

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	7/24/2024 1:40	396.50	1
Transformer	PLANNED OUTAGE	7/24/2024 2:27	1,661.68	7
Transformer	PLANNED OUTAGE	7/15/2024 16:20	660.33	10
Breaker	PLANNED OUTAGE	7/15/2024 18:36	3,547.95	763
PLF	PLANNED OUTAGE	7/15/2024 19:38	2,989.83	10
Transformer	PLANNED OUTAGE	7/16/2024 2:53	177.87	8
Transformer	PLANNED OUTAGE	7/15/2024 1:02	1,839.70	3
Breaker	PLANNED OUTAGE	7/15/2024 18:36	10.57	1
None	PLANNED OUTAGE	7/16/2024 11:30	2,634.45	579
Switch	PLANNED OUTAGE	7/12/2024 8:24	3,157.23	7
None	PLANNED OUTAGE	7/16/2024 12:00	266.27	2
PLF	PLANNED OUTAGE	7/17/2024 8:23	174.53	2
Transformer Bank	PLANNED OUTAGE	7/17/2024 11:08	773.80	4
Breaker	PLANNED OUTAGE	7/17/2024 16:49	36,912.73	1643
Pole	PLANNED OUTAGE	7/17/2024 4:35	37,803.27	59
Transformer	PLANNED OUTAGE	7/18/2024 9:21	42.48	1
Transformer	PLANNED OUTAGE	7/18/2024 11:20	499.70	3
Transformer	PLANNED OUTAGE	7/18/2024 11:37	14.80	3
Breaker	PLANNED OUTAGE	7/14/2024 17:36	167,946.00	1217
Transformer	PLANNED OUTAGE	7/18/2024 19:00	246.17	7
Transformer	PLANNED OUTAGE	7/18/2024 20:49	2,275.05	9
None	PLANNED OUTAGE	7/18/2024 22:13	397.70	2
Transformer	PLANNED OUTAGE	7/19/2024 9:46	295.80	4
Transformer Bank	PLANNED OUTAGE	7/19/2024 17:28	884.83	10
Transformer Bank	PLANNED OUTAGE	7/19/2024 18:54	10.05	1
Breaker	PLANNED OUTAGE	7/19/2024 21:38	1,567.45	141
PLF	PLANNED OUTAGE	7/20/2024 8:22	390.13	1
Transformer	PLANNED OUTAGE	7/20/2024 14:42	143.50	7
Service - Crew	PLANNED OUTAGE	7/20/2024 14:32	119.38	1
PLF	PLANNED OUTAGE	7/21/2024 15:35	220.50	6
Transformer	PLANNED OUTAGE	7/22/2024 10:08	21.40	4
Transformer	PLANNED OUTAGE	7/22/2024 9:18	93.35	1
Transformer	PLANNED OUTAGE	7/22/2024 11:59	65.92	5
PLF	PLANNED OUTAGE	7/30/2024 10:45	931.60	8
Transformer	PLANNED OUTAGE	7/30/2024 12:26	162.87	7
Transformer	PLANNED OUTAGE	7/30/2024 11:43	338.67	8
Transformer	PLANNED OUTAGE	7/30/2024 10:08	256.52	1
None	PLANNED OUTAGE	7/30/2024 13:32	257.07	2
Transformer	PLANNED OUTAGE	7/30/2024 16:01	76.93	2
Transformer	PLANNED OUTAGE	7/30/2024 14:09	1,366.17	10
Breaker	PLANNED OUTAGE	7/30/2024 17:42	22,455.40	1298

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Breaker	PLANNED OUTAGE	7/30/2024 17:42	17.28	1
Transformer	PLANNED OUTAGE	7/31/2024 11:58	435.50	10
Transformer	PLANNED OUTAGE	7/31/2024 10:41	237.88	7
Transformer	PLANNED OUTAGE	7/31/2024 10:47	63.97	2
Transformer	PLANNED OUTAGE	7/31/2024 13:14	230.53	7
Transformer	PLANNED OUTAGE	7/31/2024 15:07	844.50	9
Transformer Bank	PLANNED OUTAGE	7/31/2024 15:09	114.40	4
Transformer	PLANNED OUTAGE	7/31/2024 13:53	44.07	2
Transformer Bank	PLANNED OUTAGE	7/31/2024 18:55	328.80	9
Transformer	PLANNED OUTAGE	7/31/2024 20:16	3,168.53	8
Transformer	PLANNED OUTAGE	8/01/2024 0:39	36.90	6
None	PLANNED OUTAGE	8/01/2024 9:05	684.27	4
Transformer	PLANNED OUTAGE	8/01/2024 9:09	145.53	4
PLF	PLANNED OUTAGE	8/01/2024 10:31	82,857.50	393
PLF	PLANNED OUTAGE	8/01/2024 11:06	47,574.05	271
None	PLANNED OUTAGE	8/01/2024 9:05	696.73	4
None	PLANNED OUTAGE	8/01/2024 9:05	703.33	4
None	PLANNED OUTAGE	8/01/2024 12:30	52.87	2
Transformer	PLANNED OUTAGE	8/01/2024 10:12	1,320.75	9
Transformer	PLANNED OUTAGE	8/01/2024 9:38	287.70	3
Switch	PLANNED OUTAGE	8/02/2024 0:55	429.83	2
Transformer	PLANNED OUTAGE	8/02/2024 3:29	275.10	6
Transformer	PLANNED OUTAGE	8/02/2024 6:23	8.28	1
Transformer Bank	PLANNED OUTAGE	8/02/2024 7:22	1,761.47	8
Transformer	PLANNED OUTAGE	8/02/2024 10:04	12.15	1
Service point	PLANNED OUTAGE	7/24/2024 9:22	249.77	1
Transformer	PLANNED OUTAGE	7/25/2024 0:35	26.87	2
PLF	PLANNED OUTAGE	7/25/2024 0:46	74.55	1
PLF	PLANNED OUTAGE	7/25/2024 1:47	122.70	6
Transformer Bank	PLANNED OUTAGE	7/24/2024 21:28	402.48	1
Transformer	PLANNED OUTAGE	7/25/2024 4:13	59.15	3
Transformer	PLANNED OUTAGE	7/25/2024 11:18	89.60	6
None	PLANNED OUTAGE	7/25/2024 10:26	70.97	2
PLF	PLANNED OUTAGE	7/25/2024 9:41	304.30	3
Transformer	PLANNED OUTAGE	7/19/2024 7:29	1,029.12	7
Transformer	PLANNED OUTAGE	7/19/2024 7:35	183.55	3
Transformer	PLANNED OUTAGE	7/25/2024 11:36	57.53	2
Transformer	PLANNED OUTAGE	7/25/2024 11:45	770.75	15
Transformer	PLANNED OUTAGE	7/25/2024 11:45	90.83	2
Transformer	PLANNED OUTAGE	7/25/2024 15:12	271.67	5
PLF	PLANNED OUTAGE	7/25/2024 16:45	4,823.88	127

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	7/25/2024 20:48	328.00	1
Primary Wire	PLANNED OUTAGE	7/26/2024 1:22	176.48	1
Primary Wire	PLANNED OUTAGE	7/26/2024 1:25	187.27	1
Transformer	PLANNED OUTAGE	7/26/2024 9:47	233.47	4
Transformer Bank	PLANNED OUTAGE	7/26/2024 8:15	1,725.97	13
None	PLANNED OUTAGE	7/26/2024 9:00	217.30	1
Breaker	PLANNED OUTAGE	7/26/2024 16:50	41,365.17	1754
Breaker	PLANNED OUTAGE	7/26/2024 16:50	25.97	1
Breaker	PLANNED OUTAGE	7/26/2024 16:50	26.02	1
Breaker	PLANNED OUTAGE	7/26/2024 16:50	26.02	1
Service point	PLANNED OUTAGE	7/26/2024 19:21	22.78	1
PLF	PLANNED OUTAGE	7/26/2024 19:23	256.90	42
Breaker	PLANNED OUTAGE	7/27/2024 3:27	35,331.45	4389
Transformer	PLANNED OUTAGE	7/27/2024 11:50	89.75	5
Transformer	PLANNED OUTAGE	7/27/2024 18:27	180.15	9
Transformer	PLANNED OUTAGE	7/27/2024 20:34	35.82	1
PLF	PLANNED OUTAGE	7/27/2024 23:04	365.80	6
Transformer	PLANNED OUTAGE	7/22/2024 11:24	110.75	5
Transformer	PLANNED OUTAGE	7/22/2024 13:07	64.00	4
PLF	PLANNED OUTAGE	7/22/2024 21:06	483.47	37
Transformer	PLANNED OUTAGE	7/23/2024 11:14	567.23	11
Transformer	PLANNED OUTAGE	7/23/2024 12:57	395.05	3
PLF	PLANNED OUTAGE	7/23/2024 12:06	287.00	1
Transformer	PLANNED OUTAGE	7/23/2024 12:45	4,223.17	10
OH Other	PLANNED OUTAGE	7/23/2024 18:37	6.43	1
PLF	PLANNED OUTAGE	7/23/2024 22:34	116.83	10
None	PLANNED OUTAGE	7/24/2024 4:39	1,615.75	69
Transformer	PLANNED OUTAGE	7/24/2024 9:43	454.12	11
Transformer	PLANNED OUTAGE	7/24/2024 9:55	437.87	8
Transformer	PLANNED OUTAGE	7/24/2024 10:13	424.33	10
Transformer	PLANNED OUTAGE	7/24/2024 11:27	220.97	7
Transformer	PLANNED OUTAGE	7/24/2024 10:39	227.08	5
Transformer	PLANNED OUTAGE	7/24/2024 15:35	2,511.83	7
Transformer	PLANNED OUTAGE	7/24/2024 15:43	2,610.18	13
Transformer	PLANNED OUTAGE	7/24/2024 18:17	551.30	6
Transformer	PLANNED OUTAGE	7/25/2024 7:13	110.53	4
Transformer	PLANNED OUTAGE	7/25/2024 9:56	663.73	8
Transformer	PLANNED OUTAGE	7/25/2024 11:08	401.13	11
Transformer	PLANNED OUTAGE	7/25/2024 9:39	86.85	1
Transformer	PLANNED OUTAGE	7/25/2024 12:09	207.67	10
Transformer	PLANNED OUTAGE	7/25/2024 13:00	59.92	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	7/25/2024 8:31	10,162.57	29
PLF	PLANNED OUTAGE	7/25/2024 17:25	2,254.60	12
PLF	PLANNED OUTAGE	7/25/2024 21:38	479.77	2
Primary Wire	PLANNED OUTAGE	7/26/2024 1:13	198.33	1
Invalid	PLANNED OUTAGE	7/26/2024 9:25	33.23	1
Transformer	PLANNED OUTAGE	7/26/2024 8:09	180.93	1
Transformer	PLANNED OUTAGE	8/06/2024 2:40	26.20	3
Service point	PLANNED OUTAGE	8/06/2024 0:15	143.52	1
PLF	PLANNED OUTAGE	8/06/2024 2:11	2,053.33	20
PLF	PLANNED OUTAGE	8/06/2024 9:05	478.50	10
PLF	PLANNED OUTAGE	8/06/2024 16:39	221.10	9
Breaker	PLANNED OUTAGE	8/06/2024 16:23	89.03	1
Transformer	PLANNED OUTAGE	8/02/2024 10:04	12.12	1
Transformer	PLANNED OUTAGE	8/01/2024 18:55	568.73	1
None	PLANNED OUTAGE	8/01/2024 15:31	1,892.80	13
PLF	PLANNED OUTAGE	8/02/2024 11:09	200.40	3
PLF	PLANNED OUTAGE	8/02/2024 12:51	98.23	1
Transformer	PLANNED OUTAGE	8/03/2024 5:51	102.20	7
None	PLANNED OUTAGE	8/03/2024 19:06	990.73	44
Transformer	PLANNED OUTAGE	7/28/2024 7:13	74.47	2
Transformer	PLANNED OUTAGE	7/28/2024 12:36	582.13	16
Transformer	PLANNED OUTAGE	7/28/2024 12:37	799.75	15
None	PLANNED OUTAGE	7/28/2024 16:28	471.67	5
None	PLANNED OUTAGE	7/28/2024 20:59	240.53	4
Breaker	PLANNED OUTAGE	7/29/2024 6:54	19.73	1
PLF	PLANNED OUTAGE	7/29/2024 10:07	156.78	1
Transformer	PLANNED OUTAGE	7/29/2024 7:53	664.83	10
Transformer	PLANNED OUTAGE	7/29/2024 9:59	130.08	7
Transformer	PLANNED OUTAGE	7/29/2024 9:42	165.75	9
PLF	PLANNED OUTAGE	7/29/2024 13:22	18.15	1
PLF	PLANNED OUTAGE	7/29/2024 16:40	154.42	1
Transformer	PLANNED OUTAGE	7/30/2024 3:39	59.40	3
Transformer	PLANNED OUTAGE	7/30/2024 4:10	77.70	2
Primary Wire	PLANNED OUTAGE	7/29/2024 10:19	3,937.65	9
Primary Wire	PLANNED OUTAGE	7/29/2024 10:19	3,500.00	8
Transformer	PLANNED OUTAGE	7/30/2024 8:21	415.67	10
Transformer Bank	PLANNED OUTAGE	7/30/2024 9:01	296.92	1
Breaker	PLANNED OUTAGE	7/30/2024 14:22	26,458.33	1270
Breaker	PLANNED OUTAGE	7/30/2024 14:22	21.00	1
Breaker	PLANNED OUTAGE	7/30/2024 14:22	20.30	1
PLF	PLANNED OUTAGE	7/30/2024 14:30	551.10	18

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer Bank	PLANNED OUTAGE	7/30/2024 11:40	573.75	9
Transformer	PLANNED OUTAGE	7/30/2024 16:44	2,790.60	18
None	PLANNED OUTAGE	7/31/2024 4:34	139.93	4
Invalid	PLANNED OUTAGE	7/31/2024 1:00	90,567.87	644
Invalid	PLANNED OUTAGE	7/31/2024 1:00	140.63	1
Transformer	PLANNED OUTAGE	7/31/2024 8:58	324.70	6
Transformer	PLANNED OUTAGE	7/31/2024 8:51	532.35	7
None	PLANNED OUTAGE	7/31/2024 9:20	41.40	1
None	PLANNED OUTAGE	7/26/2024 10:42	97.70	1
None	PLANNED OUTAGE	7/26/2024 15:56	1.78	1
Transformer	PLANNED OUTAGE	7/26/2024 14:13	192.27	8
Breaker	PLANNED OUTAGE	7/26/2024 19:18	24,247.95	1887
Breaker	PLANNED OUTAGE	7/27/2024 3:27	9.30	1
Breaker	PLANNED OUTAGE	7/27/2024 3:27	9.30	1
PLF	PLANNED OUTAGE	7/27/2024 11:15	1,373.60	24
Service point	PLANNED OUTAGE	7/27/2024 18:16	90.80	1
None	PLANNED OUTAGE	7/28/2024 19:47	269.33	4
None	PLANNED OUTAGE	7/28/2024 17:13	323.65	1
Primary Wire	PLANNED OUTAGE	7/28/2024 17:59	2,881.80	12
None	PLANNED OUTAGE	7/29/2024 2:56	154.80	1
PLF	PLANNED OUTAGE	7/28/2024 22:33	1,175.75	3
Breaker	PLANNED OUTAGE	7/29/2024 6:54	20.45	1
Breaker	PLANNED OUTAGE	7/29/2024 6:54	19.58	1
Transformer	PLANNED OUTAGE	7/29/2024 10:47	198.33	7
Transformer	PLANNED OUTAGE	7/29/2024 9:40	152.20	6
Transformer	PLANNED OUTAGE	7/29/2024 8:40	604.83	10
Transformer	PLANNED OUTAGE	7/29/2024 11:11	426.50	6
Transformer	PLANNED OUTAGE	7/29/2024 11:50	1,249.85	7
Transformer	PLANNED OUTAGE	7/29/2024 13:05	493.00	5
Transformer	PLANNED OUTAGE	7/29/2024 13:08	327.17	2
Transformer	PLANNED OUTAGE	7/29/2024 18:41	400.28	7
Transformer	PLANNED OUTAGE	7/30/2024 1:56	214.65	9
Transformer	PLANNED OUTAGE	7/30/2024 10:34	225.50	5
Transformer	PLANNED OUTAGE	7/30/2024 9:06	984.00	9
Transformer	PLANNED OUTAGE	7/30/2024 9:14	34.65	1
Transformer	PLANNED OUTAGE	7/30/2024 9:36	102.80	4
Transformer	PLANNED OUTAGE	7/30/2024 10:48	972.00	15
Transformer Bank	PLANNED OUTAGE	7/30/2024 10:13	789.35	3
PLF	PLANNED OUTAGE	7/30/2024 9:53	335.40	18
Transformer Bank	PLANNED OUTAGE	7/30/2024 10:13	754.90	3
Transformer	PLANNED OUTAGE	7/30/2024 11:48	66.73	2

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
None	PLANNED OUTAGE	8/06/2024 17:09	494.13	8
Transformer	PLANNED OUTAGE	8/07/2024 12:25	56.40	2
Transformer	PLANNED OUTAGE	8/07/2024 16:13	30.00	1
PLF	PLANNED OUTAGE	8/07/2024 18:17	3,465.67	74
None	PLANNED OUTAGE	8/07/2024 18:03	1,236.42	185
Transformer	PLANNED OUTAGE	8/08/2024 0:27	284.33	2
PLF	PLANNED OUTAGE	8/08/2024 18:54	1,135.50	45
Transformer	PLANNED OUTAGE	8/08/2024 21:02	45.30	9
None	PLANNED OUTAGE	8/09/2024 8:25	61.52	1
PLF	PLANNED OUTAGE	8/09/2024 12:27	153.53	2
Transformer	PLANNED OUTAGE	8/09/2024 23:32	375.13	4
Transformer	PLANNED OUTAGE	8/10/2024 8:32	93.77	1
Transformer Bank	PLANNED OUTAGE	8/10/2024 15:58	1,142.92	5
Transformer	PLANNED OUTAGE	8/11/2024 0:53	129.90	9
Transformer	PLANNED OUTAGE	8/11/2024 1:20	88.37	2
Transformer Bank	PLANNED OUTAGE	8/11/2024 18:08	457.87	4
Transformer	PLANNED OUTAGE	7/31/2024 9:50	41.75	5
Transformer	PLANNED OUTAGE	7/31/2024 9:58	78.55	1
Breaker	PLANNED OUTAGE	7/30/2024 17:42	17.22	1
Breaker	PLANNED OUTAGE	7/30/2024 17:42	16.70	1
Transformer Bank	PLANNED OUTAGE	7/31/2024 20:56	106.83	1
PLF	PLANNED OUTAGE	8/01/2024 1:36	310.50	3
PLF	PLANNED OUTAGE	8/01/2024 3:01	1,429.07	46
None	PLANNED OUTAGE	8/01/2024 9:25	142.97	1
Transformer	PLANNED OUTAGE	8/01/2024 9:32	128.77	1
Transformer	PLANNED OUTAGE	8/01/2024 10:09	310.90	2
None	PLANNED OUTAGE	8/01/2024 10:09	364.00	3
Transformer	PLANNED OUTAGE	8/01/2024 10:14	1,918.70	14
Transformer Bank	PLANNED OUTAGE	8/01/2024 9:02	1,417.33	4
Transformer	PLANNED OUTAGE	8/01/2024 16:48	685.60	16
Transformer	PLANNED OUTAGE	8/01/2024 19:47	5.35	1
Transformer	PLANNED OUTAGE	8/02/2024 10:25	226.67	8
Transformer	PLANNED OUTAGE	8/02/2024 10:56	43.27	4
PLF	PLANNED OUTAGE	8/02/2024 9:09	197.58	5
Breaker	PLANNED OUTAGE	8/03/2024 15:04	13.97	1
PLF	PLANNED OUTAGE	8/03/2024 11:31	3,645.33	16
Switch	PLANNED OUTAGE	8/03/2024 19:06	4,233.13	188
Transformer	PLANNED OUTAGE	8/03/2024 20:46	43.88	1
Transformer Bank	PLANNED OUTAGE	8/02/2024 6:34	29.93	2
None	PLANNED OUTAGE	7/30/2024 13:07	1,280.53	7
Transformer	PLANNED OUTAGE	7/30/2024 14:26	70.97	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	7/30/2024 19:09	492.40	8
Invalid	PLANNED OUTAGE	7/30/2024 20:26	92,185.80	2802
Transformer	PLANNED OUTAGE	7/30/2024 22:50	62.10	2
Transformer	PLANNED OUTAGE	7/31/2024 8:44	443.33	8
Transformer	PLANNED OUTAGE	7/31/2024 9:59	306.55	3
Service point	PLANNED OUTAGE	7/31/2024 14:28	7.15	1
Switch	PLANNED OUTAGE	7/31/2024 23:40	22,836.95	67
PLF	PLANNED OUTAGE	8/01/2024 6:21	1,001.33	16
Transformer	PLANNED OUTAGE	8/01/2024 8:13	48.13	8
Transformer	PLANNED OUTAGE	8/01/2024 9:16	362.60	7
Switch	PLANNED OUTAGE	8/01/2024 14:57	487.53	1
PLF	PLANNED OUTAGE	8/01/2024 9:07	5,341.62	41
Transformer	PLANNED OUTAGE	8/01/2024 15:10	809.00	10
Transformer	PLANNED OUTAGE	8/02/2024 3:12	23.58	1
Transformer Bank	PLANNED OUTAGE	8/02/2024 5:17	225.57	1
Transformer	PLANNED OUTAGE	8/01/2024 19:39	3,827.72	7
Switch	PLANNED OUTAGE	8/01/2024 10:49	462.93	1
Transformer	PLANNED OUTAGE	8/02/2024 10:16	99.87	2
Transformer	PLANNED OUTAGE	8/02/2024 10:21	685.30	3
PLF	PLANNED OUTAGE	8/02/2024 14:09	158.30	1
Transformer	PLANNED OUTAGE	8/02/2024 16:06	700.20	6
Transformer	PLANNED OUTAGE	8/02/2024 22:41	1,086.63	14
Breaker	PLANNED OUTAGE	8/03/2024 15:04	13.67	1
Switch	PLANNED OUTAGE	8/03/2024 19:06	22.42	1
Breaker	PLANNED OUTAGE	8/03/2024 19:04	31.13	1
PLF	PLANNED OUTAGE	8/10/2024 8:22	2,308.40	4
Transformer	PLANNED OUTAGE	8/12/2024 8:48	559.95	9
Transformer	PLANNED OUTAGE	8/12/2024 6:33	911.58	5
Transformer	PLANNED OUTAGE	8/13/2024 1:40	117.13	4
Transformer	PLANNED OUTAGE	8/13/2024 2:16	116.15	3
Transformer Bank	PLANNED OUTAGE	8/12/2024 22:31	1,014.45	3
PLF	PLANNED OUTAGE	8/13/2024 0:13	4,214.02	17
Transformer Bank	PLANNED OUTAGE	8/13/2024 8:30	685.65	7
Transformer	PLANNED OUTAGE	8/13/2024 11:50	97.83	1
Breaker	PLANNED OUTAGE	8/13/2024 13:38	15.32	1
PLF	PLANNED OUTAGE	8/13/2024 12:22	95.97	2
Transformer	PLANNED OUTAGE	8/13/2024 12:27	1,104.60	28
PLF	PLANNED OUTAGE	8/13/2024 15:36	429.45	21
Transformer	PLANNED OUTAGE	8/13/2024 20:29	288.30	2
PLF	PLANNED OUTAGE	8/14/2024 4:01	1,539.20	26
Transformer	PLANNED OUTAGE	8/13/2024 8:36	411.65	3

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	8/13/2024 9:03	798.93	4
Transformer	PLANNED OUTAGE	8/14/2024 13:15	910.93	14
Transformer	PLANNED OUTAGE	8/14/2024 11:34	1,284.62	11
Transformer	PLANNED OUTAGE	8/14/2024 9:34	719.87	4
Transformer	PLANNED OUTAGE	8/14/2024 10:35	1,476.25	5
Transformer	PLANNED OUTAGE	8/15/2024 0:51	28.63	1
Transformer	PLANNED OUTAGE	8/15/2024 10:03	19.90	1
Transformer Bank	PLANNED OUTAGE	8/15/2024 9:59	132.67	10
PLF	PLANNED OUTAGE	8/15/2024 10:09	2,459.90	34
Breaker	PLANNED OUTAGE	8/02/2024 12:53	3,579.40	1627
Transformer	PLANNED OUTAGE	8/15/2024 9:35	1,226.17	7
Transformer Bank	PLANNED OUTAGE	8/15/2024 11:48	196.57	2
Transformer	PLANNED OUTAGE	8/15/2024 18:57	99.20	6
Breaker	PLANNED OUTAGE	8/15/2024 21:39	1,416.00	531
Service point	PLANNED OUTAGE	8/16/2024 0:36	269.45	1
Breaker	PLANNED OUTAGE	8/16/2024 12:14	19.80	1
Transformer	PLANNED OUTAGE	8/16/2024 15:39	54.23	2
None	PLANNED OUTAGE	8/16/2024 17:38	14.37	1
Transformer	PLANNED OUTAGE	8/17/2024 7:58	7.45	1
Transformer	PLANNED OUTAGE	8/17/2024 13:26	47.20	4
Transformer	PLANNED OUTAGE	8/17/2024 13:52	53.17	5
Transformer	PLANNED OUTAGE	8/17/2024 15:32	86.47	4
None	PLANNED OUTAGE	8/17/2024 15:45	2,606.40	12
PLF	PLANNED OUTAGE	8/17/2024 21:35	340.83	2
Transformer	PLANNED OUTAGE	8/18/2024 2:36	39.73	2
PLF	PLANNED OUTAGE	8/18/2024 10:33	732.97	11
Breaker	PLANNED OUTAGE	8/18/2024 17:54	20.58	1
Breaker	PLANNED OUTAGE	8/19/2024 1:39	20,455.20	1894
UG Other	PLANNED OUTAGE	8/19/2024 11:42	150.22	1
Breaker	PLANNED OUTAGE	8/19/2024 11:08	15.78	1
Breaker	PLANNED OUTAGE	8/19/2024 11:08	15.78	1
None	PLANNED OUTAGE	8/19/2024 11:26	168.80	4
Transformer	PLANNED OUTAGE	8/19/2024 11:16	767.00	10
Transformer	PLANNED OUTAGE	8/06/2024 1:11	627.00	3
Transformer	PLANNED OUTAGE	8/06/2024 2:04	54.88	1
Transformer	PLANNED OUTAGE	8/06/2024 2:06	140.87	2
None	PLANNED OUTAGE	8/06/2024 9:58	853.18	7
None	PLANNED OUTAGE	8/06/2024 12:46	1,294.50	9
Transformer	PLANNED OUTAGE	8/06/2024 16:32	28.30	1
Transformer	PLANNED OUTAGE	8/06/2024 16:30	198.58	5
Transformer	PLANNED OUTAGE	8/06/2024 21:18	404.95	7

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	8/06/2024 20:07	837.10	6
Transformer	PLANNED OUTAGE	8/06/2024 18:38	1,659.60	6
Transformer	PLANNED OUTAGE	8/06/2024 23:13	207.75	9
PLF	PLANNED OUTAGE	8/07/2024 9:35	216.53	7
PLF	PLANNED OUTAGE	8/07/2024 9:35	91.25	3
Transformer	PLANNED OUTAGE	8/07/2024 12:40	57.00	12
Transformer Bank	PLANNED OUTAGE	8/07/2024 10:22	107.67	2
Invalid	PLANNED OUTAGE	8/06/2024 8:36	387.95	1
Transformer	PLANNED OUTAGE	8/08/2024 2:46	43.92	5
Transformer	PLANNED OUTAGE	8/08/2024 10:15	136.70	6
None	PLANNED OUTAGE	8/08/2024 8:41	69.83	1
None	PLANNED OUTAGE	8/08/2024 13:00	2,778.33	25
PLF	PLANNED OUTAGE	8/08/2024 22:55	90.57	38
PLF	PLANNED OUTAGE	8/08/2024 17:25	7,278.93	16
PLF	PLANNED OUTAGE	8/08/2024 12:25	5,889.67	20
Transformer	PLANNED OUTAGE	8/07/2024 17:45	2,608.27	4
Transformer	PLANNED OUTAGE	8/09/2024 9:53	39.28	1
Transformer Bank	PLANNED OUTAGE	8/09/2024 18:34	148.50	2
Transformer Bank	PLANNED OUTAGE	8/09/2024 18:46	36.72	1
Transformer	PLANNED OUTAGE	8/09/2024 20:28	61.00	4
None	PLANNED OUTAGE	8/10/2024 3:00	4,275.60	42
Transformer	PLANNED OUTAGE	8/10/2024 8:48	78.43	1
Transformer	PLANNED OUTAGE	8/19/2024 17:27	177.70	6
Transformer	PLANNED OUTAGE	8/19/2024 23:21	177.83	2
Transformer	PLANNED OUTAGE	8/20/2024 8:41	1,093.30	6
PLF	PLANNED OUTAGE	8/20/2024 9:47	5,492.50	25
Breaker	PLANNED OUTAGE	8/20/2024 16:15	20,142.97	499
Transformer	PLANNED OUTAGE	8/20/2024 17:43	308.47	7
None	PLANNED OUTAGE	8/20/2024 17:01	102.48	1
Transformer Bank	PLANNED OUTAGE	8/20/2024 15:42	972.67	4
Transformer	PLANNED OUTAGE	8/20/2024 21:06	30.75	1
PLF	PLANNED OUTAGE	8/20/2024 20:14	2,405.33	40
PLF	PLANNED OUTAGE	8/20/2024 19:01	1,351.30	3
Service point	PLANNED OUTAGE	8/21/2024 9:25	148.47	1
Transformer	PLANNED OUTAGE	8/21/2024 9:48	11,778.67	40
Transformer	PLANNED OUTAGE	8/21/2024 10:21	287.77	2
Pole	PLANNED OUTAGE	8/21/2024 17:27	195,609.15	2757
Transformer	PLANNED OUTAGE	8/22/2024 6:11	1,021.58	13
None	PLANNED OUTAGE	8/22/2024 8:35	394.35	3
Transformer Bank	PLANNED OUTAGE	8/22/2024 9:13	45.15	7
Transformer	PLANNED OUTAGE	8/22/2024 16:15	111.92	5

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	8/22/2024 16:58	14.60	1
None	PLANNED OUTAGE	8/22/2024 23:23	4,931.20	46
None	PLANNED OUTAGE	8/22/2024 16:53	2,804.25	5
Transformer	PLANNED OUTAGE	8/23/2024 7:46	677.60	3
Transformer	PLANNED OUTAGE	8/23/2024 12:18	149.55	9
Breaker	PLANNED OUTAGE	8/23/2024 19:21	65,676.00	1872
Transformer	PLANNED OUTAGE	8/23/2024 12:01	358.88	1
Transformer	PLANNED OUTAGE	8/25/2024 4:18	50.97	1
Transformer	PLANNED OUTAGE	8/25/2024 13:02	1,239.15	9
None	PLANNED OUTAGE	8/25/2024 19:58	4,060.45	17
Transformer	PLANNED OUTAGE	8/25/2024 16:42	3,119.20	7
PLF	PLANNED OUTAGE	8/26/2024 10:16	3,275.20	138
Transformer	PLANNED OUTAGE	8/26/2024 12:30	430.20	12
Transformer	PLANNED OUTAGE	8/26/2024 13:22	535.20	8
Transformer Bank	PLANNED OUTAGE	8/12/2024 10:15	101.50	1
Transformer	PLANNED OUTAGE	8/12/2024 10:24	90.80	6
Transformer	PLANNED OUTAGE	8/12/2024 23:50	830.40	12
PLF	PLANNED OUTAGE	8/13/2024 8:03	1,126.60	12
Transformer	PLANNED OUTAGE	8/13/2024 10:19	258.53	4
Transformer	PLANNED OUTAGE	8/13/2024 12:18	67.40	3
Transformer	PLANNED OUTAGE	8/14/2024 9:44	922.50	10
Transformer Bank	PLANNED OUTAGE	8/14/2024 9:59	605.47	8
Transformer	PLANNED OUTAGE	8/14/2024 10:21	150.90	2
Transformer	PLANNED OUTAGE	8/14/2024 10:46	695.92	5
Transformer	PLANNED OUTAGE	8/14/2024 10:43	1,978.90	14
Transformer	PLANNED OUTAGE	8/14/2024 10:48	1,684.28	11
Transformer Bank	PLANNED OUTAGE	8/14/2024 14:03	37.10	1
PLF	PLANNED OUTAGE	8/14/2024 17:11	78.32	1
Transformer	PLANNED OUTAGE	8/15/2024 10:36	51.27	1
Transformer	PLANNED OUTAGE	8/15/2024 9:17	130.60	1
Transformer Bank	PLANNED OUTAGE	8/15/2024 11:36	204.08	1
Transformer	PLANNED OUTAGE	8/15/2024 15:03	146.80	4
None	PLANNED OUTAGE	8/15/2024 9:33	325.57	1
Transformer	PLANNED OUTAGE	8/16/2024 0:36	58.43	2
Transformer	PLANNED OUTAGE	8/16/2024 0:54	374.25	15
None	PLANNED OUTAGE	8/16/2024 1:43	1,202.10	6
None	PLANNED OUTAGE	8/16/2024 17:39	80.70	6
Transformer	PLANNED OUTAGE	8/16/2024 14:55	60.63	2
Transformer	PLANNED OUTAGE	8/16/2024 14:57	24.85	3
Transformer	PLANNED OUTAGE	8/17/2024 1:51	139.40	6
Transformer	PLANNED OUTAGE	8/17/2024 3:06	312.77	11

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	8/17/2024 14:21	87.30	6
PLF	PLANNED OUTAGE	8/17/2024 8:08	370.77	1
Transformer	PLANNED OUTAGE	8/17/2024 14:58	78.58	5
Transformer	PLANNED OUTAGE	8/18/2024 2:39	241.87	4
Transformer	PLANNED OUTAGE	8/18/2024 2:57	87.08	5
Transformer	PLANNED OUTAGE	8/18/2024 3:28	44.63	2
Transformer	PLANNED OUTAGE	8/18/2024 13:21	78.65	3
Transformer	PLANNED OUTAGE	8/18/2024 14:05	244.53	7
Transformer	PLANNED OUTAGE	8/18/2024 14:13	139.53	4
Breaker	PLANNED OUTAGE	8/18/2024 17:54	24,638.25	1197
Breaker	PLANNED OUTAGE	8/18/2024 17:54	20.58	1
Breaker	PLANNED OUTAGE	8/18/2024 17:54	20.58	1
Transformer Bank	PLANNED OUTAGE	8/18/2024 22:25	117.92	1
Transformer	PLANNED OUTAGE	8/19/2024 9:57	330.65	3
Breaker	PLANNED OUTAGE	8/19/2024 11:08	14,415.00	1550
PLF	PLANNED OUTAGE	8/19/2024 20:38	830.55	3
Transformer	PLANNED OUTAGE	8/20/2024 9:13	68.13	4
PLF	PLANNED OUTAGE	8/20/2024 9:16	4,025.60	34
Transformer	PLANNED OUTAGE	8/20/2024 10:24	24.90	6
Transformer	PLANNED OUTAGE	8/20/2024 10:30	266.00	6
Transformer	PLANNED OUTAGE	8/20/2024 10:20	107.15	1
Transformer	PLANNED OUTAGE	8/20/2024 13:53	92.65	1
None	PLANNED OUTAGE	8/20/2024 17:01	11,172.50	150
PLF	PLANNED OUTAGE	8/20/2024 20:01	60.00	40
Breaker	PLANNED OUTAGE	8/06/2024 2:02	2,372.15	627
Breaker	PLANNED OUTAGE	8/06/2024 2:02	3.93	1
Transformer	PLANNED OUTAGE	8/06/2024 2:16	118.13	8
Transformer	PLANNED OUTAGE	8/06/2024 10:23	58.93	8
Transformer Bank	PLANNED OUTAGE	8/06/2024 11:34	52.22	1
None	PLANNED OUTAGE	8/06/2024 17:05	9.67	1
None	PLANNED OUTAGE	8/06/2024 17:05	5,207.42	553
Breaker	PLANNED OUTAGE	8/06/2024 16:23	66,615.40	753
Service - Crew	PLANNED OUTAGE	8/06/2024 20:23	52.22	1
Transformer	PLANNED OUTAGE	8/06/2024 16:59	48.25	5
Transformer	PLANNED OUTAGE	8/06/2024 22:30	2,120.40	8
None	PLANNED OUTAGE	8/26/2024 21:04	282.30	6
Transformer	PLANNED OUTAGE	8/27/2024 0:22	68.37	1
Transformer	PLANNED OUTAGE	8/27/2024 4:44	222.27	8
Transformer	PLANNED OUTAGE	8/27/2024 9:09	617.25	9
Transformer	PLANNED OUTAGE	8/27/2024 9:16	113.10	6
PLF	PLANNED OUTAGE	8/27/2024 8:21	6,698.13	19

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer Bank	PLANNED OUTAGE	8/27/2024 12:29	423.45	3
Primary Wire	PLANNED OUTAGE	8/27/2024 20:35	161.10	1
Transformer	PLANNED OUTAGE	8/27/2024 23:38	3,353.17	10
Transformer	PLANNED OUTAGE	8/28/2024 8:39	259.35	7
PLF	PLANNED OUTAGE	8/28/2024 10:26	524.63	2
PLF	PLANNED OUTAGE	8/28/2024 12:04	132.13	1
PLF	PLANNED OUTAGE	8/28/2024 9:35	396.35	1
Primary Wire	PLANNED OUTAGE	8/28/2024 23:03	147.50	6
PLF	PLANNED OUTAGE	8/28/2024 22:03	1,067.38	7
Transformer	PLANNED OUTAGE	8/29/2024 11:29	322.20	3
Transformer	PLANNED OUTAGE	8/29/2024 11:11	986.15	11
Transformer	PLANNED OUTAGE	8/29/2024 11:36	1,556.80	21
Breaker	PLANNED OUTAGE	8/29/2024 15:16	17,145.92	455
Transformer Bank	PLANNED OUTAGE	8/30/2024 2:51	82.18	1
Transformer Bank	PLANNED OUTAGE	8/29/2024 10:44	987.38	1
OH Other	PLANNED OUTAGE	8/29/2024 21:28	589.77	1
Transformer	PLANNED OUTAGE	8/30/2024 9:13	635.60	8
Transformer	PLANNED OUTAGE	8/30/2024 8:12	483.70	7
Transformer Bank	PLANNED OUTAGE	8/06/2024 1:26	136.83	2
PLF	PLANNED OUTAGE	8/06/2024 2:47	70.05	9
Transformer	PLANNED OUTAGE	8/06/2024 3:07	3.53	1
PLF	PLANNED OUTAGE	8/06/2024 11:25	1,011.27	44
PLF	PLANNED OUTAGE	8/06/2024 11:08	1,357.83	10
None	PLANNED OUTAGE	8/06/2024 17:03	33.13	1
Breaker	PLANNED OUTAGE	8/06/2024 16:23	89.03	1
PLF	PLANNED OUTAGE	8/20/2024 21:54	1,478.00	20
PLF	PLANNED OUTAGE	8/20/2024 22:11	69.42	1
PLF	PLANNED OUTAGE	8/20/2024 22:41	448.40	2
Transformer Bank	PLANNED OUTAGE	8/21/2024 2:35	655.75	3
Transformer	PLANNED OUTAGE	8/21/2024 11:06	685.20	4
Transformer	PLANNED OUTAGE	8/21/2024 9:30	534.03	2
Transformer	PLANNED OUTAGE	8/21/2024 12:35	19.35	1
Transformer	PLANNED OUTAGE	8/22/2024 0:13	98.42	5
PLF	PLANNED OUTAGE	8/22/2024 0:39	42.93	2
Transformer	PLANNED OUTAGE	8/22/2024 0:47	128.67	10
Transformer	PLANNED OUTAGE	8/22/2024 1:13	63.00	5
None	PLANNED OUTAGE	8/22/2024 10:40	127.23	2
Transformer	PLANNED OUTAGE	8/22/2024 11:13	5.00	2
PLF	PLANNED OUTAGE	8/22/2024 10:51	84.78	1
PLF	PLANNED OUTAGE	8/22/2024 11:19	306.07	4
Transformer Bank	PLANNED OUTAGE	8/22/2024 20:00	15.32	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	8/23/2024 8:22	570.13	4
PLF	PLANNED OUTAGE	8/23/2024 9:11	175.70	3
Transformer	PLANNED OUTAGE	8/23/2024 11:22	1,501.07	8
Transformer	PLANNED OUTAGE	8/23/2024 8:38	328.83	5
Transformer	PLANNED OUTAGE	8/23/2024 20:14	2,085.50	6
Switch	PLANNED OUTAGE	8/24/2024 23:27	4,359.25	265
Transformer	PLANNED OUTAGE	8/25/2024 1:45	1,423.67	4
PLF	PLANNED OUTAGE	8/25/2024 4:55	571.40	4
PLF	PLANNED OUTAGE	8/26/2024 9:27	618.38	11
Primary Wire	PLANNED OUTAGE	8/26/2024 8:23	7,402.08	19
Invalid	PLANNED OUTAGE	8/26/2024 12:10	1,727.70	13
Transformer	PLANNED OUTAGE	8/26/2024 17:13	526.75	7
PLF	PLANNED OUTAGE	8/27/2024 3:07	995.20	24
Primary Wire	PLANNED OUTAGE	8/26/2024 20:27	5,740.15	13
PLF	PLANNED OUTAGE	8/27/2024 10:35	67.10	1
Transformer	PLANNED OUTAGE	8/27/2024 11:03	9,790.30	26
Transformer	PLANNED OUTAGE	8/27/2024 21:52	57.47	8
Transformer Bank	PLANNED OUTAGE	8/28/2024 10:59	50.38	1
None	PLANNED OUTAGE	8/08/2024 3:15	155.80	4
Transformer	PLANNED OUTAGE	8/08/2024 11:29	244.93	8
None	PLANNED OUTAGE	8/08/2024 18:49	530.60	6
None	PLANNED OUTAGE	8/08/2024 20:32	136.83	1
None	PLANNED OUTAGE	8/09/2024 2:09	1,456.50	18
PLF	PLANNED OUTAGE	8/09/2024 8:22	20,075.47	104
PLF	PLANNED OUTAGE	8/09/2024 8:26	293.63	1
PLF	PLANNED OUTAGE	8/09/2024 15:01	214.20	3
Transformer	PLANNED OUTAGE	8/10/2024 4:19	389.40	4
Transformer	PLANNED OUTAGE	8/11/2024 0:27	73.23	2
Transformer	PLANNED OUTAGE	8/11/2024 17:45	120.20	6
Transformer	PLANNED OUTAGE	8/11/2024 19:42	148.47	2
Transformer	PLANNED OUTAGE	8/11/2024 23:23	102.25	5
Transformer Bank	PLANNED OUTAGE	8/12/2024 9:22	9.13	2
Transformer Bank	PLANNED OUTAGE	8/12/2024 9:23	712.00	15
PLF	PLANNED OUTAGE	8/12/2024 8:33	172.77	1
PLF	PLANNED OUTAGE	8/12/2024 9:53	400.70	2
PLF	PLANNED OUTAGE	8/06/2024 13:04	1,375.75	5
Transformer	PLANNED OUTAGE	8/06/2024 19:01	277.50	9
Transformer	PLANNED OUTAGE	8/06/2024 19:53	108.15	9
Transformer	PLANNED OUTAGE	8/07/2024 1:43	344.48	11
Service point	PLANNED OUTAGE	8/07/2024 9:26	18.33	1
Transformer	PLANNED OUTAGE	8/07/2024 10:39	16.13	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	8/07/2024 9:42	130.15	3
Transformer	PLANNED OUTAGE	8/07/2024 14:01	234.25	5
None	PLANNED OUTAGE	8/08/2024 1:46	336.42	5
PLF	PLANNED OUTAGE	8/08/2024 8:31	180.33	1
Transformer	PLANNED OUTAGE	8/08/2024 8:25	2,594.13	16
Transformer	PLANNED OUTAGE	8/08/2024 11:37	38.47	4
Transformer	PLANNED OUTAGE	8/08/2024 9:42	369.75	5
Transformer	PLANNED OUTAGE	8/08/2024 9:44	1,428.45	9
Transformer	PLANNED OUTAGE	8/08/2024 14:36	880.00	15
PLF	PLANNED OUTAGE	8/08/2024 14:53	222.13	17
Transformer Bank	PLANNED OUTAGE	8/08/2024 21:14	386.00	5
Transformer	PLANNED OUTAGE	8/08/2024 23:49	513.40	6
None	PLANNED OUTAGE	8/08/2024 22:48	3,469.33	8
PLF	PLANNED OUTAGE	8/09/2024 9:12	227.80	2
Transformer	PLANNED OUTAGE	8/09/2024 13:12	280.17	5
Service - Crew	PLANNED OUTAGE	8/10/2024 14:35	671.60	6
PLF	PLANNED OUTAGE	8/12/2024 13:48	25.10	1
Transformer	PLANNED OUTAGE	8/12/2024 12:26	305.37	1
Transformer Bank	PLANNED OUTAGE	8/13/2024 2:39	15.40	1
Transformer	PLANNED OUTAGE	8/13/2024 9:25	203.33	4
Transformer	PLANNED OUTAGE	8/13/2024 8:26	663.07	8
PLF	PLANNED OUTAGE	8/13/2024 12:49	68.27	1
PLF	PLANNED OUTAGE	8/13/2024 13:18	1,262.25	11
None	PLANNED OUTAGE	8/13/2024 18:32	416.27	8
Transformer	PLANNED OUTAGE	8/13/2024 13:46	2,067.30	6
Transformer	PLANNED OUTAGE	8/14/2024 8:36	913.17	5
Transformer Bank	PLANNED OUTAGE	8/14/2024 17:59	357.70	6
Transformer	PLANNED OUTAGE	8/14/2024 13:48	204.50	3
Transformer	PLANNED OUTAGE	8/15/2024 1:55	58.60	2
PLF	PLANNED OUTAGE	8/14/2024 11:19	396.77	1
Transformer	PLANNED OUTAGE	8/15/2024 6:21	116.85	9
Transformer Bank	PLANNED OUTAGE	8/15/2024 3:50	151.67	1
PLF	PLANNED OUTAGE	8/15/2024 8:05	2,948.40	8
Transformer	PLANNED OUTAGE	8/15/2024 12:09	927.15	7
Transformer	PLANNED OUTAGE	8/15/2024 12:09	132.00	1
Transformer	PLANNED OUTAGE	8/15/2024 9:17	1,435.13	11
PLF	PLANNED OUTAGE	8/15/2024 10:38	682.40	16
Transformer	PLANNED OUTAGE	8/15/2024 11:01	1,891.05	7
PLF	PLANNED OUTAGE	8/15/2024 16:54	223.88	1
Transformer	PLANNED OUTAGE	8/30/2024 12:19	223.70	6
Connections	PLANNED OUTAGE	8/30/2024 16:15	469.50	9

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	8/31/2024 4:57	198.83	5
Transformer	PLANNED OUTAGE	8/31/2024 19:30	348.15	11
Transformer	PLANNED OUTAGE	9/01/2024 1:49	32.15	3
Transformer	PLANNED OUTAGE	9/01/2024 14:39	54.90	3
Breaker	PLANNED OUTAGE	9/01/2024 19:58	64,480.67	1555
PLF	PLANNED OUTAGE	9/01/2024 21:39	805.48	31
Transformer	PLANNED OUTAGE	9/02/2024 19:04	251.12	13
Transformer	PLANNED OUTAGE	9/02/2024 23:15	218.75	7
Service point	PLANNED OUTAGE	9/03/2024 0:26	5.65	1
Transformer	PLANNED OUTAGE	8/30/2024 12:55	1,447.87	8
Transformer	PLANNED OUTAGE	9/03/2024 9:18	188.25	1
None	PLANNED OUTAGE	9/03/2024 11:48	52.52	1
Transformer	PLANNED OUTAGE	9/03/2024 15:32	681.10	6
Transformer	PLANNED OUTAGE	9/03/2024 13:21	96.07	2
Transformer	PLANNED OUTAGE	9/03/2024 18:30	38.23	1
Transformer	PLANNED OUTAGE	9/03/2024 19:29	1,951.67	4
Transformer	PLANNED OUTAGE	9/04/2024 10:18	141.63	2
Transformer	PLANNED OUTAGE	9/04/2024 10:41	200.70	3
PLF	PLANNED OUTAGE	9/04/2024 13:09	59.63	1
None	PLANNED OUTAGE	9/04/2024 9:21	7,900.88	23
PLF	PLANNED OUTAGE	9/04/2024 15:16	130.57	2
Invalid	PLANNED OUTAGE	9/04/2024 13:43	338.98	11
Transformer	PLANNED OUTAGE	9/04/2024 18:30	77.58	1
Transformer	PLANNED OUTAGE	9/04/2024 18:57	50.22	1
None	PLANNED OUTAGE	9/05/2024 2:07	487.25	15
Switch	PLANNED OUTAGE	9/05/2024 10:17	244.47	2
Transformer	PLANNED OUTAGE	9/05/2024 16:51	205.20	3
Transformer	PLANNED OUTAGE	9/05/2024 15:39	49.82	1
Switch	PLANNED OUTAGE	9/05/2024 20:07	347.00	5
Breaker	PLANNED OUTAGE	9/05/2024 20:09	82.53	1
Service point	PLANNED OUTAGE	9/05/2024 22:31	87.72	1
Breaker	PLANNED OUTAGE	8/16/2024 12:14	25,007.40	1263
Breaker	PLANNED OUTAGE	8/16/2024 12:14	19.80	1
Breaker	PLANNED OUTAGE	8/16/2024 12:14	19.80	1
Breaker	PLANNED OUTAGE	8/16/2024 12:14	19.80	1
Breaker	PLANNED OUTAGE	8/16/2024 12:14	19.80	1
Transformer	PLANNED OUTAGE	8/16/2024 16:47	145.47	4
PLF	PLANNED OUTAGE	8/16/2024 21:15	357.95	3
Service point	PLANNED OUTAGE	8/16/2024 22:31	12.38	1
None	PLANNED OUTAGE	8/17/2024 12:00	363.17	5
Transformer	PLANNED OUTAGE	8/18/2024 14:33	256.50	5

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	8/18/2024 14:50	65.20	4
Transformer Bank	PLANNED OUTAGE	8/18/2024 15:32	149.92	7
Transformer	PLANNED OUTAGE	8/18/2024 20:34	319.60	8
Transformer	PLANNED OUTAGE	8/18/2024 16:09	132.20	1
Transformer	PLANNED OUTAGE	8/18/2024 15:25	379.00	5
Transformer Bank	PLANNED OUTAGE	8/19/2024 1:07	13.10	1
PLF	PLANNED OUTAGE	8/19/2024 8:24	147.15	1
Transformer Bank	PLANNED OUTAGE	8/19/2024 10:16	92.40	1
Transformer	PLANNED OUTAGE	8/19/2024 13:04	825.13	4
Transformer	PLANNED OUTAGE	8/20/2024 0:49	43.28	7
Transformer	PLANNED OUTAGE	8/19/2024 8:48	1,509.60	8
Transformer	PLANNED OUTAGE	8/20/2024 14:52	80.27	28
Breaker	PLANNED OUTAGE	8/20/2024 16:15	120.20	3
Breaker	PLANNED OUTAGE	8/20/2024 16:15	509.37	59
Transformer	PLANNED OUTAGE	8/20/2024 12:52	667.50	5
Switch	PLANNED OUTAGE	8/20/2024 18:08	130.60	3
PLF	PLANNED OUTAGE	8/20/2024 17:14	93.90	2
Transformer	PLANNED OUTAGE	8/28/2024 8:39	545.93	4
PLF	PLANNED OUTAGE	8/28/2024 12:54	55.02	1
Transformer	PLANNED OUTAGE	8/28/2024 9:05	4,746.70	14
Primary Wire	PLANNED OUTAGE	8/28/2024 23:03	447.00	18
Transformer	PLANNED OUTAGE	8/30/2024 11:03	432.80	8
Transformer	PLANNED OUTAGE	8/30/2024 13:58	57.20	3
PLF	PLANNED OUTAGE	8/30/2024 23:09	9.58	1
Transformer	PLANNED OUTAGE	8/31/2024 1:35	84.75	5
Transformer	PLANNED OUTAGE	9/01/2024 3:51	107.67	5
Transformer	PLANNED OUTAGE	9/01/2024 12:36	100.45	3
Transformer	PLANNED OUTAGE	9/01/2024 13:10	84.53	4
Transformer	PLANNED OUTAGE	9/01/2024 13:23	226.00	6
Transformer	PLANNED OUTAGE	9/02/2024 19:55	431.00	10
PLF	PLANNED OUTAGE	9/02/2024 22:22	6,493.45	61
Transformer	PLANNED OUTAGE	9/03/2024 11:01	981.83	10
Transformer	PLANNED OUTAGE	9/03/2024 9:16	380.37	2
Transformer	PLANNED OUTAGE	9/03/2024 23:04	19.87	8
PLF	PLANNED OUTAGE	9/04/2024 0:23	4,230.80	21
PLF	PLANNED OUTAGE	9/04/2024 0:23	4,939.73	32
PLF	PLANNED OUTAGE	9/04/2024 1:26	181.63	2
Transformer	PLANNED OUTAGE	9/03/2024 8:33	3,827.63	13
Transformer	PLANNED OUTAGE	9/03/2024 20:15	2,571.92	5
Transformer	PLANNED OUTAGE	9/03/2024 5:29	6,528.25	5
Transformer	PLANNED OUTAGE	9/04/2024 10:44	57.20	2

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	9/04/2024 10:45	80.90	3
Breaker	PLANNED OUTAGE	9/06/2024 10:43	5.93	1
Breaker	PLANNED OUTAGE	9/06/2024 10:43	6.53	1
Breaker	PLANNED OUTAGE	9/06/2024 10:43	6.52	1
Breaker	PLANNED OUTAGE	9/06/2024 10:43	5.82	1
Transformer	PLANNED OUTAGE	9/06/2024 9:50	306.33	5
Transformer	PLANNED OUTAGE	9/06/2024 11:31	891.73	8
Transformer	PLANNED OUTAGE	9/06/2024 14:06	26.25	7
Transformer	PLANNED OUTAGE	9/07/2024 6:32	44.47	2
Transformer	PLANNED OUTAGE	9/07/2024 5:40	37.63	1
Transformer Bank	PLANNED OUTAGE	9/07/2024 16:53	84.55	3
Breaker	PLANNED OUTAGE	9/07/2024 17:28	8.77	1
Breaker	PLANNED OUTAGE	9/07/2024 17:28	9.03	1
Breaker	PLANNED OUTAGE	9/07/2024 17:28	9.40	1
Breaker	PLANNED OUTAGE	9/07/2024 17:31	6.35	1
Breaker	PLANNED OUTAGE	9/07/2024 17:32	4.82	1
Breaker	PLANNED OUTAGE	9/07/2024 17:32	5.02	1
None	PLANNED OUTAGE	9/08/2024 16:27	451.80	9
None	PLANNED OUTAGE	9/08/2024 18:29	240.87	4
Primary Wire	PLANNED OUTAGE	9/08/2024 15:14	256.87	1
Breaker	PLANNED OUTAGE	9/06/2024 17:08	8.90	1
Breaker	PLANNED OUTAGE	9/06/2024 17:08	9.18	1
Breaker	PLANNED OUTAGE	9/06/2024 17:07	3,671.43	341
Connections	PLANNED OUTAGE	9/09/2024 7:26	29.10	1
Transformer	PLANNED OUTAGE	9/09/2024 9:03	105.67	2
Transformer	PLANNED OUTAGE	9/09/2024 10:26	2,147.75	11
PLF	PLANNED OUTAGE	9/09/2024 9:17	690.90	2
Transformer	PLANNED OUTAGE	9/09/2024 13:38	2,520.58	29
Breaker	PLANNED OUTAGE	9/09/2024 19:55	9.10	1
Breaker	PLANNED OUTAGE	9/09/2024 19:55	9.25	1
Primary Wire	PLANNED OUTAGE	9/09/2024 8:30	534.27	4
PLF	PLANNED OUTAGE	9/10/2024 9:36	168.47	4
PLF	PLANNED OUTAGE	9/10/2024 9:38	40.33	1
Transformer	PLANNED OUTAGE	9/10/2024 8:54	4,616.10	69
Transformer	PLANNED OUTAGE	8/10/2024 16:51	271.15	3
PLF	PLANNED OUTAGE	8/10/2024 20:01	133.35	7
Switch	PLANNED OUTAGE	8/10/2024 20:53	4,975.08	227
Transformer	PLANNED OUTAGE	8/11/2024 6:01	58.92	5
Transformer	PLANNED OUTAGE	8/11/2024 18:24	82.45	3
Transformer	PLANNED OUTAGE	8/12/2024 4:22	71.87	2
Transformer	PLANNED OUTAGE	8/12/2024 8:48	884.57	7

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	8/12/2024 8:34	556.07	4
Transformer	PLANNED OUTAGE	8/12/2024 8:44	214.70	2
None	PLANNED OUTAGE	8/12/2024 14:38	1,956.58	53
Transformer Bank	PLANNED OUTAGE	8/12/2024 18:44	1,868.58	5
Transformer	PLANNED OUTAGE	8/13/2024 0:26	39.53	1
Transformer	PLANNED OUTAGE	8/12/2024 22:32	678.60	2
Breaker	PLANNED OUTAGE	8/13/2024 13:38	28,565.58	1865
PLF	PLANNED OUTAGE	8/13/2024 12:22	154.15	1
Transformer	PLANNED OUTAGE	8/13/2024 8:32	253.20	1
None	PLANNED OUTAGE	8/13/2024 13:51	137.92	1
Transformer	PLANNED OUTAGE	8/14/2024 0:32	58.33	4
Transformer	PLANNED OUTAGE	8/13/2024 8:57	150.77	2
Transformer	PLANNED OUTAGE	8/14/2024 11:31	1,543.85	11
Transformer	PLANNED OUTAGE	8/21/2024 9:47	18.43	7
PLF	PLANNED OUTAGE	8/21/2024 9:18	7,039.90	178
Transformer	PLANNED OUTAGE	8/21/2024 8:47	353.60	16
Transformer	PLANNED OUTAGE	8/21/2024 12:57	495.07	8
Transformer	PLANNED OUTAGE	8/21/2024 16:57	49.32	1
Transformer	PLANNED OUTAGE	8/22/2024 10:58	87.07	1
Transformer	PLANNED OUTAGE	8/22/2024 12:45	572.60	3
Transformer	PLANNED OUTAGE	8/22/2024 15:40	35.33	1
Transformer	PLANNED OUTAGE	8/23/2024 2:50	335.00	12
Transformer	PLANNED OUTAGE	8/23/2024 6:00	95.17	2
Transformer	PLANNED OUTAGE	8/23/2024 8:59	1,003.47	8
Switch	PLANNED OUTAGE	8/22/2024 7:57	92,089.50	438
Switch	PLANNED OUTAGE	8/22/2024 7:57	1,132.45	33
Switch	PLANNED OUTAGE	8/22/2024 7:57	4,296.93	67
Service point	PLANNED OUTAGE	8/23/2024 15:51	21.08	1
Transformer	PLANNED OUTAGE	8/23/2024 13:58	87.73	1
Transformer	PLANNED OUTAGE	8/23/2024 20:28	141.27	1
PLF	PLANNED OUTAGE	8/23/2024 20:38	247.63	38
Breaker	PLANNED OUTAGE	8/23/2024 21:05	5,761.90	471
Transformer	PLANNED OUTAGE	8/24/2024 19:17	97.77	7
Transformer	PLANNED OUTAGE	8/24/2024 16:04	1,151.33	8
Transformer	PLANNED OUTAGE	8/24/2024 20:36	73.73	2
Transformer	PLANNED OUTAGE	8/26/2024 21:37	164.53	1
Transformer	PLANNED OUTAGE	8/27/2024 6:54	30.80	4
Transformer Bank	PLANNED OUTAGE	8/27/2024 7:43	372.43	1
PLF	PLANNED OUTAGE	8/27/2024 8:37	2,249.60	12
PLF	PLANNED OUTAGE	8/27/2024 8:46	1,008.90	6
PLF	PLANNED OUTAGE	8/27/2024 9:47	63.42	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	8/27/2024 9:48	42.67	1
Transformer	PLANNED OUTAGE	8/27/2024 23:41	248.40	9
PLF	PLANNED OUTAGE	8/28/2024 10:16	329.20	8
Transformer	PLANNED OUTAGE	8/28/2024 18:47	211.20	11
Transformer	PLANNED OUTAGE	8/28/2024 8:40	455.45	1
Transformer	PLANNED OUTAGE	9/04/2024 10:49	46.77	2
Transformer	PLANNED OUTAGE	9/04/2024 12:13	1,352.55	9
Transformer	PLANNED OUTAGE	9/04/2024 12:13	1,353.15	9
Transformer	PLANNED OUTAGE	9/04/2024 16:45	181.95	1
Transformer	PLANNED OUTAGE	9/04/2024 18:28	79.15	1
Transformer	PLANNED OUTAGE	9/04/2024 18:31	76.18	1
Transformer	PLANNED OUTAGE	9/04/2024 18:50	57.10	1
Transformer Bank	PLANNED OUTAGE	9/05/2024 8:33	1,125.53	4
Transformer	PLANNED OUTAGE	9/05/2024 14:00	57.87	8
None	PLANNED OUTAGE	9/05/2024 11:14	2,211.30	9
Transformer	PLANNED OUTAGE	9/05/2024 11:26	204.07	1
Transformer	PLANNED OUTAGE	9/05/2024 14:51	59.80	1
PLF	PLANNED OUTAGE	9/05/2024 15:40	75.73	8
PLF	PLANNED OUTAGE	9/05/2024 23:16	670.37	7
PLF	PLANNED OUTAGE	9/06/2024 7:27	339.80	12
PLF	PLANNED OUTAGE	9/06/2024 10:14	424.42	5
Breaker	PLANNED OUTAGE	9/06/2024 10:43	7,095.33	1160
Breaker	PLANNED OUTAGE	9/06/2024 10:43	6.70	1
Breaker	PLANNED OUTAGE	9/06/2024 10:43	6.07	1
Breaker	PLANNED OUTAGE	9/06/2024 10:43	6.20	1
Transformer	PLANNED OUTAGE	9/06/2024 9:21	577.67	4
Transformer	PLANNED OUTAGE	9/06/2024 14:33	79.73	4
Transformer	PLANNED OUTAGE	9/06/2024 9:58	213.07	1
Breaker	PLANNED OUTAGE	9/07/2024 17:32	4.90	1
Breaker	PLANNED OUTAGE	9/07/2024 17:31	6.10	1
Breaker	PLANNED OUTAGE	9/07/2024 17:32	4.70	1
Breaker	PLANNED OUTAGE	9/07/2024 17:31	5.80	1
Transformer	PLANNED OUTAGE	9/08/2024 7:43	369.02	1
PLF	PLANNED OUTAGE	9/08/2024 8:20	335.08	1
PLF	PLANNED OUTAGE	9/09/2024 9:08	1,648.20	12
Transformer	PLANNED OUTAGE	9/09/2024 3:26	364.20	3
Transformer	PLANNED OUTAGE	9/09/2024 9:38	1,821.20	12
Transformer	PLANNED OUTAGE	9/09/2024 18:35	513.45	9
PLF	PLANNED OUTAGE	8/14/2024 17:11	78.33	1
Transformer	PLANNED OUTAGE	8/15/2024 0:17	462.40	16
Transformer	PLANNED OUTAGE	8/15/2024 8:48	891.00	10

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	8/15/2024 8:48	17.90	1
Transformer	PLANNED OUTAGE	8/15/2024 10:08	75.73	8
PLF	PLANNED OUTAGE	8/15/2024 9:49	1,549.77	38
Transformer Bank	PLANNED OUTAGE	8/15/2024 15:14	498.30	2
Breaker	PLANNED OUTAGE	8/15/2024 21:39	143.57	59
Transformer	PLANNED OUTAGE	8/16/2024 5:17	175.47	7
Transformer	PLANNED OUTAGE	8/16/2024 6:08	59.85	3
Transformer	PLANNED OUTAGE	8/16/2024 10:49	256.17	10
Transformer	PLANNED OUTAGE	8/16/2024 13:33	498.07	4
Transformer	PLANNED OUTAGE	8/16/2024 16:24	384.88	7
Transformer	PLANNED OUTAGE	8/16/2024 17:23	591.67	10
PLF	PLANNED OUTAGE	8/16/2024 16:53	1,324.20	12
Transformer	PLANNED OUTAGE	8/17/2024 0:38	626.27	7
Transformer	PLANNED OUTAGE	8/17/2024 7:59	61.73	8
Transformer	PLANNED OUTAGE	8/17/2024 13:26	11.78	1
Transformer	PLANNED OUTAGE	8/17/2024 23:00	862.00	10
PLF	PLANNED OUTAGE	8/18/2024 10:33	466.43	7
Breaker	PLANNED OUTAGE	8/18/2024 17:54	20.58	1
PLF	PLANNED OUTAGE	8/17/2024 8:37	2,432.25	5
PLF	PLANNED OUTAGE	8/29/2024 9:28	1,294.85	19
PLF	PLANNED OUTAGE	8/29/2024 11:12	20.93	4
Transformer	PLANNED OUTAGE	8/29/2024 11:36	386.27	8
Transformer	PLANNED OUTAGE	8/29/2024 9:48	278.17	1
Transformer	PLANNED OUTAGE	8/29/2024 17:41	97.13	2
Transformer	PLANNED OUTAGE	8/30/2024 9:08	925.20	12
Transformer	PLANNED OUTAGE	8/30/2024 13:11	94.80	4
Transformer	PLANNED OUTAGE	8/30/2024 10:49	314.80	6
Transformer	PLANNED OUTAGE	8/30/2024 13:10	190.52	7
Transformer	PLANNED OUTAGE	8/31/2024 8:08	177.33	2
Transformer	PLANNED OUTAGE	9/01/2024 15:31	125.30	6
Transformer	PLANNED OUTAGE	9/01/2024 15:54	62.77	2
Transformer	PLANNED OUTAGE	9/02/2024 18:46	117.95	3
Transformer	PLANNED OUTAGE	9/02/2024 23:42	76.53	7
Transformer	PLANNED OUTAGE	9/03/2024 0:55	14.83	5
Transformer	PLANNED OUTAGE	9/03/2024 4:59	38.00	1
Primary Wire	PLANNED OUTAGE	9/03/2024 10:06	268.05	3
Transformer Bank	PLANNED OUTAGE	9/03/2024 8:25	707.10	2
PLF	PLANNED OUTAGE	9/03/2024 18:06	1,493.50	5
Transformer Bank	PLANNED OUTAGE	9/03/2024 23:44	477.70	2
None	PLANNED OUTAGE	9/04/2024 8:58	4,016.82	17
Transformer	PLANNED OUTAGE	9/04/2024 9:43	258.77	7

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
None	PLANNED OUTAGE	9/04/2024 9:50	305.08	5
Transformer	PLANNED OUTAGE	9/04/2024 8:32	98.82	1
Transformer	PLANNED OUTAGE	9/10/2024 10:35	400.20	2
Transformer	PLANNED OUTAGE	9/10/2024 19:05	75.00	1
Transformer	PLANNED OUTAGE	9/11/2024 0:30	188.93	8
Transformer	PLANNED OUTAGE	9/11/2024 1:18	29.52	1
Transformer Bank	PLANNED OUTAGE	9/11/2024 13:37	52.82	1
Transformer	PLANNED OUTAGE	9/11/2024 12:06	682.13	8
Transformer	PLANNED OUTAGE	9/11/2024 9:53	924.93	7
None	PLANNED OUTAGE	9/11/2024 20:07	769.35	9
Breaker	PLANNED OUTAGE	9/12/2024 10:15	4.27	1
Breaker	PLANNED OUTAGE	9/12/2024 10:15	4.27	1
PLF	PLANNED OUTAGE	9/12/2024 12:10	251.80	2
Transformer	PLANNED OUTAGE	9/12/2024 15:23	157.33	5
PLF	PLANNED OUTAGE	9/13/2024 10:01	1,285.67	19
Transformer Bank	PLANNED OUTAGE	9/13/2024 8:52	193.87	1
Transformer	PLANNED OUTAGE	9/14/2024 0:49	27.98	1
Transformer	PLANNED OUTAGE	9/14/2024 7:06	96.57	1
Transformer	PLANNED OUTAGE	9/15/2024 23:55	130.40	12
Breaker	PLANNED OUTAGE	9/16/2024 13:22	10.08	1
Transformer	PLANNED OUTAGE	9/16/2024 10:11	387.33	2
Transformer	PLANNED OUTAGE	9/16/2024 18:59	97.47	8
Transformer	PLANNED OUTAGE	9/16/2024 19:55	92.93	8
Transformer	PLANNED OUTAGE	9/16/2024 23:37	142.90	6
PLF	PLANNED OUTAGE	9/17/2024 1:33	138.55	1
Breaker	PLANNED OUTAGE	9/17/2024 9:36	10.83	1
Breaker	PLANNED OUTAGE	9/17/2024 9:36	11.17	1
PLF	PLANNED OUTAGE	9/17/2024 10:45	1,685.93	38
Transformer Bank	PLANNED OUTAGE	9/17/2024 12:43	56.63	2
Transformer	PLANNED OUTAGE	9/17/2024 11:55	591.75	9
Transformer	PLANNED OUTAGE	9/17/2024 10:38	2,178.10	23
Transformer	PLANNED OUTAGE	9/17/2024 10:21	73.88	1
Transformer	PLANNED OUTAGE	9/17/2024 19:19	203.17	5
Transformer	PLANNED OUTAGE	9/17/2024 23:24	613.58	5
PLF	PLANNED OUTAGE	9/18/2024 11:26	227.72	13
Transformer	PLANNED OUTAGE	9/09/2024 19:25	66.90	3
None	PLANNED OUTAGE	9/10/2024 9:13	122.05	3
Transformer	PLANNED OUTAGE	9/10/2024 11:26	40.42	5
PLF	PLANNED OUTAGE	9/10/2024 9:28	185.20	24
None	PLANNED OUTAGE	9/11/2024 2:32	307.20	4
PLF	PLANNED OUTAGE	9/11/2024 2:42	162.63	7

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	9/11/2024 11:10	2,370.42	25
PLF	PLANNED OUTAGE	9/11/2024 10:39	169.70	1
Transformer	PLANNED OUTAGE	9/11/2024 11:46	1,322.75	11
Breaker	PLANNED OUTAGE	9/12/2024 10:15	2,244.80	732
Breaker	PLANNED OUTAGE	9/12/2024 10:15	4.27	1
Transformer	PLANNED OUTAGE	9/12/2024 10:17	2,340.67	10
UG Other	PLANNED OUTAGE	9/12/2024 9:05	12,445.18	49
Transformer	PLANNED OUTAGE	9/12/2024 23:50	242.27	2
PLF	PLANNED OUTAGE	9/12/2024 23:51	357.08	25
Transformer	PLANNED OUTAGE	9/13/2024 1:46	13.67	1
Transformer	PLANNED OUTAGE	9/13/2024 4:53	86.08	5
Transformer	PLANNED OUTAGE	9/13/2024 6:41	384.67	4
Transformer	PLANNED OUTAGE	9/13/2024 8:47	352.75	5
Transformer	PLANNED OUTAGE	9/13/2024 8:49	101.53	2
Transformer	PLANNED OUTAGE	9/13/2024 17:22	81.50	3
Transformer	PLANNED OUTAGE	9/13/2024 15:38	539.60	8
Transformer Bank	PLANNED OUTAGE	9/13/2024 18:33	6.40	1
None	PLANNED OUTAGE	9/14/2024 13:43	1,000.10	73
None	PLANNED OUTAGE	9/14/2024 13:43	9,634.23	743
PLF	PLANNED OUTAGE	9/14/2024 21:25	1,174.60	14
Transformer	PLANNED OUTAGE	9/14/2024 21:18	61.35	3
Transformer	PLANNED OUTAGE	9/15/2024 15:59	231.92	11
Transformer	PLANNED OUTAGE	9/15/2024 16:44	132.80	6
Transformer	PLANNED OUTAGE	9/16/2024 0:53	80.50	6
Transformer	PLANNED OUTAGE	9/16/2024 12:05	283.07	8
Primary Wire	PLANNED OUTAGE	9/16/2024 11:01	719.17	5
Transformer	PLANNED OUTAGE	9/16/2024 9:46	405.87	8
Transformer Bank	PLANNED OUTAGE	9/04/2024 8:34	325.73	7
PLF	PLANNED OUTAGE	9/05/2024 11:44	612.90	18
Transformer	PLANNED OUTAGE	9/05/2024 18:31	1,686.07	4
Switch	PLANNED OUTAGE	9/05/2024 20:10	67.12	1
Switch	PLANNED OUTAGE	9/05/2024 20:37	37.97	1
Switch	PLANNED OUTAGE	9/05/2024 20:07	609.60	9
Breaker	PLANNED OUTAGE	9/05/2024 20:10	78.67	1
Transformer	PLANNED OUTAGE	9/06/2024 2:17	392.53	8
Service point	PLANNED OUTAGE	9/06/2024 2:24	24.70	1
Breaker	PLANNED OUTAGE	9/06/2024 10:43	5.82	1
Breaker	PLANNED OUTAGE	9/06/2024 10:43	5.98	1
Breaker	PLANNED OUTAGE	9/06/2024 10:43	6.12	1
Breaker	PLANNED OUTAGE	9/06/2024 10:43	6.25	1
Breaker	PLANNED OUTAGE	9/06/2024 10:43	6.38	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	9/06/2024 20:21	104.27	8
Breaker	PLANNED OUTAGE	9/07/2024 17:28	8.90	1
Breaker	PLANNED OUTAGE	9/07/2024 17:28	8.97	1
Breaker	PLANNED OUTAGE	9/07/2024 17:28	8.70	1
Breaker	PLANNED OUTAGE	9/07/2024 17:28	9.55	1
Breaker	PLANNED OUTAGE	9/07/2024 17:28	9.48	1
Breaker	PLANNED OUTAGE	9/07/2024 17:32	5.07	1
Breaker	PLANNED OUTAGE	9/07/2024 17:32	4.85	1
Transformer	PLANNED OUTAGE	9/09/2024 3:49	3.47	2
None	PLANNED OUTAGE	9/08/2024 14:08	2,891.15	53
Breaker	PLANNED OUTAGE	9/06/2024 17:08	1,331.58	145
Breaker	PLANNED OUTAGE	9/06/2024 17:08	8.35	1
Transformer	PLANNED OUTAGE	9/09/2024 8:45	852.20	12
Transformer	PLANNED OUTAGE	9/09/2024 8:50	4,813.20	8
None	PLANNED OUTAGE	9/09/2024 14:39	417.60	8
Breaker	PLANNED OUTAGE	9/09/2024 19:55	9.32	1
Breaker	PLANNED OUTAGE	9/09/2024 19:55	9.38	1
Breaker	PLANNED OUTAGE	9/09/2024 19:55	9.45	1
Transformer	PLANNED OUTAGE	9/09/2024 20:06	38.30	6
Breaker	PLANNED OUTAGE	8/19/2024 11:08	15.78	1
Breaker	PLANNED OUTAGE	8/19/2024 11:08	9.35	1
PLF	PLANNED OUTAGE	8/19/2024 21:31	322.88	1
Transformer	PLANNED OUTAGE	8/20/2024 0:32	54.47	4
PLF	PLANNED OUTAGE	8/19/2024 4:42	5,284.77	14
None	PLANNED OUTAGE	8/20/2024 8:14	715.20	12
Transformer	PLANNED OUTAGE	8/20/2024 8:42	50.07	1
Primary Wire	PLANNED OUTAGE	8/20/2024 10:34	894.08	5
PLF	PLANNED OUTAGE	8/20/2024 10:08	302.62	1
Breaker	PLANNED OUTAGE	8/20/2024 16:15	40.20	1
None	PLANNED OUTAGE	8/20/2024 17:01	104.10	1
None	PLANNED OUTAGE	8/20/2024 16:59	9,672.60	126
Transformer	PLANNED OUTAGE	8/20/2024 20:25	288.83	10
PLF	PLANNED OUTAGE	8/20/2024 19:55	463.30	3
PLF	PLANNED OUTAGE	8/20/2024 22:29	472.90	2
Transformer Bank	PLANNED OUTAGE	8/20/2024 9:31	1,589.67	5
PLF	PLANNED OUTAGE	8/21/2024 9:06	31.33	5
None	PLANNED OUTAGE	8/21/2024 10:41	210.05	3
PLF	PLANNED OUTAGE	8/21/2024 8:13	390.57	1
Transformer	PLANNED OUTAGE	8/21/2024 14:53	18.83	1
Transformer	PLANNED OUTAGE	8/21/2024 14:06	683.20	8
Transformer	PLANNED OUTAGE	8/21/2024 23:37	273.20	12

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	8/22/2024 9:02	532.67	17
Transformer	PLANNED OUTAGE	8/23/2024 1:58	185.50	7
None	PLANNED OUTAGE	8/23/2024 11:20	308.33	10
Service point	PLANNED OUTAGE	8/24/2024 6:44	344.55	1
Transformer	PLANNED OUTAGE	8/24/2024 21:31	67.85	3
Transformer	PLANNED OUTAGE	8/24/2024 22:00	133.42	5
Invalid	PLANNED OUTAGE	8/24/2024 22:32	1,106.40	6
Transformer	PLANNED OUTAGE	8/25/2024 5:11	98.50	3
PLF	PLANNED OUTAGE	8/25/2024 12:49	44.92	1
PLF	PLANNED OUTAGE	8/25/2024 21:40	211.22	1
Transformer	PLANNED OUTAGE	8/25/2024 5:39	4,996.38	11
PLF	PLANNED OUTAGE	9/18/2024 11:46	1,797.47	68
PLF	PLANNED OUTAGE	9/18/2024 11:48	2,221.63	83
Transformer Bank	PLANNED OUTAGE	9/18/2024 7:36	305.68	1
None	PLANNED OUTAGE	9/18/2024 15:54	3,561.83	142
None	PLANNED OUTAGE	9/18/2024 15:54	2,583.58	103
Breaker	PLANNED OUTAGE	9/18/2024 22:59	58,463.00	1140
PLF	PLANNED OUTAGE	9/19/2024 9:04	2,342.55	21
None	PLANNED OUTAGE	9/19/2024 12:27	290.90	6
Transformer	PLANNED OUTAGE	9/19/2024 9:02	1,583.10	9
PLF	PLANNED OUTAGE	9/19/2024 9:30	6,933.17	17
PLF	PLANNED OUTAGE	9/19/2024 18:52	71.77	2
Transformer Bank	PLANNED OUTAGE	9/19/2024 23:33	76.87	1
Transformer	PLANNED OUTAGE	9/19/2024 16:58	1,923.75	5
PLF	PLANNED OUTAGE	9/20/2024 8:44	190.37	1
Transformer	PLANNED OUTAGE	9/20/2024 12:27	26.97	2
None	PLANNED OUTAGE	9/20/2024 21:26	970.67	14
PLF	PLANNED OUTAGE	9/21/2024 6:45	98.87	4
Transformer	PLANNED OUTAGE	9/21/2024 9:14	428.00	5
Transformer	PLANNED OUTAGE	9/21/2024 9:29	186.00	8
None	PLANNED OUTAGE	9/21/2024 15:59	892.27	7
Transformer	PLANNED OUTAGE	9/22/2024 2:56	112.40	3
Transformer	PLANNED OUTAGE	9/22/2024 23:00	49.60	2
Transformer	PLANNED OUTAGE	9/20/2024 8:20	468.13	1
Breaker	PLANNED OUTAGE	9/23/2024 10:54	3,103.00	580
Breaker	PLANNED OUTAGE	9/23/2024 10:54	5.20	1
None	PLANNED OUTAGE	9/23/2024 9:17	1,751.20	16
Transformer	PLANNED OUTAGE	9/23/2024 8:40	2,783.00	10
Transformer	PLANNED OUTAGE	9/23/2024 15:20	131.20	8
Transformer	PLANNED OUTAGE	9/23/2024 13:24	72.73	2
Transformer	PLANNED OUTAGE	9/24/2024 1:22	120.92	5

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	9/24/2024 10:15	352.92	5
Transformer	PLANNED OUTAGE	9/24/2024 9:54	2,046.75	9
Transformer	PLANNED OUTAGE	9/24/2024 11:00	439.02	7
Transformer	PLANNED OUTAGE	9/24/2024 11:25	1,125.25	7
Transformer	PLANNED OUTAGE	9/16/2024 12:18	148.00	8
Transformer	PLANNED OUTAGE	9/16/2024 16:47	168.67	4
Breaker	PLANNED OUTAGE	9/17/2024 9:36	11.32	1
Breaker	PLANNED OUTAGE	9/17/2024 9:36	11.43	1
Breaker	PLANNED OUTAGE	9/17/2024 9:36	11.67	1
Switch	PLANNED OUTAGE	9/17/2024 9:54	596.92	19
None	PLANNED OUTAGE	9/17/2024 8:34	1,159.80	18
PLF	PLANNED OUTAGE	9/17/2024 12:27	673.75	11
Transformer Bank	PLANNED OUTAGE	9/17/2024 21:02	183.40	12
None	PLANNED OUTAGE	9/18/2024 5:48	553.73	4
Transformer Bank	PLANNED OUTAGE	9/18/2024 8:22	828.40	4
PLF	PLANNED OUTAGE	9/18/2024 9:56	124.30	1
Transformer	PLANNED OUTAGE	9/18/2024 22:28	423.37	13
Transformer	PLANNED OUTAGE	9/19/2024 0:22	75.20	3
Transformer	PLANNED OUTAGE	9/18/2024 9:29	2,093.80	6
PLF	PLANNED OUTAGE	9/19/2024 10:56	260.00	5
None	PLANNED OUTAGE	9/19/2024 8:36	176.75	3
Transformer	PLANNED OUTAGE	9/19/2024 10:43	1,270.30	6
Transformer	PLANNED OUTAGE	9/19/2024 13:23	28.93	2
PLF	PLANNED OUTAGE	9/19/2024 8:51	3,527.47	16
Transformer Bank	PLANNED OUTAGE	9/19/2024 13:54	58.92	1
Transformer	PLANNED OUTAGE	9/19/2024 8:39	8,722.60	12
Transformer	PLANNED OUTAGE	9/20/2024 2:32	151.15	3
Transformer	PLANNED OUTAGE	9/20/2024 3:45	532.80	12
Transformer	PLANNED OUTAGE	9/20/2024 12:49	72.25	1
Transformer Bank	PLANNED OUTAGE	9/20/2024 18:51	120.92	5
Transformer Bank	PLANNED OUTAGE	9/20/2024 18:15	151.37	2
Breaker	PLANNED OUTAGE	9/21/2024 9:41	14,590.80	1351
PLF	PLANNED OUTAGE	9/21/2024 7:21	175.13	1
Transformer	PLANNED OUTAGE	9/21/2024 7:38	998.40	8
None	PLANNED OUTAGE	9/21/2024 15:17	843.30	9
PLF	PLANNED OUTAGE	9/21/2024 15:21	376.30	2
Transformer	PLANNED OUTAGE	9/22/2024 0:09	923.10	9
Invalid	PLANNED OUTAGE	9/09/2024 19:37	2,128.67	10
PLF	PLANNED OUTAGE	9/09/2024 23:09	511.92	5
PLF	PLANNED OUTAGE	9/10/2024 11:51	216.90	2
Transformer	PLANNED OUTAGE	9/10/2024 12:01	300.93	8

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	9/11/2024 11:52	2,244.23	13
Transformer	PLANNED OUTAGE	9/12/2024 1:13	986.67	10
Transformer	PLANNED OUTAGE	9/12/2024 3:17	1,370.80	8
PLF	PLANNED OUTAGE	9/12/2024 9:53	384.80	12
Transformer	PLANNED OUTAGE	9/12/2024 12:23	93.87	2
Transformer	PLANNED OUTAGE	9/12/2024 10:34	797.33	8
Transformer	PLANNED OUTAGE	9/12/2024 13:01	352.75	15
Transformer	PLANNED OUTAGE	9/13/2024 2:15	59.92	5
Transformer	PLANNED OUTAGE	9/13/2024 2:39	126.12	7
Transformer	PLANNED OUTAGE	9/13/2024 12:05	503.00	6
Transformer	PLANNED OUTAGE	9/13/2024 8:34	2,449.67	10
Transformer	PLANNED OUTAGE	9/13/2024 16:27	99.35	3
Transformer	PLANNED OUTAGE	9/14/2024 1:36	36.75	3
Transformer	PLANNED OUTAGE	9/14/2024 2:01	17.47	2
None	PLANNED OUTAGE	9/14/2024 12:19	1,414.98	73
None	PLANNED OUTAGE	9/14/2024 12:19	14,401.82	743
None	PLANNED OUTAGE	9/14/2024 12:19	19.38	1
Service point	PLANNED OUTAGE	9/14/2024 17:06	216.10	1
Transformer	PLANNED OUTAGE	9/15/2024 20:42	41.23	2
PLF	PLANNED OUTAGE	9/16/2024 9:53	16.95	9
PLF	PLANNED OUTAGE	9/16/2024 9:04	2,525.90	39
PLF	PLANNED OUTAGE	9/16/2024 14:49	44.42	1
Transformer	PLANNED OUTAGE	9/16/2024 18:20	144.10	6
Transformer	PLANNED OUTAGE	9/17/2024 9:21	368.53	4
Breaker	PLANNED OUTAGE	9/17/2024 9:36	12,738.67	1124
Transformer	PLANNED OUTAGE	9/17/2024 12:51	179.85	9
PLF	PLANNED OUTAGE	9/17/2024 9:25	29,755.80	183
Transformer Bank	PLANNED OUTAGE	9/17/2024 11:44	156.60	18
Switch	PLANNED OUTAGE	9/17/2024 10:25	267.08	1
Switch	PLANNED OUTAGE	9/17/2024 12:21	244.12	1
None	PLANNED OUTAGE	8/26/2024 10:21	1,171.87	17
Transformer	PLANNED OUTAGE	8/26/2024 19:13	42.60	6
None	PLANNED OUTAGE	8/27/2024 8:33	42.58	1
PLF	PLANNED OUTAGE	8/27/2024 8:37	15,354.50	82
Transformer	PLANNED OUTAGE	8/27/2024 9:07	105.15	9
Transformer	PLANNED OUTAGE	8/27/2024 8:33	59.53	1
Transformer	PLANNED OUTAGE	8/27/2024 11:05	47.60	6
Transformer	PLANNED OUTAGE	8/27/2024 9:03	297.67	4
PLF	PLANNED OUTAGE	8/27/2024 7:58	357.78	1
Transformer	PLANNED OUTAGE	8/27/2024 10:05	317.23	1
PLF	PLANNED OUTAGE	8/27/2024 19:03	73.95	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Breaker	PLANNED OUTAGE	8/27/2024 8:27	41,733.07	2212
PLF	PLANNED OUTAGE	8/28/2024 0:08	459.55	1
None	PLANNED OUTAGE	8/28/2024 9:57	329.33	8
Transformer	PLANNED OUTAGE	8/28/2024 12:16	14.63	1
Transformer	PLANNED OUTAGE	8/28/2024 16:37	115.33	5
Transformer	PLANNED OUTAGE	8/28/2024 19:19	381.97	7
Transformer Bank	PLANNED OUTAGE	8/28/2024 23:15	88.95	1
Transformer	PLANNED OUTAGE	8/29/2024 11:27	530.93	8
Transformer	PLANNED OUTAGE	8/29/2024 9:46	280.20	1
Breaker	PLANNED OUTAGE	8/29/2024 15:16	9,910.72	263
Transformer	PLANNED OUTAGE	8/30/2024 11:02	643.30	14
Transformer	PLANNED OUTAGE	8/30/2024 9:25	997.50	7
Transformer	PLANNED OUTAGE	9/22/2024 1:11	449.75	7
Transformer	PLANNED OUTAGE	9/22/2024 2:13	170.60	6
Transformer	PLANNED OUTAGE	9/22/2024 16:13	16.75	5
PLF	PLANNED OUTAGE	9/24/2024 10:50	1,722.00	56
Switch	PLANNED OUTAGE	9/24/2024 8:42	173.57	1
Transformer Bank	PLANNED OUTAGE	9/24/2024 9:12	243.33	1
Transformer	PLANNED OUTAGE	9/24/2024 9:16	831.47	8
PLF	PLANNED OUTAGE	9/24/2024 10:05	2,291.60	17
None	PLANNED OUTAGE	9/24/2024 13:02	6,790.93	112
Transformer	PLANNED OUTAGE	9/24/2024 8:24	288.88	1
Transformer	PLANNED OUTAGE	9/24/2024 13:28	82.87	2
PLF	PLANNED OUTAGE	9/24/2024 18:04	406.45	11
Transformer	PLANNED OUTAGE	9/24/2024 19:54	102.53	4
Transformer	PLANNED OUTAGE	9/25/2024 6:36	234.70	6
PLF	PLANNED OUTAGE	9/25/2024 13:58	623.02	29
Breaker	PLANNED OUTAGE	9/25/2024 12:20	3.22	1
Breaker	PLANNED OUTAGE	9/25/2024 12:20	8,446.97	2626
Breaker	PLANNED OUTAGE	9/25/2024 12:20	3.22	1
Breaker	PLANNED OUTAGE	9/25/2024 12:20	3.22	1
Breaker	PLANNED OUTAGE	9/25/2024 12:20	3.22	1
UG Other	PLANNED OUTAGE	9/18/2024 10:14	281.87	7
PLF	PLANNED OUTAGE	9/18/2024 11:14	53.17	2
PLF	PLANNED OUTAGE	9/18/2024 14:02	387.00	27
PLF	PLANNED OUTAGE	9/18/2024 14:03	375.70	26
Transformer	PLANNED OUTAGE	9/18/2024 12:04	72.43	2
None	PLANNED OUTAGE	9/18/2024 16:29	1,759.45	21
None	PLANNED OUTAGE	9/18/2024 15:54	50.17	2
None	PLANNED OUTAGE	9/18/2024 15:54	25.08	1
None	PLANNED OUTAGE	9/18/2024 15:54	25.08	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
None	PLANNED OUTAGE	9/18/2024 15:54	25.08	1
None	PLANNED OUTAGE	9/18/2024 15:54	25.08	1
None	PLANNED OUTAGE	9/18/2024 15:54	25.08	1
None	PLANNED OUTAGE	9/18/2024 15:54	25.08	1
None	PLANNED OUTAGE	9/18/2024 15:54	25.08	1
PLF	PLANNED OUTAGE	9/19/2024 10:56	109.43	2
Primary Wire	PLANNED OUTAGE	9/19/2024 9:41	6,456.87	23
Transformer	PLANNED OUTAGE	9/19/2024 11:54	142.82	11
PLF	PLANNED OUTAGE	9/19/2024 9:30	10,591.97	26
Transformer	PLANNED OUTAGE	9/19/2024 17:11	26.87	1
Transformer	PLANNED OUTAGE	9/19/2024 13:39	202.85	3
PLF	PLANNED OUTAGE	9/20/2024 8:57	377.60	2
None	PLANNED OUTAGE	9/20/2024 14:08	349.00	4
Primary Wire	PLANNED OUTAGE	9/20/2024 14:10	363.43	2
Transformer	PLANNED OUTAGE	9/21/2024 6:12	72.60	3
Breaker	PLANNED OUTAGE	9/21/2024 18:12	22,806.80	1702
Breaker	PLANNED OUTAGE	9/21/2024 18:12	13.40	1
Breaker	PLANNED OUTAGE	9/21/2024 18:12	13.40	1
Breaker	PLANNED OUTAGE	9/21/2024 18:12	13.40	1
Primary Wire	PLANNED OUTAGE	9/22/2024 19:20	260.45	3
Transformer	PLANNED OUTAGE	9/23/2024 1:48	70.13	2
Breaker	PLANNED OUTAGE	9/23/2024 10:54	5.42	1
Transformer Bank	PLANNED OUTAGE	9/23/2024 9:03	114.87	1
Transformer	PLANNED OUTAGE	9/23/2024 12:26	298.25	3
Transformer	PLANNED OUTAGE	9/23/2024 12:43	14.68	1
PLF	PLANNED OUTAGE	8/30/2024 12:39	151.00	151
Transformer	PLANNED OUTAGE	8/31/2024 4:30	124.13	8
None	PLANNED OUTAGE	8/31/2024 13:41	594.00	8
Transformer	PLANNED OUTAGE	8/31/2024 16:13	165.10	13
Transformer	PLANNED OUTAGE	9/01/2024 14:08	134.00	8
Transformer	PLANNED OUTAGE	9/01/2024 14:18	61.28	1
Transformer Bank	PLANNED OUTAGE	9/01/2024 16:20	90.83	2
Transformer	PLANNED OUTAGE	9/01/2024 13:17	77.35	3
Transformer	PLANNED OUTAGE	9/02/2024 23:25	74.40	9
Service point	PLANNED OUTAGE	9/03/2024 0:24	34.85	1
PLF	PLANNED OUTAGE	9/01/2024 17:49	8,768.40	12
PLF	PLANNED OUTAGE	9/03/2024 9:11	372.30	6
None	PLANNED OUTAGE	9/03/2024 9:36	802.40	12
Transformer	PLANNED OUTAGE	9/03/2024 7:49	2,885.60	6
Transformer	PLANNED OUTAGE	9/03/2024 9:34	1,185.20	6
Primary Wire	PLANNED OUTAGE	9/03/2024 14:35	285.20	8

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	9/03/2024 13:23	294.83	5
Transformer	PLANNED OUTAGE	9/03/2024 23:04	2.60	1
PLF	PLANNED OUTAGE	9/03/2024 22:52	244.72	1
None	PLANNED OUTAGE	9/04/2024 8:59	73.82	1
None	PLANNED OUTAGE	9/04/2024 8:39	151.57	1
Transformer	PLANNED OUTAGE	9/04/2024 8:33	224.62	1
Transformer Bank	PLANNED OUTAGE	9/04/2024 11:57	88.23	2
Transformer	PLANNED OUTAGE	9/04/2024 17:57	110.00	1
PLF	PLANNED OUTAGE	9/04/2024 20:57	118.15	3
PLF	PLANNED OUTAGE	9/05/2024 8:35	241.80	6
Transformer	PLANNED OUTAGE	9/05/2024 10:15	343.33	2
Transformer	PLANNED OUTAGE	9/05/2024 16:48	39.40	4
Transformer Bank	PLANNED OUTAGE	9/05/2024 12:57	128.50	1
PLF	PLANNED OUTAGE	9/05/2024 15:40	18.88	1
None	PLANNED OUTAGE	9/05/2024 18:04	318.13	4
Switch	PLANNED OUTAGE	9/05/2024 20:08	64.85	1
Switch	PLANNED OUTAGE	9/05/2024 20:08	68.43	1
Transformer	PLANNED OUTAGE	9/24/2024 16:09	720.00	15
Transformer	PLANNED OUTAGE	9/24/2024 9:08	370.03	1
Transformer	PLANNED OUTAGE	9/24/2024 17:01	707.20	13
Transformer	PLANNED OUTAGE	9/25/2024 2:48	318.00	12
Transformer	PLANNED OUTAGE	9/25/2024 3:34	144.40	8
Breaker	PLANNED OUTAGE	9/25/2024 12:20	3.22	1
Breaker	PLANNED OUTAGE	9/25/2024 12:20	3.22	1
Transformer	PLANNED OUTAGE	9/25/2024 16:31	153.47	2
Transformer	PLANNED OUTAGE	9/25/2024 11:06	1,613.40	2
Transformer	PLANNED OUTAGE	9/23/2024 18:03	124.75	5
Transformer	PLANNED OUTAGE	9/23/2024 20:46	158.13	8
Transformer	PLANNED OUTAGE	9/23/2024 15:34	229.37	1
Transformer	PLANNED OUTAGE	9/24/2024 0:51	136.67	8
None	PLANNED OUTAGE	9/24/2024 9:23	1,309.00	14
PLF	PLANNED OUTAGE	9/24/2024 9:27	289.68	1
PLF	PLANNED OUTAGE	9/24/2024 14:41	12.03	1
PLF	PLANNED OUTAGE	9/24/2024 15:45	16.48	1
PLF	PLANNED OUTAGE	9/24/2024 20:00	71.60	1
Transformer	PLANNED OUTAGE	9/24/2024 22:58	299.57	11
None	PLANNED OUTAGE	9/25/2024 9:26	190.93	16
Transformer	PLANNED OUTAGE	9/25/2024 9:41	310.67	8
Transformer	PLANNED OUTAGE	9/25/2024 12:40	35.70	7
Transformer	PLANNED OUTAGE	9/25/2024 12:04	2.10	1
Switch	PLANNED OUTAGE	9/05/2024 20:07	270.93	4

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Breaker	PLANNED OUTAGE	9/06/2024 10:43	6.38	1
Breaker	PLANNED OUTAGE	9/06/2024 10:43	6.67	1
Breaker	PLANNED OUTAGE	9/06/2024 10:43	6.63	1
Breaker	PLANNED OUTAGE	9/06/2024 10:43	5.95	1
Transformer	PLANNED OUTAGE	9/06/2024 9:52	118.20	2
Transformer	PLANNED OUTAGE	9/07/2024 0:25	655.75	5
PLF	PLANNED OUTAGE	9/07/2024 16:53	474.87	17
Breaker	PLANNED OUTAGE	9/07/2024 17:28	11,300.25	1235
Breaker	PLANNED OUTAGE	9/07/2024 17:28	8.82	1
Breaker	PLANNED OUTAGE	9/07/2024 17:28	9.62	1
Breaker	PLANNED OUTAGE	9/07/2024 17:28	9.32	1
Breaker	PLANNED OUTAGE	9/07/2024 17:32	5.42	1
Breaker	PLANNED OUTAGE	9/07/2024 17:31	6.33	1
PLF	PLANNED OUTAGE	9/07/2024 22:12	455.60	24
None	PLANNED OUTAGE	9/08/2024 17:57	4,740.45	51
Transformer	PLANNED OUTAGE	9/07/2024 22:27	3,961.10	11
Breaker	PLANNED OUTAGE	9/06/2024 17:08	9.13	1
None	PLANNED OUTAGE	9/08/2024 7:43	587.10	2
Breaker	PLANNED OUTAGE	9/06/2024 17:08	8.65	1
Breaker	PLANNED OUTAGE	9/06/2024 17:07	10.77	1
Transformer	PLANNED OUTAGE	9/09/2024 8:01	772.13	8
Transformer	PLANNED OUTAGE	9/09/2024 10:26	1,864.00	10
Breaker	PLANNED OUTAGE	9/09/2024 19:55	8,765.42	965
Breaker	PLANNED OUTAGE	9/09/2024 19:55	9.20	1
Invalid	PLANNED OUTAGE	9/09/2024 19:10	930.23	11
Transformer	PLANNED OUTAGE	9/10/2024 9:13	1,645.37	13
Transformer	PLANNED OUTAGE	9/10/2024 10:39	670.90	6
Transformer	PLANNED OUTAGE	9/10/2024 13:09	310.50	9
Transformer	PLANNED OUTAGE	9/10/2024 19:05	45.50	7
Transformer	PLANNED OUTAGE	9/11/2024 0:35	48.80	2
Transformer	PLANNED OUTAGE	9/11/2024 9:48	92.07	4
Transformer	PLANNED OUTAGE	9/11/2024 10:23	333.30	3
Transformer	PLANNED OUTAGE	9/11/2024 16:49	737.22	7
Transformer	PLANNED OUTAGE	9/11/2024 19:22	427.15	3
Transformer	PLANNED OUTAGE	9/11/2024 17:26	2,035.37	7
Breaker	PLANNED OUTAGE	9/12/2024 10:15	4.27	1
Transformer	PLANNED OUTAGE	9/12/2024 9:16	228.27	16
Transformer	PLANNED OUTAGE	9/12/2024 12:13	647.07	8
Transformer	PLANNED OUTAGE	9/12/2024 17:51	772.00	5
Transformer	PLANNED OUTAGE	9/13/2024 9:29	806.55	9
Primary Wire	PLANNED OUTAGE	9/13/2024 8:17	6,173.65	21

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	9/14/2024 1:16	55.65	9
None	PLANNED OUTAGE	9/14/2024 13:43	12.95	1
Transformer	PLANNED OUTAGE	9/14/2024 13:56	135.13	4
PLF	PLANNED OUTAGE	9/15/2024 7:22	297.00	1
Transformer	PLANNED OUTAGE	9/15/2024 15:57	59.20	2
Transformer	PLANNED OUTAGE	9/15/2024 23:53	92.42	5
Transformer	PLANNED OUTAGE	9/16/2024 0:12	230.07	17
Transformer	PLANNED OUTAGE	9/16/2024 11:01	48.90	9
Breaker	PLANNED OUTAGE	9/16/2024 13:22	5,646.67	560
Breaker	PLANNED OUTAGE	9/16/2024 13:22	10.08	1
Transformer	PLANNED OUTAGE	9/16/2024 10:03	604.73	2
Transformer	PLANNED OUTAGE	9/16/2024 12:41	1,009.98	11
Transformer	PLANNED OUTAGE	9/16/2024 19:39	657.62	11
Transformer	PLANNED OUTAGE	9/16/2024 15:58	107.47	8
Transformer	PLANNED OUTAGE	9/17/2024 0:12	89.10	6
Switch	PLANNED OUTAGE	9/17/2024 1:18	2,564.90	13
Transformer	PLANNED OUTAGE	9/17/2024 0:38	1,111.87	4
Breaker	PLANNED OUTAGE	9/17/2024 9:36	11.72	1
Breaker	PLANNED OUTAGE	9/17/2024 9:36	10.97	1
PLF	PLANNED OUTAGE	9/17/2024 8:17	191.27	2
None	PLANNED OUTAGE	9/17/2024 11:51	882.55	19
Transformer	PLANNED OUTAGE	9/17/2024 12:01	313.20	3
Transformer	PLANNED OUTAGE	9/17/2024 15:12	39.33	2
Switch	PLANNED OUTAGE	9/17/2024 9:54	30,088.80	108
Transformer	PLANNED OUTAGE	9/17/2024 23:19	778.40	8
Primary Wire	PLANNED OUTAGE	9/17/2024 21:10	1,368.33	4
Primary Wire	PLANNED OUTAGE	9/17/2024 8:53	2,780.00	16
PLF	PLANNED OUTAGE	9/18/2024 9:16	9,060.80	112
PLF	PLANNED OUTAGE	9/18/2024 11:48	814.50	30
Transformer	PLANNED OUTAGE	9/18/2024 9:51	284.40	1
Transformer	PLANNED OUTAGE	9/18/2024 15:06	119.33	5
None	PLANNED OUTAGE	9/18/2024 15:54	3,185.58	127
PLF	PLANNED OUTAGE	9/19/2024 9:54	577.00	3
Transformer	PLANNED OUTAGE	9/19/2024 9:37	543.47	4
Transformer	PLANNED OUTAGE	9/19/2024 14:57	38.40	8
Transformer	PLANNED OUTAGE	9/19/2024 19:00	79.57	1
None	PLANNED OUTAGE	9/19/2024 18:44	1,202.13	8
Transformer	PLANNED OUTAGE	9/19/2024 23:58	338.17	10
Transformer	PLANNED OUTAGE	9/20/2024 1:37	276.97	7
Transformer	PLANNED OUTAGE	9/20/2024 8:56	1,196.07	7
Transformer	PLANNED OUTAGE	9/20/2024 13:56	959.20	11

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	9/20/2024 21:51	54.25	15
Invalid	PLANNED OUTAGE	9/20/2024 18:20	182.18	1
Transformer	PLANNED OUTAGE	9/21/2024 9:13	1,224.67	10
Transformer	PLANNED OUTAGE	9/21/2024 13:38	109.20	4
Switch	PLANNED OUTAGE	9/21/2024 15:56	14,162.67	113
Breaker	PLANNED OUTAGE	9/21/2024 18:12	13.40	1
Transformer	PLANNED OUTAGE	9/22/2024 15:21	28.93	1
Transformer	PLANNED OUTAGE	9/22/2024 18:11	56.40	3
Transformer	PLANNED OUTAGE	9/22/2024 23:39	100.53	8
Transformer	PLANNED OUTAGE	9/21/2024 7:22	636.37	1
Breaker	PLANNED OUTAGE	9/23/2024 10:54	4.87	1
Transformer	PLANNED OUTAGE	9/23/2024 10:45	104.37	1
Transformer	PLANNED OUTAGE	9/23/2024 20:59	180.92	5
Transformer	PLANNED OUTAGE	9/24/2024 10:01	51.13	4
PLF	PLANNED OUTAGE	9/24/2024 8:24	281.30	1
Transformer	PLANNED OUTAGE	9/24/2024 14:03	46.77	2
Transformer	PLANNED OUTAGE	9/24/2024 15:18	79.22	1
PLF	PLANNED OUTAGE	9/24/2024 14:12	162.97	2
Transformer	PLANNED OUTAGE	9/25/2024 14:52	382.33	5
Transformer	PLANNED OUTAGE	9/25/2024 12:07	58.30	1
Breaker	PLANNED OUTAGE	9/25/2024 12:20	3.22	1
Breaker	PLANNED OUTAGE	9/25/2024 12:20	3.22	1
None	PLANNED OUTAGE	10/01/2024 6:12	4.87	2
Service point	PLANNED OUTAGE	10/01/2024 11:35	184.70	1
Transformer	PLANNED OUTAGE	10/01/2024 8:22	308.25	9
None	PLANNED OUTAGE	10/01/2024 9:19	4,038.80	23
PLF	PLANNED OUTAGE	10/01/2024 11:45	388.80	8
Transformer	PLANNED OUTAGE	10/02/2024 2:58	294.12	7
Transformer	PLANNED OUTAGE	10/02/2024 5:06	10.58	5
Transformer	PLANNED OUTAGE	10/01/2024 9:49	725.32	1
Transformer	PLANNED OUTAGE	10/02/2024 9:25	188.13	8
Transformer	PLANNED OUTAGE	10/02/2024 10:24	1,158.67	8
None	PLANNED OUTAGE	10/02/2024 23:01	682.17	5
Transformer	PLANNED OUTAGE	10/02/2024 14:22	1,852.92	5
PLF	PLANNED OUTAGE	10/03/2024 10:12	1,848.00	66
None	PLANNED OUTAGE	10/03/2024 12:29	862.05	9
Transformer	PLANNED OUTAGE	10/03/2024 13:32	326.83	10
None	PLANNED OUTAGE	10/03/2024 13:39	170.52	1
PLF	PLANNED OUTAGE	10/03/2024 23:27	280.52	1
Transformer	PLANNED OUTAGE	10/04/2024 3:31	442.00	12
PLF	PLANNED OUTAGE	10/04/2024 9:58	197.73	2

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	10/04/2024 12:26	521.83	5
Transformer	PLANNED OUTAGE	10/04/2024 9:39	6,229.58	25
Transformer	PLANNED OUTAGE	10/04/2024 12:38	1,630.52	19
Transformer	PLANNED OUTAGE	10/04/2024 20:43	148.13	4
Transformer	PLANNED OUTAGE	10/05/2024 12:27	132.77	7
Transformer	PLANNED OUTAGE	10/05/2024 13:26	5,759.75	15
None	PLANNED OUTAGE	10/05/2024 22:37	80.13	2
Transformer	PLANNED OUTAGE	10/05/2024 21:54	812.73	4
PLF	PLANNED OUTAGE	10/06/2024 14:56	2,592.80	6
PLF	PLANNED OUTAGE	10/06/2024 16:09	92.47	2
Breaker	PLANNED OUTAGE	10/06/2024 20:19	1,759.87	788
Breaker	PLANNED OUTAGE	10/06/2024 20:19	2.23	1
Transformer	PLANNED OUTAGE	10/06/2024 21:51	425.60	7
Switch	PLANNED OUTAGE	10/04/2024 20:08	4,268.33	260
Transformer	PLANNED OUTAGE	10/07/2024 9:38	73.07	2
Breaker	PLANNED OUTAGE	10/07/2024 13:39	46.85	1
Breaker	PLANNED OUTAGE	10/07/2024 13:39	46.85	1
Breaker	PLANNED OUTAGE	10/07/2024 16:23	3.00	1
Breaker	PLANNED OUTAGE	10/07/2024 16:30	6.22	1
Breaker	PLANNED OUTAGE	10/07/2024 16:30	6.45	1
Breaker	PLANNED OUTAGE	10/07/2024 16:30	6.88	1
Breaker	PLANNED OUTAGE	10/07/2024 16:30	6.23	1
Transformer	PLANNED OUTAGE	10/07/2024 18:23	85.93	4
Transformer	PLANNED OUTAGE	10/08/2024 8:51	1,347.53	17
None	PLANNED OUTAGE	10/08/2024 15:33	5,331.40	69
Transformer	PLANNED OUTAGE	10/08/2024 17:12	467.47	8
PLF	PLANNED OUTAGE	10/09/2024 5:17	33.77	2
Transformer	PLANNED OUTAGE	10/08/2024 13:07	328.20	9
None	PLANNED OUTAGE	10/01/2024 8:18	208.35	27
PLF	PLANNED OUTAGE	10/01/2024 9:41	39.35	1
Transformer	PLANNED OUTAGE	10/01/2024 8:26	1,293.42	11
PLF	PLANNED OUTAGE	10/01/2024 11:35	670.08	55
Transformer	PLANNED OUTAGE	10/01/2024 13:21	422.80	7
Service point	PLANNED OUTAGE	10/01/2024 14:57	52.85	1
Transformer	PLANNED OUTAGE	10/01/2024 17:18	48.67	5
PLF	PLANNED OUTAGE	10/01/2024 16:44	533.27	19
Service point	PLANNED OUTAGE	10/01/2024 16:49	174.12	1
PLF	PLANNED OUTAGE	10/01/2024 17:18	1,642.90	6
Transformer	PLANNED OUTAGE	10/02/2024 3:12	51.17	10
Transformer Bank	PLANNED OUTAGE	10/02/2024 8:49	173.63	1
Transformer Bank	PLANNED OUTAGE	10/02/2024 7:31	1,269.22	7

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
None	PLANNED OUTAGE	10/02/2024 12:36	519.07	17
Transformer	PLANNED OUTAGE	10/02/2024 11:38	2,136.90	6
Transformer	PLANNED OUTAGE	10/02/2024 13:49	595.25	3
Transformer Bank	PLANNED OUTAGE	10/02/2024 12:16	241.90	1
Transformer	PLANNED OUTAGE	10/02/2024 20:02	51.25	5
PLF	PLANNED OUTAGE	10/03/2024 9:22	50.83	1
PLF	PLANNED OUTAGE	10/03/2024 10:06	32.35	1
None	PLANNED OUTAGE	10/03/2024 12:29	287.35	3
None	PLANNED OUTAGE	10/03/2024 12:56	230.20	6
Breaker	PLANNED OUTAGE	10/09/2024 8:37	4.80	1
Switch	PLANNED OUTAGE	10/03/2024 10:04	119.22	1
Transformer	PLANNED OUTAGE	10/03/2024 11:30	232.55	3
PLF	PLANNED OUTAGE	10/03/2024 12:19	1,297.68	7
PLF	PLANNED OUTAGE	10/03/2024 17:23	173.67	1
Transformer	PLANNED OUTAGE	10/04/2024 10:48	878.53	8
PLF	PLANNED OUTAGE	10/04/2024 12:59	114.03	11
Transformer	PLANNED OUTAGE	10/04/2024 13:04	64.80	6
Service - Crew	PLANNED OUTAGE	10/04/2024 12:11	207.98	1
Transformer	PLANNED OUTAGE	10/05/2024 1:46	436.80	8
None	PLANNED OUTAGE	10/05/2024 22:37	280.35	7
Transformer	PLANNED OUTAGE	10/05/2024 15:29	152.30	6
Transformer	PLANNED OUTAGE	10/06/2024 0:32	150.47	4
PLF	PLANNED OUTAGE	10/06/2024 17:32	16.28	1
Transformer	PLANNED OUTAGE	10/06/2024 14:42	389.83	5
Breaker	PLANNED OUTAGE	10/06/2024 20:19	2.23	1
PLF	PLANNED OUTAGE	10/07/2024 8:12	1,899.33	55
Breaker	PLANNED OUTAGE	10/07/2024 13:39	42.88	1
Breaker	PLANNED OUTAGE	10/07/2024 13:39	42.88	1
Breaker	PLANNED OUTAGE	10/07/2024 13:39	42.88	1
Breaker	PLANNED OUTAGE	10/07/2024 13:39	42.48	1
PLF	PLANNED OUTAGE	10/07/2024 13:37	31.75	3
Transformer	PLANNED OUTAGE	10/07/2024 16:25	121.60	3
Breaker	PLANNED OUTAGE	10/07/2024 16:09	6.68	1
Breaker	PLANNED OUTAGE	10/07/2024 16:09	10,207.00	1770
Breaker	PLANNED OUTAGE	10/07/2024 16:30	6.53	1
Breaker	PLANNED OUTAGE	10/07/2024 16:30	6.62	1
Breaker	PLANNED OUTAGE	10/07/2024 12:01	276.15	1
Breaker	PLANNED OUTAGE	10/07/2024 16:30	6.80	1
Transformer	PLANNED OUTAGE	10/08/2024 1:50	77.70	6
Breaker	PLANNED OUTAGE	10/09/2024 4:35	9.90	2
Breaker	PLANNED OUTAGE	10/09/2024 4:35	1,904.40	414

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Breaker	PLANNED OUTAGE	10/09/2024 8:37	4.85	1
PLF	PLANNED OUTAGE	10/09/2024 9:18	421.80	3
Invalid	PLANNED OUTAGE	10/01/2024 10:11	735.67	10
OH Other	PLANNED OUTAGE	10/01/2024 17:56	229.70	1
Transformer	PLANNED OUTAGE	10/01/2024 20:07	208.27	8
PLF	PLANNED OUTAGE	10/01/2024 14:01	7,792.33	10
Transformer	PLANNED OUTAGE	10/02/2024 10:21	144.50	3
PLF	PLANNED OUTAGE	10/02/2024 10:48	31.03	1
PLF	PLANNED OUTAGE	10/02/2024 10:09	379.80	2
Transformer	PLANNED OUTAGE	10/02/2024 10:06	802.67	4
Transformer	PLANNED OUTAGE	10/02/2024 20:55	330.67	4
Invalid	PLANNED OUTAGE	10/02/2024 19:16	3,932.53	16
None	PLANNED OUTAGE	10/03/2024 0:19	195.80	4
Transformer	PLANNED OUTAGE	10/03/2024 2:40	818.50	6
Transformer	PLANNED OUTAGE	10/03/2024 8:45	8,242.50	25
PLF	PLANNED OUTAGE	10/03/2024 12:12	260.87	13
Transformer	PLANNED OUTAGE	10/03/2024 16:32	496.30	14
Transformer Bank	PLANNED OUTAGE	10/03/2024 11:25	216.00	1
None	PLANNED OUTAGE	10/03/2024 13:49	515.87	8
PLF	PLANNED OUTAGE	10/03/2024 22:50	255.93	1
Transformer	PLANNED OUTAGE	10/04/2024 3:17	66.40	3
Transformer	PLANNED OUTAGE	10/04/2024 8:55	239.40	7
Transformer	PLANNED OUTAGE	10/04/2024 9:15	160.00	1
Transformer	PLANNED OUTAGE	10/04/2024 9:20	467.08	25
Transformer	PLANNED OUTAGE	10/04/2024 13:31	50.13	8
Transformer	PLANNED OUTAGE	10/04/2024 8:31	3,239.55	9
Transformer	PLANNED OUTAGE	10/04/2024 10:38	997.68	31
PLF	PLANNED OUTAGE	10/04/2024 8:41	1,097.27	4
Transformer	PLANNED OUTAGE	10/04/2024 16:52	53.20	3
Transformer	PLANNED OUTAGE	10/04/2024 17:31	90.80	8
Transformer	PLANNED OUTAGE	10/05/2024 3:00	323.77	11
None	PLANNED OUTAGE	10/05/2024 16:07	89.30	2
None	PLANNED OUTAGE	10/05/2024 11:26	2,606.53	8
Transformer Bank	PLANNED OUTAGE	10/05/2024 22:39	848.47	4
None	PLANNED OUTAGE	10/06/2024 9:04	1,012.67	35
Transformer	PLANNED OUTAGE	10/06/2024 17:41	24.63	1
Transformer	PLANNED OUTAGE	10/06/2024 23:48	488.02	7
Breaker	PLANNED OUTAGE	10/07/2024 16:30	12,703.33	1850
Breaker	PLANNED OUTAGE	10/07/2024 16:30	6.80	1
Breaker	PLANNED OUTAGE	10/07/2024 16:30	6.92	1
Breaker	PLANNED OUTAGE	10/07/2024 16:30	6.03	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Breaker	PLANNED OUTAGE	10/07/2024 16:30	6.38	1
Breaker	PLANNED OUTAGE	10/07/2024 16:30	6.48	1
Transformer	PLANNED OUTAGE	10/07/2024 16:45	113.07	8
Transformer	PLANNED OUTAGE	10/07/2024 18:20	560.00	25
Transformer	PLANNED OUTAGE	10/08/2024 3:46	32.33	4
Transformer	PLANNED OUTAGE	10/07/2024 0:22	2,587.05	9
None	PLANNED OUTAGE	10/01/2024 2:19	529.43	14
Transformer	PLANNED OUTAGE	10/01/2024 8:56	1,102.83	5
None	PLANNED OUTAGE	10/01/2024 9:39	87.40	2
Transformer	PLANNED OUTAGE	10/01/2024 8:24	218.90	6
PLF	PLANNED OUTAGE	10/01/2024 12:06	110.18	11
PLF	PLANNED OUTAGE	10/01/2024 12:47	99.23	1
Primary Wire	PLANNED OUTAGE	10/01/2024 16:06	5.78	1
Service point	PLANNED OUTAGE	10/01/2024 23:23	22.68	1
Transformer	PLANNED OUTAGE	10/01/2024 12:05	1,296.00	10
Transformer	PLANNED OUTAGE	10/01/2024 14:58	2,045.33	2
Transformer	PLANNED OUTAGE	10/02/2024 11:49	64.03	1
Transformer	PLANNED OUTAGE	10/02/2024 12:08	181.67	2
Transformer	PLANNED OUTAGE	10/02/2024 14:41	25.10	2
None	PLANNED OUTAGE	10/02/2024 15:41	790.50	18
Transformer	PLANNED OUTAGE	10/02/2024 15:03	627.90	3
PLF	PLANNED OUTAGE	10/02/2024 20:28	20.85	1
Transformer	PLANNED OUTAGE	10/02/2024 19:07	387.22	7
Service point	PLANNED OUTAGE	10/02/2024 23:01	136.15	1
Transformer	PLANNED OUTAGE	10/02/2024 8:29	3,938.90	3
Transformer	PLANNED OUTAGE	10/03/2024 11:35	68.80	12
PLF	PLANNED OUTAGE	10/03/2024 10:44	66.78	1
None	PLANNED OUTAGE	10/03/2024 13:39	52,178.10	306
Transformer	PLANNED OUTAGE	10/04/2024 1:04	105.08	13
Transformer	PLANNED OUTAGE	10/04/2024 9:43	427.65	9
Transformer	PLANNED OUTAGE	10/04/2024 12:28	141.80	6
None	PLANNED OUTAGE	10/05/2024 11:26	15.23	2
Transformer	PLANNED OUTAGE	10/05/2024 21:50	218.93	4
PLF	PLANNED OUTAGE	10/06/2024 13:34	23.63	2
PLF	PLANNED OUTAGE	10/06/2024 9:54	1,985.80	6
Breaker	PLANNED OUTAGE	10/06/2024 20:19	2.23	1
Transformer	PLANNED OUTAGE	10/06/2024 23:57	321.18	7
Primary Wire	PLANNED OUTAGE	10/06/2024 19:24	4,363.25	15
Transformer Bank	PLANNED OUTAGE	10/07/2024 5:11	95.60	6
Transformer	PLANNED OUTAGE	10/04/2024 11:33	12,780.53	16
PLF	PLANNED OUTAGE	10/05/2024 1:11	715.45	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	10/07/2024 8:22	303.75	5
Breaker	PLANNED OUTAGE	10/07/2024 13:39	42,210.00	1005
Breaker	PLANNED OUTAGE	10/07/2024 13:39	46.85	1
Breaker	PLANNED OUTAGE	10/07/2024 13:39	46.85	1
Breaker	PLANNED OUTAGE	10/07/2024 16:09	6.68	1
Breaker	PLANNED OUTAGE	10/07/2024 16:23	6,460.50	1770
Breaker	PLANNED OUTAGE	10/07/2024 16:23	2.97	1
Breaker	PLANNED OUTAGE	10/07/2024 16:30	6.13	1
Breaker	PLANNED OUTAGE	10/07/2024 16:30	6.33	1
Breaker	PLANNED OUTAGE	10/07/2024 12:01	275.60	1
Breaker	PLANNED OUTAGE	10/07/2024 16:30	6.32	1
Transformer	PLANNED OUTAGE	10/07/2024 19:53	203.42	5
None	PLANNED OUTAGE	10/08/2024 9:41	225.60	9
Transformer	PLANNED OUTAGE	10/08/2024 10:55	432.27	8
Transformer	PLANNED OUTAGE	10/08/2024 12:41	145.97	2
Transformer	PLANNED OUTAGE	10/09/2024 1:50	106.70	6
Breaker	PLANNED OUTAGE	10/09/2024 8:37	3,126.25	1025
Breaker	PLANNED OUTAGE	10/09/2024 8:37	4.85	1
Breaker	PLANNED OUTAGE	10/19/2024 22:23	26.50	1
Breaker	PLANNED OUTAGE	10/19/2024 22:23	26.50	1
None	PLANNED OUTAGE	10/19/2024 0:23	867.35	11
None	PLANNED OUTAGE	10/19/2024 3:30	249.90	7
Transformer	PLANNED OUTAGE	10/19/2024 15:59	795.78	7
PLF	PLANNED OUTAGE	10/19/2024 15:59	163.23	2
Breaker	PLANNED OUTAGE	10/19/2024 11:05	335,865.83	2575
Breaker	PLANNED OUTAGE	10/19/2024 11:05	139.00	1
Invalid	PLANNED OUTAGE	10/19/2024 15:36	20,826.83	29
Transformer	PLANNED OUTAGE	10/20/2024 14:52	35.33	8
Transformer	PLANNED OUTAGE	10/20/2024 16:53	336.50	15
None	PLANNED OUTAGE	10/20/2024 10:33	772.85	13
None	PLANNED OUTAGE	10/20/2024 10:30	63.37	1
None	PLANNED OUTAGE	10/20/2024 10:31	62.05	1
None	PLANNED OUTAGE	10/20/2024 10:30	126.93	2
None	PLANNED OUTAGE	10/20/2024 10:30	63.52	1
None	PLANNED OUTAGE	10/20/2024 10:29	40.62	1
None	PLANNED OUTAGE	10/20/2024 10:30	126.77	2
Transformer	PLANNED OUTAGE	10/20/2024 16:01	156.10	7
TX Repaired (OH)	PLANNED OUTAGE	10/19/2024 10:55	265.35	1
None	PLANNED OUTAGE	10/19/2024 10:42	2,492.10	78
Breaker	PLANNED OUTAGE	10/19/2024 22:23	35,260.33	1339
Breaker	PLANNED OUTAGE	10/19/2024 22:23	7.43	2

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	10/19/2024 14:59	211.60	6
Transformer	PLANNED OUTAGE	10/19/2024 16:57	344.63	7
PLF	PLANNED OUTAGE	10/19/2024 15:59	163.37	2
Transformer	PLANNED OUTAGE	10/19/2024 17:31	53.10	3
None	PLANNED OUTAGE	10/19/2024 9:58	154.40	16
Transformer	PLANNED OUTAGE	10/19/2024 13:18	631.67	10
Breaker	PLANNED OUTAGE	10/19/2024 11:05	139.33	1
Breaker	PLANNED OUTAGE	10/19/2024 11:05	139.52	1
None	PLANNED OUTAGE	10/20/2024 4:33	334,810.70	854
Transformer	PLANNED OUTAGE	10/20/2024 8:52	344.83	10
None	PLANNED OUTAGE	10/20/2024 10:33	8,145.00	135
None	PLANNED OUTAGE	10/20/2024 10:33	303.08	5
None	PLANNED OUTAGE	10/20/2024 10:33	5,260.60	87
None	PLANNED OUTAGE	10/20/2024 10:30	62.92	1
None	PLANNED OUTAGE	10/20/2024 10:31	61.57	1
None	PLANNED OUTAGE	10/20/2024 10:30	62.85	1
None	PLANNED OUTAGE	10/20/2024 10:31	1,114.80	18
Transformer	PLANNED OUTAGE	10/20/2024 23:04	220.97	7
Transformer	PLANNED OUTAGE	10/20/2024 10:43	206.60	6
Invalid	PLANNED OUTAGE	10/20/2024 15:45	2,345.00	201
None	PLANNED OUTAGE	10/21/2024 16:02	15,388.45	1617
None	PLANNED OUTAGE	10/21/2024 16:02	9.93	1
None	PLANNED OUTAGE	10/21/2024 16:02	9.93	1
None	PLANNED OUTAGE	10/21/2024 16:02	9.93	1
Transformer	PLANNED OUTAGE	10/20/2024 17:57	64.30	6
None	PLANNED OUTAGE	10/20/2024 10:27	416.80	12
PLF	PLANNED OUTAGE	10/20/2024 14:11	2,107.15	37
Transformer	PLANNED OUTAGE	10/20/2024 13:16	80.60	6
PLF	PLANNED OUTAGE	10/20/2024 1:48	5,518.00	310
Transformer Bank	PLANNED OUTAGE	10/20/2024 3:32	2,808.35	3
PLF	PLANNED OUTAGE	10/21/2024 0:57	4,008.90	46
None	PLANNED OUTAGE	10/21/2024 16:02	9.93	1
None	PLANNED OUTAGE	10/21/2024 18:10	334.73	4
Transformer Bank	PLANNED OUTAGE	10/22/2024 9:19	105.85	1
Transformer	PLANNED OUTAGE	10/22/2024 14:30	165.73	4
Breaker	PLANNED OUTAGE	10/22/2024 15:55	71.00	10
Transformer	PLANNED OUTAGE	10/22/2024 8:32	109.07	8
Switchgear	PLANNED OUTAGE	10/22/2024 15:29	191.70	9
PLF	PLANNED OUTAGE	10/22/2024 20:20	208.20	12
Transformer	PLANNED OUTAGE	10/23/2024 2:03	728.20	11
Breaker	PLANNED OUTAGE	10/23/2024 7:40	2,786.30	298

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	10/23/2024 8:11	251.80	3
Transformer Bank	PLANNED OUTAGE	10/22/2024 16:20	86.25	5
Transformer	PLANNED OUTAGE	10/22/2024 14:32	2,044.50	9
PLF	PLANNED OUTAGE	10/23/2024 13:00	263.25	1
PLF	PLANNED OUTAGE	10/23/2024 12:25	97.60	8
Primary Wire	PLANNED OUTAGE	10/23/2024 13:52	8,037.00	15
Transformer	PLANNED OUTAGE	10/23/2024 14:05	310.53	8
Transformer	PLANNED OUTAGE	10/23/2024 9:20	1,546.00	4
Transformer	PLANNED OUTAGE	10/23/2024 9:22	2,310.10	6
PLF	PLANNED OUTAGE	10/23/2024 21:00	732.47	2
Transformer	PLANNED OUTAGE	10/23/2024 20:29	68.02	7
PLF	PLANNED OUTAGE	10/24/2024 0:57	89.48	1
Breaker	PLANNED OUTAGE	10/24/2024 8:55	102.85	1
None	PLANNED OUTAGE	10/21/2024 16:02	9.93	1
Service - Crew	PLANNED OUTAGE	10/21/2024 10:35	380.58	1
Transformer	PLANNED OUTAGE	10/22/2024 2:08	290.67	8
Transformer	PLANNED OUTAGE	10/22/2024 13:25	181.70	6
Transformer	PLANNED OUTAGE	10/22/2024 8:03	10.90	6
PLF	PLANNED OUTAGE	10/22/2024 12:30	68.75	1
Service - Crew	PLANNED OUTAGE	10/22/2024 7:08	271.52	1
Transformer	PLANNED OUTAGE	10/22/2024 8:20	658.70	7
Transformer	PLANNED OUTAGE	10/22/2024 14:27	605.55	11
Breaker	PLANNED OUTAGE	10/23/2024 7:39	4,921.97	298
Transformer	PLANNED OUTAGE	10/23/2024 11:50	126.93	7
None	PLANNED OUTAGE	10/24/2024 1:12	257.72	7
Transformer	PLANNED OUTAGE	10/24/2024 2:46	21.87	1
Transformer	PLANNED OUTAGE	10/24/2024 3:40	385.07	8
Transformer	PLANNED OUTAGE	10/24/2024 3:42	322.12	7
Service point	PLANNED OUTAGE	10/24/2024 14:16	179.32	1
Transformer Bank	PLANNED OUTAGE	10/24/2024 20:41	157.95	9
Transformer	PLANNED OUTAGE	10/25/2024 3:31	87.30	3
Transformer	PLANNED OUTAGE	10/24/2024 16:52	1,077.00	18
Transformer	PLANNED OUTAGE	10/25/2024 4:16	400.67	10
Breaker	PLANNED OUTAGE	10/25/2024 11:44	27.37	1
Breaker	PLANNED OUTAGE	10/25/2024 11:44	39,033.50	1510
Breaker	PLANNED OUTAGE	10/25/2024 11:44	27.37	1
Service - Crew	PLANNED OUTAGE	10/25/2024 12:14	251.05	1
Transformer	PLANNED OUTAGE	10/25/2024 10:51	138.02	1
Breaker	PLANNED OUTAGE	10/25/2024 18:50	10,483.20	182
PLF	PLANNED OUTAGE	10/27/2024 1:54	97.50	6
Breaker	PLANNED OUTAGE	10/27/2024 14:24	1.18	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	10/28/2024 13:57	606.20	12
PLF	PLANNED OUTAGE	10/28/2024 13:48	88.25	3
Transformer	PLANNED OUTAGE	10/28/2024 10:24	249.63	1
Transformer	PLANNED OUTAGE	10/28/2024 9:56	2,231.00	6
Transformer	PLANNED OUTAGE	10/28/2024 9:29	812.63	2
Breaker	PLANNED OUTAGE	10/28/2024 19:33	17,356.80	1536
Breaker	PLANNED OUTAGE	10/28/2024 19:33	12.82	1
Breaker	PLANNED OUTAGE	10/28/2024 19:33	12.82	1
Breaker	PLANNED OUTAGE	10/28/2024 19:33	12.82	1
Transformer	PLANNED OUTAGE	10/29/2024 8:26	155.85	9
Transformer	PLANNED OUTAGE	10/29/2024 8:49	39.77	1
Transformer	PLANNED OUTAGE	10/29/2024 9:20	293.55	3
Transformer	PLANNED OUTAGE	10/27/2024 2:42	312.43	7
Breaker	PLANNED OUTAGE	10/27/2024 14:24	1.18	1
Breaker	PLANNED OUTAGE	10/27/2024 14:24	1.18	1
Transformer	PLANNED OUTAGE	10/28/2024 8:48	26.03	1
Transformer	PLANNED OUTAGE	10/28/2024 10:43	259.78	13
PLF	PLANNED OUTAGE	10/28/2024 11:06	807.80	21
None	PLANNED OUTAGE	10/28/2024 10:20	375.83	10
Transformer	PLANNED OUTAGE	10/28/2024 10:06	4,021.25	15
Transformer	PLANNED OUTAGE	10/28/2024 12:16	31.40	3
Transformer	PLANNED OUTAGE	10/28/2024 12:21	896.25	15
Transformer	PLANNED OUTAGE	10/28/2024 12:21	920.97	14
Breaker	PLANNED OUTAGE	10/28/2024 19:33	12.82	1
Breaker	PLANNED OUTAGE	10/28/2024 19:33	12.82	1
Breaker	PLANNED OUTAGE	10/28/2024 19:33	12.82	1
Breaker	PLANNED OUTAGE	10/28/2024 19:33	12.82	1
Transformer	PLANNED OUTAGE	10/29/2024 9:02	193.90	7
PLF	PLANNED OUTAGE	10/29/2024 12:34	270.93	64
Transformer	PLANNED OUTAGE	10/29/2024 8:48	225.07	2
Breaker	PLANNED OUTAGE	10/19/2024 22:23	26.50	1
PLF	PLANNED OUTAGE	10/19/2024 9:38	6,557.53	38
Transformer	PLANNED OUTAGE	10/19/2024 20:17	35.42	1
Transformer	PLANNED OUTAGE	10/19/2024 12:22	910.20	12
Transformer	PLANNED OUTAGE	10/29/2024 8:46	463.07	4
PLF	PLANNED OUTAGE	10/29/2024 11:34	174.02	1
Transformer	PLANNED OUTAGE	10/29/2024 12:29	1,976.25	17
Transformer	PLANNED OUTAGE	10/29/2024 13:32	348.80	6
Switch	PLANNED OUTAGE	10/29/2024 10:12	2,241.83	10
Transformer	PLANNED OUTAGE	10/29/2024 12:09	465.10	6
Transformer	PLANNED OUTAGE	10/29/2024 9:46	277.80	4

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	10/29/2024 12:23	595.13	4
PLF	PLANNED OUTAGE	10/29/2024 23:16	1,236.38	31
Breaker	PLANNED OUTAGE	10/19/2024 11:05	139.07	1
Breaker	PLANNED OUTAGE	10/19/2024 11:05	139.13	1
Breaker	PLANNED OUTAGE	10/19/2024 11:05	139.18	1
Breaker	PLANNED OUTAGE	10/19/2024 11:05	139.27	1
Service - Crew	PLANNED OUTAGE	10/19/2024 13:08	196.43	1
None	PLANNED OUTAGE	10/20/2024 10:30	444.15	7
None	PLANNED OUTAGE	10/20/2024 10:32	61.05	1
None	PLANNED OUTAGE	10/20/2024 10:31	62.03	1
None	PLANNED OUTAGE	10/20/2024 10:30	12,431.25	195
None	PLANNED OUTAGE	10/20/2024 10:30	317.67	5
None	PLANNED OUTAGE	10/20/2024 10:30	124.90	2
None	PLANNED OUTAGE	10/20/2024 10:30	63.60	1
None	PLANNED OUTAGE	10/20/2024 10:30	63.37	1
Transformer	PLANNED OUTAGE	10/20/2024 16:39	145.30	3
Transformer	PLANNED OUTAGE	10/20/2024 9:40	418.70	3
PLF	PLANNED OUTAGE	10/20/2024 12:10	698.13	22
Transformer	PLANNED OUTAGE	10/20/2024 14:02	1,188.00	8
Transformer	PLANNED OUTAGE	10/20/2024 11:51	501.90	9
Transformer	PLANNED OUTAGE	10/20/2024 3:44	323.50	2
Secondary Wire	PLANNED OUTAGE	10/20/2024 14:43	4,513.00	10
Invalid	PLANNED OUTAGE	10/20/2024 15:45	11.70	1
Invalid	PLANNED OUTAGE	10/20/2024 18:04	92.70	1
Transformer	PLANNED OUTAGE	10/21/2024 23:13	303.00	10
None	PLANNED OUTAGE	10/21/2024 13:29	626.00	15
Transformer	PLANNED OUTAGE	10/21/2024 14:21	187.30	6
Transformer	PLANNED OUTAGE	10/21/2024 16:04	630.83	10
PLF	PLANNED OUTAGE	10/21/2024 21:22	50.68	1
TX Repaired (OH)	PLANNED OUTAGE	10/21/2024 11:03	2,665.00	2
Transformer	PLANNED OUTAGE	10/22/2024 10:49	366.27	8
Service - Crew	PLANNED OUTAGE	10/22/2024 10:59	1,762.22	1
Transformer	PLANNED OUTAGE	10/22/2024 18:53	1,470.00	8
PLF	PLANNED OUTAGE	10/23/2024 13:00	263.27	1
Transformer	PLANNED OUTAGE	10/23/2024 12:22	92.27	8
Transformer	PLANNED OUTAGE	10/23/2024 12:35	201.20	8
Transformer	PLANNED OUTAGE	10/29/2024 18:04	70.80	2
Transformer	PLANNED OUTAGE	10/29/2024 21:56	234.13	8
Invalid	PLANNED OUTAGE	10/29/2024 18:51	611.37	2
Transformer	PLANNED OUTAGE	10/23/2024 9:18	2,095.10	14
PLF	PLANNED OUTAGE	10/23/2024 23:37	47.25	27

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	10/23/2024 23:48	991.73	16
Transformer Bank	PLANNED OUTAGE	10/24/2024 10:14	205.68	7
Breaker	PLANNED OUTAGE	10/24/2024 8:55	88,854.27	868
Transformer Bank	PLANNED OUTAGE	10/24/2024 14:06	175.83	5
Transformer	PLANNED OUTAGE	10/24/2024 13:11	149.00	4
None	PLANNED OUTAGE	10/24/2024 15:39	4,431.65	61
Transformer	PLANNED OUTAGE	10/24/2024 14:43	1,305.33	11
Breaker	PLANNED OUTAGE	10/25/2024 10:13	77,959.08	2131
PLF	PLANNED OUTAGE	10/19/2024 21:02	285.67	1
Breaker	PLANNED OUTAGE	10/19/2024 22:23	26.50	1
Breaker	PLANNED OUTAGE	10/19/2024 22:23	26.50	1
Transformer	PLANNED OUTAGE	10/19/2024 2:19	162.17	7
Transformer	PLANNED OUTAGE	10/19/2024 13:40	54.85	3
PLF	PLANNED OUTAGE	10/19/2024 8:14	1,284.70	3
Transformer	PLANNED OUTAGE	10/19/2024 19:53	246.13	16
PLF	PLANNED OUTAGE	10/19/2024 12:21	724.12	1
Breaker	PLANNED OUTAGE	10/19/2024 11:05	20,418.30	147
Breaker	PLANNED OUTAGE	10/19/2024 11:05	138.95	1
Service - Crew	PLANNED OUTAGE	10/19/2024 8:53	573.40	1
PLF	PLANNED OUTAGE	10/20/2024 9:24	635.40	2
None	PLANNED OUTAGE	10/20/2024 10:31	62.13	1
None	PLANNED OUTAGE	10/20/2024 10:30	63.27	1
None	PLANNED OUTAGE	10/20/2024 10:30	2,354.43	37
None	PLANNED OUTAGE	10/20/2024 10:30	63.47	1
None	PLANNED OUTAGE	10/20/2024 10:30	63.48	1
Transformer	PLANNED OUTAGE	10/25/2024 13:23	393.00	6
None	PLANNED OUTAGE	10/20/2024 10:32	61.10	1
PLF	PLANNED OUTAGE	10/20/2024 18:41	271.00	10
PLF	PLANNED OUTAGE	10/20/2024 23:00	6,013.18	17
Transformer	PLANNED OUTAGE	10/20/2024 13:13	484.93	8
PLF	PLANNED OUTAGE	10/20/2024 2:07	2,235.67	190
Invalid	PLANNED OUTAGE	10/20/2024 15:43	15.70	1
Invalid	PLANNED OUTAGE	10/20/2024 11:21	280.42	1
Service - Crew	PLANNED OUTAGE	10/21/2024 0:57	7,765.82	11
None	PLANNED OUTAGE	10/21/2024 16:02	9.93	1
Transformer	PLANNED OUTAGE	10/22/2024 14:19	532.80	4
Transformer	PLANNED OUTAGE	10/23/2024 11:46	32.43	7
Transformer	PLANNED OUTAGE	10/22/2024 8:03	3,958.80	6
PLF	PLANNED OUTAGE	10/23/2024 13:00	4,382.60	17
PLF	PLANNED OUTAGE	10/23/2024 11:36	73.03	2
Transformer Bank	PLANNED OUTAGE	10/23/2024 16:06	366.67	5

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Primary Wire	PLANNED OUTAGE	10/24/2024 1:54	83.10	3
Transformer	PLANNED OUTAGE	10/24/2024 2:18	325.65	13
Breaker	PLANNED OUTAGE	10/24/2024 8:55	102.85	1
Breaker	PLANNED OUTAGE	10/24/2024 8:55	102.70	1
Transformer	PLANNED OUTAGE	10/25/2024 15:32	317.25	9
Transformer	PLANNED OUTAGE	10/24/2024 17:19	208.13	8
Service point	PLANNED OUTAGE	10/25/2024 6:11	406.03	1
Service - Crew	PLANNED OUTAGE	10/25/2024 11:57	310.10	1
Breaker	PLANNED OUTAGE	10/25/2024 11:44	27.37	1
PLF	PLANNED OUTAGE	10/30/2024 9:45	167.47	2
Transformer	PLANNED OUTAGE	10/30/2024 8:07	1,121.20	6
Breaker	PLANNED OUTAGE	10/25/2024 18:50	62.37	1
PLF	PLANNED OUTAGE	10/26/2024 9:23	848.47	52
Transformer	PLANNED OUTAGE	10/28/2024 8:38	1,297.47	8
Transformer	PLANNED OUTAGE	10/28/2024 11:58	61.78	1
PLF	PLANNED OUTAGE	10/30/2024 9:35	2,043.67	10
PLF	PLANNED OUTAGE	10/30/2024 13:52	11.20	8
Transformer Bank	PLANNED OUTAGE	10/30/2024 11:57	796.90	6
Transformer	PLANNED OUTAGE	10/30/2024 11:16	2,113.83	11
Transformer	PLANNED OUTAGE	10/30/2024 12:09	177.07	4
None	PLANNED OUTAGE	10/30/2024 14:53	140.00	60
None	PLANNED OUTAGE	10/30/2024 14:56	84.00	60
Transformer	PLANNED OUTAGE	10/30/2024 10:46	969.70	3
Transformer	PLANNED OUTAGE	10/30/2024 11:14	243.93	1
Breaker	PLANNED OUTAGE	10/30/2024 17:55	3,528.00	98
Breaker	PLANNED OUTAGE	10/30/2024 17:55	40.80	1
Breaker	PLANNED OUTAGE	10/30/2024 17:55	26.52	1
Breaker	PLANNED OUTAGE	10/30/2024 17:55	101.75	1
Breaker	PLANNED OUTAGE	10/30/2024 17:55	15,826.68	943
Breaker	PLANNED OUTAGE	10/30/2024 17:55	36,155.17	962
Transformer	PLANNED OUTAGE	10/30/2024 15:49	703.53	2
Transformer	PLANNED OUTAGE	10/31/2024 12:20	187.07	8
None	PLANNED OUTAGE	10/30/2024 14:53	844.00	60
None	PLANNED OUTAGE	10/30/2024 14:44	340.97	193
None	PLANNED OUTAGE	10/30/2024 15:05	1,173.15	27
PLF	PLANNED OUTAGE	10/30/2024 15:32	57,535.83	226
Breaker	PLANNED OUTAGE	10/30/2024 17:55	16.90	1
Breaker	PLANNED OUTAGE	10/30/2024 17:55	321.10	19
Breaker	PLANNED OUTAGE	10/30/2024 17:55	32,921.20	1948
Breaker	PLANNED OUTAGE	10/30/2024 17:55	73,212.33	1948
Breaker	PLANNED OUTAGE	10/30/2024 17:55	75.17	2

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Breaker	PLANNED OUTAGE	10/30/2024 18:43	52.90	1
Breaker	PLANNED OUTAGE	10/30/2024 18:43	581.90	11
Transformer	PLANNED OUTAGE	10/30/2024 16:33	1,114.75	5
Transformer	PLANNED OUTAGE	10/31/2024 11:07	303.45	3
Transformer	PLANNED OUTAGE	10/31/2024 8:29	1,335.95	11
Service point	PLANNED OUTAGE	10/31/2024 13:19	7.38	1
Transformer	PLANNED OUTAGE	10/31/2024 21:20	385.60	8
Transformer	PLANNED OUTAGE	10/31/2024 21:45	118.35	9
Transformer	PLANNED OUTAGE	10/31/2024 22:30	171.13	2
PLF	PLANNED OUTAGE	11/01/2024 11:31	36.15	3
Transformer	PLANNED OUTAGE	11/01/2024 9:01	1,233.98	7
Transformer	PLANNED OUTAGE	11/01/2024 9:18	2,176.90	11
Transformer	PLANNED OUTAGE	11/01/2024 9:20	404.35	3
Transformer	PLANNED OUTAGE	11/01/2024 9:33	794.33	5
Breaker	PLANNED OUTAGE	11/02/2024 2:38	31,086.85	2451
PLF	PLANNED OUTAGE	11/02/2024 14:17	1,702.43	22
None	PLANNED OUTAGE	11/01/2024 15:23	695.50	26
None	PLANNED OUTAGE	11/01/2024 20:50	21.05	1
Transformer	PLANNED OUTAGE	11/02/2024 4:44	3,934.17	10
Transformer	PLANNED OUTAGE	11/02/2024 8:07	1,044.50	5
PLF	PLANNED OUTAGE	11/02/2024 8:48	175.70	2
OH Other	PLANNED OUTAGE	11/03/2024 11:06	1,988.80	11
Breaker	PLANNED OUTAGE	11/03/2024 15:55	5,112.80	664
Breaker	PLANNED OUTAGE	11/03/2024 15:55	7.70	1
Breaker	PLANNED OUTAGE	11/03/2024 15:55	7.83	1
Breaker	PLANNED OUTAGE	11/03/2024 15:55	7.92	1
PLF	PLANNED OUTAGE	11/03/2024 19:20	959.33	8
PLF	PLANNED OUTAGE	11/01/2024 15:40	121,203.12	97
PLF	PLANNED OUTAGE	11/04/2024 9:53	47.40	6
Invalid	PLANNED OUTAGE	11/04/2024 10:49	196.67	10
PLF	PLANNED OUTAGE	11/04/2024 19:52	770.83	10
Transformer	PLANNED OUTAGE	11/05/2024 0:49	212.53	8
Breaker	PLANNED OUTAGE	11/03/2024 15:55	8.20	1
Breaker	PLANNED OUTAGE	11/03/2024 15:55	7.98	1
Breaker	PLANNED OUTAGE	11/03/2024 15:55	8.12	1
Transformer	PLANNED OUTAGE	11/04/2024 8:27	773.47	8
PLF	PLANNED OUTAGE	11/04/2024 9:33	2,093.70	7
Transformer	PLANNED OUTAGE	11/04/2024 12:47	146.33	4
PLF	PLANNED OUTAGE	11/05/2024 10:49	154.67	8
Transformer	PLANNED OUTAGE	11/05/2024 10:07	623.35	7
Breaker	PLANNED OUTAGE	11/05/2024 12:13	14.37	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	11/05/2024 13:39	277.87	8
Transformer Bank	PLANNED OUTAGE	11/05/2024 13:59	293.42	1
Transformer	PLANNED OUTAGE	11/06/2024 2:08	8.47	2
None	PLANNED OUTAGE	11/06/2024 9:44	219.60	2
Transformer	PLANNED OUTAGE	11/06/2024 9:42	583.42	5
Switch	PLANNED OUTAGE	11/06/2024 14:36	91.00	1
Transformer Bank	PLANNED OUTAGE	11/06/2024 20:16	312.43	13
PLF	PLANNED OUTAGE	11/06/2024 8:31	1,964.32	7
Breaker	PLANNED OUTAGE	11/07/2024 15:39	5,227.70	857
Transformer	PLANNED OUTAGE	11/07/2024 13:01	1,152.00	8
Invalid	PLANNED OUTAGE	11/07/2024 16:16	9,228.80	103
PLF	PLANNED OUTAGE	11/08/2024 9:59	1,035.78	29
Transformer	PLANNED OUTAGE	11/08/2024 12:16	108.17	10
Transformer	PLANNED OUTAGE	11/07/2024 12:12	1,954.93	16
Breaker	PLANNED OUTAGE	11/08/2024 17:34	15.70	1
Breaker	PLANNED OUTAGE	11/08/2024 17:44	240.00	1
Transformer	PLANNED OUTAGE	11/08/2024 15:03	165.47	8
Transformer	PLANNED OUTAGE	11/08/2024 19:38	418.83	10
Breaker	PLANNED OUTAGE	11/09/2024 8:40	5.03	1
Breaker	PLANNED OUTAGE	11/09/2024 8:40	5.03	1
Breaker	PLANNED OUTAGE	11/09/2024 8:40	5.03	1
Breaker	PLANNED OUTAGE	11/09/2024 8:40	5.03	1
Breaker	PLANNED OUTAGE	11/09/2024 8:40	5.03	1
Breaker	PLANNED OUTAGE	11/09/2024 8:40	5.88	1
Transformer	PLANNED OUTAGE	10/29/2024 9:36	576.65	3
PLF	PLANNED OUTAGE	10/29/2024 10:44	917.23	14
Transformer	PLANNED OUTAGE	10/29/2024 12:01	34.30	3
Transformer	PLANNED OUTAGE	10/29/2024 12:08	843.73	8
PLF	PLANNED OUTAGE	11/05/2024 11:24	25.67	1
Transformer	PLANNED OUTAGE	11/05/2024 9:19	231.83	5
Transformer	PLANNED OUTAGE	11/05/2024 11:06	302.73	4
Breaker	PLANNED OUTAGE	11/05/2024 12:13	8,720.57	607
Breaker	PLANNED OUTAGE	11/05/2024 12:13	14.18	1
PLF	PLANNED OUTAGE	11/06/2024 6:16	72.40	24
Transformer	PLANNED OUTAGE	11/06/2024 9:03	302.27	4
None	PLANNED OUTAGE	11/06/2024 13:42	66.73	4
Transformer	PLANNED OUTAGE	11/06/2024 15:22	84.05	1
Transformer	PLANNED OUTAGE	11/06/2024 17:24	1.67	1
Transformer	PLANNED OUTAGE	11/06/2024 15:16	271.60	6
Switch	PLANNED OUTAGE	11/06/2024 14:36	112.92	1
Breaker	PLANNED OUTAGE	11/06/2024 14:36	109.00	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Switch	PLANNED OUTAGE	11/06/2024 14:36	89.15	1
Switch	PLANNED OUTAGE	11/06/2024 14:36	109.87	1
Transformer	PLANNED OUTAGE	11/07/2024 9:51	552.60	9
Breaker	PLANNED OUTAGE	11/07/2024 15:39	7.48	1
Breaker	PLANNED OUTAGE	11/07/2024 15:39	7.62	1
Breaker	PLANNED OUTAGE	11/07/2024 15:39	240.00	1
Transformer	PLANNED OUTAGE	11/07/2024 13:24	5.18	1
Invalid	PLANNED OUTAGE	11/07/2024 16:57	71.88	1
Invalid	PLANNED OUTAGE	11/07/2024 16:16	89.60	1
Invalid	PLANNED OUTAGE	11/07/2024 16:16	89.60	1
Invalid	PLANNED OUTAGE	11/07/2024 16:16	89.60	1
Transformer	PLANNED OUTAGE	11/08/2024 9:47	189.50	2
PLF	PLANNED OUTAGE	11/08/2024 10:00	280.27	8
Transformer	PLANNED OUTAGE	11/08/2024 9:05	651.30	13
Transformer Bank	PLANNED OUTAGE	11/08/2024 10:51	38.28	1
Transformer Bank	PLANNED OUTAGE	11/07/2024 20:23	597.17	1
Breaker	PLANNED OUTAGE	11/08/2024 16:55	56.58	1
Breaker	PLANNED OUTAGE	11/08/2024 16:55	56.58	1
Breaker	PLANNED OUTAGE	11/08/2024 17:00	96,356.00	1853
Breaker	PLANNED OUTAGE	11/08/2024 16:55	56.48	1
OH Other	PLANNED OUTAGE	11/08/2024 13:28	6,420.80	32
Breaker	PLANNED OUTAGE	11/09/2024 2:49	17,191.30	861
Switch	PLANNED OUTAGE	11/09/2024 7:14	32.80	1
Breaker	PLANNED OUTAGE	11/09/2024 8:40	5.03	1
Breaker	PLANNED OUTAGE	11/09/2024 8:40	5.03	1
Breaker	PLANNED OUTAGE	11/09/2024 8:40	5.03	1
Breaker	PLANNED OUTAGE	11/09/2024 8:40	5.88	1
Transformer	PLANNED OUTAGE	11/09/2024 20:46	646.43	11
Transformer	PLANNED OUTAGE	11/10/2024 21:48	226.08	5
PLF	PLANNED OUTAGE	11/10/2024 15:00	10,811.68	29
Transformer	PLANNED OUTAGE	11/11/2024 8:15	34.38	1
Transformer	PLANNED OUTAGE	11/09/2024 9:29	3,154.33	4
Transformer	PLANNED OUTAGE	11/09/2024 9:29	2,366.60	3
None	PLANNED OUTAGE	11/11/2024 10:57	99.00	2
Transformer	PLANNED OUTAGE	11/11/2024 9:42	300.57	1
Transformer Bank	PLANNED OUTAGE	11/11/2024 19:56	218.25	9
Transformer	PLANNED OUTAGE	11/11/2024 14:03	2,141.80	6
Transformer	PLANNED OUTAGE	11/11/2024 8:51	2,840.70	6
Transformer	PLANNED OUTAGE	11/11/2024 8:53	2,972.83	10
PLF	PLANNED OUTAGE	11/12/2024 9:40	169.73	4
Transformer	PLANNED OUTAGE	11/12/2024 10:14	2,782.83	10

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	11/12/2024 10:18	277.18	1
Transformer	PLANNED OUTAGE	11/12/2024 11:24	426.60	9
Transformer	PLANNED OUTAGE	11/13/2024 7:22	7,632.73	13
None	PLANNED OUTAGE	11/13/2024 9:38	210.60	6
Transformer	PLANNED OUTAGE	11/13/2024 10:43	1,038.83	10
PLF	PLANNED OUTAGE	11/13/2024 11:16	90.12	1
PLF	PLANNED OUTAGE	11/13/2024 17:17	1,781.27	77
Service point	PLANNED OUTAGE	11/14/2024 1:21	64.18	1
Invalid	PLANNED OUTAGE	11/14/2024 10:58	10,462.40	1248
Transformer	PLANNED OUTAGE	11/10/2024 12:12	805.80	9
Transformer	PLANNED OUTAGE	11/10/2024 14:40	36.72	1
Transformer	PLANNED OUTAGE	11/10/2024 15:00	2,404.50	18
Transformer	PLANNED OUTAGE	11/11/2024 8:25	119.58	5
Transformer	PLANNED OUTAGE	11/10/2024 14:22	4,005.20	12
None	PLANNED OUTAGE	11/10/2024 17:29	1,391.47	16
None	PLANNED OUTAGE	11/11/2024 13:19	3,034.52	163
Transformer	PLANNED OUTAGE	11/11/2024 11:37	490.97	11
PLF	PLANNED OUTAGE	11/11/2024 9:35	1,222.35	3
Transformer	PLANNED OUTAGE	11/11/2024 10:20	1,933.05	7
Transformer	PLANNED OUTAGE	11/11/2024 19:03	34.55	3
Transformer	PLANNED OUTAGE	11/11/2024 19:28	186.20	4
Transformer	PLANNED OUTAGE	11/11/2024 9:47	2,859.42	5
Transformer	PLANNED OUTAGE	11/12/2024 9:03	358.80	6
Switch	PLANNED OUTAGE	11/12/2024 8:21	1,370.73	4
Invalid	PLANNED OUTAGE	11/14/2024 10:58	426.07	44
Transformer	PLANNED OUTAGE	11/14/2024 9:26	217.52	1
Transformer	PLANNED OUTAGE	11/14/2024 12:12	159.60	7
PLF	PLANNED OUTAGE	11/14/2024 13:24	3,176.47	58
Primary Wire	PLANNED OUTAGE	11/14/2024 9:31	6,870.27	34
PLF	PLANNED OUTAGE	11/14/2024 18:01	199.20	2
PLF	PLANNED OUTAGE	11/15/2024 1:51	31.57	1
Transformer	PLANNED OUTAGE	11/15/2024 14:15	93.90	3
Transformer	PLANNED OUTAGE	11/15/2024 15:09	314.00	12
Breaker	PLANNED OUTAGE	11/15/2024 18:18	9,597.27	1604
Breaker	PLANNED OUTAGE	11/15/2024 18:18	5.78	1
OH Other	PLANNED OUTAGE	10/25/2024 20:18	102.77	1
Transformer Bank	PLANNED OUTAGE	10/25/2024 16:27	507.70	2
Breaker	PLANNED OUTAGE	10/25/2024 18:50	62.28	1
Transformer Bank	PLANNED OUTAGE	10/26/2024 9:57	2,025.62	13
PLF	PLANNED OUTAGE	10/26/2024 20:19	907.33	10
Breaker	PLANNED OUTAGE	10/27/2024 14:24	6,697.67	2830

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Breaker	PLANNED OUTAGE	10/27/2024 14:24	1.18	1
Transformer	PLANNED OUTAGE	10/28/2024 8:38	2,319.00	12
Transformer	PLANNED OUTAGE	10/28/2024 9:38	31.47	1
Transformer	PLANNED OUTAGE	10/28/2024 10:53	120.40	8
Transformer	PLANNED OUTAGE	10/28/2024 11:53	198.45	3
Transformer	PLANNED OUTAGE	10/28/2024 14:48	22.07	1
Transformer	PLANNED OUTAGE	10/28/2024 9:28	1,091.60	4
Transformer	PLANNED OUTAGE	10/28/2024 11:55	190.28	1
Breaker	PLANNED OUTAGE	10/28/2024 19:33	12.82	1
Breaker	PLANNED OUTAGE	10/28/2024 19:33	12.82	1
Breaker	PLANNED OUTAGE	10/28/2024 19:33	12.82	1
Breaker	PLANNED OUTAGE	10/28/2024 19:33	12.82	1
Transformer	PLANNED OUTAGE	10/29/2024 8:57	742.53	8
Transformer	PLANNED OUTAGE	10/29/2024 8:49	80.15	7
Invalid	PLANNED OUTAGE	11/14/2024 10:58	9.68	1
Invalid	PLANNED OUTAGE	11/14/2024 10:58	34.30	1
Transformer	PLANNED OUTAGE	11/14/2024 8:41	1,599.90	6
Transformer Bank	PLANNED OUTAGE	11/14/2024 11:16	440.75	5
PLF	PLANNED OUTAGE	11/14/2024 11:49	1,554.85	33
PLF	PLANNED OUTAGE	11/14/2024 13:24	54.77	1
Transformer Bank	PLANNED OUTAGE	11/15/2024 9:27	43.60	4
PLF	PLANNED OUTAGE	11/15/2024 9:36	4.05	1
Breaker	PLANNED OUTAGE	11/15/2024 18:18	5.87	1
Breaker	PLANNED OUTAGE	11/15/2024 18:18	5.95	1
Breaker	PLANNED OUTAGE	11/15/2024 18:18	6.05	1
Breaker	PLANNED OUTAGE	11/15/2024 18:18	6.15	1
Breaker	PLANNED OUTAGE	11/17/2024 5:17	10.90	1
Breaker	PLANNED OUTAGE	11/17/2024 5:17	11.03	1
Breaker	PLANNED OUTAGE	11/17/2024 5:17	11.15	1
Breaker	PLANNED OUTAGE	11/17/2024 5:17	11.28	1
Breaker	PLANNED OUTAGE	11/17/2024 17:25	3.07	1
Breaker	PLANNED OUTAGE	11/17/2024 17:25	3.07	1
Breaker	PLANNED OUTAGE	11/17/2024 17:25	3.07	1
Breaker	PLANNED OUTAGE	11/17/2024 17:25	3.07	1
Breaker	PLANNED OUTAGE	11/17/2024 17:25	3.07	1
Breaker	PLANNED OUTAGE	11/17/2024 17:25	3.07	1
Breaker	PLANNED OUTAGE	11/17/2024 17:25	3.07	1
Transformer	PLANNED OUTAGE	11/15/2024 8:45	1,518.00	3
Transformer	PLANNED OUTAGE	11/15/2024 8:32	2,073.20	4
None	PLANNED OUTAGE	11/15/2024 10:17	2,543.42	5
Transformer Bank	PLANNED OUTAGE	11/18/2024 7:50	171.85	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	11/18/2024 9:44	384.13	8
PLF	PLANNED OUTAGE	11/18/2024 14:27	1,237.60	52
Transformer	PLANNED OUTAGE	11/18/2024 23:24	392.93	7
Transformer	PLANNED OUTAGE	11/18/2024 20:26	1,441.08	5
None	PLANNED OUTAGE	11/18/2024 20:26	1,435.50	5
Transformer	PLANNED OUTAGE	11/19/2024 6:29	29.08	1
PLF	PLANNED OUTAGE	11/19/2024 10:01	6.55	1
Breaker	PLANNED OUTAGE	11/15/2024 18:18	6.23	1
Breaker	PLANNED OUTAGE	11/15/2024 18:18	6.42	1
Transformer	PLANNED OUTAGE	11/15/2024 18:43	242.90	7
PLF	PLANNED OUTAGE	11/16/2024 5:21	185.73	4
Breaker	PLANNED OUTAGE	11/17/2024 5:17	30,560.77	2627
Breaker	PLANNED OUTAGE	11/17/2024 17:25	3.07	1
Breaker	PLANNED OUTAGE	11/17/2024 17:25	3.07	1
Breaker	PLANNED OUTAGE	11/17/2024 17:25	3.07	1
Breaker	PLANNED OUTAGE	11/17/2024 17:25	3.07	1
Breaker	PLANNED OUTAGE	11/17/2024 17:25	2.82	1
Breaker	PLANNED OUTAGE	11/17/2024 17:25	3.00	1
Transformer	PLANNED OUTAGE	11/15/2024 8:34	4,133.07	8
None	PLANNED OUTAGE	11/18/2024 11:00	602.25	15
Switch	PLANNED OUTAGE	11/16/2024 2:01	33.83	14
Transformer	PLANNED OUTAGE	11/18/2024 14:59	108.13	4
Transformer	PLANNED OUTAGE	11/19/2024 9:02	648.33	4
Transformer	PLANNED OUTAGE	11/19/2024 12:35	61.33	8
Transformer Bank	PLANNED OUTAGE	11/19/2024 12:36	101.25	1
PLF	PLANNED OUTAGE	11/19/2024 10:46	2,776.67	17
Transformer	PLANNED OUTAGE	11/19/2024 12:20	1.23	1
PLF	PLANNED OUTAGE	11/19/2024 14:19	88.23	1
Transformer	PLANNED OUTAGE	11/19/2024 20:01	76.33	4
PLF	PLANNED OUTAGE	11/19/2024 23:16	1,763.67	44
Breaker	PLANNED OUTAGE	11/20/2024 4:54	7,910.53	632
PLF	PLANNED OUTAGE	11/20/2024 9:10	1,552.65	9
Transformer	PLANNED OUTAGE	11/20/2024 11:43	103.30	6
PLF	PLANNED OUTAGE	11/20/2024 15:05	10.07	1
PLF	PLANNED OUTAGE	11/20/2024 15:55	146.20	6
PLF	PLANNED OUTAGE	11/20/2024 15:55	24.98	1
PLF	PLANNED OUTAGE	11/20/2024 21:49	489.67	5
Transformer	PLANNED OUTAGE	11/20/2024 23:22	120.80	4
None	PLANNED OUTAGE	11/21/2024 7:34	484.87	14
Transformer	PLANNED OUTAGE	11/21/2024 10:28	245.07	8
Transformer	PLANNED OUTAGE	11/21/2024 9:02	1,429.50	6

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	11/19/2024 11:15	159.60	8
Transformer	PLANNED OUTAGE	11/19/2024 9:07	42.70	3
Transformer	PLANNED OUTAGE	11/19/2024 14:32	73.28	1
Breaker	PLANNED OUTAGE	11/20/2024 4:17	49.35	1
Transformer Bank	PLANNED OUTAGE	11/20/2024 8:15	273.13	2
PLF	PLANNED OUTAGE	11/20/2024 9:38	3,508.00	20
Transformer	PLANNED OUTAGE	11/20/2024 10:52	953.20	6
Transformer	PLANNED OUTAGE	11/20/2024 16:52	3.20	1
Primary Wire	PLANNED OUTAGE	11/20/2024 11:44	3,471.67	25
Primary Wire	PLANNED OUTAGE	11/20/2024 23:32	239.98	17
Transformer	PLANNED OUTAGE	11/21/2024 3:07	393.30	9
Transformer	PLANNED OUTAGE	11/21/2024 8:03	2,592.20	13
Transformer	PLANNED OUTAGE	11/21/2024 9:39	338.85	3
PLF	PLANNED OUTAGE	11/21/2024 11:00	158.27	2
Transformer	PLANNED OUTAGE	11/21/2024 11:27	442.80	3
Transformer	PLANNED OUTAGE	11/21/2024 9:46	2,235.87	8
PLF	PLANNED OUTAGE	11/22/2024 9:57	2,738.10	18
Transformer	PLANNED OUTAGE	11/22/2024 12:23	82.48	7
Transformer	PLANNED OUTAGE	11/22/2024 10:10	931.60	6
Transformer Bank	PLANNED OUTAGE	11/22/2024 11:02	428.85	3
Breaker	PLANNED OUTAGE	11/23/2024 11:29	5,986.95	1503
Breaker	PLANNED OUTAGE	11/23/2024 11:29	4.13	1
Breaker	PLANNED OUTAGE	11/23/2024 11:29	4.13	1
Breaker	PLANNED OUTAGE	11/23/2024 11:29	4.13	1
Breaker	PLANNED OUTAGE	11/23/2024 11:29	4.13	1
Breaker	PLANNED OUTAGE	11/23/2024 11:29	4.13	1
Breaker	PLANNED OUTAGE	11/23/2024 11:29	4.13	1
Breaker	PLANNED OUTAGE	11/23/2024 11:29	4.13	1
Breaker	PLANNED OUTAGE	11/23/2024 11:29	4.13	1
Transformer	PLANNED OUTAGE	11/23/2024 10:16	593.55	3
Switch	PLANNED OUTAGE	11/23/2024 7:22	1,161.83	5
Transformer	PLANNED OUTAGE	11/23/2024 18:16	60.95	3
Transformer	PLANNED OUTAGE	11/24/2024 20:36	212.57	7
Transformer	PLANNED OUTAGE	11/25/2024 8:59	1,977.80	11
Switch	PLANNED OUTAGE	11/25/2024 11:29	2,354.98	101
None	PLANNED OUTAGE	11/25/2024 12:41	3.75	1
None	PLANNED OUTAGE	11/25/2024 12:41	3.82	1
Transformer	PLANNED OUTAGE	11/25/2024 11:07	134.97	1
Transformer	PLANNED OUTAGE	11/25/2024 13:56	174.97	1
PLF	PLANNED OUTAGE	11/26/2024 5:32	834.33	10
Transformer Bank	PLANNED OUTAGE	11/26/2024 3:58	890.05	7

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer Bank	PLANNED OUTAGE	11/26/2024 4:01	359.75	5
None	PLANNED OUTAGE	11/26/2024 8:20	1,086.93	8
Transformer	PLANNED OUTAGE	11/26/2024 11:58	119.97	1
None	PLANNED OUTAGE	11/26/2024 9:05	290.97	2
Transformer	PLANNED OUTAGE	11/26/2024 13:34	299.25	9
PLF	PLANNED OUTAGE	11/26/2024 8:30	339.02	1
Transformer	PLANNED OUTAGE	11/26/2024 8:37	2,348.00	10
Transformer	PLANNED OUTAGE	11/26/2024 10:40	931.05	9
PLF	PLANNED OUTAGE	11/26/2024 10:41	131.43	1
Transformer	PLANNED OUTAGE	11/26/2024 15:35	73.33	2
Transformer	PLANNED OUTAGE	11/26/2024 16:15	338.93	16
PLF	PLANNED OUTAGE	11/26/2024 15:15	1,130.67	160
None	PLANNED OUTAGE	11/27/2024 11:18	59.50	7
Transformer	PLANNED OUTAGE	11/27/2024 8:19	409.97	7
None	PLANNED OUTAGE	11/27/2024 10:08	5,667.73	32
None	PLANNED OUTAGE	11/27/2024 10:11	27.23	1
Transformer	PLANNED OUTAGE	11/27/2024 13:04	62.00	2
Transformer	PLANNED OUTAGE	11/27/2024 21:26	690.25	3
None	PLANNED OUTAGE	11/28/2024 2:13	3,774.83	319
Transformer	PLANNED OUTAGE	11/28/2024 12:45	40.83	5
Breaker	PLANNED OUTAGE	11/29/2024 17:56	101.10	1
Breaker	PLANNED OUTAGE	11/29/2024 17:56	100.40	1
PLF	PLANNED OUTAGE	12/02/2024 0:41	258.50	10
Transformer	PLANNED OUTAGE	11/27/2024 9:37	96.40	8
Transformer	PLANNED OUTAGE	12/02/2024 8:52	281.42	11
PLF	PLANNED OUTAGE	11/21/2024 10:42	1,964.08	7
Transformer	PLANNED OUTAGE	11/21/2024 17:24	3,026.70	6
Service point	PLANNED OUTAGE	11/22/2024 9:40	50.98	1
Transformer	PLANNED OUTAGE	11/22/2024 10:42	139.83	1
PLF	PLANNED OUTAGE	11/22/2024 14:51	84.63	2
Transformer	PLANNED OUTAGE	11/22/2024 23:00	2,417.73	8
Breaker	PLANNED OUTAGE	11/23/2024 11:29	4.13	1
Breaker	PLANNED OUTAGE	11/23/2024 11:29	4.13	1
Breaker	PLANNED OUTAGE	11/23/2024 11:29	4.13	1
Breaker	PLANNED OUTAGE	11/23/2024 11:29	4.13	1
Breaker	PLANNED OUTAGE	11/23/2024 11:29	4.13	1
Breaker	PLANNED OUTAGE	11/23/2024 11:29	4.13	1
Breaker	PLANNED OUTAGE	11/23/2024 11:29	4.13	1
Switch	PLANNED OUTAGE	11/23/2024 7:22	462.83	2
Transformer	PLANNED OUTAGE	11/24/2024 18:18	57.20	3
Transformer	PLANNED OUTAGE	11/24/2024 20:04	215.25	7

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	11/24/2024 23:04	778.25	5
None	PLANNED OUTAGE	11/25/2024 12:41	3.58	1
Transformer	PLANNED OUTAGE	11/25/2024 11:07	19.33	1
Transformer	PLANNED OUTAGE	11/25/2024 9:32	1,131.73	8
PLF	PLANNED OUTAGE	11/25/2024 19:37	36.60	1
Transformer	PLANNED OUTAGE	11/26/2024 9:49	335.00	10
Transformer	PLANNED OUTAGE	11/26/2024 9:27	550.45	3
Transformer	PLANNED OUTAGE	11/26/2024 11:17	1,897.50	22
Transformer	PLANNED OUTAGE	11/26/2024 9:14	1,384.10	6
Transformer	PLANNED OUTAGE	11/26/2024 14:04	57.47	1
Transformer	PLANNED OUTAGE	11/26/2024 9:10	419.80	2
Transformer	PLANNED OUTAGE	11/26/2024 18:18	720.93	8
Transformer	PLANNED OUTAGE	11/26/2024 20:04	770.13	16
Transformer	PLANNED OUTAGE	11/26/2024 19:57	300.80	1
None	PLANNED OUTAGE	11/26/2024 10:08	88.90	2
Transformer	PLANNED OUTAGE	11/27/2024 10:17	156.70	6
PLF	PLANNED OUTAGE	11/27/2024 8:59	102.58	1
Transformer	PLANNED OUTAGE	10/29/2024 12:48	50.47	2
Transformer	PLANNED OUTAGE	10/29/2024 11:03	99.07	1
Transformer	PLANNED OUTAGE	10/29/2024 13:29	145.77	2
Transformer	PLANNED OUTAGE	12/03/2024 1:12	49.50	2
None	PLANNED OUTAGE	12/03/2024 10:32	339.75	5
Transformer	PLANNED OUTAGE	12/03/2024 22:34	123.87	4
Transformer	PLANNED OUTAGE	12/03/2024 13:29	1,649.50	3
Transformer	PLANNED OUTAGE	12/03/2024 23:18	1,547.75	5
None	PLANNED OUTAGE	12/04/2024 3:09	6,110.55	367
PLF	PLANNED OUTAGE	12/04/2024 3:18	259.58	175
Transformer	PLANNED OUTAGE	12/04/2024 10:24	138.17	1
Transformer	PLANNED OUTAGE	12/04/2024 12:52	668.50	10
PLF	PLANNED OUTAGE	12/04/2024 15:37	276.20	4
None	PLANNED OUTAGE	12/04/2024 13:21	488.83	5
PLF	PLANNED OUTAGE	12/04/2024 19:44	86.82	1
Transformer	PLANNED OUTAGE	12/04/2024 20:01	940.18	19
Transformer	PLANNED OUTAGE	12/04/2024 16:45	1,723.70	6
Transformer	PLANNED OUTAGE	12/04/2024 22:03	190.30	3
Transformer	PLANNED OUTAGE	12/05/2024 0:13	488.80	1
None	PLANNED OUTAGE	12/05/2024 9:20	720.60	6
Transformer Bank	PLANNED OUTAGE	12/05/2024 9:09	366.18	1
Transformer	PLANNED OUTAGE	12/05/2024 12:49	955.90	6
Transformer	PLANNED OUTAGE	12/05/2024 9:12	474.20	4
Transformer	PLANNED OUTAGE	12/06/2024 9:48	330.33	4

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	12/06/2024 8:30	281.25	1
PLF	PLANNED OUTAGE	12/06/2024 17:27	66.17	2
PLF	PLANNED OUTAGE	12/07/2024 7:02	141.50	6
PLF	PLANNED OUTAGE	12/07/2024 7:02	233.67	10
Transformer	PLANNED OUTAGE	12/07/2024 19:00	24.43	2
Transformer	PLANNED OUTAGE	12/07/2024 17:05	461.35	3
Transformer	PLANNED OUTAGE	12/07/2024 23:09	25.70	3
Breaker	PLANNED OUTAGE	12/08/2024 9:21	515.78	1
Breaker	PLANNED OUTAGE	12/08/2024 19:57	3.33	1
Breaker	PLANNED OUTAGE	12/08/2024 19:57	3.43	1
Breaker	PLANNED OUTAGE	12/08/2024 19:57	3.58	1
Breaker	PLANNED OUTAGE	12/08/2024 19:57	3.65	1
Transformer Bank	PLANNED OUTAGE	12/06/2024 15:15	1,461.07	2
Transformer	PLANNED OUTAGE	11/27/2024 9:43	15.90	3
Transformer	PLANNED OUTAGE	11/27/2024 12:28	619.70	6
Transformer Bank	PLANNED OUTAGE	11/27/2024 15:32	4,625.87	22
Breaker	PLANNED OUTAGE	11/28/2024 4:21	7.75	1
Breaker	PLANNED OUTAGE	11/29/2024 13:33	1,644.85	491
Breaker	PLANNED OUTAGE	11/29/2024 17:56	247,177.58	2455
PLF	PLANNED OUTAGE	11/30/2024 7:30	344.40	28
None	PLANNED OUTAGE	11/30/2024 0:48	4,248.90	9
None	PLANNED OUTAGE	11/30/2024 0:48	1,743.00	9
Transformer	PLANNED OUTAGE	11/30/2024 15:26	324.33	10
Transformer	PLANNED OUTAGE	12/01/2024 15:47	402.75	5
Transformer	PLANNED OUTAGE	12/02/2024 9:45	308.90	1
PLF	PLANNED OUTAGE	12/02/2024 12:36	1,143.20	8
Transformer	PLANNED OUTAGE	12/02/2024 17:07	640.40	2
Transformer Bank	PLANNED OUTAGE	12/03/2024 0:03	904.00	3
Transformer	PLANNED OUTAGE	12/03/2024 9:38	1,214.73	7
None	PLANNED OUTAGE	12/03/2024 14:15	384.80	8
Transformer	PLANNED OUTAGE	12/04/2024 4:59	183.33	4
PLF	PLANNED OUTAGE	12/04/2024 8:36	150.40	2
None	PLANNED OUTAGE	12/04/2024 9:09	1,863.40	154
Transformer	PLANNED OUTAGE	12/04/2024 13:16	102.50	1
Transformer	PLANNED OUTAGE	12/04/2024 11:30	134.43	2
OH Other	PLANNED OUTAGE	12/04/2024 23:24	76.88	1
Transformer Bank	PLANNED OUTAGE	12/04/2024 20:26	1,505.58	7
Transformer Bank	PLANNED OUTAGE	12/05/2024 0:04	1,412.95	3
PLF	PLANNED OUTAGE	12/05/2024 10:57	1.88	1
Transformer	PLANNED OUTAGE	12/05/2024 9:58	324.67	10
Transformer	PLANNED OUTAGE	12/05/2024 8:07	1,005.40	4

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	12/05/2024 13:52	43.48	1
PLF	PLANNED OUTAGE	12/05/2024 16:02	683.90	7
Transformer	PLANNED OUTAGE	12/05/2024 9:17	2,352.83	10
PLF	PLANNED OUTAGE	12/05/2024 11:04	255.43	1
None	PLANNED OUTAGE	12/05/2024 13:38	324.33	4
Transformer Bank	PLANNED OUTAGE	12/06/2024 19:24	481.62	1
Transformer	PLANNED OUTAGE	12/09/2024 12:48	207.90	14
Transformer Bank	PLANNED OUTAGE	12/09/2024 14:18	532.10	17
Transformer	PLANNED OUTAGE	12/10/2024 0:53	91.83	2
None	PLANNED OUTAGE	12/10/2024 10:41	12.17	2
None	PLANNED OUTAGE	12/10/2024 8:28	369.33	10
PLF	PLANNED OUTAGE	12/10/2024 8:47	252.98	1
Transformer Bank	PLANNED OUTAGE	12/10/2024 9:03	2,230.15	13
None	PLANNED OUTAGE	12/10/2024 14:51	54.13	29
None	PLANNED OUTAGE	12/10/2024 12:25	1,831.83	10
Transformer	PLANNED OUTAGE	12/11/2024 9:50	580.98	11
Transformer	PLANNED OUTAGE	12/11/2024 10:02	96.22	23
Transformer	PLANNED OUTAGE	12/11/2024 14:49	307.67	13
Transformer	PLANNED OUTAGE	12/11/2024 10:17	19.07	1
Transformer	PLANNED OUTAGE	12/11/2024 11:14	19.45	1
Transformer	PLANNED OUTAGE	12/11/2024 10:57	357.33	10
Switch	PLANNED OUTAGE	12/11/2024 17:00	13.68	1
Breaker	PLANNED OUTAGE	12/11/2024 15:33	55,713.13	1618
Breaker	PLANNED OUTAGE	12/11/2024 15:33	34.43	1
Switch	PLANNED OUTAGE	12/11/2024 14:40	18,884.15	69
Transformer	PLANNED OUTAGE	12/11/2024 17:03	54.90	1
Transformer	PLANNED OUTAGE	12/11/2024 15:02	1,101.87	2
Transformer	PLANNED OUTAGE	12/11/2024 12:05	965.97	2
Transformer Bank	PLANNED OUTAGE	12/12/2024 9:25	3,448.03	13
Transformer	PLANNED OUTAGE	12/12/2024 16:35	572.00	12
Transformer	PLANNED OUTAGE	12/13/2024 0:10	205.35	9
Transformer	PLANNED OUTAGE	12/13/2024 0:43	133.47	8
Transformer	PLANNED OUTAGE	12/05/2024 16:19	1,236.43	7
Transformer	PLANNED OUTAGE	12/06/2024 8:59	1,400.00	10
Transformer Bank	PLANNED OUTAGE	12/06/2024 8:57	45.75	1
Transformer	PLANNED OUTAGE	12/06/2024 13:20	171.60	9
Switch	PLANNED OUTAGE	12/06/2024 20:32	1,238.20	3
Switch	PLANNED OUTAGE	12/07/2024 13:23	11.97	2
Transformer Bank	PLANNED OUTAGE	12/08/2024 7:14	68.08	5
Breaker	PLANNED OUTAGE	12/08/2024 19:57	4.00	1
Breaker	PLANNED OUTAGE	12/08/2024 19:57	4.17	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Breaker	PLANNED OUTAGE	12/08/2024 19:57	4.28	1
Transformer	PLANNED OUTAGE	12/08/2024 22:19	22.67	2
Transformer	PLANNED OUTAGE	12/09/2024 2:20	103.80	6
Transformer	PLANNED OUTAGE	12/09/2024 4:25	109.33	5
Transformer	PLANNED OUTAGE	12/09/2024 9:23	68.07	2
Transformer	PLANNED OUTAGE	12/09/2024 10:02	1,273.00	6
Transformer	PLANNED OUTAGE	12/09/2024 9:54	666.35	3
Transformer	PLANNED OUTAGE	12/09/2024 11:20	968.33	7
TX Repaired (OH)	PLANNED OUTAGE	12/09/2024 17:49	4,391.22	7
None	PLANNED OUTAGE	12/11/2024 15:39	25.40	6
Switch	PLANNED OUTAGE	12/11/2024 14:40	30,138.17	110
PLF	PLANNED OUTAGE	12/12/2024 2:15	66.53	4
PLF	PLANNED OUTAGE	12/12/2024 8:59	31.23	2
Transformer	PLANNED OUTAGE	12/12/2024 9:32	378.20	12
Transformer	PLANNED OUTAGE	12/12/2024 11:01	199.65	3
Transformer	PLANNED OUTAGE	12/12/2024 12:51	1,454.93	11
Transformer	PLANNED OUTAGE	12/12/2024 21:17	173.60	8
Transformer	PLANNED OUTAGE	12/12/2024 7:57	2,086.70	7
Transformer	PLANNED OUTAGE	12/12/2024 8:23	322.53	4
Transformer	PLANNED OUTAGE	12/13/2024 10:18	88.40	12
None	PLANNED OUTAGE	12/13/2024 10:33	450.00	5
Transformer	PLANNED OUTAGE	12/14/2024 1:12	124.95	9
PLF	PLANNED OUTAGE	12/14/2024 9:44	486.80	24
Transformer Bank	PLANNED OUTAGE	12/14/2024 6:43	963.80	6
PLF	PLANNED OUTAGE	12/14/2024 10:19	209.00	2
Transformer	PLANNED OUTAGE	12/15/2024 11:58	86.73	4
Transformer Bank	PLANNED OUTAGE	12/13/2024 17:02	667.45	21
Transformer Bank	PLANNED OUTAGE	12/14/2024 9:10	632.75	1
Transformer	PLANNED OUTAGE	12/16/2024 9:45	659.07	8
Transformer	PLANNED OUTAGE	12/16/2024 10:19	96.90	2
Transformer	PLANNED OUTAGE	12/16/2024 8:29	434.20	26
Transformer	PLANNED OUTAGE	12/16/2024 12:36	484.17	5
Transformer	PLANNED OUTAGE	12/16/2024 12:36	290.40	3
Transformer	PLANNED OUTAGE	12/16/2024 12:47	73.40	4
Transformer	PLANNED OUTAGE	12/16/2024 20:04	115.10	1
Transformer	PLANNED OUTAGE	12/16/2024 23:37	92.27	8
Transformer	PLANNED OUTAGE	12/16/2024 23:02	193.32	7
Transformer	PLANNED OUTAGE	12/17/2024 8:37	1,279.95	21
Transformer	PLANNED OUTAGE	12/17/2024 11:52	187.83	7
PLF	PLANNED OUTAGE	12/18/2024 9:30	69.77	2
PLF	PLANNED OUTAGE	12/18/2024 10:58	23.00	2

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	12/18/2024 9:32	1,436.17	5
Transformer Bank	PLANNED OUTAGE	12/18/2024 7:43	275.65	1
PLF	PLANNED OUTAGE	12/18/2024 14:23	265.02	1
Transformer	PLANNED OUTAGE	12/18/2024 18:40	58.00	10
PLF	PLANNED OUTAGE	12/19/2024 9:43	1,040.10	9
Transformer	PLANNED OUTAGE	12/19/2024 12:36	10,703.47	244
Transformer	PLANNED OUTAGE	12/19/2024 13:08	69.18	1
Transformer	PLANNED OUTAGE	12/19/2024 13:08	69.17	1
PLF	PLANNED OUTAGE	12/13/2024 8:51	2,231.17	10
Primary Wire	PLANNED OUTAGE	12/13/2024 11:59	21,622.50	75
Transformer	PLANNED OUTAGE	12/13/2024 21:29	391.33	8
PLF	PLANNED OUTAGE	12/14/2024 7:50	225.65	3
Transformer	PLANNED OUTAGE	12/14/2024 13:14	2,249.00	26
Breaker	PLANNED OUTAGE	12/15/2024 10:13	11.03	1
Breaker	PLANNED OUTAGE	12/15/2024 10:13	10.42	1
Transformer	PLANNED OUTAGE	12/15/2024 17:44	273.33	4
PLF	PLANNED OUTAGE	12/15/2024 18:39	6.18	1
Primary Wire	PLANNED OUTAGE	12/15/2024 10:31	10,356.15	21
Transformer	PLANNED OUTAGE	12/16/2024 9:43	37.63	2
Transformer	PLANNED OUTAGE	12/16/2024 11:13	324.10	6
Transformer	PLANNED OUTAGE	12/16/2024 11:20	197.10	2
Transformer	PLANNED OUTAGE	12/16/2024 13:02	21.55	3
Transformer	PLANNED OUTAGE	12/16/2024 12:39	290.67	2
PLF	PLANNED OUTAGE	12/17/2024 2:14	140.23	1
Transformer	PLANNED OUTAGE	12/17/2024 8:05	1,610.13	8
PLF	PLANNED OUTAGE	12/17/2024 12:19	5.80	4
Breaker	PLANNED OUTAGE	12/17/2024 13:43	9,540.27	1118
Breaker	PLANNED OUTAGE	12/17/2024 13:43	7.78	1
Transformer Bank	PLANNED OUTAGE	12/17/2024 16:42	224.25	3
Transformer	PLANNED OUTAGE	12/18/2024 1:12	203.33	4
Transformer	PLANNED OUTAGE	12/18/2024 1:13	56.65	3
Transformer	PLANNED OUTAGE	12/18/2024 11:06	167.77	2
PLF	PLANNED OUTAGE	12/18/2024 23:00	1,390.83	50
Transformer	PLANNED OUTAGE	12/19/2024 13:08	69.25	1
Transformer	PLANNED OUTAGE	12/19/2024 13:07	422.70	6
Transformer	PLANNED OUTAGE	12/19/2024 16:23	51.95	3
Transformer	PLANNED OUTAGE	12/19/2024 22:46	414.07	2
None	PLANNED OUTAGE	12/20/2024 10:58	245.00	6
Transformer	PLANNED OUTAGE	12/20/2024 10:16	119.55	3
Transformer	PLANNED OUTAGE	12/20/2024 13:43	34.65	9
Transformer	PLANNED OUTAGE	12/20/2024 9:06	495.45	9

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	12/19/2024 13:08	69.12	1
Transformer	PLANNED OUTAGE	12/19/2024 10:45	325.50	7
Transformer	PLANNED OUTAGE	12/19/2024 9:42	149.45	7
PLF	PLANNED OUTAGE	12/19/2024 13:00	160.15	1
PLF	PLANNED OUTAGE	12/19/2024 9:14	962.50	5
Transformer Bank	PLANNED OUTAGE	12/19/2024 8:03	520.97	1
Breaker	PLANNED OUTAGE	12/21/2024 1:39	10.47	1
Transformer	PLANNED OUTAGE	12/22/2024 12:11	180.80	8
PLF	PLANNED OUTAGE	12/22/2024 13:53	220.90	3
PLF	PLANNED OUTAGE	12/23/2024 8:21	279.13	2
Transformer Bank	PLANNED OUTAGE	12/27/2024 1:44	8.22	1
Transformer Bank	PLANNED OUTAGE	12/27/2024 1:53	58.88	1
Transformer	PLANNED OUTAGE	12/27/2024 17:26	10.13	4
None	PLANNED OUTAGE	12/28/2024 15:17	16,422.57	397
None	PLANNED OUTAGE	12/28/2024 15:22	367.03	1
None	PLANNED OUTAGE	12/28/2024 15:22	367.03	1
None	PLANNED OUTAGE	12/28/2024 15:21	40.52	1
None	PLANNED OUTAGE	12/28/2024 15:30	31.88	1
None	PLANNED OUTAGE	12/28/2024 15:21	90.83	1
None	PLANNED OUTAGE	12/28/2024 15:21	89.90	1
None	PLANNED OUTAGE	12/28/2024 15:19	93.33	1
None	PLANNED OUTAGE	12/28/2024 15:20	92.73	1
None	PLANNED OUTAGE	12/28/2024 15:24	151.20	4
PLF	PLANNED OUTAGE	12/29/2024 15:48	8,778.00	198
PLF	PLANNED OUTAGE	12/29/2024 15:48	44.33	1
PLF	PLANNED OUTAGE	12/29/2024 15:48	44.33	1
Switch	PLANNED OUTAGE	12/29/2024 19:45	51.53	1
None	PLANNED OUTAGE	12/29/2024 19:57	1,838.97	86
Switch	PLANNED OUTAGE	12/29/2024 19:49	7,626.00	124
Switch	PLANNED OUTAGE	12/29/2024 19:49	291.50	3
Switch	PLANNED OUTAGE	12/29/2024 19:43	5,947.33	88
Switch	PLANNED OUTAGE	12/29/2024 22:41	229.22	1
Breaker	PLANNED OUTAGE	12/29/2024 18:57	171.00	1
Breaker	PLANNED OUTAGE	12/29/2024 18:57	171.08	1
Breaker	PLANNED OUTAGE	12/21/2024 1:39	10.33	1
Breaker	PLANNED OUTAGE	12/21/2024 1:39	10.43	1
Transformer	PLANNED OUTAGE	12/21/2024 14:23	19.60	1
Transformer	PLANNED OUTAGE	12/22/2024 12:14	31.47	1
Transformer Bank	PLANNED OUTAGE	12/23/2024 9:31	52.37	2
None	PLANNED OUTAGE	12/23/2024 9:41	1,383.07	4
Breaker	PLANNED OUTAGE	12/24/2024 18:03	4,142.37	433

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Switch	PLANNED OUTAGE	12/23/2024 21:23	2,324.00	28
None	PLANNED OUTAGE	12/26/2024 11:10	40.80	34
Transformer	PLANNED OUTAGE	12/26/2024 8:45	317.72	1
Transformer	PLANNED OUTAGE	12/27/2024 0:59	161.23	7
Transformer	PLANNED OUTAGE	12/28/2024 1:30	589.32	19
None	PLANNED OUTAGE	12/28/2024 15:21	686.52	17
PLF	PLANNED OUTAGE	12/28/2024 18:54	536.67	8
None	PLANNED OUTAGE	12/28/2024 15:22	367.03	1
None	PLANNED OUTAGE	12/28/2024 15:22	367.03	1
None	PLANNED OUTAGE	12/28/2024 20:55	2,792.95	83
None	PLANNED OUTAGE	12/28/2024 15:21	41.12	1
None	PLANNED OUTAGE	12/28/2024 15:18	43.60	1
None	PLANNED OUTAGE	12/28/2024 15:19	2,027.67	22
None	PLANNED OUTAGE	12/28/2024 15:24	37.68	1
None	PLANNED OUTAGE	12/28/2024 15:30	31.95	1
Breaker	PLANNED OUTAGE	12/29/2024 17:11	165,810.60	1004
Breaker	PLANNED OUTAGE	12/29/2024 21:25	3,141.67	325
Switch	PLANNED OUTAGE	12/29/2024 22:17	2,534.33	10
Breaker	PLANNED OUTAGE	12/29/2024 18:57	170.62	1
Breaker	PLANNED OUTAGE	12/29/2024 18:57	170.23	1
Transformer Bank	PLANNED OUTAGE	12/29/2024 20:20	781.92	5
Transformer	PLANNED OUTAGE	12/30/2024 10:40	219.10	1
Transformer Bank	PLANNED OUTAGE	12/31/2024 9:53	215.37	2
Breaker	PLANNED OUTAGE	12/31/2024 15:03	37,741.00	1410
None	PLANNED OUTAGE	12/31/2024 21:32	8,826.27	424
Transformer	PLANNED OUTAGE	12/31/2024 23:54	942.70	11
Transformer	PLANNED OUTAGE	12/29/2024 15:54	145.70	2
Transformer	PLANNED OUTAGE	12/30/2024 11:31	98.82	7
Connections	PLANNED OUTAGE	12/30/2024 10:45	924.12	89
Connections	PLANNED OUTAGE	12/30/2024 10:45	10.72	1
Breaker	PLANNED OUTAGE	12/31/2024 15:07	46,478.53	1942
Breaker	PLANNED OUTAGE	12/31/2024 15:07	24.05	1
Breaker	PLANNED OUTAGE	12/31/2024 15:03	26.87	1
None	PLANNED OUTAGE	12/31/2024 21:32	166.53	8
None	PLANNED OUTAGE	12/31/2024 21:32	20.82	1
None	PLANNED OUTAGE	12/31/2024 21:32	20.82	1
Transformer Bank	PLANNED OUTAGE	12/31/2024 8:32	876.17	5
None	PLANNED OUTAGE	10/30/2024 14:53	74.00	60
None	PLANNED OUTAGE	10/30/2024 14:53	90.00	60
None	PLANNED OUTAGE	10/30/2024 14:53	106.00	60
Transformer Bank	PLANNED OUTAGE	10/30/2024 9:48	17,078.23	47

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	10/30/2024 13:52	879.30	3
Breaker	PLANNED OUTAGE	10/30/2024 17:55	28,408.60	1047
Breaker	PLANNED OUTAGE	10/30/2024 17:55	101.75	1
Breaker	PLANNED OUTAGE	10/30/2024 17:55	100.83	1
Transformer	PLANNED OUTAGE	10/30/2024 15:38	834.30	3
PLF	PLANNED OUTAGE	10/31/2024 1:51	48.33	4
Transformer	PLANNED OUTAGE	10/31/2024 6:28	73.63	2
Service - Crew	PLANNED OUTAGE	10/31/2024 11:23	742.68	1
Transformer	PLANNED OUTAGE	10/31/2024 9:06	433.17	5
Transformer	PLANNED OUTAGE	10/31/2024 10:40	184.10	2
None	PLANNED OUTAGE	10/31/2024 13:03	2,619.73	32
Transformer	PLANNED OUTAGE	10/31/2024 8:43	3,486.13	16
Transformer	PLANNED OUTAGE	10/31/2024 19:48	60.42	5
Transformer	PLANNED OUTAGE	10/31/2024 9:46	542.40	4
Transformer	PLANNED OUTAGE	11/01/2024 9:37	720.67	4
Service - Crew	PLANNED OUTAGE	11/01/2024 12:17	1,232.97	1
None	PLANNED OUTAGE	11/01/2024 21:08	1.53	1
None	PLANNED OUTAGE	11/01/2024 20:50	6,851.10	557
None	PLANNED OUTAGE	11/01/2024 20:50	19.70	1
None	PLANNED OUTAGE	11/01/2024 21:08	24.00	16
Transformer Bank	PLANNED OUTAGE	11/02/2024 2:43	171.17	2
OCR, Sec.	PLANNED OUTAGE	11/02/2024 14:03	11,487.93	239
OCR, Sec.	PLANNED OUTAGE	11/02/2024 14:03	48.13	1
OCR, Sec.	PLANNED OUTAGE	11/02/2024 14:03	84.97	1
Transformer	PLANNED OUTAGE	11/04/2024 1:54	2,002.00	12
Primary Wire	PLANNED OUTAGE	11/04/2024 10:15	139.35	9
Transformer Bank	PLANNED OUTAGE	11/04/2024 12:23	29.67	1
Switch	PLANNED OUTAGE	11/04/2024 10:37	2,741.20	84
Switch	PLANNED OUTAGE	11/04/2024 10:37	1,627.98	97
Transformer	PLANNED OUTAGE	11/06/2024 1:02	331.33	10
Transformer	PLANNED OUTAGE	11/05/2024 23:47	318.65	3
Transformer	PLANNED OUTAGE	11/06/2024 4:44	2,094.40	16
PLF	PLANNED OUTAGE	11/06/2024 11:06	23.38	1
Transformer	PLANNED OUTAGE	11/06/2024 8:25	4,772.50	50
Transformer	PLANNED OUTAGE	11/06/2024 10:42	15.50	2
Transformer	PLANNED OUTAGE	11/06/2024 12:07	149.20	4
Transformer	PLANNED OUTAGE	11/06/2024 12:32	10.33	1
Transformer	PLANNED OUTAGE	11/06/2024 20:44	75.80	1
Transformer	PLANNED OUTAGE	11/06/2024 20:17	117.92	5
Breaker	PLANNED OUTAGE	11/06/2024 14:36	414.73	1
Transformer	PLANNED OUTAGE	11/07/2024 17:06	45.87	4

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	11/07/2024 17:38	34.15	3
Invalid	PLANNED OUTAGE	11/07/2024 16:16	89.60	1
Transformer	PLANNED OUTAGE	11/08/2024 13:08	28.10	3
Transformer	PLANNED OUTAGE	11/08/2024 19:26	116.30	6
Transformer	PLANNED OUTAGE	11/09/2024 7:32	31.80	6
Breaker	PLANNED OUTAGE	11/09/2024 8:40	5.03	1
Breaker	PLANNED OUTAGE	11/09/2024 8:40	5.03	1
Breaker	PLANNED OUTAGE	11/09/2024 8:40	5.03	1
Breaker	PLANNED OUTAGE	11/09/2024 8:40	5.03	1
Transformer	PLANNED OUTAGE	11/09/2024 13:15	62.73	4
Transformer	PLANNED OUTAGE	11/09/2024 11:38	110.50	3
Transformer	PLANNED OUTAGE	11/10/2024 5:16	281.60	8
Transformer	PLANNED OUTAGE	11/10/2024 15:00	1,465.75	11
PLF	PLANNED OUTAGE	11/11/2024 9:12	192.10	2
Transformer	PLANNED OUTAGE	11/09/2024 2:58	2,138.93	4
Transformer	PLANNED OUTAGE	11/08/2024 8:34	891.72	1
Transformer	PLANNED OUTAGE	11/08/2024 8:45	978.70	6
Service point	PLANNED OUTAGE	11/08/2024 9:39	531.28	1
Primary Wire	PLANNED OUTAGE	11/11/2024 9:00	8,093.25	33
Primary Wire	PLANNED OUTAGE	11/11/2024 9:00	277.05	1
Transformer	PLANNED OUTAGE	11/11/2024 10:23	120.00	9
Transformer	PLANNED OUTAGE	11/11/2024 9:23	36.20	3
Service point	PLANNED OUTAGE	11/11/2024 12:11	242.17	1
Transformer	PLANNED OUTAGE	11/11/2024 10:05	1,424.00	12
Transformer	PLANNED OUTAGE	11/11/2024 9:12	55.20	1
Transformer	PLANNED OUTAGE	11/11/2024 10:40	537.25	3
Transformer Bank	PLANNED OUTAGE	11/11/2024 18:57	632.00	3
Transformer Bank	PLANNED OUTAGE	11/12/2024 8:59	217.02	1
Transformer	PLANNED OUTAGE	11/12/2024 19:43	215.42	5
Transformer	PLANNED OUTAGE	11/13/2024 12:06	1,018.97	11
Transformer	PLANNED OUTAGE	11/13/2024 9:08	1,210.17	10
Transformer	PLANNED OUTAGE	11/13/2024 9:20	722.55	3
Transformer	PLANNED OUTAGE	11/13/2024 9:21	1,706.27	4
Transformer Bank	PLANNED OUTAGE	11/13/2024 19:45	1,211.00	2
Transformer	PLANNED OUTAGE	10/30/2024 12:23	404.40	6
Transformer Bank	PLANNED OUTAGE	10/30/2024 14:11	151.80	6
None	PLANNED OUTAGE	10/30/2024 11:01	842.60	11
Transformer	PLANNED OUTAGE	10/30/2024 11:09	894.17	5
Transformer	PLANNED OUTAGE	10/30/2024 9:21	2,207.88	11
None	PLANNED OUTAGE	10/30/2024 14:53	122.00	60
None	PLANNED OUTAGE	10/30/2024 14:53	196.00	60

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	10/30/2024 9:52	714.67	2
Breaker	PLANNED OUTAGE	10/30/2024 17:55	540.00	15
Breaker	PLANNED OUTAGE	10/30/2024 17:55	4,680.00	130
Breaker	PLANNED OUTAGE	10/30/2024 17:55	135.67	5
Breaker	PLANNED OUTAGE	10/30/2024 17:55	72,039.00	708
Breaker	PLANNED OUTAGE	10/30/2024 17:55	37.58	1
Breaker	PLANNED OUTAGE	10/30/2024 17:55	56,901.17	1514
Breaker	PLANNED OUTAGE	10/30/2024 18:43	23,276.00	440
Primary Wire	PLANNED OUTAGE	10/30/2024 20:26	423.73	1
Transformer	PLANNED OUTAGE	10/31/2024 0:32	63.40	4
Transformer	PLANNED OUTAGE	10/31/2024 9:56	232.27	4
Breaker	PLANNED OUTAGE	10/30/2024 17:55	158,665.60	4432
Transformer	PLANNED OUTAGE	11/14/2024 9:21	427.07	4
Transformer	PLANNED OUTAGE	11/14/2024 9:22	3,107.42	7
Transformer Bank	PLANNED OUTAGE	11/14/2024 8:37	982.07	2
Transformer	PLANNED OUTAGE	11/15/2024 13:46	357.38	1
Breaker	PLANNED OUTAGE	11/15/2024 18:18	6.68	1
None	PLANNED OUTAGE	11/16/2024 0:08	675.50	6
PLF	PLANNED OUTAGE	11/16/2024 1:16	528.73	44
PLF	PLANNED OUTAGE	11/16/2024 1:16	209.80	4
Breaker	PLANNED OUTAGE	11/16/2024 7:49	12,962.05	1191
Breaker	PLANNED OUTAGE	11/16/2024 7:49	10.75	1
Breaker	PLANNED OUTAGE	11/16/2024 7:49	10.98	1
Breaker	PLANNED OUTAGE	11/16/2024 7:49	10.98	1
Transformer	PLANNED OUTAGE	11/16/2024 10:46	180.67	10
Transformer	PLANNED OUTAGE	11/16/2024 11:12	136.53	8
Transformer	PLANNED OUTAGE	11/16/2024 21:01	468.22	13
Breaker	PLANNED OUTAGE	11/17/2024 17:25	3.07	1
Breaker	PLANNED OUTAGE	11/17/2024 17:25	3.07	1
Breaker	PLANNED OUTAGE	11/17/2024 17:25	3.02	1
Breaker	PLANNED OUTAGE	11/17/2024 17:25	3.07	1
Breaker	PLANNED OUTAGE	11/17/2024 17:25	2.17	1
Breaker	PLANNED OUTAGE	11/17/2024 17:25	2.25	1
Breaker	PLANNED OUTAGE	11/17/2024 17:25	2.35	1
PLF	PLANNED OUTAGE	11/17/2024 23:51	1,473.50	35
Transformer Bank	PLANNED OUTAGE	11/18/2024 9:13	90.80	2
PLF	PLANNED OUTAGE	11/18/2024 10:37	278.55	27
Transformer	PLANNED OUTAGE	11/18/2024 13:37	729.50	6
Transformer	PLANNED OUTAGE	11/18/2024 9:02	3,049.20	7
Transformer	PLANNED OUTAGE	11/18/2024 9:04	2,372.13	8
Transformer	PLANNED OUTAGE	11/18/2024 12:03	270.23	2

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	11/19/2024 9:05	147.60	8
PLF	PLANNED OUTAGE	11/19/2024 10:59	1,542.33	10
Transformer	PLANNED OUTAGE	11/19/2024 12:33	135.67	2
Transformer	PLANNED OUTAGE	11/19/2024 12:35	1,149.05	7
Transformer	PLANNED OUTAGE	11/19/2024 12:20	900.08	5
Transformer	PLANNED OUTAGE	10/31/2024 13:06	212.80	12
Transformer	PLANNED OUTAGE	10/31/2024 13:16	246.40	3
PLF	PLANNED OUTAGE	10/31/2024 12:20	3,074.93	26
Transformer	PLANNED OUTAGE	10/31/2024 9:03	1,190.00	6
Transformer	PLANNED OUTAGE	10/31/2024 9:04	2,347.83	5
Primary Wire	PLANNED OUTAGE	10/31/2024 16:34	1,883.87	8
Transformer	PLANNED OUTAGE	10/31/2024 11:45	5,898.80	8
Transformer	PLANNED OUTAGE	11/01/2024 7:16	126.80	6
Transformer	PLANNED OUTAGE	11/01/2024 9:18	1,655.50	10
Transformer	PLANNED OUTAGE	11/19/2024 19:00	765.60	3
PLF	PLANNED OUTAGE	11/19/2024 21:26	1,270.20	12
Transformer	PLANNED OUTAGE	11/19/2024 8:38	5,661.60	8
PLF	PLANNED OUTAGE	11/20/2024 8:23	545.60	11
Transformer	PLANNED OUTAGE	11/20/2024 8:35	110.07	1
Transformer	PLANNED OUTAGE	11/20/2024 9:49	410.30	3
PLF	PLANNED OUTAGE	11/20/2024 7:23	6,955.83	50
Transformer	PLANNED OUTAGE	11/21/2024 12:51	279.60	8
Transformer	PLANNED OUTAGE	11/21/2024 15:29	679.20	9
Transformer	PLANNED OUTAGE	11/21/2024 21:58	119.27	4
Transformer Bank	PLANNED OUTAGE	11/21/2024 14:20	339.38	7
Transformer Bank	PLANNED OUTAGE	11/21/2024 14:19	400.27	8
PLF	PLANNED OUTAGE	11/21/2024 0:03	4,838.30	6
PLF	PLANNED OUTAGE	11/21/2024 16:40	2,158.87	94
Transformer	PLANNED OUTAGE	11/22/2024 7:58	995.63	7
Transformer	PLANNED OUTAGE	11/22/2024 8:16	708.33	4
Transformer	PLANNED OUTAGE	11/22/2024 9:08	1,433.25	7
Transformer	PLANNED OUTAGE	11/22/2024 9:09	1,040.75	5
Transformer	PLANNED OUTAGE	11/22/2024 17:04	191.33	10
Breaker	PLANNED OUTAGE	11/23/2024 4:37	4.40	1
Transformer	PLANNED OUTAGE	11/23/2024 4:42	193.05	9
Breaker	PLANNED OUTAGE	11/23/2024 11:29	4.13	1
Breaker	PLANNED OUTAGE	11/23/2024 11:29	4.13	1
Breaker	PLANNED OUTAGE	11/23/2024 11:29	4.13	1
Breaker	PLANNED OUTAGE	11/23/2024 11:29	4.13	1
Breaker	PLANNED OUTAGE	11/23/2024 11:29	4.13	1
Breaker	PLANNED OUTAGE	11/23/2024 11:29	4.13	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Breaker	PLANNED OUTAGE	11/23/2024 11:29	4.13	1
Breaker	PLANNED OUTAGE	11/23/2024 11:29	4.13	1
PLF	PLANNED OUTAGE	11/23/2024 11:25	937.73	26
Transformer	PLANNED OUTAGE	11/23/2024 13:34	45.63	2
Transformer	PLANNED OUTAGE	11/23/2024 11:48	48.33	4
None	PLANNED OUTAGE	11/23/2024 12:21	24.10	1
Transformer	PLANNED OUTAGE	11/24/2024 0:36	187.50	9
Transformer	PLANNED OUTAGE	11/25/2024 16:53	72.60	9
Transformer	PLANNED OUTAGE	11/25/2024 12:42	880.20	4
Transformer	PLANNED OUTAGE	11/25/2024 17:26	312.60	9
Transformer	PLANNED OUTAGE	11/26/2024 8:45	343.30	6
PLF	PLANNED OUTAGE	11/26/2024 10:23	1,641.28	73
Transformer	PLANNED OUTAGE	11/26/2024 9:27	2,709.00	14
Primary Wire	PLANNED OUTAGE	11/26/2024 10:42	917.58	7
PLF	PLANNED OUTAGE	11/26/2024 10:43	219.28	1
Transformer	PLANNED OUTAGE	11/26/2024 10:44	1,081.27	7
Switch	PLANNED OUTAGE	11/26/2024 13:31	1,280.53	196
None	PLANNED OUTAGE	11/27/2024 13:37	446.33	13
PLF	PLANNED OUTAGE	11/27/2024 18:44	420.80	32
Breaker	PLANNED OUTAGE	11/28/2024 4:21	8.60	1
None	PLANNED OUTAGE	11/28/2024 22:43	248.27	4
Transformer	PLANNED OUTAGE	11/28/2024 16:44	133.35	7
Breaker	PLANNED OUTAGE	11/29/2024 13:33	3.35	1
Transformer Bank	PLANNED OUTAGE	11/29/2024 12:40	610.00	5
PLF	PLANNED OUTAGE	11/29/2024 8:25	8,595.77	34
Primary Wire	PLANNED OUTAGE	11/30/2024 0:48	954.27	2
Transformer	PLANNED OUTAGE	11/30/2024 13:11	77.42	5
Transformer	PLANNED OUTAGE	11/30/2024 22:21	239.52	7
Transformer	PLANNED OUTAGE	11/30/2024 23:11	131.47	8
Transformer	PLANNED OUTAGE	12/02/2024 7:42	2,650.00	15
Transformer	PLANNED OUTAGE	12/02/2024 11:41	251.10	6
Transformer	PLANNED OUTAGE	12/02/2024 10:31	157.08	1
Transformer	PLANNED OUTAGE	12/02/2024 11:48	71.85	1
None	PLANNED OUTAGE	12/02/2024 11:54	732.75	9
Transformer	PLANNED OUTAGE	12/02/2024 8:04	147.42	1
Primary Wire	PLANNED OUTAGE	12/02/2024 8:46	4,462.25	13
Transformer	PLANNED OUTAGE	12/02/2024 9:27	1,690.27	7
Invalid	PLANNED OUTAGE	12/03/2024 7:58	461.55	51
Transformer	PLANNED OUTAGE	12/03/2024 9:34	94.25	5
PLF	PLANNED OUTAGE	11/01/2024 14:51	13.88	1
Transformer	PLANNED OUTAGE	11/02/2024 0:44	74.90	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	11/02/2024 14:17	1,622.87	22
OCR, Sec.	PLANNED OUTAGE	11/02/2024 14:55	969.65	33
Transformer	PLANNED OUTAGE	11/02/2024 16:29	1,063.80	4
Breaker	PLANNED OUTAGE	11/03/2024 15:55	8.05	1
PLF	PLANNED OUTAGE	11/03/2024 16:37	112.97	1
Service - Crew	PLANNED OUTAGE	11/03/2024 22:40	291.57	1
Transformer	PLANNED OUTAGE	11/04/2024 9:34	105.33	8
Transformer	PLANNED OUTAGE	11/04/2024 13:20	27.42	5
Switch	PLANNED OUTAGE	11/04/2024 10:37	1,668.65	69
Transformer	PLANNED OUTAGE	11/04/2024 20:23	523.50	10
Breaker	PLANNED OUTAGE	11/05/2024 12:13	14.35	1
Breaker	PLANNED OUTAGE	11/05/2024 12:13	14.37	1
Transformer	PLANNED OUTAGE	11/05/2024 19:06	182.00	8
None	PLANNED OUTAGE	11/06/2024 11:54	245.10	9
Primary Wire	PLANNED OUTAGE	11/06/2024 11:32	1,428.17	10
Primary Wire	PLANNED OUTAGE	11/06/2024 14:49	18,299.00	87
Transformer	PLANNED OUTAGE	11/06/2024 14:34	266.90	6
Transformer	PLANNED OUTAGE	11/06/2024 13:35	87.70	1
Switch	PLANNED OUTAGE	11/06/2024 14:36	728.00	8
Switch	PLANNED OUTAGE	11/06/2024 14:39	350.53	4
Transformer	PLANNED OUTAGE	11/06/2024 20:44	85.33	4
Transformer	PLANNED OUTAGE	12/03/2024 10:51	887.87	8
Transformer	PLANNED OUTAGE	12/03/2024 9:21	515.87	8
None	PLANNED OUTAGE	12/04/2024 9:23	954.40	16
None	PLANNED OUTAGE	12/04/2024 13:40	103.40	4
Transformer	PLANNED OUTAGE	12/04/2024 12:55	70.45	3
None	PLANNED OUTAGE	12/04/2024 22:58	382.50	5
PLF	PLANNED OUTAGE	12/04/2024 23:08	175.42	1
Transformer	PLANNED OUTAGE	12/04/2024 8:40	1,104.40	6
None	PLANNED OUTAGE	12/05/2024 12:12	30.50	10
Transformer Bank	PLANNED OUTAGE	12/05/2024 12:16	27.28	1
Transformer	PLANNED OUTAGE	12/05/2024 10:36	434.65	3
PLF	PLANNED OUTAGE	12/05/2024 11:12	248.32	1
Transformer	PLANNED OUTAGE	12/05/2024 8:58	309.30	2
Invalid	PLANNED OUTAGE	12/05/2024 8:56	9,715.00	29
Transformer	PLANNED OUTAGE	12/06/2024 7:09	131.72	1
Transformer	PLANNED OUTAGE	12/06/2024 12:21	207.90	18
None	PLANNED OUTAGE	12/06/2024 15:22	119.90	22
Transformer Bank	PLANNED OUTAGE	12/07/2024 8:02	240.95	1
PLF	PLANNED OUTAGE	12/07/2024 8:13	1,430.80	6
Transformer	PLANNED OUTAGE	12/07/2024 16:05	180.95	3

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	12/08/2024 19:16	26.40	4
Breaker	PLANNED OUTAGE	12/08/2024 19:57	4,099.15	957
Breaker	PLANNED OUTAGE	12/08/2024 19:57	3.85	1
Transformer	PLANNED OUTAGE	12/09/2024 1:52	88.67	5
Transformer	PLANNED OUTAGE	12/09/2024 0:55	124.95	7
Transformer	PLANNED OUTAGE	12/09/2024 8:36	136.93	4
PLF	PLANNED OUTAGE	12/09/2024 8:43	39.30	1
Service point	PLANNED OUTAGE	12/09/2024 15:34	9.50	1
PLF	PLANNED OUTAGE	12/09/2024 15:36	21.33	1
Transformer	PLANNED OUTAGE	12/09/2024 17:44	587.42	19
Service point	PLANNED OUTAGE	12/09/2024 7:37	447.10	1
Transformer	PLANNED OUTAGE	12/10/2024 9:48	182.67	5
Transformer	PLANNED OUTAGE	12/10/2024 9:58	48.93	1
Transformer Bank	PLANNED OUTAGE	11/06/2024 23:41	329.80	3
Transformer	PLANNED OUTAGE	11/07/2024 7:43	2,165.25	9
Breaker	PLANNED OUTAGE	11/07/2024 16:57	15,016.17	305
Breaker	PLANNED OUTAGE	11/07/2024 15:39	7.42	1
Service - Crew	PLANNED OUTAGE	11/07/2024 18:26	368.75	1
Transformer	PLANNED OUTAGE	11/08/2024 1:28	1,796.27	8
PLF	PLANNED OUTAGE	11/08/2024 10:56	279.93	26
Transformer	PLANNED OUTAGE	11/08/2024 11:00	200.80	16
Service - Crew	PLANNED OUTAGE	11/08/2024 11:06	205.05	1
Transformer	PLANNED OUTAGE	11/07/2024 12:12	634.73	4
Service - Crew	PLANNED OUTAGE	11/07/2024 19:21	690.55	1
Breaker	PLANNED OUTAGE	11/08/2024 17:34	12,776.40	819
Breaker	PLANNED OUTAGE	11/08/2024 17:44	240.00	1
Breaker	PLANNED OUTAGE	11/08/2024 16:55	56.65	1
Transformer	PLANNED OUTAGE	11/08/2024 19:38	125.80	3
Transformer Bank	PLANNED OUTAGE	11/08/2024 18:32	158.98	1
PLF	PLANNED OUTAGE	11/09/2024 8:47	19.93	1
Switch	PLANNED OUTAGE	11/09/2024 7:14	22,817.20	696
Breaker	PLANNED OUTAGE	11/09/2024 8:40	3,522.05	1041
Breaker	PLANNED OUTAGE	11/09/2024 8:40	5.03	1
Breaker	PLANNED OUTAGE	11/09/2024 8:40	5.03	1
Breaker	PLANNED OUTAGE	11/09/2024 8:40	5.03	1
Breaker	PLANNED OUTAGE	11/09/2024 8:40	5.88	1
Transformer	PLANNED OUTAGE	11/10/2024 8:07	3,490.80	12
Transformer	PLANNED OUTAGE	11/10/2024 14:29	280.47	7
PLF	PLANNED OUTAGE	11/10/2024 23:37	3,977.33	20
Transformer Bank	PLANNED OUTAGE	11/08/2024 11:24	428.17	1
Transformer	PLANNED OUTAGE	11/10/2024 20:02	892.67	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	12/10/2024 10:41	1,704.75	9
Transformer	PLANNED OUTAGE	12/10/2024 14:16	11,198.13	14
PLF	PLANNED OUTAGE	12/10/2024 14:26	676.73	1
Transformer	PLANNED OUTAGE	12/10/2024 15:29	354.40	8
Transformer	PLANNED OUTAGE	12/11/2024 2:57	250.53	8
None	PLANNED OUTAGE	12/11/2024 15:02	2,736.77	74
None	PLANNED OUTAGE	12/11/2024 15:02	37.27	1
None	PLANNED OUTAGE	12/11/2024 15:02	5,694.15	153
Transformer	PLANNED OUTAGE	12/11/2024 21:16	349.88	7
PLF	PLANNED OUTAGE	12/12/2024 12:56	207.30	6
Transformer	PLANNED OUTAGE	12/12/2024 16:06	3.30	3
Transformer	PLANNED OUTAGE	12/12/2024 16:12	3,953.50	15
Transformer	PLANNED OUTAGE	12/13/2024 10:47	70.00	8
Transformer	PLANNED OUTAGE	12/13/2024 9:02	318.80	3
Transformer	PLANNED OUTAGE	12/13/2024 9:40	173.13	4
Transformer	PLANNED OUTAGE	12/13/2024 16:11	452.20	12
Transformer	PLANNED OUTAGE	12/14/2024 6:13	888.30	6
Breaker	PLANNED OUTAGE	12/15/2024 2:30	1,644.77	742
Transformer	PLANNED OUTAGE	12/16/2024 9:54	1,070.50	5
Transformer Bank	PLANNED OUTAGE	12/16/2024 9:59	1,213.25	5
Transformer	PLANNED OUTAGE	12/16/2024 10:41	912.92	7
Transformer	PLANNED OUTAGE	12/17/2024 9:13	148.80	4
Transformer	PLANNED OUTAGE	12/17/2024 10:45	101.20	2
Transformer	PLANNED OUTAGE	12/17/2024 10:25	700.05	3
Transformer	PLANNED OUTAGE	12/17/2024 13:07	72.90	3
Transformer	PLANNED OUTAGE	12/17/2024 8:08	249.05	1
PLF	PLANNED OUTAGE	12/17/2024 8:09	1,000.53	4
Transformer	PLANNED OUTAGE	12/17/2024 10:58	343.97	1
PLF	PLANNED OUTAGE	12/18/2024 11:38	219.07	1
Primary Wire	PLANNED OUTAGE	12/18/2024 15:49	2,291.33	5
None	PLANNED OUTAGE	12/18/2024 9:34	12,167.60	24
Transformer	PLANNED OUTAGE	12/18/2024 9:13	12,147.07	23
Primary Wire	PLANNED OUTAGE	11/11/2024 7:11	289.65	1
Breaker	PLANNED OUTAGE	11/11/2024 20:37	24.40	24
Transformer	PLANNED OUTAGE	11/11/2024 17:56	1,533.87	8
Transformer Bank	PLANNED OUTAGE	11/11/2024 9:47	2,469.00	6
Transformer	PLANNED OUTAGE	11/12/2024 14:50	11.30	6
None	PLANNED OUTAGE	11/12/2024 9:00	1,132.07	4
Transformer	PLANNED OUTAGE	11/12/2024 9:39	317.10	1
Transformer	PLANNED OUTAGE	11/12/2024 14:25	142.37	2
TX Repaired (OH)	PLANNED OUTAGE	11/13/2024 14:58	74.58	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer Bank	PLANNED OUTAGE	11/13/2024 9:57	1,622.10	9
Transformer Bank	PLANNED OUTAGE	11/13/2024 20:18	105.80	4
None	PLANNED OUTAGE	11/14/2024 1:21	572.10	9
Transformer	PLANNED OUTAGE	11/14/2024 9:24	1,636.25	11
None	PLANNED OUTAGE	11/14/2024 8:42	1,569.83	10
Service point	PLANNED OUTAGE	11/14/2024 13:24	60.03	1
Transformer	PLANNED OUTAGE	11/14/2024 22:45	326.80	8
Connections	PLANNED OUTAGE	11/14/2024 16:04	8,398.13	14
Transformer	PLANNED OUTAGE	11/15/2024 10:30	710.10	6
Transformer	PLANNED OUTAGE	11/15/2024 13:02	136.37	2
Transformer	PLANNED OUTAGE	11/15/2024 17:00	774.55	7
Breaker	PLANNED OUTAGE	11/15/2024 18:18	6.68	1
Breaker	PLANNED OUTAGE	11/15/2024 18:18	6.32	1
Transformer	PLANNED OUTAGE	11/16/2024 17:30	411.60	14
Breaker	PLANNED OUTAGE	11/17/2024 5:17	10.78	1
Breaker	PLANNED OUTAGE	11/17/2024 17:25	3.07	1
Breaker	PLANNED OUTAGE	11/17/2024 17:25	3.07	1
Breaker	PLANNED OUTAGE	11/17/2024 17:25	3.07	1
Breaker	PLANNED OUTAGE	11/17/2024 17:25	2.68	1
Breaker	PLANNED OUTAGE	11/17/2024 17:25	2.92	1
Breaker	PLANNED OUTAGE	11/17/2024 17:25	3.08	1
Transformer	PLANNED OUTAGE	11/15/2024 8:33	3,622.97	7
Transformer Bank	PLANNED OUTAGE	11/17/2024 19:29	3,468.62	7
Transformer	PLANNED OUTAGE	11/15/2024 17:31	309.73	4
PLF	PLANNED OUTAGE	12/18/2024 8:29	1,869.40	4
Transformer	PLANNED OUTAGE	12/19/2024 8:27	211.65	17
Transformer	PLANNED OUTAGE	12/19/2024 9:16	403.25	5
Transformer	PLANNED OUTAGE	12/19/2024 14:05	103.42	17
None	PLANNED OUTAGE	12/19/2024 13:48	117.37	1
None	PLANNED OUTAGE	12/19/2024 13:37	1,795.03	14
Transformer	PLANNED OUTAGE	12/19/2024 12:07	58.50	2
Transformer	PLANNED OUTAGE	12/20/2024 8:06	1,282.50	5
Transformer	PLANNED OUTAGE	12/20/2024 10:25	131.67	10
PLF	PLANNED OUTAGE	12/20/2024 8:32	455.10	3
Transformer	PLANNED OUTAGE	12/20/2024 10:14	1,147.25	5
Transformer	PLANNED OUTAGE	12/21/2024 16:29	883.47	4
Transformer	PLANNED OUTAGE	12/22/2024 15:25	21.50	5
Service point	PLANNED OUTAGE	12/23/2024 2:33	16.08	1
None	PLANNED OUTAGE	12/23/2024 22:42	115.85	1
None	PLANNED OUTAGE	12/23/2024 22:26	1,452.18	11
Transformer	PLANNED OUTAGE	12/24/2024 1:08	1,488.43	7

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Breaker	PLANNED OUTAGE	12/25/2024 22:34	17,741.60	1072
Transformer	PLANNED OUTAGE	12/26/2024 8:50	229.73	8
None	PLANNED OUTAGE	12/26/2024 9:41	239.13	2
PLF	PLANNED OUTAGE	12/27/2024 8:04	64.53	1
Transformer Bank	PLANNED OUTAGE	12/27/2024 9:05	256.75	3
Transformer Bank	PLANNED OUTAGE	12/27/2024 9:45	71.93	2
Transformer Bank	PLANNED OUTAGE	12/27/2024 17:06	1,190.42	5
None	PLANNED OUTAGE	12/28/2024 15:17	573.90	6
None	PLANNED OUTAGE	12/28/2024 15:39	699.10	2
None	PLANNED OUTAGE	12/28/2024 15:17	370.75	1
None	PLANNED OUTAGE	12/28/2024 15:22	313.33	8
None	PLANNED OUTAGE	12/28/2024 15:20	368.80	4
None	PLANNED OUTAGE	12/28/2024 15:20	92.78	1
None	PLANNED OUTAGE	12/28/2024 15:29	32.95	1
None	PLANNED OUTAGE	12/28/2024 15:22	39.78	1
None	PLANNED OUTAGE	12/28/2024 15:38	24.28	1
None	PLANNED OUTAGE	12/29/2024 3:06	9,454.00	978
Primary Wire	PLANNED OUTAGE	11/18/2024 12:21	76,664.50	265
Transformer	PLANNED OUTAGE	11/18/2024 13:39	658.82	7
Service point	PLANNED OUTAGE	11/19/2024 11:23	137.02	1
PLF	PLANNED OUTAGE	11/19/2024 9:42	141.75	15
Transformer Bank	PLANNED OUTAGE	11/19/2024 10:59	26.67	1
Transformer	PLANNED OUTAGE	11/19/2024 12:36	141.25	3
Transformer Bank	PLANNED OUTAGE	11/19/2024 12:08	133.53	1
Transformer	PLANNED OUTAGE	11/19/2024 12:35	51.47	1
Transformer Bank	PLANNED OUTAGE	11/19/2024 19:29	229.58	5
PLF	PLANNED OUTAGE	11/19/2024 13:50	15,611.60	93
Primary Wire	PLANNED OUTAGE	11/19/2024 22:01	2,958.43	31
Breaker	PLANNED OUTAGE	11/20/2024 1:37	101,300.33	485
Transformer	PLANNED OUTAGE	11/19/2024 8:37	1,369.78	7
Transformer	PLANNED OUTAGE	11/20/2024 11:20	22.20	4
Transformer	PLANNED OUTAGE	11/20/2024 8:41	1,130.93	8
Transformer	PLANNED OUTAGE	11/20/2024 10:38	808.87	4
Transformer	PLANNED OUTAGE	11/20/2024 13:04	122.15	1
PLF	PLANNED OUTAGE	11/20/2024 17:50	3,124.50	10
Transformer	PLANNED OUTAGE	11/20/2024 10:02	1,337.70	7
PLF	PLANNED OUTAGE	11/20/2024 15:55	449.70	18
PLF	PLANNED OUTAGE	11/20/2024 15:55	24.98	1
None	PLANNED OUTAGE	11/21/2024 7:50	1,376.40	72
Switch	PLANNED OUTAGE	11/21/2024 8:44	3,676.55	417
Transformer Bank	PLANNED OUTAGE	11/21/2024 8:12	295.87	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	11/21/2024 9:22	586.20	4
Transformer	PLANNED OUTAGE	11/21/2024 15:09	99.00	3
Transformer	PLANNED OUTAGE	11/21/2024 9:37	2,145.70	6
Transformer	PLANNED OUTAGE	11/21/2024 22:16	813.87	16
Transformer	PLANNED OUTAGE	11/22/2024 9:50	889.40	4
Transformer	PLANNED OUTAGE	11/22/2024 10:33	231.50	5
Transformer	PLANNED OUTAGE	11/22/2024 13:06	536.93	4
Breaker	PLANNED OUTAGE	11/23/2024 4:37	2,813.52	757
Breaker	PLANNED OUTAGE	11/23/2024 11:29	4.13	1
Breaker	PLANNED OUTAGE	11/23/2024 11:29	4.13	1
Breaker	PLANNED OUTAGE	11/23/2024 11:29	4.13	1
Breaker	PLANNED OUTAGE	11/23/2024 11:29	4.13	1
Breaker	PLANNED OUTAGE	11/23/2024 11:29	4.13	1
Breaker	PLANNED OUTAGE	11/23/2024 11:29	4.13	1
PLF	PLANNED OUTAGE	11/23/2024 8:55	173.00	1
Transformer	PLANNED OUTAGE	11/24/2024 18:58	17.33	4
Transformer	PLANNED OUTAGE	11/25/2024 11:57	93.33	32
PLF	PLANNED OUTAGE	11/25/2024 7:36	1,409.07	8
Transformer Bank	PLANNED OUTAGE	11/25/2024 8:06	219.15	1
None	PLANNED OUTAGE	11/25/2024 12:41	5,452.68	1273
PLF	PLANNED OUTAGE	11/26/2024 10:23	22.48	1
Transformer	PLANNED OUTAGE	11/26/2024 8:05	716.10	7
Switch	PLANNED OUTAGE	11/26/2024 9:06	316.87	196
Transformer Bank	PLANNED OUTAGE	11/26/2024 12:23	128.12	1
PLF	PLANNED OUTAGE	11/26/2024 8:26	221.23	1
None	PLANNED OUTAGE	11/26/2024 12:02	2,449.65	21
Transformer	PLANNED OUTAGE	11/26/2024 9:16	1,196.80	6
Transformer	PLANNED OUTAGE	11/26/2024 16:34	203.25	5
Transformer Bank	PLANNED OUTAGE	11/26/2024 20:03	329.60	1
Transformer	PLANNED OUTAGE	11/27/2024 8:54	448.53	4
PLF	PLANNED OUTAGE	11/27/2024 10:57	44.27	4
Transformer Bank	PLANNED OUTAGE	11/27/2024 7:55	126.10	1
None	PLANNED OUTAGE	11/27/2024 11:32	370.50	6
Service point	PLANNED OUTAGE	11/27/2024 19:46	233.87	1
Breaker	PLANNED OUTAGE	11/28/2024 4:21	8,593.95	1081
Breaker	PLANNED OUTAGE	11/29/2024 0:00	41,218.40	1608
Transformer Bank	PLANNED OUTAGE	11/29/2024 13:11	117.67	2
Breaker	PLANNED OUTAGE	11/29/2024 17:56	100.73	1
Breaker	PLANNED OUTAGE	11/29/2024 17:56	100.92	1
PLF	PLANNED OUTAGE	11/30/2024 7:38	3,067.20	8
None	PLANNED OUTAGE	11/30/2024 0:48	945.63	2

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	11/30/2024 14:27	307.40	12
Transformer	PLANNED OUTAGE	12/01/2024 22:53	103.17	5
Transformer	PLANNED OUTAGE	12/01/2024 18:51	317.97	2
Transformer	PLANNED OUTAGE	12/02/2024 13:52	290.50	6
None	PLANNED OUTAGE	12/02/2024 13:15	168.83	10
Transformer Bank	PLANNED OUTAGE	12/02/2024 17:12	287.42	1
PLF	PLANNED OUTAGE	12/03/2024 2:10	2.45	1
PLF	PLANNED OUTAGE	12/03/2024 0:09	1,654.35	9
Transformer	PLANNED OUTAGE	12/03/2024 11:22	141.47	4
Transformer	PLANNED OUTAGE	12/03/2024 8:44	100.57	2
Transformer	PLANNED OUTAGE	12/03/2024 12:33	288.38	13
Transformer	PLANNED OUTAGE	12/03/2024 12:45	344.60	4
PLF	PLANNED OUTAGE	12/04/2024 0:02	926.10	6
None	PLANNED OUTAGE	12/04/2024 9:09	2,577.30	213
Transformer	PLANNED OUTAGE	12/04/2024 9:15	541.47	8
PLF	PLANNED OUTAGE	12/04/2024 9:24	213.27	1
Transformer Bank	PLANNED OUTAGE	12/04/2024 20:24	656.10	3
None	PLANNED OUTAGE	12/04/2024 22:06	482.07	4
Transformer Bank	PLANNED OUTAGE	12/05/2024 2:08	2,048.60	6
Transformer	PLANNED OUTAGE	12/05/2024 10:02	1,297.20	9
PLF	PLANNED OUTAGE	12/05/2024 11:17	243.05	1
PLF	PLANNED OUTAGE	12/05/2024 10:58	3,671.50	14
Switch	PLANNED OUTAGE	12/05/2024 13:05	609.33	5
Transformer	PLANNED OUTAGE	12/05/2024 19:43	141.17	1
Transformer	PLANNED OUTAGE	12/05/2024 23:30	1,631.85	11
Transformer	PLANNED OUTAGE	12/06/2024 7:33	107.75	1
Transformer	PLANNED OUTAGE	12/06/2024 9:17	45.85	7
Transformer	PLANNED OUTAGE	12/06/2024 14:04	31.58	5
Transformer	PLANNED OUTAGE	12/06/2024 10:30	151.92	1
Transformer	PLANNED OUTAGE	12/06/2024 9:33	633.45	3
Transformer	PLANNED OUTAGE	12/06/2024 10:48	220.67	8
PLF	PLANNED OUTAGE	12/07/2024 8:13	293.40	18
None	PLANNED OUTAGE	12/07/2024 13:57	524.50	10
Breaker	PLANNED OUTAGE	12/08/2024 19:57	4.07	1
Breaker	PLANNED OUTAGE	12/29/2024 17:11	165.03	1
Breaker	PLANNED OUTAGE	12/29/2024 17:11	7,927.20	48
Breaker	PLANNED OUTAGE	12/29/2024 18:57	202,447.07	1189
Breaker	PLANNED OUTAGE	12/29/2024 18:57	171.77	1
None	PLANNED OUTAGE	12/30/2024 8:35	446.80	8
PLF	PLANNED OUTAGE	12/30/2024 13:00	719.70	18
PLF	PLANNED OUTAGE	12/30/2024 13:26	332.53	8

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
None	PLANNED OUTAGE	12/30/2024 23:57	11,253.33	160
None	PLANNED OUTAGE	12/31/2024 8:50	406.53	4
Transformer	PLANNED OUTAGE	12/31/2024 9:24	143.07	2
Breaker	PLANNED OUTAGE	12/08/2024 19:57	3.23	1
Breaker	PLANNED OUTAGE	12/08/2024 19:57	3.73	1
Breaker	PLANNED OUTAGE	12/08/2024 19:57	4.28	1
Transformer	PLANNED OUTAGE	12/09/2024 2:53	535.03	7
Transformer	PLANNED OUTAGE	12/09/2024 7:22	106.63	7
None	PLANNED OUTAGE	12/09/2024 6:24	4,246.67	1960
Transformer	PLANNED OUTAGE	12/09/2024 11:19	52.45	3
Invalid	PLANNED OUTAGE	12/09/2024 12:05	2,633.40	189
Service point	PLANNED OUTAGE	12/09/2024 7:18	376.77	1
Transformer	PLANNED OUTAGE	12/09/2024 9:36	256.42	1
Transformer	PLANNED OUTAGE	12/09/2024 15:20	541.18	19
None	PLANNED OUTAGE	12/09/2024 22:14	257.25	5
Transformer	PLANNED OUTAGE	12/10/2024 1:39	335.60	6
Transformer	PLANNED OUTAGE	12/10/2024 2:36	205.63	2
Invalid	PLANNED OUTAGE	12/09/2024 12:05	492.10	7
PLF	PLANNED OUTAGE	12/10/2024 10:09	143.15	1
Transformer	PLANNED OUTAGE	12/11/2024 11:12	78.13	1
Breaker	PLANNED OUTAGE	12/11/2024 13:36	20,370.18	787
Primary Wire	PLANNED OUTAGE	12/11/2024 9:24	774.27	2
Switch	PLANNED OUTAGE	12/11/2024 16:28	7,190.40	252
None	PLANNED OUTAGE	12/11/2024 15:02	37.20	1
Transformer	PLANNED OUTAGE	12/11/2024 19:02	323.27	13
Switch	PLANNED OUTAGE	12/11/2024 16:28	4,157.07	16
Breaker	PLANNED OUTAGE	12/12/2024 2:13	1,875.10	1103
Transformer	PLANNED OUTAGE	12/12/2024 11:21	915.67	5
Primary Wire	PLANNED OUTAGE	12/12/2024 8:19	808.33	2
PLF	PLANNED OUTAGE	12/14/2024 7:34	1,336.67	8
Primary Wire	PLANNED OUTAGE	12/14/2024 18:14	380.17	1
Breaker	PLANNED OUTAGE	12/15/2024 10:13	11.32	1
Transformer	PLANNED OUTAGE	12/15/2024 17:57	288.05	7
PLF	PLANNED OUTAGE	12/15/2024 10:31	10,371.90	21
PLF	PLANNED OUTAGE	12/16/2024 9:22	1,259.60	12
Transformer	PLANNED OUTAGE	12/16/2024 9:45	227.45	3
Transformer	PLANNED OUTAGE	12/16/2024 11:20	36.23	2
Transformer	PLANNED OUTAGE	12/16/2024 11:28	281.75	3
Transformer	PLANNED OUTAGE	12/16/2024 16:56	43.33	5
Transformer	PLANNED OUTAGE	12/16/2024 15:13	661.38	7
Transformer Bank	PLANNED OUTAGE	12/16/2024 16:11	35.60	6

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	12/17/2024 9:18	695.40	4
Transformer	PLANNED OUTAGE	12/17/2024 11:08	81.00	3
Breaker	PLANNED OUTAGE	12/17/2024 13:43	7.67	1
Transformer	PLANNED OUTAGE	12/18/2024 1:12	103.03	2
PLF	PLANNED OUTAGE	12/18/2024 8:59	5,487.03	34
Transformer	PLANNED OUTAGE	12/18/2024 10:11	147.10	6
Transformer	PLANNED OUTAGE	12/18/2024 10:46	409.25	3
Transformer	PLANNED OUTAGE	12/18/2024 11:07	1,334.50	6
Transformer	PLANNED OUTAGE	12/18/2024 11:53	175.20	4
Transformer	PLANNED OUTAGE	12/18/2024 19:47	46.87	4
Transformer	PLANNED OUTAGE	12/19/2024 13:08	69.23	1
PLF	PLANNED OUTAGE	12/19/2024 9:59	170.47	1
Transformer Bank	PLANNED OUTAGE	12/19/2024 22:46	205.00	1
Transformer	PLANNED OUTAGE	12/20/2024 0:08	226.93	16
Transformer	PLANNED OUTAGE	12/20/2024 8:42	1,145.52	17
None	PLANNED OUTAGE	12/20/2024 10:01	579.13	17
Transformer Bank	PLANNED OUTAGE	12/20/2024 8:38	270.93	1
PLF	PLANNED OUTAGE	12/20/2024 11:53	30.37	1
Breaker	PLANNED OUTAGE	12/21/2024 1:39	8,184.00	1440
Breaker	PLANNED OUTAGE	12/21/2024 1:39	10.38	1
Transformer	PLANNED OUTAGE	12/21/2024 4:58	1,851.20	12
Transformer	PLANNED OUTAGE	12/21/2024 12:53	81.60	9
PLF	PLANNED OUTAGE	12/21/2024 20:55	3,669.33	40
Transformer	PLANNED OUTAGE	12/23/2024 0:54	40.43	1
Transformer Bank	PLANNED OUTAGE	12/23/2024 11:45	250.30	3
PLF	PLANNED OUTAGE	12/23/2024 18:19	802.30	3
Transformer Bank	PLANNED OUTAGE	12/26/2024 10:44	55.30	6
Transformer	PLANNED OUTAGE	12/26/2024 8:34	462.40	4
Transformer	PLANNED OUTAGE	12/26/2024 10:59	164.83	2
Transformer	PLANNED OUTAGE	12/26/2024 13:57	162.72	13
Transformer Bank	PLANNED OUTAGE	12/26/2024 11:30	43.98	1
Transformer	PLANNED OUTAGE	12/26/2024 16:12	644.60	11
PLF	PLANNED OUTAGE	12/27/2024 3:58	3,756.13	52
Transformer	PLANNED OUTAGE	12/27/2024 10:16	288.75	11
Transformer Bank	PLANNED OUTAGE	12/27/2024 21:04	173.17	5
Transformer	PLANNED OUTAGE	12/28/2024 12:24	108.08	5
None	PLANNED OUTAGE	12/28/2024 15:17	4,719.17	50
PLF	PLANNED OUTAGE	12/28/2024 18:54	2,160.95	33
PLF	PLANNED OUTAGE	12/28/2024 18:50	1,046.25	15
None	PLANNED OUTAGE	12/28/2024 15:22	367.03	1
None	PLANNED OUTAGE	12/28/2024 15:22	367.03	1

2024 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
None	PLANNED OUTAGE	12/28/2024 15:21	90.62	1
None	PLANNED OUTAGE	12/28/2024 15:23	38.47	1
None	PLANNED OUTAGE	12/28/2024 15:37	25.35	1
None	PLANNED OUTAGE	12/28/2024 15:19	93.55	1
None	PLANNED OUTAGE	12/28/2024 15:19	42.83	1
None	PLANNED OUTAGE	12/28/2024 15:22	40.37	1
Breaker	PLANNED OUTAGE	12/29/2024 17:11	20,904.45	129
Breaker	PLANNED OUTAGE	12/29/2024 18:57	171.70	1
Breaker	PLANNED OUTAGE	12/29/2024 18:57	170.93	1
Connections	PLANNED OUTAGE	12/30/2024 10:45	976.03	94
Transformer	PLANNED OUTAGE	12/30/2024 15:44	47.83	10
Transformer	PLANNED OUTAGE	12/31/2024 8:24	239.63	13
Transformer	PLANNED OUTAGE	12/31/2024 8:34	316.00	3
None	PLANNED OUTAGE	12/31/2024 16:58	7,397.25	315
Breaker	PLANNED OUTAGE	12/31/2024 15:03	27.03	1
None	PLANNED OUTAGE	12/31/2024 21:32	10,516.37	506
None	PLANNED OUTAGE	12/31/2024 23:19	881.30	21
			13,944,816.83	**314,563**

2024 Adjustments: Substation Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Substation	FPSC Commission Rule 26-6.0455	1/1/24 9:38 AM	1,553.35	47
Substation	FPSC Commission Rule 26-6.0455	1/1/24 9:38 AM	20,755.40	628
Substation	FPSC Commission Rule 26-6.0455	1/1/24 9:38 AM	1,288.95	39
Substation	FPSC Commission Rule 26-6.0455	1/1/24 9:38 AM	8,845.00	174
Substation	FPSC Commission Rule 26-6.0455	1/1/24 9:38 AM	48,850.83	961
Substation	FPSC Commission Rule 26-6.0455	1/1/24 9:38 AM	3,965.00	78
Substation	FPSC Commission Rule 26-6.0455	1/21/24 8:06 AM	5,015.00	30
Substation	FPSC Commission Rule 26-6.0455	1/21/24 8:06 AM	32,936.00	460
Substation	FPSC Commission Rule 26-6.0456	1/21/24 8:06 AM	9,116.25	51
Substation	FPSC Commission Rule 26-6.0457	1/1/24 9:38 AM	28,162.25	635
Substation	FPSC Commission Rule 26-6.0458	2/13/24 8:15 AM	20.60	2
Substation	FPSC Commission Rule 26-6.0459	2/13/24 8:15 AM	24,968.80	708
Substation	FPSC Commission Rule 26-6.0460	2/13/24 8:15 AM	10.02	1
Substation	FPSC Commission Rule 26-6.0461	2/13/24 8:15 AM	10.02	1
Substation	FPSC Commission Rule 26-6.0462	2/16/24 7:11 PM	87.28	1
Substation	FPSC Commission Rule 26-6.0463	1/21/24 8:06 AM	14,633.33	125
Substation	FPSC Commission Rule 26-6.0464	2/13/24 8:15 AM	24,301.03	667
Substation	FPSC Commission Rule 26-6.0465	2/13/24 8:15 AM	111,490.50	2,330
Substation	FPSC Commission Rule 26-6.0466	2/13/24 8:15 AM	20,435.20	1,984
Substation	FPSC Commission Rule 26-6.0467	2/13/24 8:15 AM	47.85	1
Substation	FPSC Commission Rule 26-6.0468	2/13/24 8:15 AM	10.02	1
Substation	FPSC Commission Rule 26-6.0469	2/13/24 8:15 AM	10.02	1
Substation	FPSC Commission Rule 26-6.0470	2/13/24 8:15 AM	45,456.25	1,039
Substation	FPSC Commission Rule 26-6.0471	2/13/24 8:15 AM	9,537.50	218
Substation	FPSC Commission Rule 26-6.0472	2/13/24 8:15 AM	47.15	1
Substation	FPSC Commission Rule 26-6.0473	2/13/24 8:15 AM	75,817.20	1,608
Substation	FPSC Commission Rule 26-6.0474	2/13/24 8:15 AM	47.85	1
Substation	FPSC Commission Rule 26-6.0475	2/16/24 7:11 PM	128,219.22	1,469
Substation	FPSC Commission Rule 26-6.0476	2/13/24 8:15 AM	47.85	1
Substation	FPSC Commission Rule 26-6.0477	2/13/24 8:15 AM	47.85	1
Substation	FPSC Commission Rule 26-6.0478	2/13/24 8:15 AM	10.40	1
Substation	FPSC Commission Rule 26-6.0479	2/13/24 8:15 AM	14,904.80	1,488
Substation	FPSC Commission Rule 26-6.0480	2/13/24 8:15 AM	10.52	1
Substation	FPSC Commission Rule 26-6.0481	4/4/24 10:36 AM	7.68	1
Substation	FPSC Commission Rule 26-6.0482	4/4/24 10:36 AM	7.68	1
Substation	FPSC Commission Rule 26-6.0483	2/16/24 7:11 PM	87.28	1
Substation	FPSC Commission Rule 26-6.0484	2/16/24 7:11 PM	87.28	1
Substation	FPSC Commission Rule 26-6.0485	2/16/24 7:11 PM	87.28	1
Substation	FPSC Commission Rule 26-6.0486	4/8/24 1:38 AM	83.58	1
Substation	FPSC Commission Rule 26-6.0487	4/4/24 10:36 AM	7.68	1
Substation	FPSC Commission Rule 26-6.0488	4/4/24 10:36 AM	6,354.12	827
Substation	FPSC Commission Rule 26-6.0489	4/4/24 10:36 AM	8,958.77	1,166
Substation	FPSC Commission Rule 26-6.0490	4/4/24 10:36 AM	7.68	1
Substation	FPSC Commission Rule 26-6.0491	4/4/24 10:36 AM	7.68	1
Substation	FPSC Commission Rule 26-6.0492	4/4/24 10:36 AM	7.68	1
Substation	FPSC Commission Rule 26-6.0493	4/4/24 10:36 AM	7.68	1
Substation	FPSC Commission Rule 26-6.0494	4/8/24 1:38 AM	134.73	1
Substation	FPSC Commission Rule 26-6.0495	4/5/24 7:31 AM	134,102.62	1,487
Substation	FPSC Commission Rule 26-6.0496	4/4/24 10:36 AM	7.68	1

2024 Adjustments: Substation Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Substation	FPSC Commission Rule 26-6.0497	4/4/24 10:36 AM	7.68	1
Substation	FPSC Commission Rule 26-6.0498	4/4/24 10:36 AM	7.68	1
Substation	FPSC Commission Rule 26-6.0499	5/14/24 11:49 AM	19,954.43	1,862
Substation	FPSC Commission Rule 26-6.0500	5/26/24 5:59 AM	2.88	1
Substation	FPSC Commission Rule 26-6.0501	5/26/24 5:59 AM	2,766.98	641
Substation	FPSC Commission Rule 26-6.0502	5/26/24 5:59 AM	1,678.10	582
Substation	FPSC Commission Rule 26-6.0503	5/26/24 5:59 AM	5.77	2
Substation	FPSC Commission Rule 26-6.0504	5/26/24 5:59 AM	3,175.50	1,095
Substation	FPSC Commission Rule 26-6.0505	6/27/24 6:43 PM	53,384.92	1,211
Substation	FPSC Commission Rule 26-6.0506	6/27/24 6:43 PM	4,171.05	39
Substation	FPSC Commission Rule 26-6.0507	7/18/24 11:13 AM	18.63	1
Substation	FPSC Commission Rule 26-6.0508	7/14/24 5:27 PM	154,345.50	1,854
Substation	FPSC Commission Rule 26-6.0509	7/21/24 8:36 PM	6,121.50	45
Substation	FPSC Commission Rule 26-6.0510	7/22/24 6:28 PM	67,638.27	1,177
Substation	FPSC Commission Rule 26-6.0511	6/29/24 1:56 PM	1.12	1
Substation	FPSC Commission Rule 26-6.0512	7/23/24 6:27 PM	38.98	1
Substation	FPSC Commission Rule 26-6.0513	7/23/24 6:27 PM	10,650.50	238
Substation	FPSC Commission Rule 26-6.0514	6/27/24 6:43 PM	55,671.30	1,458
Substation	FPSC Commission Rule 26-6.0515	6/27/24 6:43 PM	1,121.63	19
Substation	FPSC Commission Rule 26-6.0516	6/27/24 6:43 PM	1,062.60	18
Substation	FPSC Commission Rule 26-6.0517	6/27/24 6:43 PM	28,158.90	477
Substation	FPSC Commission Rule 26-6.0518	6/27/24 6:43 PM	132,511.05	1,239
Substation	FPSC Commission Rule 26-6.0519	7/14/24 5:27 PM	365.83	5
Substation	FPSC Commission Rule 26-6.0520	7/18/24 11:13 AM	19.27	1
Substation	FPSC Commission Rule 26-6.0521	7/14/24 5:25 PM	325,797.33	2,405
Substation	FPSC Commission Rule 26-6.0522	7/14/24 5:27 PM	159,257.25	1,913
Substation	FPSC Commission Rule 26-6.0523	7/23/24 6:27 PM	53.78	1
Substation	FPSC Commission Rule 26-6.0524	7/23/24 6:27 PM	48.13	1
Substation	FPSC Commission Rule 26-6.0525	7/23/24 6:27 PM	48.13	1
Substation	FPSC Commission Rule 26-6.0526	7/18/24 11:13 AM	25,056.42	1,313
Substation	FPSC Commission Rule 26-6.0527	7/21/24 8:36 PM	57,814.17	425
Substation	FPSC Commission Rule 26-6.0528	7/22/24 6:28 PM	459.73	8
Substation	FPSC Commission Rule 26-6.0529	7/23/24 6:27 PM	54.90	1
Substation	FPSC Commission Rule 26-6.0530	7/23/24 6:27 PM	33,873.87	944
Substation	FPSC Commission Rule 26-6.0531	8/10/24 12:28 AM	1,506.27	1,144
Substation	FPSC Commission Rule 26-6.0532	8/14/24 12:43 AM	149,359.13	802
Substation	FPSC Commission Rule 26-6.0533	8/14/24 12:41 AM	356,112.53	2,404
Substation	FPSC Commission Rule 26-6.0534	8/28/24 4:15 PM	991.53	139
Substation	FPSC Commission Rule 26-6.0535	8/29/24 3:09 PM	2.85	1
Substation	FPSC Commission Rule 26-6.0536	8/29/24 3:09 PM	2.85	1
Substation	FPSC Commission Rule 26-6.0537	8/29/24 3:09 PM	2.85	1
Substation	FPSC Commission Rule 26-6.0538	8/29/24 3:09 PM	2.85	1
Substation	FPSC Commission Rule 26-6.0539	8/29/24 3:09 PM	2.85	1
Substation	FPSC Commission Rule 26-6.0540	8/29/24 3:09 PM	2.85	1
Substation	FPSC Commission Rule 26-6.0541	8/29/24 3:09 PM	2.85	1
Substation	FPSC Commission Rule 26-6.0542	8/29/24 3:09 PM	2.85	1
Substation	FPSC Commission Rule 26-6.0543	8/14/24 12:41 AM	148.13	1
Substation	FPSC Commission Rule 26-6.0544	8/14/24 12:43 AM	195,097.50	1,334
Substation	FPSC Commission Rule 26-6.0545	8/29/24 3:09 PM	2.85	1

2024 Adjustments: Substation Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Substation	FPSC Commission Rule 26-6.0546	8/29/24 3:09 PM	2.85	1
Substation	FPSC Commission Rule 26-6.0547	8/29/24 3:09 PM	2.85	1
Substation	FPSC Commission Rule 26-6.0548	8/29/24 3:09 PM	2.85	1
Substation	FPSC Commission Rule 26-6.0549	8/29/24 3:09 PM	2.85	1
Substation	FPSC Commission Rule 26-6.0550	8/29/24 3:09 PM	2.85	1
Substation	FPSC Commission Rule 26-6.0551	8/29/24 3:09 PM	2.85	1
Substation	FPSC Commission Rule 26-6.0552	8/29/24 3:09 PM	2.85	1
Substation	FPSC Commission Rule 26-6.0553	8/14/24 12:40 AM	184,985.70	1,041
Substation	FPSC Commission Rule 26-6.0554	8/29/24 3:09 PM	2.85	1
Substation	FPSC Commission Rule 26-6.0555	8/29/24 3:09 PM	2.85	1
Substation	FPSC Commission Rule 26-6.0556	8/29/24 3:09 PM	2.85	1
Substation	FPSC Commission Rule 26-6.0557	8/29/24 3:09 PM	2.85	1
Substation	FPSC Commission Rule 26-6.0558	8/29/24 3:09 PM	2.85	1
Substation	FPSC Commission Rule 26-6.0559	8/29/24 3:09 PM	2.85	1
Substation	FPSC Commission Rule 26-6.0560	8/29/24 3:09 PM	4,319.70	1,694
Substation	FPSC Commission Rule 26-6.0561	8/29/24 3:09 PM	2.85	1
Substation	FPSC Commission Rule 26-6.0562	8/29/24 3:09 PM	2.85	1
Substation	FPSC Commission Rule 26-6.0563	8/20/24 5:58 PM	1,580.40	1,317
Substation	FPSC Commission Rule 26-6.0564	8/28/24 4:15 PM	14.27	2
Substation	FPSC Commission Rule 26-6.0565	8/28/24 4:15 PM	7.13	1
Substation	FPSC Commission Rule 26-6.0566	8/29/24 3:09 PM	2.85	1
Substation	FPSC Commission Rule 26-6.0567	8/29/24 3:09 PM	2.85	1
Substation	FPSC Commission Rule 26-6.0568	8/29/24 3:09 PM	2.85	1
Substation	FPSC Commission Rule 26-6.0569	8/29/24 3:09 PM	2.85	1
Substation	FPSC Commission Rule 26-6.0570	8/29/24 3:09 PM	2.85	1
Substation	FPSC Commission Rule 26-6.0571	8/29/24 3:09 PM	2.85	1
Substation	FPSC Commission Rule 26-6.0572	8/29/24 3:09 PM	2.85	1
Substation	FPSC Commission Rule 26-6.0573	8/29/24 3:09 PM	2.85	1
Substation	FPSC Commission Rule 26-6.0574	11/3/24 12:42 PM	90.85	1
Substation	FPSC Commission Rule 26-6.0575	11/3/24 12:42 PM	91.18	1
Substation	FPSC Commission Rule 26-6.0576	11/3/24 12:42 PM	137,520.20	1,509
Substation	FPSC Commission Rule 26-6.0577	11/3/24 12:42 PM	91.65	1
Substation	FPSC Commission Rule 26-6.0578	12/12/24 1:49 PM	2.45	1
Substation	FPSC Commission Rule 26-6.0579	12/12/24 1:49 PM	1.87	1
Substation	FPSC Commission Rule 26-6.0580	12/12/24 1:49 PM	2.17	1
Substation	FPSC Commission Rule 26-6.0581	12/12/24 1:49 PM	2.35	1
Substation	FPSC Commission Rule 26-6.0582	12/12/24 4:31 PM	34,144.37	502
Substation	FPSC Commission Rule 26-6.0583	12/12/24 4:31 PM	68.05	1
Substation	FPSC Commission Rule 26-6.0584	12/12/24 1:49 PM	2.70	1
Substation	FPSC Commission Rule 26-6.0585	12/12/24 1:49 PM	2.07	1
Substation	FPSC Commission Rule 26-6.0586	12/12/24 1:49 PM	1.98	1
Substation	FPSC Commission Rule 26-6.0587	12/12/24 1:49 PM	2,109.80	924
Substation	FPSC Commission Rule 26-6.0588	12/12/24 4:31 PM	49,385.70	603
Substation	FPSC Commission Rule 26-6.0589	12/15/24 8:27 AM	161.92	1
Substation	FPSC Commission Rule 26-6.0590	12/15/24 8:27 AM	161.75	1
Substation	FPSC Commission Rule 26-6.0591	12/15/24 8:27 AM	285,327.00	1,764
Substation	FPSC Commission Rule 26-6.0592	11/3/24 12:42 PM	91.10	1
Substation	FPSC Commission Rule 26-6.0593	11/3/24 12:42 PM	90.95	1
Substation	FPSC Commission Rule 26-6.0594	11/3/24 12:42 PM	91.02	1

2024 Adjustments: Substation Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Substation	FPSC Commission Rule 26-6.0595	12/12/24 1:49 PM	2.62	1
Substation	FPSC Commission Rule 26-6.0596	12/12/24 1:49 PM	2.05	1
Substation	FPSC Commission Rule 26-6.0597	12/12/24 1:49 PM	1.78	1
Substation	FPSC Commission Rule 26-6.0598	12/12/24 1:49 PM	1,650.85	723
Substation	FPSC Commission Rule 26-6.0599	12/12/24 1:49 PM	2.52	1
			3,331,274.65	**53,183**

2024 Adjustments: Transmission Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transmission	FPSC Commission Rule 26-6.0455	2/12/24 8:03 PM	54.62	1
Transmission	FPSC Commission Rule 26-6.0455	2/12/24 8:03 PM	54.62	1
Transmission	FPSC Commission Rule 26-6.0455	2/12/24 8:03 PM	54.62	1
Transmission	FPSC Commission Rule 26-6.0455	2/12/24 8:03 PM	54.62	1
Transmission	FPSC Commission Rule 26-6.0455	2/12/24 8:03 PM	150.80	78
Transmission	FPSC Commission Rule 26-6.0455	2/12/24 8:03 PM	2.15	1
Transmission	FPSC Commission Rule 26-6.0455	2/12/24 8:03 PM	1.93	1
Transmission	FPSC Commission Rule 26-6.0455	2/12/24 8:03 PM	54.62	1
Transmission	FPSC Commission Rule 26-6.0455	2/12/24 8:03 PM	16.82	1
Transmission	FPSC Commission Rule 26-6.0456	2/12/24 8:03 PM	11.42	1
Transmission	FPSC Commission Rule 26-6.0457	2/12/24 8:03 PM	11.42	1
Transmission	FPSC Commission Rule 26-6.0458	2/12/24 8:03 PM	76.82	1
Transmission	FPSC Commission Rule 26-6.0459	2/12/24 8:03 PM	54.62	1
Transmission	FPSC Commission Rule 26-6.0460	2/12/24 8:03 PM	16.82	1
Transmission	FPSC Commission Rule 26-6.0461	2/12/24 8:03 PM	54.62	1
Transmission	FPSC Commission Rule 26-6.0462	2/12/24 8:15 PM	85.27	2
Transmission	FPSC Commission Rule 26-6.0463	2/12/24 8:03 PM	54.60	1
Transmission	FPSC Commission Rule 26-6.0464	2/12/24 8:03 PM	11.37	1
Transmission	FPSC Commission Rule 26-6.0465	2/12/24 8:03 PM	1.93	1
Transmission	FPSC Commission Rule 26-6.0466	2/12/24 8:03 PM	1.93	1
Transmission	FPSC Commission Rule 26-6.0467	2/12/24 8:03 PM	1.93	1
Transmission	FPSC Commission Rule 26-6.0468	2/12/24 8:03 PM	1.93	1
Transmission	FPSC Commission Rule 26-6.0469	3/6/24 10:37 AM	3,333.63	1,274
Transmission	FPSC Commission Rule 26-6.0470	3/6/24 10:37 AM	2.88	1
Transmission	FPSC Commission Rule 26-6.0471	3/6/24 10:37 AM	2,054.00	790
Transmission	FPSC Commission Rule 26-6.0472	3/6/24 10:37 AM	3.03	1
Transmission	FPSC Commission Rule 26-6.0473	3/6/24 10:37 AM	3.18	1
Transmission	FPSC Commission Rule 26-6.0474	2/12/24 8:03 PM	54.62	1
Transmission	FPSC Commission Rule 26-6.0475	2/12/24 8:03 PM	54.62	1
Transmission	FPSC Commission Rule 26-6.0476	2/12/24 8:03 PM	2,271.67	1,175
Transmission	FPSC Commission Rule 26-6.0477	2/12/24 8:03 PM	4,862.33	2,515
Transmission	FPSC Commission Rule 26-6.0478	2/12/24 8:03 PM	2,513.33	1,300
Transmission	FPSC Commission Rule 26-6.0479	3/6/24 10:37 AM	2.43	1
Transmission	FPSC Commission Rule 26-6.0480	3/6/24 10:37 AM	5,127.20	1,972
Transmission	FPSC Commission Rule 26-6.0481	3/6/24 10:37 AM	1,775.80	683
Transmission	FPSC Commission Rule 26-6.0482	3/6/24 10:37 AM	2.30	1
Transmission	FPSC Commission Rule 26-6.0483	3/6/24 10:37 AM	3.10	1
Transmission	FPSC Commission Rule 26-6.0484	3/6/24 10:37 AM	189.80	73
Transmission	FPSC Commission Rule 26-6.0485	3/6/24 10:37 AM	3.08	1
Transmission	FPSC Commission Rule 26-6.0486	3/6/24 10:37 AM	2.85	1
Transmission	FPSC Commission Rule 26-6.0487	3/6/24 10:37 AM	2.80	1
Transmission	FPSC Commission Rule 26-6.0488	3/6/24 10:37 AM	3,291.77	1,258
Transmission	FPSC Commission Rule 26-6.0489	3/6/24 10:37 AM	5,481.92	2,095
Transmission	FPSC Commission Rule 26-6.0490	3/6/24 10:37 AM	5.23	2
Transmission	FPSC Commission Rule 26-6.0491	3/6/24 10:37 AM	1,312.73	28
Transmission	FPSC Commission Rule 26-6.0492	3/6/24 10:37 AM	2.95	1
Transmission	FPSC Commission Rule 26-6.0493	3/6/24 10:37 AM	2.98	1

2024 Adjustments: Transmission Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transmission	FPSC Commission Rule 26-6.0494	5/26/24 5:59 AM	69.00	12
Transmission	FPSC Commission Rule 26-6.0495	5/26/24 5:59 AM	787.75	137
Transmission	FPSC Commission Rule 26-6.0496	6/3/24 6:03 PM	1,100.47	971
Transmission	FPSC Commission Rule 26-6.0497	5/14/24 3:14 AM	1,937.77	1,906
Transmission	FPSC Commission Rule 26-6.0498	6/28/24 5:39 AM	5,243.23	977
Transmission	FPSC Commission Rule 26-6.0499	6/28/24 5:39 AM	2,157.30	423
Transmission	FPSC Commission Rule 26-6.0500	6/29/24 7:00 PM	2,551.27	1,078
Transmission	FPSC Commission Rule 26-6.0501	6/3/24 6:03 PM	971.27	857
Transmission	FPSC Commission Rule 26-6.0502	6/3/24 6:03 PM	13.00	1
Transmission	FPSC Commission Rule 26-6.0503	6/3/24 6:03 PM	15.48	1
Transmission	FPSC Commission Rule 26-6.0504	7/10/24 8:53 AM	11.72	1
Transmission	FPSC Commission Rule 26-6.0505	7/10/24 8:53 AM	92.40	21
Transmission	FPSC Commission Rule 26-6.0506	7/30/24 6:57 PM	2,028.95	1,581
Transmission	FPSC Commission Rule 26-6.0507	6/28/24 5:39 AM	10,309.37	1,921
Transmission	FPSC Commission Rule 26-6.0508	6/28/24 5:39 AM	26.83	5
Transmission	FPSC Commission Rule 26-6.0509	6/28/24 5:39 AM	14,285.10	2,801
Transmission	FPSC Commission Rule 26-6.0510	6/29/24 7:00 PM	740.77	313
Transmission	FPSC Commission Rule 26-6.0511	6/29/24 7:00 PM	4,144.03	1,751
Transmission	FPSC Commission Rule 26-6.0512	6/29/24 7:00 PM	7.10	3
Transmission	FPSC Commission Rule 26-6.0513	6/28/24 5:39 AM	16,631.30	3,099
Transmission	FPSC Commission Rule 26-6.0514	6/28/24 5:39 AM	2,672.40	524
Transmission	FPSC Commission Rule 26-6.0515	6/29/24 7:00 PM	1,784.47	754
Transmission	FPSC Commission Rule 26-6.0516	8/3/24 1:06 PM	37.20	18
Transmission	FPSC Commission Rule 26-6.0517	8/3/24 1:06 PM	2.38	1
Transmission	FPSC Commission Rule 26-6.0518	8/3/24 1:06 PM	3.08	1
Transmission	FPSC Commission Rule 26-6.0519	7/10/24 8:53 AM	11.33	1
Transmission	FPSC Commission Rule 26-6.0520	7/10/24 8:53 AM	11.47	1
Transmission	FPSC Commission Rule 26-6.0521	7/10/24 8:53 AM	12.18	1
Transmission	FPSC Commission Rule 26-6.0522	7/10/24 8:53 AM	11.60	1
Transmission	FPSC Commission Rule 26-6.0523	6/29/24 7:00 PM	3,119.27	1,318
Transmission	FPSC Commission Rule 26-6.0524	7/10/24 8:53 AM	11.40	1
Transmission	FPSC Commission Rule 26-6.0525	7/10/24 8:53 AM	11.53	1
Transmission	FPSC Commission Rule 26-6.0526	7/10/24 8:53 AM	5,742.00	1,305
Transmission	FPSC Commission Rule 26-6.0527	7/10/24 8:53 AM	11.65	1
Transmission	FPSC Commission Rule 26-6.0528	8/3/24 1:06 PM	18.80	8
Transmission	FPSC Commission Rule 26-6.0529	8/3/24 1:06 PM	30.55	13
Transmission	FPSC Commission Rule 26-6.0530	8/3/24 1:06 PM	2.35	1
Transmission	FPSC Commission Rule 26-6.0531	8/3/24 1:06 PM	30.55	13
Transmission	FPSC Commission Rule 26-6.0532	8/3/24 1:06 PM	2.67	1
Transmission	FPSC Commission Rule 26-6.0533	7/30/24 6:57 PM	28.27	16
Transmission	FPSC Commission Rule 26-6.0534	7/30/24 6:57 PM	514.10	291
Transmission	FPSC Commission Rule 26-6.0535	7/30/24 6:57 PM	3.85	3
Transmission	FPSC Commission Rule 26-6.0536	8/3/24 1:06 PM	2,512.15	1,069
Transmission	FPSC Commission Rule 26-6.0537	8/3/24 1:06 PM	129.25	55
Transmission	FPSC Commission Rule 26-6.0538	8/3/24 1:06 PM	1,137.40	484
Transmission	FPSC Commission Rule 26-6.0539	8/3/24 1:06 PM	22.73	11
Transmission	FPSC Commission Rule 26-6.0540	7/30/24 6:57 PM	1.77	1

2024 Adjustments: Transmission Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transmission	FPSC Commission Rule 26-6.0541	8/3/24 1:06 PM	3.15	1
Transmission	FPSC Commission Rule 26-6.0542	8/3/24 1:06 PM	2.52	1
Transmission	FPSC Commission Rule 26-6.0543	8/3/24 1:06 PM	8.28	1
Transmission	FPSC Commission Rule 26-6.0544	8/13/24 7:24 PM	11,510.10	1,323
Transmission	FPSC Commission Rule 26-6.0545	8/13/24 7:24 PM	8.37	1
Transmission	FPSC Commission Rule 26-6.0546	8/13/24 7:24 PM	8.37	1
Transmission	FPSC Commission Rule 26-6.0547	8/3/24 1:06 PM	4.77	2
Transmission	FPSC Commission Rule 26-6.0548	8/16/24 7:02 AM	4.82	1
Transmission	FPSC Commission Rule 26-6.0549	8/16/24 7:02 AM	9.63	2
Transmission	FPSC Commission Rule 26-6.0550	8/16/24 7:02 AM	9.48	1
Transmission	FPSC Commission Rule 26-6.0551	8/16/24 7:02 AM	7.87	1
Transmission	FPSC Commission Rule 26-6.0552	8/16/24 7:02 AM	4.82	1
Transmission	FPSC Commission Rule 26-6.0553	8/16/24 7:02 AM	10.97	1
Transmission	FPSC Commission Rule 26-6.0554	8/16/24 7:02 AM	4.82	1
Transmission	FPSC Commission Rule 26-6.0555	8/16/24 7:02 AM	4.82	1
Transmission	FPSC Commission Rule 26-6.0556	8/16/24 7:02 AM	10.02	1
Transmission	FPSC Commission Rule 26-6.0557	8/16/24 7:02 AM	4.82	1
Transmission	FPSC Commission Rule 26-6.0558	8/16/24 7:02 AM	10.35	1
Transmission	FPSC Commission Rule 26-6.0559	8/16/24 7:02 AM	11,457.60	1,848
Transmission	FPSC Commission Rule 26-6.0560	8/16/24 7:02 AM	6.20	1
Transmission	FPSC Commission Rule 26-6.0561	8/16/24 7:05 AM	2.48	1
Transmission	FPSC Commission Rule 26-6.0562	8/16/24 7:02 AM	7.92	1
Transmission	FPSC Commission Rule 26-6.0563	8/16/24 7:02 AM	5.78	1
Transmission	FPSC Commission Rule 26-6.0564	8/16/24 7:02 AM	4.82	1
Transmission	FPSC Commission Rule 26-6.0565	8/16/24 7:02 AM	6.38	1
Transmission	FPSC Commission Rule 26-6.0566	8/16/24 7:02 AM	10.43	1
Transmission	FPSC Commission Rule 26-6.0567	8/16/24 7:02 AM	4.82	1
Transmission	FPSC Commission Rule 26-6.0568	8/16/24 7:02 AM	6.45	1
Transmission	FPSC Commission Rule 26-6.0569	8/13/24 7:24 PM	8.37	1
Transmission	FPSC Commission Rule 26-6.0570	8/13/24 7:24 PM	8.37	1
Transmission	FPSC Commission Rule 26-6.0571	8/13/24 7:24 PM	8.37	1
Transmission	FPSC Commission Rule 26-6.0572	8/13/24 7:24 PM	8.37	1
Transmission	FPSC Commission Rule 26-6.0573	8/16/24 7:02 AM	4.35	1
Transmission	FPSC Commission Rule 26-6.0574	8/16/24 7:02 AM	6.38	1
Transmission	FPSC Commission Rule 26-6.0575	8/16/24 7:02 AM	10.23	1
Transmission	FPSC Commission Rule 26-6.0576	8/16/24 7:02 AM	4.82	1
Transmission	FPSC Commission Rule 26-6.0577	8/16/24 7:02 AM	4.82	1
Transmission	FPSC Commission Rule 26-6.0578	8/16/24 7:02 AM	11.05	1
Transmission	FPSC Commission Rule 26-6.0579	8/16/24 7:02 AM	34.80	6
Transmission	FPSC Commission Rule 26-6.0580	8/16/24 7:02 AM	12,168.40	2,098
Transmission	FPSC Commission Rule 26-6.0581	8/16/24 7:02 AM	5.80	1
Transmission	FPSC Commission Rule 26-6.0582	8/16/24 7:02 AM	12.78	1
Transmission	FPSC Commission Rule 26-6.0583	8/13/24 7:24 PM	11,872.30	1,419
Transmission	FPSC Commission Rule 26-6.0584	8/13/24 7:24 PM	17.40	2
Transmission	FPSC Commission Rule 26-6.0585	8/13/24 7:24 PM	8.37	1
Transmission	FPSC Commission Rule 26-6.0586	8/13/24 7:24 PM	8.37	1
Transmission	FPSC Commission Rule 26-6.0587	8/16/24 7:05 AM	74.07	44

2024 Adjustments: Transmission Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transmission	FPSC Commission Rule 26-6.0588	8/16/24 7:02 AM	6,121.98	1,271
Transmission	FPSC Commission Rule 26-6.0589	8/16/24 7:02 AM	9.75	1
Transmission	FPSC Commission Rule 26-6.0590	8/16/24 7:02 AM	5.78	1
Transmission	FPSC Commission Rule 26-6.0591	8/16/24 7:02 AM	4.82	1
Transmission	FPSC Commission Rule 26-6.0592	8/16/24 7:02 AM	10.75	1
Transmission	FPSC Commission Rule 26-6.0593	8/16/24 7:02 AM	9.95	1
Transmission	FPSC Commission Rule 26-6.0594	8/16/24 7:02 AM	4.82	1
Transmission	FPSC Commission Rule 26-6.0595	8/16/24 7:02 AM	9.60	1
Transmission	FPSC Commission Rule 26-6.0596	8/16/24 7:02 AM	7.77	1
Transmission	FPSC Commission Rule 26-6.0597	10/9/24 11:38 PM	85.03	2
Transmission	FPSC Commission Rule 26-6.0598	10/9/24 11:36 PM	62,845.87	1,424
Transmission	FPSC Commission Rule 26-6.0599	10/9/24 11:34 PM	8,764.80	664
Transmission	FPSC Commission Rule 26-6.0600	10/9/24 10:25 PM	3,352.83	2
Transmission	FPSC Commission Rule 26-6.0601	10/9/24 10:53 PM	6,247.40	4
Transmission	FPSC Commission Rule 26-6.0602	10/29/24 10:18 AM	11.78	1
Transmission	FPSC Commission Rule 26-6.0603	10/29/24 10:18 AM	2,673.43	1,154
Transmission	FPSC Commission Rule 26-6.0604	10/29/24 10:18 AM	2,846.67	1,220
Transmission	FPSC Commission Rule 26-6.0605	10/29/24 10:18 AM	2.33	1
Transmission	FPSC Commission Rule 26-6.0606	10/29/24 10:18 AM	11.70	1
Transmission	FPSC Commission Rule 26-6.0607	10/29/24 10:18 AM	10.13	1
Transmission	FPSC Commission Rule 26-6.0608	10/29/24 10:18 AM	2.33	1
Transmission	FPSC Commission Rule 26-6.0609	10/29/24 10:18 AM	2.32	1
Transmission	FPSC Commission Rule 26-6.0610	10/29/24 10:18 AM	11.35	1
Transmission	FPSC Commission Rule 26-6.0611	10/29/24 10:18 AM	11.43	1
Transmission	FPSC Commission Rule 26-6.0612	10/29/24 10:18 AM	2.32	1
Transmission	FPSC Commission Rule 26-6.0613	10/29/24 10:18 AM	2.33	1
Transmission	FPSC Commission Rule 26-6.0614	10/29/24 10:18 AM	2.33	1
Transmission	FPSC Commission Rule 26-6.0615	10/29/24 10:18 AM	2.32	1
Transmission	FPSC Commission Rule 26-6.0616	10/29/24 10:18 AM	10.07	1
Transmission	FPSC Commission Rule 26-6.0617	10/30/24 5:55 PM	39,809.60	1,112
Transmission	FPSC Commission Rule 26-6.0618	10/31/24 9:58 PM	1,681.82	893
Transmission	FPSC Commission Rule 26-6.0619	10/31/24 9:58 PM	2,184.00	1,260
Transmission	FPSC Commission Rule 26-6.0620	10/31/24 9:58 PM	2,494.27	1,439
Transmission	FPSC Commission Rule 26-6.0621	10/31/24 9:58 PM	1,540.93	889
Transmission	FPSC Commission Rule 26-6.0622	10/31/24 9:58 PM	1,818.27	1,049
Transmission	FPSC Commission Rule 26-6.0623	10/29/24 10:18 AM	1,920.52	829
Transmission	FPSC Commission Rule 26-6.0624	10/29/24 10:18 AM	2.32	1
Transmission	FPSC Commission Rule 26-6.0625	10/29/24 10:18 AM	2.32	1
Transmission	FPSC Commission Rule 26-6.0626	10/29/24 10:18 AM	4,543.00	1,947
Transmission	FPSC Commission Rule 26-6.0627	10/29/24 10:18 AM	11.63	1
Transmission	FPSC Commission Rule 26-6.0628	10/29/24 10:18 AM	11.55	1
Transmission	FPSC Commission Rule 26-6.0629	10/29/24 10:18 AM	2.33	1
Transmission	FPSC Commission Rule 26-6.0630	10/29/24 10:18 AM	2.33	1
Transmission	FPSC Commission Rule 26-6.0631	11/11/24 10:19 AM	4,985.20	2,904
Transmission	FPSC Commission Rule 26-6.0632	11/11/24 10:19 AM	1,074.63	626
Transmission	FPSC Commission Rule 26-6.0633	11/11/24 10:19 AM	6,691.57	3,898
Transmission	FPSC Commission Rule 26-6.0634	11/11/24 10:19 AM	1.72	1

2024 Adjustments: Transmission Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transmission	FPSC Commission Rule 26-6.0635	11/11/24 10:19 AM	1.98	1
Transmission	FPSC Commission Rule 26-6.0636	11/11/24 10:19 AM	751.90	438
Transmission	FPSC Commission Rule 26-6.0637	11/11/24 10:19 AM	1,009.40	588
Transmission	FPSC Commission Rule 26-6.0638	11/11/24 10:19 AM	1.97	1
Transmission	FPSC Commission Rule 26-6.0639	11/11/24 10:19 AM	1.88	1
Transmission	FPSC Commission Rule 26-6.0640	11/11/24 10:19 AM	2.23	1
Transmission	FPSC Commission Rule 26-6.0641	11/11/24 10:19 AM	1.72	1
Transmission	FPSC Commission Rule 26-6.0642	10/29/24 10:18 AM	2.32	1
Transmission	FPSC Commission Rule 26-6.0643	10/29/24 10:18 AM	4,281.20	1,848
Transmission	FPSC Commission Rule 26-6.0644	10/29/24 10:18 AM	4,827.67	2,069
Transmission	FPSC Commission Rule 26-6.0645	10/29/24 10:18 AM	4.67	2
Transmission	FPSC Commission Rule 26-6.0646	10/29/24 10:18 AM	2.33	1
Transmission	FPSC Commission Rule 26-6.0647	10/29/24 10:18 AM	2.32	1
Transmission	FPSC Commission Rule 26-6.0648	10/29/24 10:18 AM	2.32	1
Transmission	FPSC Commission Rule 26-6.0649	10/29/24 10:18 AM	2.33	1
Transmission	FPSC Commission Rule 26-6.0650	11/23/24 4:18 AM	6,579.83	97
Transmission	FPSC Commission Rule 26-6.0651	10/30/24 5:55 PM	35.80	1
Transmission	FPSC Commission Rule 26-6.0652	10/30/24 5:55 PM	35.80	1
Transmission	FPSC Commission Rule 26-6.0653	10/30/24 5:55 PM	393.80	11
Transmission	FPSC Commission Rule 26-6.0654	10/31/24 9:58 PM	2,725.18	1,447
Transmission	FPSC Commission Rule 26-6.0655	10/31/24 9:58 PM	22.60	12
Transmission	FPSC Commission Rule 26-6.0656	10/31/24 9:58 PM	17.33	10
Transmission	FPSC Commission Rule 26-6.0657	10/31/24 9:58 PM	32.93	19
Transmission	FPSC Commission Rule 26-6.0658	10/31/24 9:58 PM	1.73	1
Transmission	FPSC Commission Rule 26-6.0659	10/31/24 9:58 PM	1,178.67	680
Transmission	FPSC Commission Rule 26-6.0660	11/11/24 10:19 AM	2.33	1
Transmission	FPSC Commission Rule 26-6.0661	11/11/24 10:19 AM	2.00	1
Transmission	FPSC Commission Rule 26-6.0662	11/11/24 10:19 AM	2.15	1
Transmission	FPSC Commission Rule 26-6.0663	11/11/24 10:19 AM	1.72	1
Transmission	FPSC Commission Rule 26-6.0664	10/30/24 5:55 PM	15,752.00	440
Transmission	FPSC Commission Rule 26-6.0665	10/30/24 5:55 PM	35.80	1
Transmission	FPSC Commission Rule 26-6.0666	10/31/24 9:59 PM	17.00	10
Transmission	FPSC Commission Rule 26-6.0667	10/31/24 9:58 PM	2,395.60	1,272
Transmission	FPSC Commission Rule 26-6.0668	10/31/24 9:58 PM	1,293.07	746
Transmission	FPSC Commission Rule 26-6.0669	10/31/24 9:58 PM	1,866.80	1,077
Transmission	FPSC Commission Rule 26-6.0670	10/31/24 9:58 PM	2,137.20	1,233
Transmission	FPSC Commission Rule 26-6.0671	10/31/24 9:58 PM	1.73	1
Transmission	FPSC Commission Rule 26-6.0672	11/11/24 10:19 AM	1.80	1
Transmission	FPSC Commission Rule 26-6.0673	11/11/24 10:19 AM	4,382.65	2,553
Transmission	FPSC Commission Rule 26-6.0674	11/11/24 10:19 AM	1.72	1
Transmission	FPSC Commission Rule 26-6.0675	11/11/24 10:19 AM	2.05	1
Transmission	FPSC Commission Rule 26-6.0676	11/11/24 10:19 AM	1.92	1
			373,287.88	**81,003**

Feeder Specific Report

Displays the CMI (customer minutes of interruption), CI (customer interruptions), customer count it serves, and overhead/underground feeder and lateral mileage for each of the distribution circuits on Tampa Electric system.

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the
13001	South Hillsborough	N/A	12.29	830	36169.033	396	N/A	5.23	674	18984.633	77	0
13002	South Hillsborough	N/A	0.26	18	0	0	N/A	0.83	11	0	0	0
13003	South Hillsborough	N/A	23.71	573	176565.383	421	N/A	2.52	206	6078.700	45	0
13004	Dade City	N/A	10.06	520	20700.200	98	N/A	14.75	929	359.000	3	0
13005	Dade City	N/A	6.2	264	6517.883	61	N/A	2.69	442	0	0	0
13006	Dade City	N/A	21.75	798	180716.567	2974	N/A	13.58	943	39059.317	186	0
13007	Plant City	N/A	29.46	499	155503.383	1727	N/A	4.1	76	9349.317	23	0
13008	Plant City	N/A	17.58	393	16335.483	202	N/A	2.46	32	7207.633	73	0
13009	Plant City	N/A	3.01	71	487.300	3	N/A	0.99	45	49.017	1	0
13010	Plant City	N/A	7.17	459	282937.750	3792	N/A	15.4	1322	20365.200	178	0
13011	Plant City	N/A	27.88	1573	13055.250	148	N/A	1.09	92	0	0	0
13012	Western	N/A	0.28	66	0	0	N/A	0.11	11	0	0	0
13013	Western	N/A	0.17	15	6284.567	36	N/A	1.4	190	1172.583	2	0
13016	Western	N/A	0.72	163	5002.550	21	N/A	0.52	103	0	0	0
13017	South Hillsborough	N/A	8.55	367	75315.000	333	N/A	9.75	1135	32654.633	92	0
13019	South Hillsborough	N/A	11.07	658	79258.850	2027	N/A	9.82	993	5038.250	21	0
13020	South Hillsborough	N/A	17.47	1242	19576.333	145	N/A	15.82	1334	64160.917	656	0
13021	Central	N/A	1.98	164	4233.683	10	N/A	6.24	1115	18319.283	90	0
13022	Central	N/A	3.28	463	16033.850	130	N/A	1.01	353	13968.083	151	0
13023	Central	N/A	8.34	1023	17244.817	225	N/A	2.04	399	15705.950	54	0
13024	Central	N/A	7.53	854	36922.950	279	N/A	1.21	182	23562.650	433	0
13026	Central	N/A	1.89	171	2267.300	64	N/A	6.78	1676	10795.717	81	0
13027	Central	N/A	9.08	699	20736.850	101	N/A	2.11	426	804.283	5	0
13028	Central	N/A	5.29	601	33616.450	122	N/A	4.59	1463	7434.667	64	0
13029	Central	N/A	5.66	512	56497.250	746	N/A	3.78	681	0	0	0
13030	Winter Haven	N/A	28.15	833	17970.950	154	N/A	14.65	1039	21561.783	132	0
13031	Winter Haven	N/A	10.7	462	147209.550	665	N/A	12.65	872	1341.250	5	0
13034	Central	N/A	9.87	1294	7771.267	41	N/A	1.47	243	1848.300	3	0
13035	Central	N/A	4.99	485	29286.033	225	N/A	0.79	95	0	0	0
13036	Central	N/A	8.88	982	22303.683	169	N/A	1.41	274	5208.950	101	0

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the
13037	Central	N/A	5.52	596	13728.417	60	N/A	1.66	343	19816.583	38	0
13038	Eastern	N/A	6.37	374	35709.283	340	N/A	5.46	320	8096.383	35	0
13039	Eastern	N/A	7.28	450	20918.183	118	N/A	8.53	755	0	0	0
13040	Eastern	N/A	0.34	7	5712.033	47	N/A	12.95	1069	69306.650	590	0
13041	Eastern	N/A	5.42	315	36461.900	259	N/A	14.76	1019	3847.050	8	0
13042	Central	N/A	8.39	1176	19757.833	80	N/A	0.42	130	1112.467	3	0
13043	Central	N/A	12.7	1799	101144.367	657	N/A	2.15	552	1298.817	13	0
13044	Central	N/A	10.97	1628	39072.267	277	N/A	0.38	14	752.433	2	0
13045	Central	N/A	6.88	998	94267.883	1410	N/A	0.19	34	0	0	0
13046	Central	N/A	7.86	1078	16714.150	159	N/A	1.52	120	3166.883	8	0
13047	Central	N/A	3.43	567	30858.733	282	N/A	0.77	208	240.000	1	0
13048	Central	N/A	7.96	1256	27807.400	132	N/A	0.79	55	0	0	0
13049	Central	N/A	5.74	697	5988.750	29	N/A	2.32	501	10634.700	141	0
13050	Central	N/A	0.05	0	332.050	1	N/A	0.82	26	0	0	0
13051	Central	N/A	1.41	77	1025.883	9	N/A	4.47	955	2625.200	29	0
13052	Central	N/A	0.64	40	0	0	N/A	0.63	140	91.467	2	0
13053	Central	N/A	8.58	1153	33556.600	191	N/A	3.58	403	8314.567	16	0
13054	Central	N/A	0.12	0	619.300	3	N/A	1.17	440	0	0	0
13055	Central	N/A	0.12	0	0	0	N/A	0.38	27	370.167	1	0
13057	Central	N/A	0.18	4	0	0	N/A	1.04	176	0	0	0
13059	Western	N/A	6.49	702	83928.533	1248	N/A	0.76	141	34.533	1	0
13060	Western	N/A	4.67	786	532.333	1	N/A	1.93	570	10783.667	109	0
13061	Western	N/A	4	547	10228.800	55	N/A	0.69	31	0	0	0
13062	Western	N/A	4.68	588	29476.150	157	N/A	0.15	15	0	0	0
13063	Western	N/A	5.31	713	1108.217	13	N/A	8.26	1989	3398.900	8	0
13064	Western	N/A	8.86	1004	31395.000	195	N/A	4.89	811	18443.000	39	0
13065	Western	N/A	8.73	1066	86509.417	287	N/A	2.36	472	41962.950	141	0
13066	Western	N/A	2.95	458	15248.233	28	N/A	0	0	0	0	0
13067	Western	N/A	5.36	689	10048.550	179	N/A	0.42	14	0	0	0
13068	Western	N/A	5.56	845	59953.450	333	N/A	1.57	338	210.250	17	0
13069	Western	N/A	3.87	534	518.667	19	N/A	1.3	405	7431.633	25	0
13070	Western	N/A	13.25	381	25457.517	119	N/A	5.89	199	98.733	2	0
13071	Western	N/A	1.64	69	251562.000	4885	N/A	30.17	1420	96576.717	189	0
13072	Western	N/A	4.92	587	136072.950	639	N/A	0.73	43	14770.717	118	0
13073	Western	N/A	3.45	464	39500.667	111	N/A	7.34	347	3869.950	21	0
13076	Western	N/A	2.14	102	8942.367	181	N/A	1.64	124	0	0	0
13077	Western	N/A	7.8	660	3830.667	27	N/A	1.92	55	620.183	5	0
13078	Western	N/A	7.13	970	50160.050	165	N/A	1	124	0	0	0
13079	Western	N/A	3.97	526	23110.417	114	N/A	4.47	839	3855.267	18	0
13080	Western	N/A	7.89	1111	5894.950	137	N/A	1.38	539	23844.767	58	0
13081	Western	N/A	2.9	454	12014.983	154	N/A	1.71	700	0	0	0

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the
13082	Western	N/A	6.38	792	73214.633	765	N/A	1	309	1963.967	5	0
13084	Eastern	N/A	3.92	166	663.217	19	N/A	2.03	87	123.867	1	0
13085	Eastern	N/A	2.44	61	1912.800	16	N/A	0.41	8	0	0	0
13086	Eastern	N/A	3.32	266	6544.450	26	N/A	1.03	13	582.917	2	0
13087	Eastern	N/A	4.27	364	28693.567	181	N/A	2.59	325	0	0	0
13088	Central	N/A	3.46	412	7207.850	55	N/A	1.63	337	0	0	0
13089	Central	N/A	7.31	848	5328.217	50	N/A	1.3	363	4764.000	51	0
13090	Central	N/A	4.67	637	41400.300	259	N/A	1.52	350	4286.517	46	0
13091	Central	N/A	6.12	1011	5352.183	15	N/A	0.09	24	372.883	5	0
13092	Central	N/A	5.55	649	23515.700	159	N/A	0.36	54	428.683	1	0
13093	Central	N/A	3.95	699	4544.800	69	N/A	1.57	86	1400.683	2	0
13094	Central	N/A	6.13	807	9611.633	152	N/A	2.56	474	1727.250	5	0
13095	Central	N/A	3.85	560	27206.383	72	N/A	0.33	98	603.783	1	0
13096	Central	N/A	19.61	679	212010.467	3544	N/A	12.43	543	10759.650	105	0
13097	Central	N/A	14.41	570	84476.217	627	N/A	26.29	805	20906.283	67	0
13098	Central	N/A	10.1	558	24160.417	178	N/A	10.74	606	249.417	5	0
13099	Central	N/A	8.71	333	187170.233	2549	N/A	26.29	915	10479.433	26	0
13100	Central	N/A	5.73	295	29370.200	268	N/A	1.05	77	2418.167	33	0
13101	Central	N/A	2.29	345	24366.050	362	N/A	0.73	190	132.700	1	0
13102	Central	N/A	4.73	766	13035.083	172	N/A	2.03	111	222.033	2	0
13103	Central	N/A	3.39	581	7865.633	58	N/A	0.41	16	1859.200	5	0
13104	Central	N/A	3.91	416	73688.467	636	N/A	6.16	607	29173.200	25	0
13105	Central	N/A	6.29	473	25300.733	103	N/A	5.47	631	5892.533	37	0
13106	Central	N/A	1.14	161	14019.800	105	N/A	8.66	2274	39491.417	119	0
13107	Central	N/A	3.12	513	53666.767	821	N/A	7.49	1351	8843.417	58	0
13109	Western	N/A	3.86	718	31744.367	94	N/A	4.55	1853	552.650	3	0
13110	Western	N/A	0.96	41	1014.000	8	N/A	3.17	373	273.150	2	0
13111	Western	N/A	3.19	463	44716.150	420	N/A	2.34	390	146.067	1	0
13112	Western	N/A	11.56	1263	124214.167	1891	N/A	7.85	1395	221558.067	1343	0
13113	Western	N/A	1.96	295	20287.383	83	N/A	1.91	300	0	0	0
13114	Western	N/A	3.28	307	16690.233	44	N/A	11.01	3633	17252.850	12	0
13115	Winter Haven	N/A	6.61	495	2282.517	46	N/A	2.85	210	6176.533	62	0
13116	Winter Haven	N/A	0	0	0	0	N/A	0	0	0	0	0
13117	Winter Haven	N/A	11.79	715	258741.450	1010	N/A	38.61	1594	121230.833	1566	0
13118	Winter Haven	N/A	8.51	667	72455.367	2339	N/A	29.3	1713	31537.100	86	0
13119	Plant City	N/A	1.61	31	64.083	1	N/A	2.14	631	0	0	0
13120	Plant City	N/A	2.57	63	21072.967	150	N/A	10.99	961	5782.650	27	0
13121	Plant City	N/A	3.54	91	8517.867	98	N/A	7.38	705	0	0	0
13122	Plant City	N/A	4.02	326	35753.100	93	N/A	1.12	71	6515.100	19	0
13123	Plant City	N/A	7.57	747	23053.367	119	N/A	1.64	281	1034.817	11	0
13124	Plant City	N/A	6.79	342	31343.300	222	N/A	3.59	183	4849.333	41	0

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the
13125	Plant City	N/A	4	432	12853.183	102	N/A	3.73	373	0	0	0
13126	Plant City	N/A	16.88	474	10658.867	68	N/A	3.84	289	3104.583	9	0
13127	Eastern	N/A	5.35	275	55225.500	285	N/A	20.46	1449	44155.617	271	0
13128	Eastern	N/A	9.28	574	266784.150	1054	N/A	7.92	619	18962.967	68	0
13129	Eastern	N/A	2.86	250	24831.233	128	N/A	5.51	422	2728.017	19	0
13130	Eastern	N/A	8.48	456	23919.900	270	N/A	6.82	875	1976.867	20	0
13132	Eastern	N/A	1.63	37	756.950	16	N/A	1.84	116	0	0	0
13133	Eastern	N/A	13.51	1366	293866.717	6812	N/A	4.96	1065	12985.583	414	0
13134	Eastern	N/A	2.15	172	34781.933	108	N/A	2.64	214	130.117	1	0
13136	Western	N/A	4.34	492	37143.900	195	N/A	0.49	8	0	0	0
13137	Western	N/A	0.79	138	0	0	N/A	2.47	781	0	0	0
13138	Western	N/A	2.08	329	5979.083	56	N/A	5.65	693	0	0	0
13139	Western	N/A	5.85	554	34296.283	617	N/A	3.38	930	78957.350	215	0
13140	Western	N/A	3.19	445	32702.850	285	N/A	1.51	896	0	0	0
13141	Western	N/A	2.49	492	25927.067	195	N/A	1.04	500	5835.733	15	0
13142	Western	N/A	2.59	597	10172.667	57	N/A	1.94	1182	57930.100	282	0
13143	Western	N/A	7.74	1149	44518.700	330	N/A	0.65	158	1785.667	25	0
13146	Plant City	N/A	28.08	647	144127.250	640	N/A	3.45	83	32.567	1	0
13147	Plant City	N/A	31.48	1019	291260.450	1897	N/A	12.44	675	6645.800	60	0
13148	Plant City	N/A	29.45	656	15003.183	91	N/A	1.44	54	1644.667	7	0
13150	Winter Haven	N/A	4.36	378	9750.183	293	N/A	6.22	228	1304.067	4	0
13151	Winter Haven	N/A	1.81	38	132.533	2	N/A	13.66	2148	23469.033	89	0
13152	Winter Haven	N/A	3.43	323	49669.683	233	N/A	8.76	616	6193.467	8	0
13153	Winter Haven	N/A	7.23	697	47850.433	174	N/A	4.47	344	15326.383	153	0
13154	Western	N/A	3.65	397	117189.883	410	N/A	8.83	1474	70159.917	873	0
13155	Western	N/A	3.78	386	37096.383	203	N/A	12.18	1274	44693.967	209	0
13156	Western	N/A	2.22	209	2616.967	8	N/A	3.93	921	39.433	1	0
13157	Western	N/A	0.87	63	18673.617	221	N/A	10.34	573	37688.533	152	0
13158	Central	N/A	0	0	0	0	N/A	0	0	0	0	0
13159	Central	N/A	9.3	1057	46816.517	266	N/A	1.61	272	7737.183	80	0
13160	Central	N/A	4.95	551	8674.467	53	N/A	2.04	388	43137.767	111	0
13161	Western	N/A	3.51	448	30827.083	155	N/A	0.19	59	71.683	1	0
13162	Western	N/A	5.74	639	8565.050	42	N/A	1.47	275	30.983	1	0
13163	Western	N/A	5.62	863	12848.367	65	N/A	0.59	137	198.933	1	0
13164	Western	N/A	5.82	711	90771.850	588	N/A	0.9	45	0	0	0
13165	Western	N/A	1.81	274	10136.267	71	N/A	0.35	55	4088.967	20	0
13166	Western	N/A	2.79	767	4981.733	62	N/A	1.25	535	75.833	1	0
13167	Western	N/A	7.72	1341	6082.667	38	N/A	0.89	431	300.917	1	0
13169	Eastern	N/A	0.79	4	9159.417	43	N/A	10.43	1229	16777.417	66	0
13170	Eastern	N/A	0.29	1	0	0	N/A	16.85	2128	11613.383	27	0
13171	Eastern	N/A	5.31	228	59107.983	360	N/A	16.9	1444	4668.483	37	0

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the
13172	Eastern	N/A	6.65	393	1419.183	12	N/A	3.87	274	8879.617	59	0
13173	Eastern	N/A	3.27	469	13772.117	86	N/A	15.12	2288	25.667	1	0
13174	Eastern	N/A	1.9	15	30168.467	356	N/A	14.49	3143	6030.500	155	0
13175	Central	N/A	16.68	1857	48355.633	238	N/A	1.09	46	5914.700	18	0
13176	Central	N/A	7.79	775	3842.483	27	N/A	3.71	199	78.750	1	0
13177	Central	N/A	3.28	335	39005.117	252	N/A	0.45	50	0	0	0
13178	Central	N/A	3.09	108	19582.117	78	N/A	0.7	166	553.167	1	0
13180	Central	N/A	2.15	268	177.300	54	N/A	0.62	247	12402.600	21	0
13181	Central	N/A	3.68	302	260113.717	1354	N/A	1.46	893	26716.400	159	0
13183	Central	N/A	6.53	355	4613.083	35	N/A	0.62	37	0	0	0
13184	Central	N/A	1.48	70	256.350	9	N/A	0.53	38	240.000	1	0
13185	Central	N/A	2.54	222	11976.600	214	N/A	7.8	1058	12088.000	120	0
13186	Central	N/A	4.57	487	2139.950	34	N/A	0.67	117	664.267	1	0
13187	Central	N/A	6.01	550	286782.467	145	N/A	5.01	672	10214.950	3	0
13188	Central	N/A	4.87	415	11991.817	70	N/A	6.01	631	4002.667	10	0
13189	Western	N/A	2.2	143	9441.917	127	N/A	1.92	77	10956.950	13	0
13190	Western	N/A	7.75	582	24064.350	188	N/A	9.09	487	1141.067	7	0
13191	Western	N/A	5.33	471	28982.983	131	N/A	4.44	303	6771.467	47	0
13192	Western	N/A	3.95	285	115.733	8	N/A	8.19	833	21197.833	74	0
13193	Western	N/A	0	0	564.217	1	N/A	10.23	828	42.900	1	0
13194	Western	N/A	4.96	187	34161.917	421	N/A	2.22	122	14067.450	190	0
13195	Western	N/A	0.72	70	0	0	N/A	2.12	15	0	0	0
13198	Western	N/A	3.81	545	12479.883	105	N/A	2.89	222	2370.300	17	0
13199	Western	N/A	4.36	837	7062.267	117	N/A	1.18	197	23.683	1	0
13200	Western	N/A	0.36	22	0	0	N/A	0.39	5	0	0	0
13201	Western	N/A	2.75	389	963.100	1	N/A	0.71	474	47.100	3	0
13204	Central	N/A	2.85	308	92840.883	595	N/A	8.14	1406	25476.683	191	0
13205	Central	N/A	1.06	66	0	0	N/A	7.99	751	81.017	1	0
13206	Western	N/A	10.07	1434	43337.817	441	N/A	0.16	30	1564.850	7	0
13207	Western	N/A	9.06	884	36365.900	333	N/A	0.97	53	2089.450	33	0
13208	Western	N/A	2.93	306	6697.933	52	N/A	4.39	170	0	0	0
13210	Western	N/A	6.63	815	36620.067	253	N/A	2.23	61	695.617	7	0
13211	Eastern	N/A	1.43	62	9587.067	67	N/A	7.22	605	0	0	0
13213	Eastern	N/A	17.16	688	47937.983	1105	N/A	12.59	1083	5860.150	20	0
13214	Eastern	N/A	5.97	425	16813.333	194	N/A	4.55	238	3290.400	9	0
13215	Eastern	N/A	0.05	2	0	0	N/A	0.28	3	0	0	0
13217	Western	N/A	2.79	307	26371.933	259	N/A	1.85	188	0	0	0
13218	Western	N/A	5.51	578	10183.050	89	N/A	2.09	768	0	0	0
13219	Western	N/A	8.79	1305	46792.933	331	N/A	2.2	369	3963.950	26	0
13220	Western	N/A	4.55	406	278594.467	658	N/A	1.51	294	2188.000	43	0
13221	Central	N/A	3.83	131	532.700	2	N/A	5.71	1268	17178.767	152	0

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the
13222	Central	N/A	2.54	186	2689.167	18	N/A	1.89	38	56.417	5	0
13223	Central	N/A	4.48	327	30823.183	329	N/A	1.52	103	34.983	1	0
13224	Central	N/A	9.62	949	21299.450	165	N/A	1.34	360	0	0	0
13225	Eastern	N/A	5.77	430	27410.183	307	N/A	4.6	377	2042.283	12	0
13226	Eastern	N/A	3.04	331	1003.700	7	N/A	7.6	956	23177.917	267	0
13227	Eastern	N/A	5.94	457	26771.650	186	N/A	9.91	836	39262.483	684	0
13228	Eastern	N/A	3.94	247	53484.983	183	N/A	5.66	1188	2843.833	51	0
13229	Eastern	N/A	8.07	655	34831.800	223	N/A	4.39	623	7394.267	73	0
13230	Eastern	N/A	3.71	226	6203.517	45	N/A	5.09	874	1638.567	10	0
13231	Eastern	N/A	4.64	418	164519.500	1563	N/A	8.64	752	5331.250	25	0
13233	South Hillsborough	N/A	5.99	80	303.383	2	N/A	18.86	1747	0	0	0
13235	South Hillsborough	N/A	0.01	0	0	0	N/A	30.87	3010	3162.133	8	0
13236	South Hillsborough	N/A	2.75	28	889.600	5	N/A	21.42	2059	6726.667	60	0
13237	South Hillsborough	N/A	0.1	0	310.250	1	N/A	23.83	2032	0	0	0
13238	South Hillsborough	N/A	0.02	0	661.117	2	N/A	25.92	1951	2622.167	9	0
13239	South Hillsborough	N/A	0.92	14	5856.450	302	N/A	7.41	947	8422.317	76	0
13240	South Hillsborough	N/A	0.87	11	0	0	N/A	11.85	1000	49.383	1	0
13241	Plant City	N/A	10.99	859	15690.750	80	N/A	5.92	574	31442.133	79	0
13242	Plant City	N/A	10.62	325	12965.233	122	N/A	3.67	385	0	0	0
13243	Plant City	N/A	9.38	829	113305.667	571	N/A	5.98	450	0	0	0
13253	Central	N/A	0.09	0	0	0	N/A	0	0	0	0	0
13254	South Hillsborough	N/A	21.59	681	40670.417	366	N/A	11.72	1056	358.517	1	0
13256	South Hillsborough	N/A	21.71	552	42068.083	551	N/A	7.04	758	10069.600	44	0
13258	Central	N/A	0	0	0	0	N/A	0.4	24	0	0	0
13259	Central	N/A	0	0	0	0	N/A	1.46	66	0	0	0
13260	Central	N/A	0	0	0	0	N/A	0	0	0	0	0
13261	Central	N/A	0	0	0	0	N/A	1.25	11	0	0	0
13262	Central	N/A	0	0	0	0	N/A	0.01	1	0	0	0
13263	Central	N/A	0	0	0	0	N/A	0.3	2	0	0	0
13264	Central	N/A	0	0	0	0	N/A	1.62	815	0	0	0
13265	Central	N/A	0	0	0	0	N/A	0.92	58	0	0	0
13267	Plant City	N/A	0	0	0	0	N/A	1.28	14	0	0	0
13268	Plant City	N/A	2.43	78	1157.267	11	N/A	1.52	14	0	0	0

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the
13269	Plant City	N/A	1.67	31	524.583	3	N/A	3.91	91	0	0	0
13270	Western	N/A	0.36	29	5839.600	83	N/A	4.31	490	0	0	0
13275	Western	N/A	0	0	0	0	N/A	1.35	4	0	0	0
13276	Western	N/A	0	0	0	0	N/A	2.39	12	0	0	0
13278	Winter Haven	N/A	7.9	661	434778.050	3980	N/A	1.19	93	18165.483	34	0
13279	Winter Haven	N/A	9.15	941	10853.167	92	N/A	1.71	51	75.783	2	0
13280	Winter Haven	N/A	2.75	95	42.750	1	N/A	0.62	14	520.967	3	0
13281	Winter Haven	N/A	0	0	0	0	N/A	0.18	5	0	0	0
13282	Winter Haven	N/A	0	0	0	0	N/A	0.11	3	0	0	0
13283	Winter Haven	N/A	0	0	0	0	N/A	0.23	6	0	0	0
13288	Winter Haven	N/A	1.02	86	235.083	7	N/A	2	120	1007.900	2	0
13289	Winter Haven	N/A	3.95	265	348012.267	953	N/A	2.29	380	209.283	1	0
13290	Winter Haven	N/A	5.05	565	46910.617	736	N/A	1.24	342	3754.350	11	0
13291	Winter Haven	N/A	6.7	558	148.300	1	N/A	7.71	923	24657.900	139	0
13292	Winter Haven	N/A	6.57	530	2613.750	55	N/A	4.97	579	0	0	0
13293	Winter Haven	N/A	8.31	981	16062.583	122	N/A	4.12	576	1061.283	33	0
13294	Winter Haven	N/A	13.49	703	14349.000	136	N/A	4.29	223	980.317	7	0
13295	Winter Haven	N/A	2.72	276	9012.367	119	N/A	11.22	930	0	0	0
13296	Winter Haven	N/A	5.87	338	28095.717	2216	N/A	28.36	1943	12452.183	71	0
13297	Winter Haven	N/A	3.8	289	117291.283	559	N/A	7.93	893	2503.467	8	0
13298	Winter Haven	N/A	136.11	1173	123319.233	4801	N/A	6.67	61	244.983	3	0
13299	Winter Haven	N/A	8.64	350	42960.133	405	N/A	8.09	593	626.217	3	0
13302	South Hillsborough	N/A	2.81	209	162761.150	698	N/A	20.29	1496	216932.083	2269	0
13303	South Hillsborough	N/A	26.3	889	324574.100	1216	N/A	2.8	342	287.017	3	0
13304	South Hillsborough	N/A	0.76	9	421.100	1	N/A	23.67	2106	44414.267	228	0
13305	South Hillsborough	N/A	0	0	0	0	N/A	23.44	1748	4.550	2	0
13308	Winter Haven	N/A	6.19	617	33181.900	1319	N/A	3.6	544	0	0	0
13309	Winter Haven	N/A	2.5	264	0	0	N/A	0.36	46	0	0	0
13310	Winter Haven	N/A	2.05	363	6149.183	77	N/A	0.68	220	0	0	0
13311	Winter Haven	N/A	5.75	677	3091.250	14	N/A	0.63	100	0	0	0
13312	Winter Haven	N/A	3.93	463	22863.250	279	N/A	2.57	404	1172.450	4	0
13313	Winter Haven	N/A	2.28	234	6377.950	43	N/A	1.37	146	0	0	0
13314	Winter Haven	N/A	0.98	26	20400.800	271	N/A	3.36	402	23139.633	207	0
13315	Winter Haven	N/A	0	0	0	0	N/A	0.33	14	0	0	0
13317	Western	N/A	0.78	0	0	0	N/A	5.5	1434	6828.850	21	0
13318	Western	N/A	0	0	0	0	N/A	0	0	0	0	0
13319	Western	N/A	0	0	0	0	N/A	0	0	0	0	0
13320	Western	N/A	0	0	0	0	N/A	0	0	0	0	0

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the
13321	Western	N/A	0	0	0	0	N/A	1.47	6	0	0	0
13322	Western	N/A	0.01	0	0	0	N/A	1.63	667	395.083	2	0
13323	Western	N/A	0.36	47	0	0	N/A	4.61	253	12507.000	12	0
13324	Eastern	N/A	8.95	353	21639.100	180	N/A	1	21	0	0	0
13325	Eastern	N/A	8.99	281	85322.933	321	N/A	1.1	18	0	0	0
13326	Eastern	N/A	0.73	4	101495.183	1403	N/A	3.31	118	0	0	0
13327	Eastern	N/A	2.63	21	375.000	4	N/A	0.77	13	0	0	0
13328	Dade City	N/A	6.22	498	9572.367	30	N/A	1.55	72	505.850	5	0
13329	Dade City	N/A	7.72	465	6917.100	72	N/A	3.27	175	4240.033	14	0
13330	Dade City	N/A	35.46	1288	116467.083	4400	N/A	11.91	480	8218.067	28	0
13331	Dade City	N/A	27.67	1143	251458.733	1421	N/A	4.38	152	13908.817	143	0
13332	Western	N/A	1.82	74	584.467	13	N/A	11.12	1704	0	0	0
13333	Western	N/A	1.07	95	2828.767	13	N/A	3.38	375	0	0	0
13334	Western	N/A	3.66	600	16411.233	169	N/A	2.58	302	31.800	1	0
13335	Western	N/A	1.38	33	2248.000	40	N/A	1.8	27	240.000	1	0
13336	Western	N/A	2.45	54	972.967	13	N/A	2.94	208	1500.633	13	0
13337	Western	N/A	2.77	231	81139.200	1168	N/A	5.58	2108	15753.517	91	0
13338	Western	N/A	2.97	127	5344.433	73	N/A	2.33	240	0	0	0
13339	Western	N/A	0.48	3	77621.883	441	N/A	5.41	1230	103706.800	593	0
13340	South Hillsborough	N/A	1.41	29	0	0	N/A	9.18	1268	7293.583	13	0
13341	South Hillsborough	N/A	3.61	98	59590.017	785	N/A	25.83	2271	0	0	0
13342	South Hillsborough	N/A	8.41	396	6315.533	12	N/A	8.56	979	676.867	2	0
13343	South Hillsborough	N/A	2.29	55	1593.200	3	N/A	11.36	1346	0	0	0
13344	South Hillsborough	N/A	0.53	18	0	0	N/A	1.43	266	0	0	0
13346	South Hillsborough	N/A	0.7	10	8068.833	769	N/A	9.95	894	2507.667	26	0
13348	Central	N/A	3.56	636	51626.267	453	N/A	5.82	1826	10742.767	62	0
13349	Central	N/A	0.09	0	0	0	N/A	0.1	3	0	0	0
13350	Central	N/A	0.15	69	109.117	2	N/A	1.84	386	0	0	0
13351	Central	N/A	2.72	395	21056.050	176	N/A	5.36	1361	1739.333	116	0
13352	Central	N/A	0.74	130	6869.917	63	N/A	5.62	1632	7258.683	26	0
13353	Central	N/A	0	0	0	0	N/A	0.85	78	0	0	0
13354	Central	N/A	1.16	14	423133.950	1602	N/A	8.58	1756	44100.183	183	0
13355	Central	N/A	0	0	0	0	N/A	0.06	2	0	0	0
13358	Western	N/A	4.26	949	16058.100	65	N/A	1.44	588	0	0	0
13359	Western	N/A	6.17	640	94977.867	1425	N/A	2.48	181	14.650	1	0
13360	Western	N/A	0.06	10	0	0	N/A	0.02	46	0	0	0

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the
13362	Central	N/A	0	0	133.450	3	N/A	0.82	233	0	0	0
13363	Central	N/A	0	0	0	0	N/A	0.01	0	0	0	0
13364	Central	N/A	0.09	0	0	0	N/A	0.35	299	0	0	0
13365	Central	N/A	2.04	344	20795.617	294	N/A	8.07	940	4209.333	88	0
13366	Central	N/A	0	0	0	0	N/A	0.41	5	0	0	0
13367	Central	N/A	0.01	0	0	0	N/A	0.72	214	150.333	1	0
13368	Central	N/A	0	0	0	0	N/A	0	0	0	0	0
13369	Central	N/A	0	0	0	0	N/A	0	0	0	0	0
13370	Winter Haven	N/A	8.06	781	23247.800	148	N/A	4.95	504	16599.250	104	0
13371	Winter Haven	N/A	7.21	459	7966.733	91	N/A	9.65	857	27846.550	138	0
13372	Winter Haven	N/A	2.37	239	129.800	1	N/A	1.16	54	0	0	0
13373	Winter Haven	N/A	14.2	1442	47586.950	434	N/A	0.73	134	16852.100	23	0
13375	Western	N/A	0	0	0	0	N/A	0.05	0	0	0	0
13376	Western	N/A	0	0	0	0	N/A	0.18	22	0	0	0
13377	Western	N/A	4.12	879	89690.883	430	N/A	2	166	5624.167	39	0
13378	Western	N/A	0	0	0	0	N/A	0	0	0	0	0
13379	Western	N/A	0	0	0	0	N/A	0.12	0	0	0	0
13380	Western	N/A	0	0	41.100	1	N/A	0.06	399	41.717	1	0
13381	Western	N/A	0	0	0	0	N/A	0.15	2	0	0	0
13382	Western	N/A	0	0	2809.467	8	N/A	0.19	0	0	0	0
13383	Western	N/A	0	0	0	0	N/A	0.88	9	0	0	0
13384	Western	N/A	0	0	0	0	N/A	0.01	8	0	0	0
13385	Western	N/A	0	0	0	0	N/A	0	0	0	0	0
13388	Plant City	N/A	17.15	473	50792.217	259	N/A	8.67	190	1350.467	8	0
13389	Plant City	N/A	17.06	945	23816.500	79	N/A	5.25	106	159.000	1	0
13390	Plant City	N/A	29.47	1080	173824.683	687	N/A	14.47	466	313.417	2	0
13391	Plant City	N/A	47.91	1154	129861.933	946	N/A	8.63	386	9326.700	61	0
13397	Central	N/A	0.31	79	0	0	N/A	0.35	48	0	0	0
13398	Central	N/A	0.47	13	545.100	2	N/A	1.33	1819	0	0	0
13399	Central	N/A	0.84	37	91.717	1	N/A	0.13	15	0	0	0
13400	Central	N/A	1.88	117	40116.300	161	N/A	2.02	1666	103704.083	1506	0
13405	Western	N/A	9.13	182	39520.200	160	N/A	4.06	125	0	0	0
13406	Western	N/A	1.37	29	0	0	N/A	6.12	273	0	0	0
13410	Plant City	N/A	4.83	416	10086.167	34	N/A	2.9	150	486.617	16	0
13412	Plant City	N/A	1.19	97	1994.550	31	N/A	0.03	1	0	0	0
13414	Plant City	N/A	8.74	583	30573.483	365	N/A	5.17	370	83.633	1	0
13417	Central	N/A	4.8	645	128703.433	430	N/A	1.55	107	3198.300	14	0
13418	Central	N/A	7.75	1054	23322.083	59	N/A	3.44	382	13784.533	70	0
13419	Central	N/A	10.13	1364	3281.817	33	N/A	1.09	111	0	0	0
13420	Central	N/A	3.86	295	11632.650	58	N/A	7.83	1498	38581.467	303	0
13422	Dade City	N/A	28.95	928	29081431.717	8550	N/A	13.52	691	1574.300	3	0

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the
13423	Dade City	N/A	27.73	632	35540.917	262	N/A	9.79	913	1349.733	7	0
13425	Western	N/A	0.62	4	1131.400	4	N/A	15.04	1639	114741.733	685	0
13426	Western	N/A	5.75	398	83583.367	634	N/A	12.12	1359	132604.483	787	0
13427	Western	N/A	0	1	11594.050	80	N/A	3.95	291	13228.833	80	0
13428	Western	N/A	0.83	49	3708.883	16	N/A	9.25	1063	19129.667	53	0
13430	Dade City	N/A	29.54	553	157127.733	908	N/A	18.26	611	6123.667	29	0
13431	Dade City	N/A	9.16	138	12153.000	155	N/A	26.14	548	71.100	1	0
13432	Dade City	N/A	2.03	29	2151.333	13	N/A	18.7	752	49069.600	118	0
13433	Eastern	N/A	8.79	269	6644.500	35	N/A	3.56	380	2734.000	6	0
13434	Eastern	N/A	9.74	841	33139.583	175	N/A	4.37	571	0	0	0
13435	Eastern	N/A	5.55	247	2435.000	19	N/A	1.95	386	0	0	0
13436	Eastern	N/A	11.74	648	157768.850	745	N/A	7.02	621	3287.533	51	0
13438	South Hillsborough	N/A	1	101	41219.933	150	N/A	22.58	2983	39030.367	239	0
13439	South Hillsborough	N/A	2.8	320	9875.183	79	N/A	7.22	508	3872.100	24	0
13440	South Hillsborough	N/A	2.02	1	90163.050	923	N/A	21.44	2000	401.233	4	0
13442	Winter Haven	N/A	10.03	377	13597.417	293	N/A	20.65	1600	104821.600	561	0
13443	Winter Haven	N/A	9.5	614	58652.783	345	N/A	9.77	985	84179.917	396	0
13444	Winter Haven	N/A	3.98	333	8559.100	68	N/A	1.57	209	252.600	1	0
13446	Western	N/A	0	3	0	0	N/A	0.72	89	0	0	0
13447	Western	N/A	1.63	51	3007.467	26	N/A	0.95	45	95.650	3	0
13448	Western	N/A	1.32	98	0	0	N/A	2.47	741	1744.200	5	0
13449	Western	N/A	2.53	207	16723.033	109	N/A	1.71	189	175.333	4	0
13450	Western	N/A	0.61	17	2619.200	12	N/A	1.91	65	102.650	3	0
13451	Western	N/A	0.13	1	0	0	N/A	2.47	93	4120.383	7	0
13452	Western	N/A	0.2	8	0	0	N/A	0.19	5	0	0	0
13453	Western	N/A	0.14	4	0	0	N/A	4.51	28	2409.133	6	0
13454	Eastern	N/A	3.19	197	22653.300	88	N/A	14.3	1255	5695.500	10	0
13455	Eastern	N/A	2.9	207	2955.150	71	N/A	3.23	761	14907.083	110	0
13456	Eastern	N/A	1.63	149	482.267	7	N/A	3.06	886	0	0	0
13457	Eastern	N/A	2.18	107	11349.800	53	N/A	5.37	683	6946.433	36	0
13458	Eastern	N/A	15.3	470	17392.717	78	N/A	4.61	115	697.583	3	0
13459	Eastern	N/A	10.4	390	8377.250	70	N/A	15.71	528	14966.133	83	0
13460	Eastern	N/A	37.28	910	168885.700	2619	N/A	3.95	240	1467.550	44	0
13461	Eastern	N/A	30.06	1112	631602.850	9677	N/A	15.45	401	63751.667	811	0
13462	Plant City	N/A	3.18	183	44096.750	1244	N/A	13.07	1098	11135.867	50	0
13463	Plant City	N/A	1.56	249	3725.717	30	N/A	0.25	15	0	0	0
13464	Plant City	N/A	5.33	447	2453.233	22	N/A	2.77	175	6939.183	84	0
13466	Central	N/A	1.7	124	240.000	1	N/A	1.19	151	339.483	1	0
13467	Central	N/A	0	0	0	0	N/A	0.24	4	0	0	0

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the
13468	Central	N/A	4.59	364	144864.217	652	N/A	8.32	1081	107588.167	277	0
13469	Central	N/A	1.98	97	13062.733	61	N/A	8.5	718	105.267	2	0
13470	Winter Haven	N/A	31.51	1745	73430.800	828	N/A	8.44	608	624.933	5	0
13471	Winter Haven	N/A	4.36	432	12720.183	76	N/A	5.18	513	0	0	0
13473	Winter Haven	N/A	7.25	550	11348.950	113	N/A	10.77	593	2010.700	18	0
13479	Winter Haven	N/A	8.99	461	14978.350	162	N/A	4.48	340	0	0	0
13480	Western	N/A	0.75	7	998.767	1	N/A	11.48	1603	10655.533	88	0
13481	Western	N/A	0	0	240.517	1	N/A	6.67	754	24625.200	173	0
13482	Western	N/A	0.88	8	895.167	2	N/A	15.6	1552	0	0	0
13483	Western	N/A	2.79	352	7403.300	57	N/A	15.24	1366	72280.067	572	0
13484	Western	N/A	0.18	3	528.100	2	N/A	11.26	1451	2340.067	6	0
13485	Western	N/A	2.91	120	16760.417	1039	N/A	7.58	745	8056.733	121	0
13488	South Hillsborough	N/A	0.95	89	10426.983	70	N/A	18.94	2512	38284.783	203	0
13489	South Hillsborough	N/A	6.16	256	9684.517	79	N/A	3.87	193	1431.150	6	0
13490	Western	N/A	0.93	128	4692.633	19	N/A	7.13	704	152.133	1	0
13491	Western	N/A	0.6	51	638.317	1	N/A	12.38	1668	5253.850	40	0
13492	Western	N/A	5.23	556	76733.817	101	N/A	2.53	229	1996.800	25	0
13493	Western	N/A	2.13	262	67578.233	206	N/A	3.5	322	6358.517	46	0
13494	South Hillsborough	N/A	0.33	2	20706.133	368	N/A	3.6	416	0	0	0
13495	Eastern	N/A	2.62	198	5244.050	11	N/A	10.31	1196	1680.150	7	0
13496	Central	N/A	1.1	73	3016.483	8	N/A	1.1	387	0	0	0
13497	Central	N/A	0.11	3	0	0	N/A	1.51	135	0	0	0
13498	Central	N/A	0	0	0	0	N/A	0.44	0	0	0	0
13499	Central	N/A	0.04	2	161.750	1	N/A	0.6	47	0	0	0
13501	Eastern	N/A	0.92	16	7824.150	32	N/A	1.95	62	0	0	0
13502	Eastern	N/A	6.16	378	39186.333	322	N/A	11.44	2131	4485.983	21	0
13504	Eastern	N/A	0.13	4	156.900	1	N/A	1.25	12	0	0	0
13505	Eastern	N/A	3.17	169	31926.317	267	N/A	5.7	892	1910.400	3	0
13506	Eastern	N/A	2.83	85	794.133	3	N/A	4.98	593	10944.183	126	0
13507	Eastern	N/A	0.05	1	0	0	N/A	1.88	34	0	0	0
13509	Eastern	N/A	1.67	105	15408.583	201	N/A	7.65	962	6175.617	56	0
13510	Western	N/A	3.02	337	48340.133	468	N/A	9.37	1200	27271.167	91	0
13511	Western	N/A	3.27	405	10284.217	67	N/A	4.15	298	35728.733	150	0
13512	Western	N/A	3.49	429	34994.367	306	N/A	8.22	1356	17597.917	73	0
13513	Western	N/A	0.85	26	8041.200	23	N/A	1.61	244	0	0	0
13514	Western	N/A	1.3	149	1013.383	4	N/A	5.31	533	16271.367	72	0
13516	Western	N/A	3.75	465	32970.850	174	N/A	5.02	384	6814.200	141	0
13517	Western	N/A	4.08	430	6122.750	22	N/A	3.52	1072	3428.250	36	0
13518	Western	N/A	0.27	24	0	0	N/A	0.2	3	0	0	0

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the
13519	Western	N/A	0.63	32	18960.133	86	N/A	0.12	89	0	0	0
13520	Western	N/A	0.7	81	1075.000	4	N/A	4.27	455	3214.250	29	0
13521	Western	N/A	0.01	0	0	0	N/A	1.87	24	0	0	0
13522	Western	N/A	9.54	1151	166202.783	847	N/A	2	349	6000.867	44	0
13523	Western	N/A	4.59	535	7900.850	123	N/A	1.87	1100	21351.617	84	0
13524	Western	N/A	0.98	122	0	0	N/A	1.25	97	138.550	1	0
13530	Western	N/A	5.42	873	46605.733	140	N/A	0	0	366.317	1	0
13531	Western	N/A	2.15	47	8439.833	31	N/A	5.14	181	318.033	1	0
13532	Western	N/A	4.26	346	176.450	3	N/A	1.02	76	584.600	10	0
13533	Western	N/A	2.35	251	10381.867	87	N/A	9.15	1568	27067.950	93	0
13535	Western	N/A	4.79	267	52479.100	860	N/A	16.47	1906	4408.850	34	0
13538	Western	N/A	0.23	5	1255.833	3	N/A	14.02	917	14538.933	194	0
13539	Western	N/A	0.62	11	12054.733	180	N/A	12.97	1094	2929.883	51	0
13540	Western	N/A	0.2	4	850.350	1	N/A	7.04	698	23911.700	164	0
13541	Western	N/A	0	0	0	0	N/A	15.05	1005	14163.950	27	0
13544	Western	N/A	0.49	28	6518.550	54	N/A	5.17	701	4914.067	68	0
13546	Central	N/A	6.38	293	2589.800	21	N/A	3.23	53	1223.833	3	0
13547	Central	N/A	4.03	312	18067.350	147	N/A	1.83	221	47.700	1	0
13551	Central	N/A	0	0	0	0	N/A	0	0	0	0	0
13552	Central	N/A	2.76	48	18744.033	119	N/A	1.26	20	0	0	0
13553	Central	N/A	0	2	0	0	N/A	1.21	1	0	0	0
13554	Central	N/A	0	0	0	0	N/A	0	0	0	0	0
13560	Central	N/A	0	0	0	0	N/A	0.14	0	0	0	0
13561	Central	N/A	0	0	0	0	N/A	0.15	0	0	0	0
13562	Central	N/A	0	0	0	0	N/A	0.42	273	0	0	0
13563	Central	N/A	0	0	0	0	N/A	0.36	0	0	0	0
13564	Central	N/A	0	0	0	0	N/A	0.56	364	0	0	0
13565	Central	N/A	0	0	0	0	N/A	0.39	0	0	0	0
13566	Central	N/A	0	0	0	0	N/A	1.45	613	240.000	1	0
13567	Central	N/A	0	0	0	0	N/A	0.04	506	0	0	0
13572	Western	N/A	0.76	68	119145.917	894	N/A	9.28	949	15890.700	62	0
13573	Western	N/A	0.46	5	0	0	N/A	10.75	1053	12430.033	42	0
13574	Western	N/A	2.81	232	1954.917	35	N/A	6.02	604	432.833	7	0
13575	Western	N/A	0.24	5	681.200	9	N/A	5.89	599	7644.517	61	0
13576	Eastern	N/A	2.89	221	65656.700	285	N/A	14.64	1435	18784.083	105	0
13577	Eastern	N/A	3.11	236	2720.967	15	N/A	9.21	741	5117.433	70	0
13579	Eastern	N/A	6.26	189	30326.383	157	N/A	17.94	1397	6272.933	77	0
13582	Western	N/A	5.83	179	20410.200	184	N/A	19.12	1197	19793.133	79	0
13583	Western	N/A	4.58	119	2247.117	18	N/A	6.52	382	0	0	0
13584	Western	N/A	0.19	1	490.883	2	N/A	10.34	947	11351.850	121	0
13585	Western	N/A	0.51	17	1777.200	11	N/A	7.13	1402	2965.100	69	0

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the
13586	Western	N/A	4.39	97	3229.567	13	N/A	20.89	1172	13090.100	117	0
13587	Western	N/A	1.56	5	14515.567	137	N/A	14.49	2244	4070.517	129	0
13589	Western	N/A	0.1	4	0	0	N/A	11.82	1332	127.917	2	0
13590	Central	N/A	2.72	317	54953.917	1180	N/A	4.05	1442	87986.650	2622	0
13591	Central	N/A	7.95	1060	20196.350	110	N/A	2.44	610	16446.050	62	0
13592	Central	N/A	5.9	957	7283.517	101	N/A	3.32	210	7023.950	60	0
13593	Central	N/A	4.55	504	28767.733	41	N/A	2.35	177	0	0	0
13598	Central	N/A	0	0	0	0	N/A	0.02	0	0	0	0
13600	Central	N/A	6.16	616	32197.050	295	N/A	1.73	498	6868.900	27	0
13601	Central	N/A	4.62	386	86087.950	316	N/A	9.78	1185	10383.667	110	0
13602	Central	N/A	0	0	0	0	N/A	0	0	0	0	0
13605	Western	N/A	2.6	351	82825.300	374	N/A	1.76	295	572.017	5	0
13606	Western	N/A	0.75	24	0	0	N/A	0.39	193	0	0	0
13607	Western	N/A	0	0	0	0	N/A	0	0	0	0	0
13608	Western	N/A	0	0	0	0	N/A	0	2	0	0	0
13610	Western	N/A	5.72	634	1153.433	17	N/A	1.68	666	0	0	0
13611	Western	N/A	3.28	360	17828.133	168	N/A	0.66	507	599.600	6	0
13612	Western	N/A	7.39	808	12308.283	44	N/A	1.76	371	3925.550	9	0
13613	Western	N/A	5.57	751	17086.867	77	N/A	0.93	285	0	0	0
13614	Western	N/A	0	0	0	0	N/A	0	0	0	0	0
13621	Western	N/A	15.62	412	4882.117	50	N/A	4.95	78	14762.183	2903	0
13622	Western	N/A	19.78	759	153685.233	1633	N/A	14.29	679	16324.150	78	0
13624	Western	N/A	15.71	369	40023.167	251	N/A	11.08	295	1535.883	7	0
13630	Central	N/A	5.75	668	28861.967	157	N/A	1.73	298	4333.267	24	0
13631	Central	N/A	5.46	423	91122.000	1153	N/A	9.84	945	29663.383	68	0
13632	Central	N/A	2.66	244	5088.250	63	N/A	3.8	240	954.000	9	0
13633	Central	N/A	1.54	84	4125.400	12	N/A	7.92	911	467.567	13	0
13635	Western	N/A	0.05	0	0	0	N/A	2.58	25	0	0	0
13636	Western	N/A	0.04	1	0	0	N/A	0.54	7	0	0	0
13637	Western	N/A	0.78	56	13086.683	121	N/A	1.42	102	69.617	1	0
13638	Western	N/A	2.11	206	0	0	N/A	1.13	136	0	0	0
13639	Western	N/A	0	0	0	0	N/A	0	0	0	0	0
13640	Western	N/A	0	0	0	0	N/A	2.13	8	0	0	0
13641	Western	N/A	0	0	0	0	N/A	1.23	18	7.150	3	0
13642	Western	N/A	0	0	0	0	N/A	0.25	3	5.033	2	0
13643	Western	N/A	0	0	0	0	N/A	1.58	10	0	0	0
13645	South Hillsborough	N/A	1.67	19	0	0	N/A	20.29	1938	0	0	0
13646	South Hillsborough	N/A	0.16	1	542.000	1	N/A	17.81	1713	11373.867	61	0
13647	South Hillsborough	N/A	1.28	72	0	0	N/A	22.41	1903	0	0	0

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the
13648	South Hillsborough	N/A	16.43	360	45084.833	545	N/A	18.83	989	0	0	0
13649	South Hillsborough	N/A	5.05	327	150.350	1	N/A	2.68	265	0	0	0
13650	South Hillsborough	N/A	0	0	0	0	N/A	11.09	1033	8117.583	46	0
13651	South Hillsborough	N/A	3.23	155	11564.800	139	N/A	14.6	1660	854.850	9	0
13652	South Hillsborough	N/A	3.62	191	8610.333	73	N/A	11.22	848	0	0	0
13655	Plant City	N/A	3.13	177	309.383	5	N/A	14.34	806	117.050	2	0
13656	Plant City	N/A	39.29	1145	159346.750	1822	N/A	9.49	579	26849.633	432	0
13657	Plant City	N/A	10.39	257	9623.633	40	N/A	3.81	189	0	0	0
13659	Winter Haven	N/A	3.68	95	2359.333	37	N/A	16.73	1237	17406.083	94	0
13660	Winter Haven	N/A	1.77	35	33812.567	497	N/A	10.3	788	657.750	15	0
13661	Winter Haven	N/A	6.76	340	297823.333	3482	N/A	23.52	1622	6450.050	34	0
13668	Plant City	N/A	9.31	294	25245.883	148	N/A	21.49	1540	3429.867	8	0
13669	Western	N/A	1.33	100	383.050	6	N/A	14.66	1176	112.400	3	0
13670	Western	N/A	0.44	2	5492.900	38	N/A	8.68	612	4549.967	46	0
13671	Western	N/A	0.11	0	389.267	4	N/A	13.2	1741	25553.250	140	0
13672	Western	N/A	1.05	57	37025.217	252	N/A	20.06	2756	21635.067	84	0
13673	Western	N/A	0.07	0	373.850	2	N/A	14.64	1200	128.583	1	0
13674	Western	N/A	0.15	0	211688.500	3213	N/A	10.01	1071	2732.450	30	0
13677	Western	N/A	4.74	91	0	0	N/A	21.73	1070	395.633	1	0
13678	Western	N/A	1.87	65	107991.317	1628	N/A	22.47	2443	95423.583	979	0
13679	Western	N/A	9.29	343	320107.867	2282	N/A	17.45	886	7666.167	20	0
13685	Eastern	N/A	2.36	109	26057.033	84	N/A	17.9	1284	46633.183	348	0
13686	Eastern	N/A	3.1	107	9484.183	70	N/A	16.18	1227	5534.467	47	0
13687	Eastern	N/A	15.37	520	46325.700	908	N/A	14.43	1008	19731.783	99	0
13690	Eastern	N/A	1.75	88	25926.967	189	N/A	11.54	772	0	0	0
13691	Eastern	N/A	0.89	28	24241.867	428	N/A	11	873	8190.633	46	0
13692	Eastern	N/A	1.09	19	11145.783	89	N/A	6.68	627	4371.650	55	0
13693	Eastern	N/A	4.9	191	25707.383	119	N/A	7.5	623	0	0	0
13695	Winter Haven	N/A	9.21	688	21105.050	195	N/A	17.4	1154	0	0	0
13696	Winter Haven	N/A	13.58	1277	36075.133	249	N/A	1.84	108	211.817	1	0
13697	Winter Haven	N/A	14.04	675	62047.250	581	N/A	2.9	125	8329.783	66	0
13698	Winter Haven	N/A	16.89	1038	46086.050	334	N/A	2.56	24	1312.067	31	0
13699	Winter Haven	N/A	4.53	270	18480.367	230	N/A	12.81	1020	275176.683	817	0
13705	Eastern	N/A	8.41	483	20604.100	113	N/A	11.58	972	60071.017	57	0
13706	Eastern	N/A	3.74	178	2612.150	21	N/A	10.91	1491	12066.100	11	0
13707	Eastern	N/A	1.19	59	39353.233	679	N/A	8.39	1097	1429.983	49	0
13708	Eastern	N/A	1.09	44	50805.017	311	N/A	14.14	2102	14926.500	24	0

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the
13709	Eastern	N/A	6.2	544	6126.383	43	N/A	8.22	610	4036.700	20	0
13710	Eastern	N/A	6.22	300	50833.517	439	N/A	16.46	2359	28041.183	197	0
13711	Eastern	N/A	1.24	12	23057.200	293	N/A	17.76	2727	14341.383	117	0
13712	Eastern	N/A	8.49	424	19782.483	168	N/A	6.3	552	8277.500	29	0
13713	Central	N/A	0	0	0	0	N/A	0.04	1	0	0	0
13714	Central	N/A	0.46	8	4861.150	37	N/A	15.84	3351	5988.333	50	0
13715	Central	N/A	0.61	5	66352.517	1921	N/A	10.79	3452	488.867	2	0
13716	Central	N/A	0.02	0	0	0	N/A	7.11	577	0	0	0
13717	Central	N/A	1.86	6	1055.717	11	N/A	8.86	536	0	0	0
13718	Central	N/A	0.01	0	6323.700	52	N/A	18.79	1158	3468.133	37	0
13719	Central	N/A	0.23	0	0	0	N/A	26.57	1565	46.167	1	0
13722	Plant City	N/A	9.72	417	30309.867	137	N/A	2.83	79	3014.667	8	0
13723	Plant City	N/A	14.68	400	9665.250	43	N/A	4.11	208	5259.817	40	0
13724	Plant City	N/A	15.55	445	202299.383	1084	N/A	44.4	869	1159.100	1	0
13729	Eastern	N/A	2.03	37	10261.067	184	N/A	10.72	930	0	0	0
13731	Eastern	N/A	0.1	1	19699.750	143	N/A	11.41	895	5675.367	44	0
13732	Eastern	N/A	0.1	21	11336.950	129	N/A	16.58	1251	7785.517	25	0
13733	Eastern	N/A	1.06	2	231.300	1	N/A	20.89	1516	3376.467	16	0
13737	Western	N/A	3.43	340	3419.250	13	N/A	2.59	260	0	0	0
13738	Western	N/A	1.69	59	1951.950	15	N/A	3.48	592	10692.950	37	0
13739	Western	N/A	0.83	43	5114.667	175	N/A	0.83	120	254.367	3	0
13740	Western	N/A	10.39	1319	6377.633	54	N/A	0.19	16	112.950	2	0
13741	Western	N/A	0.04	1	0	0	N/A	0.52	371	0	0	0
13742	Western	N/A	0	0	0	0	N/A	0.29	84	0	0	0
13743	Western	N/A	2.79	323	6664.317	72	N/A	0.93	1205	139.500	2	0
13745	Western	N/A	0.63	25	24438.417	4629	N/A	16.32	1813	46474.800	729	0
13747	Western	N/A	1.35	126	1370.400	8	N/A	2.65	478	40532.517	88	0
13748	Western	N/A	4.31	371	33706.650	294	N/A	7.92	755	19994.550	195	0
13749	Western	N/A	1.78	202	4845.350	56	N/A	9.79	1239	90727.000	596	0
13750	Western	N/A	3.93	193	2150.033	15	N/A	8.07	838	912.483	4	0
13753	Western	N/A	3.98	611	14263.650	130	N/A	0.07	10	0	0	0
13754	Western	N/A	7.27	1171	6490.450	46	N/A	1.07	268	0	0	0
13756	Western	N/A	2.33	794	33970.300	120	N/A	1.37	918	0	0	0
13761	Western	N/A	0.34	5	34125.333	764	N/A	1.78	1053	0	0	0
13762	Western	N/A	0.16	6	775.367	1	N/A	1.97	35	0	0	0
13763	Western	N/A	0	0	0	0	N/A	0.03	0	0	0	0
13764	Western	N/A	0.16	2	0	0	N/A	1.3	473	0	0	0
13765	Western	N/A	0	0	0	0	N/A	0.57	5	0	0	0
13766	Western	N/A	0	0	0	0	N/A	1.24	17	0	0	0
13769	Winter Haven	N/A	15.52	350	25664.383	259	N/A	25.62	1938	568.083	8	0
13770	Winter Haven	N/A	3.17	178	2129.750	11	N/A	21.54	1608	7578.200	48	0

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the
13772	Winter Haven	N/A	8.37	309	148304.167	1743	N/A	10.3	411	15650.283	157	0
13777	South Hillsborough	N/A	2.12	248	81516.800	225	N/A	12.54	804	26201.017	99	0
13780	South Hillsborough	N/A	6.83	649	21631.867	162	N/A	9.85	758	8700.417	44	0
13781	South Hillsborough	N/A	0.23	17	0	0	N/A	0.71	69	0	0	0
13785	Plant City	N/A	14.85	321	10367.317	43	N/A	36.12	482	19476.550	56	0
13786	Plant City	N/A	43.42	787	101741.333	845	N/A	3.6	37	1462.683	4	0
13787	Plant City	N/A	42.76	862	142841.233	929	N/A	10.01	155	5575.717	19	0
13793	Eastern	N/A	3.76	198	75063.517	994	N/A	12.81	1439	20980.217	158	0
13795	Eastern	N/A	3.94	129	183582.583	982	N/A	18.02	1336	37017.867	216	0
13796	Eastern	N/A	6.51	139	4484.400	48	N/A	9.8	1336	16253.117	62	0
13797	Eastern	N/A	3.56	164	9860.133	70	N/A	18.73	1294	327.833	1	0
13798	Eastern	N/A	3.51	185	21350.217	121	N/A	10	1053	8731.033	17	0
13799	Eastern	N/A	2.6	116	7085.283	75	N/A	11.55	1704	0	0	0
13805	Plant City	N/A	47.87	1093	40773.983	492	N/A	6.81	104	1079.533	8	0
13807	Plant City	N/A	43.93	1302	202322.417	1098	N/A	7.05	318	3096.133	28	0
13808	Plant City	N/A	100.88	1783	256491.633	1264	N/A	8.43	147	742.700	9	0
13813	Dade City	N/A	44.65	749	174112.433	845	N/A	9.83	152	888.917	17	0
13815	Dade City	N/A	37.19	498	298948.183	3517	N/A	19.69	195	1913.783	16	0
13817	South Hillsborough	N/A	13.94	747	243873.483	2314	N/A	18.09	1317	714.600	14	0
13818	South Hillsborough	N/A	1.1	10	2998.617	34	N/A	13.46	1172	5288.133	50	0
13819	South Hillsborough	N/A	0.52	4	0	0	N/A	2.29	416	26.817	1	0
13820	South Hillsborough	N/A	2.75	68	7803.617	58	N/A	3.19	247	2073.867	22	0
13822	South Hillsborough	N/A	1.81	47	163.483	1	N/A	20.08	1579	292579.933	487	0
13823	Central	N/A	0	0	0	0	N/A	0.01	0	0	0	0
13825	Central	N/A	7.13	769	33708.700	283	N/A	2.12	601	1481.333	5	0
13826	Central	N/A	3.46	180	326647.083	1753	N/A	7.88	1669	30299.683	92	0
13827	Central	N/A	3.99	368	13904.867	92	N/A	3.45	387	21331.383	92	0
13828	Central	N/A	5.74	472	66010.417	1071	N/A	3.78	975	66.567	1	0
13829	Central	N/A	1.03	40	3328.450	68	N/A	8.27	788	3149.283	11	0
13830	Central	N/A	3.69	290	22391.383	116	N/A	5.19	297	338.267	2	0
13831	Central	N/A	0.3	48	0	0	N/A	5.89	1144	0	0	0
13832	Central	N/A	2.99	249	56006.383	309	N/A	1.39	150	62.267	1	0
13833	Central	N/A	0	0	0	0	N/A	0.02	0	0	0	0
13834	Central	N/A	0	0	0	0	N/A	0	0	0	0	0

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the
13835	Central	N/A	3.71	420	52590.033	308	N/A	6.29	853	0	0	0
13836	Central	N/A	1.83	77	16082.533	74	N/A	16.91	577	909.283	1	0
13837	Central	N/A	4	439	123738.333	513	N/A	7.59	613	19680.733	131	0
13838	Central	N/A	9.22	661	41816.033	227	N/A	6.87	993	13676.017	78	0
13839	Central	N/A	6.77	325	158019.083	1579	N/A	17.48	851	12447.717	57	0
13840	Central	N/A	6.94	311	46573.950	4886	N/A	10.15	1539	3131.000	17	0
13843	Central	N/A	0.22	3	0	0	N/A	0.17	2	0	0	0
13844	Central	N/A	0.14	4	18.100	1	N/A	2.84	723	0	0	0
13845	Central	N/A	0	0	0	0	N/A	3.95	1	0	0	0
13850	Plant City	N/A	0.08	2	103.533	1	N/A	15.2	959	13486.800	57	0
13853	Plant City	N/A	2.11	21	33142.033	261	N/A	27.86	1487	147362.200	1117	0
13854	Plant City	N/A	10.49	599	177941.917	8312	N/A	14.79	1312	16319.567	98	0
13858	Central	N/A	0	0	0	0	N/A	0.24	0	0	0	0
13859	Central	N/A	0	0	0	0	N/A	0.01	0	0	0	0
13860	Western	N/A	1.34	45	890.367	3	N/A	10.86	1005	12894.617	145	0
13863	Western	N/A	0.25	13	18088.400	528	N/A	9.14	720	5920.700	58	0
13864	Western	N/A	1.48	42	1613.750	19	N/A	4.85	320	3780.667	11	0
13865	Western	N/A	2.02	112	6474.117	68	N/A	17.35	1761	7251.733	61	0
13866	Western	N/A	0.38	16	470.733	2	N/A	2.65	88	0	0	0
13867	Western	N/A	1.69	104	6392.000	26	N/A	2	93	118.133	1	0
13869	Western	N/A	0.17	4	0	0	N/A	7.18	567	29.233	1	0
13870	Western	N/A	2.38	39	5328.550	55	N/A	20.31	2160	21516.017	195	0
13871	Western	N/A	1.43	25	18460.667	157	N/A	8.8	1054	8370.300	116	0
13872	Western	N/A	0	0	0	0	N/A	11.58	914	295.333	4	0
13873	Western	N/A	2.19	40	17012.533	140	N/A	10.46	1015	52712.483	229	0
13878	Eastern	N/A	1.99	44	2300.583	10	N/A	8.85	1489	34260.433	244	0
13879	Eastern	N/A	0.13	3	0	0	N/A	8.64	2272	0	0	0
13880	Eastern	N/A	0.15	2	0	0	N/A	8.2	1658	0	0	0
13881	Eastern	N/A	0	0	0	0	N/A	1.74	121	0	0	0
13882	Eastern	N/A	0	0	0	0	N/A	2.24	394	0	0	0
13883	Eastern	N/A	1.1	29	252.183	1	N/A	6.84	1426	38.567	1	0
13884	Eastern	N/A	0.31	0	0	0	N/A	11.48	1613	0	0	0
13885	Eastern	N/A	0.57	7	9185.150	95	N/A	9.97	1194	1270.083	5	0
13886	Western	N/A	0	0	4328.400	45	N/A	11.64	1146	23556.267	93	0
13888	Western	N/A	0.84	16	3406.900	60	N/A	11.66	1147	23483.067	101	0
13889	Western	N/A	6.91	279	33748.283	1441	N/A	13.83	1429	30205.400	235	0
13890	Western	N/A	0.17	17	415.067	5	N/A	7.05	660	13879.717	159	0
13891	Western	N/A	0.01	0	16946.117	175	N/A	17.49	1363	28525.533	120	0
13892	Western	N/A	1.62	69	64.683	1	N/A	7.74	1042	0	0	0
13893	Western	N/A	0	0	0	0	N/A	0	0	0	0	0
13895	Western	N/A	0.76	80	10.967	1	N/A	2.15	230	79.867	1	0

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the
13896	South Hillsborough	N/A	7.8	699	14692.000	63	N/A	10.61	1150	6047.217	45	0
13897	South Hillsborough	N/A	2.38	23	2865.517	11	N/A	19.44	1340	0	0	0
13898	South Hillsborough	N/A	0.52	10	1674.017	7	N/A	21.08	1951	2962.633	7	0
13899	South Hillsborough	N/A	7.1	523	19751.767	340	N/A	6.61	826	368.433	9	0
13900	South Hillsborough	N/A	1.84	25	144834.183	4245	N/A	23.88	2302	5450.183	16	0
13901	South Hillsborough	N/A	0	0	0	0	N/A	15.51	969	3015.433	9	0
13906	Eastern	N/A	8.77	466	361048.217	2989	N/A	17.6	1160	144350.967	541	0
13909	Eastern	N/A	3.92	329	59550.683	573	N/A	2	51	556.800	3	0
13910	Eastern	N/A	6.63	333	40062.633	626	N/A	10.4	805	42622.167	145	0
13911	Eastern	N/A	6.67	557	36082.850	347	N/A	6.4	755	57224.983	222	0
13916	Winter Haven	N/A	1.61	87	8768.767	64	N/A	15.48	1700	3806.217	43	0
13918	Winter Haven	N/A	1.9	89	7200.117	81	N/A	10.8	755	4019.100	18	0
13919	Winter Haven	N/A	0.01	0	224.433	1	N/A	1.08	36	0	0	0
13920	Winter Haven	N/A	1.42	62	5183.983	58	N/A	12.28	1515	208764.833	1589	0
13921	Winter Haven	N/A	2.43	166	316.833	2	N/A	6.07	598	26856.000	55	0
13922	Winter Haven	N/A	0.31	10	303172.583	7217	N/A	35.03	2476	2443.050	28	0
13924	Winter Haven	N/A	46.41	409	49457.617	760	N/A	20.1	993	23250.667	79	0
13927	Winter Haven	N/A	24.61	729	67426.667	340	N/A	12.18	1093	5287.017	70	0
13928	Winter Haven	N/A	0	1	0	0	N/A	0	0	0	0	0
13932	Central	N/A	1.23	154	21845.133	121	N/A	4.52	292	7853.200	66	0
13934	Central	N/A	0.65	9	11621.967	62	N/A	8.84	988	9605.000	102	0
13935	Central	N/A	1.87	99	10728.033	121	N/A	5.83	467	280.217	1	0
13939	Central	N/A	1.76	79	8384.317	65	N/A	12.59	1098	8018.150	100	0
13940	Eastern	N/A	0	0	0	0	N/A	0	0	0	0	0
13942	Central	N/A	0.11	35	3916.150	167	N/A	1.74	1411	17787.233	144	0
13943	Central	N/A	0.2	12	0	0	N/A	0.57	59	0	0	0
13944	Central	N/A	0.14	0	0	0	N/A	0.75	341	0	0	0
13945	Central	N/A	0	0	0	0	N/A	0.48	250	0	0	0
13946	Central	N/A	8.01	1219	211219.683	1410	N/A	0.33	41	24422.317	187	0
13947	Central	N/A	9.23	1374	31482.967	466	N/A	0.89	49	27549.817	207	0
13948	Central	N/A	3.96	821	10833.517	26	N/A	5.83	585	904.183	4	0
13951	Eastern	N/A	1	61	849.750	9	N/A	1.79	104	0	0	0
13952	Eastern	N/A	0.38	12	0	0	N/A	2.56	69	85.567	2	0
13953	Eastern	N/A	4.2	157	690.850	3	N/A	7.47	236	5875.150	19	0
13954	Eastern	N/A	0.41	4	107.767	1	N/A	3.42	104	0	0	0
13955	Eastern	N/A	0.69	32	142.333	4	N/A	0.43	18	0	0	0

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the
13956	Eastern	N/A	0.04	0	10023.567	108	N/A	2.76	755	0	0	0
13957	Eastern	N/A	0.16	1	0	0	N/A	3.62	478	18970.017	171	0
13959	Plant City	N/A	3.87	158	24073.233	191	N/A	25.37	1781	10061.983	91	0
13961	Plant City	N/A	1.43	109	0	0	N/A	8.7	676	0	0	0
13962	Plant City	N/A	9.99	284	30527.583	534	N/A	20.39	633	17620.850	371	0
13963	Eastern	N/A	3.45	220	2596.417	20	N/A	1.74	102	0	0	0
13964	Eastern	N/A	6.98	421	6024.150	40	N/A	0.54	5	4666.200	84	0
13967	Winter Haven	N/A	3.59	254	28528.317	350	N/A	14.11	1368	16938.083	155	0
13968	Winter Haven	N/A	5.24	570	6456.283	82	N/A	1.52	449	18066.450	97	0
13971	Winter Haven	N/A	0.15	2	216.200	3	N/A	29.06	2850	1416.617	2	0
13972	Winter Haven	N/A	2.91	58	89097.817	257	N/A	20.29	1258	28866.133	118	0
13973	Winter Haven	N/A	1.22	5	18571.083	160	N/A	9.21	840	27318.250	197	0
13974	Winter Haven	N/A	0	0	0	0	N/A	0	0	0	0	0
13980	Plant City	N/A	0.98	2	1910.567	13	N/A	0.34	6	995.133	2	0
13982	Plant City	N/A	9.37	278	10627.383	52	N/A	5.01	91	0	0	0
13983	Plant City	N/A	15.49	479	78556.133	565	N/A	28.58	579	1885.583	5	0
13984	Plant City	N/A	9.83	304	100390.767	1311	N/A	11.39	649	20.650	3	0
13985	Central	N/A	0.02	0	41.850	1	N/A	8.08	1456	7816.150	51	0
13986	Central	N/A	1.13	4	302.283	1	N/A	14.91	1100	0	0	0
13987	Central	N/A	0.03	0	11802.083	79	N/A	10.87	1094	26668.100	97	0
13988	Central	N/A	0	0	13961.317	93	N/A	14.41	1461	9365.200	24	0
13989	Central	N/A	0	0	9726.317	101	N/A	20.11	1735	218.283	1	0
13990	Central	N/A	0.25	0	3006.500	42	N/A	15.93	1155	2504.400	8	0
13991	Central	N/A	0.37	7	2363.833	23	N/A	26.83	2045	9412.250	70	0
13992	Central	N/A	0	0	0	0	N/A	14.38	1048	61.333	1	0
13993	Central	N/A	4.39	162	21381.633	135	N/A	20.73	1039	5043.883	49	0
13994	Central	N/A	0	0	3197.300	42	N/A	0	0	0	0	0
14000	Plant City	N/A	18.88	614	7138.883	90	N/A	2.69	124	1431.483	17	0
14001	Plant City	N/A	0.61	2	1556.800	12	N/A	0.89	41	0	0	0
14002	Plant City	N/A	0.02	0	271.583	1	N/A	14.03	811	18894.967	87	0
14004	Plant City	N/A	0.05	1	0	0	N/A	0.22	3	0	0	0
14010	Central	N/A	0	0	0	0	N/A	2.11	40	58.183	1	0
14011	Central	N/A	0.74	7	0	0	N/A	6.35	1066	0	0	0
14012	Central	N/A	10.96	690	141119.700	857	N/A	7.34	1240	29958.667	352	0
14014	Central	N/A	0.56	16	0	0	N/A	2.48	675	381.033	2	0
14020	South Hillsborough	N/A	1.14	47	37511.667	560	N/A	10.76	984	26935.367	198	0
14021	South Hillsborough	N/A	12.44	641	84084.533	1357	N/A	16.45	1335	8832.200	53	0
14022	South Hillsborough	N/A	1.03	3	57821.367	566	N/A	6.66	474	409.750	5	0

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the
14023	South Hillsborough	N/A	13.2	407	2350.233	9	N/A	9.49	687	287.600	1	0
14024	South Hillsborough	N/A	3.96	203	76768.900	1167	N/A	5.66	669	3905.800	12	0
14025	South Hillsborough	N/A	1.04	52	54.767	1	N/A	14.76	1380	0	0	0
14026	South Hillsborough	N/A	3.15	62	27041.333	289	N/A	13.74	788	0	0	0
14030	Western	N/A	3.89	85	217934.900	6109	N/A	33.97	2317	23009.183	169	0
14031	Western	N/A	7.46	364	26077.867	276	N/A	14.22	1735	24840.000	104	0
14032	Western	N/A	1.64	48	48438.133	243	N/A	10.16	1320	335.800	4	0
14035	Western	N/A	0.93	72	2705.617	65	N/A	2.21	342	0	0	0
14036	Western	N/A	0	0	0	0	N/A	0.82	30	0	0	0
14037	Western	N/A	0.7	4	0	0	N/A	18.99	2021	20853.150	172	0
14040	Central	N/A	4	242	10952.767	936	N/A	16.12	1594	3986.067	43	0
14041	Central	N/A	12.35	511	113004.500	644	N/A	16.97	1064	7170.250	47	0
14042	Central	N/A	2.14	104	1598.533	6	N/A	11.66	1198	28162.967	223	0
14045	Central	N/A	0.26	4	0	0	N/A	1.01	7	2828.400	6	0
14046	Central	N/A	6.76	251	29243.000	186	N/A	4.01	202	9557.767	115	0
14050	Plant City	N/A	34.07	465	78648.517	1155	N/A	3.2	7	0	0	0
14051	Plant City	N/A	1.76	0	0	0	N/A	0.07	0	0	0	0
14059	Central	N/A	0.07	2	0	0	N/A	2.25	1340	0	0	0
14060	Central	N/A	0	0	0	0	N/A	0.53	31	240.000	1	0
14064	Central	N/A	0	0	0	0	N/A	0.94	452	0	0	0
14065	Central	N/A	0	0	0	0	N/A	7.02	1462	6724.967	245	0
14066	Central	N/A	0	0	0	0	N/A	0.16	12	0	0	0
14069	Western	N/A	3.93	211	90050.783	773	N/A	21.25	1170	0	0	0
14070	Western	N/A	0.08	7	29849.400	674	N/A	18.92	1178	13052.217	101	0
14071	Western	N/A	8.14	344	33604.417	62	N/A	23.33	1331	1985.900	22	0
14079	Western	N/A	0.41	0	0	0	N/A	14.65	1232	3169.350	9	0
14080	Western	N/A	0.01	0	0	0	N/A	16.88	1444	18717.017	109	0
14081	Western	N/A	1.07	81	4.183	1	N/A	11.89	1570	320.483	1	0
14082	Western	N/A	0	0	0	0	N/A	13.35	1054	25918.200	190	0
14083	Western	N/A	0	0	2435.183	7	N/A	15.95	1719	17427.017	38	0
14084	Western	N/A	0.11	5	0	0	N/A	15.78	1161	13274.283	86	0
14089	Central	N/A	0.16	3	0	0	N/A	19.64	727	0	0	0
14090	Central	N/A	0.11	0	1181.367	17	N/A	9.01	676	0	0	0
14091	Central	N/A	0.22	0	0	0	N/A	12.73	1033	8971.733	64	0
14092	Central	N/A	0	0	676.050	3	N/A	17.13	1407	3653.400	12	0
14094	Central	N/A	0.03	2	115.900	1	N/A	10.22	1474	0	0	0
14095	Central	N/A	0	0	0	0	N/A	18.08	1178	0	0	0
14096	Central	N/A	0	0	0	0	N/A	14.04	1323	7981.833	30	0

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the
14099	Central	N/A	2.66	43	515.450	3	N/A	10.56	685	2858.500	6	0
14100	Central	N/A	0	0	8880.200	78	N/A	21.4	2089	9329.167	35	0
14101	Central	N/A	0	0	3104.200	34	N/A	20.71	1527	6648.867	26	0
14102	Central	N/A	1.85	48	32292.100	306	N/A	19.08	1844	68225.333	1414	0
14109	Eastern	N/A	0.45	6	14051.800	104	N/A	5.3	655	47678.017	161	0
14110	Eastern	N/A	3.11	162	1086.967	5	N/A	16.29	734	0	0	0
14111	Eastern	N/A	7.18	485	9886.533	49	N/A	7.93	690	185.617	2	0
14112	Eastern	N/A	2.89	105	7789.500	71	N/A	13.65	912	27825.500	486	0
14114	Eastern	N/A	8.16	392	26968.417	134	N/A	19.14	1926	12520.250	149	0
14115	Eastern	N/A	0.86	9	526.833	2	N/A	3.37	136	0	0	0
14116	Eastern	N/A	0.81	44	1385.133	2	N/A	2.63	397	30172.150	109	0
14117	Eastern	N/A	1.13	69	1904.033	5	N/A	2.34	101	0	0	0
14119	Plant City	N/A	0.05	2	0	0	N/A	10.74	1007	0	0	0
14120	Plant City	N/A	0.4	5	0	0	N/A	14.5	966	6387.017	43	0
14121	Plant City	N/A	0.48	10	7656.867	76	N/A	11.52	741	15788.400	77	0
14122	Plant City	N/A	0	0	0	0	N/A	22.94	1347	5008.200	36	0
14123	Plant City	N/A	5.85	149	3850.833	39	N/A	14.63	893	0	0	0
14124	Plant City	N/A	5.01	106	4270.600	32	N/A	13.97	885	2439.200	9	0
14125	Plant City	N/A	0.82	1	122.650	1	N/A	24.61	1696	0	0	0
14144	South Hillsborough	N/A	7.13	573	27934.283	477	N/A	15.07	1263	0	0	0
14145	South Hillsborough	N/A	0.19	2	247.150	2	N/A	22.12	1756	0	0	0
14146	South Hillsborough	N/A	13.37	431	47953.333	225	N/A	16.26	542	21.217	1	0
14147	South Hillsborough	N/A	9.8	182	1612.650	37	N/A	16.98	913	460.800	2	0
14187	Winter Haven	N/A	6.75	176	4981.850	54	N/A	14.66	544	0	0	0
14188	Winter Haven	N/A	3.48	102	42.133	1	N/A	4.31	75	899.350	3	0
14196	Eastern	N/A	0	0	0	0	N/A	0.07	1	0	0	0
14197	Eastern	N/A	1.87	31	2501.167	8	N/A	0.78	54	4921.700	24	0
14198	Eastern	N/A	1.96	49	94977.000	661	N/A	3.57	246	199.333	1	0
14199	Eastern	N/A	0.95	34	153.967	2	N/A	0.55	24	0	0	0
14200	South Hillsborough	N/A	0	0	0	0	N/A	0	0	0	0	0
14201	South Hillsborough	N/A	0	0	0	0	N/A	0	0	0	0	0
14202	South Hillsborough	N/A	3.26	25	68569.850	388	N/A	12.61	1067	54588.917	155	0
14203	South Hillsborough	N/A	1.4	4	47.200	1	N/A	1.23	8	0	0	0
14207	Eastern	N/A	0.15	2	0	0	N/A	0	0	0	0	0

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the
14208	Eastern	N/A	0	0	0	0	N/A	0.05	1	0	0	0
14209	Eastern	N/A	0	0	0	0	N/A	0	0	0	0	0
14210	Eastern	N/A	0	0	0	0	N/A	0.01	1	0	0	0
14216	Central	N/A	5.61	126	5461.900	61	N/A	12.95	38	0	0	0
14217	Central	N/A	5.21	24	2149.917	4	N/A	7.86	722	2133.067	8	0
14218	Central	N/A	0.06	2	0	0	N/A	23.9	1915	0	0	0
14221	Central	N/A	0	0	0	0	N/A	20.64	1657	5818.600	18	0
14222	Central	N/A	0	0	4079.900	30	N/A	21.26	1214	283.283	1	0
14226	Central	N/A	0.33	29	0	0	N/A	0.69	136	0	0	0
14227	Central	N/A	0	0	0	0	N/A	0.04	29	0	0	0
14228	Central	N/A	0	0	0	0	N/A	0.26	530	0	0	0
14229	Central	N/A	0	0	0	0	N/A	0	0	0	0	0
14230	Central	N/A	0	0	0	0	N/A	0.04	402	0	0	0
14231	Central	N/A	0	0	0	0	N/A	0	0	0	0	0
14232	Central	N/A	0	0	0	0	N/A	0	0	0	0	0
14233	Central	N/A	0	0	0	0	N/A	0	0	0	0	0
14258	South Hillsborough	N/A	12.96	152	11043.400	93	N/A	23.63	1456	9392.317	60	0
14259	South Hillsborough	N/A	40.9	348	234691.233	562	N/A	4.14	116	4278.833	72	0
14260	South Hillsborough	N/A	0.07	1	343926.367	803	N/A	34.74	2284	240.000	1	0
14261	South Hillsborough	N/A	79.7	838	162527.600	1754	N/A	23.2	865	837.667	7	0
14266	Central	N/A	2.2	131	2089.000	28	N/A	10.42	2469	86133.333	319	0
14267	Central	N/A	0	0	82.833	1	N/A	19.13	1591	0	0	0
14268	Central	N/A	0	0	0	0	N/A	12.34	865	0	0	0
14269	Central	N/A	0	0	0	0	N/A	0	0	0	0	0
14274	Western	N/A	28.53	520	24016.867	158	N/A	21.69	505	14776.667	66	0
14275	Western	N/A	1.43	9	6385.950	72	N/A	28.51	1330	41315.000	165	0
14306	Dade City	N/A	17.18	425	153097.267	747	N/A	2	23	1126.200	3	0
14310	Eastern	N/A	0	0	0	0	N/A	0	0	0	0	0
14316	South Hillsborough	N/A	0.19	3	3192.383	11	N/A	30.15	1725	0	0	0
14317	South Hillsborough	N/A	0	0	0	0	N/A	8.18	681	10631.983	59	0
14319	South Hillsborough	N/A	0	0	0	0	N/A	5.73	540	0	0	0
14320	South Hillsborough	N/A	0.36	49	20885.067	224	N/A	8.67	916	159.983	2	0
14341	Eastern	N/A	4.22	22	2141.200	13	N/A	4.64	68	555.567	2	0
14349	Western	N/A	0	0	0	0	N/A	0	0	0	0	0

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the
14350	Western	N/A	0	0	0	0	N/A	0	0	0	0	0
14355	Eastern	N/A	2.19	25	8768.067	149	N/A	9.47	2617	526.400	1	0
14356	Eastern	N/A	0.86	93	0	0	N/A	6.07	1685	0	0	0
14358	Eastern	N/A	0.2	7	0	0	N/A	6.59	1085	0	0	0
14396	South Hillsborough	N/A	1.92	92	61167.317	658	N/A	15.89	2182	20068.183	362	0
14397	South Hillsborough	N/A	2.09	46	6888.733	106	N/A	4.37	562	0	0	0
14398	South Hillsborough	N/A	5.79	170	44073.300	299	N/A	17.7	1416	4037.667	65	0
14399	South Hillsborough	N/A	4.74	128	20797.917	230	N/A	25.99	2353	43502.900	609	0
14937	Winter Haven	N/A	2.75	160	9627.033	89	N/A	0.88	32	0	0	0
CB_13647	South Hillsborough	N/A	1.28	0	12934.567	75	N/A	22.41	0	0	0	0
CB_14578	Plant City	N/A	0	0	0	0	N/A	3.28	0	0	0	0
EAST BAY	South Hillsborough	N/A	0.7	0	0	0	N/A	9.95	0	0	0	0
Fowler	Central	N/A	1.1	0	0	0	N/A	6.84	0	0	0	0
SCB_5206	Winter Haven	N/A	0	0	0	0	N/A	0	0	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	4.35	0.1	0	0	0	4.25	98	0	0	-12.76%	6.77
0	Yes	3.29	2.6	0	0	0	0.69	1	0	0	-18.47%	4.59
0	Yes	7.86	0.03	0	0	0	7.83	103	0	0	-9.07%	3.91
0	Yes	4.25	0	0	0	0	4.25	105	0	0	-21.10%	6.32
0	Yes	1.83	0.28	0	0	0	1.55	35	0	0	-6.92%	3.63
0	Yes	6.09	0.16	0	0	0	5.93	94	0	0	-8.20%	6.72
0	Yes	3.57	0.25	0	0	0	3.32	35	47545.733	873	8.37%	7.38
0	Yes	0.44	0.01	0	0	0	0.43	2	0	0	5.32%	2.77
0	Yes	2.26	0.09	0	0	0	2.17	32	769.833	149	-11.18%	2.94
0	Yes	5.51	0.89	0	0	0	4.62	106	47391.417	2480	-8.59%	6.92
0	Yes	6.14	0.43	0	0	0	5.71	77	0	0	-1.59%	7.42
0	Yes	0.75	0.09	0	0	0	0.66	31	0	0	54.88%	1.27
0	Yes	1.51	0.82	0	0	0	0.69	86	0	0	31.80%	3.73
0	Yes	1.58	0.68	0	0	0	0.9	35	0	0	7.48%	4.31
0	Yes	2.63	0.67	22	0	0	1.96	33	0	0	41.73%	9
0	Yes	4.47	1.17	36	0	0	3.3	31	12.400	6	7.05%	10.18
0	Yes	6.98	1.07	24	0	0	5.91	187	37388.767	5678	-55.49%	5.03
0	Yes	3.44	0.39	0	0	0	3.05	79	0	0	10.25%	6.67
0	Yes	0.93	0.11	0	0	0	0.82	16	20461.400	778	-1.98%	2.47
0	Yes	2.43	0.1	0	0	0	2.33	88	0	0	-6.59%	5.95
0	Yes	1.88	0.13	0	0	0	1.75	86	0	0	-5.01%	4.55
0	Yes	1.34	0.04	0	0	0	1.3	80	2434.483	1897	-14.48%	5.14
0	Yes	1.2	0.46	0	0	0	0.74	36	0	0	-7.14%	4.68
0	Yes	1.72	0.23	0	0	0	1.49	28	0	0	-4.27%	6.05
0	Yes	1.22	0.29	0	0	0	0.93	34	0	0	-5.28%	5.02
0	Yes	5.63	0.39	0	0	0	5.24	79	0	0	-6.90%	8.1
0	Yes	7.1	0.29	0	0	0	6.81	109	0	0	-23.20%	3.31
0	Yes	1.85	0.03	0	0	0	1.82	112	0	0	-14.94%	4.67
0	Yes	2.27	0.02	0	0	0	2.25	81	0	0	6.60%	5.49
0	Yes	3.91	1.53	0	0	0	2.38	128	0	0	8.07%	6.43

(N) Number of Automatic Line Sectionalizing Devices on the	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	2.9	0.08	0	0	0	2.82	176	75320.083	1463	-8.13%	4.52
0	Yes	2.21	0.1	0	0	0	2.11	68	3940.350	723	-1.12%	4.41
0	Yes	3.1	0.07	0	0	0	3.03	61	0	0	-2.55%	6.87
0	Yes	2.36	1.68	0	0	0	0.68	3	0	0	-1.06%	5.6
0	Yes	4.82	0.16	0	0	0	4.66	109	237856.383	4232	0.00%	8.05
0	Yes	2.52	0.06	0	0	0	2.46	170	0	0	15.33%	5.04
0	Yes	1.71	0.05	0	0	0	1.66	106	0	0	-3.08%	8.51
0	Yes	2.04	0.18	0	0	0	1.86	138	0	0	-2.97%	7.83
0	Yes	1.96	0.1	0	0	0	1.86	180	0	0	-3.83%	4.77
0	Yes	2.89	0	0	0	0	2.89	255	7237.850	1444	57.84%	8.05
0	Yes	1.33	0.07	0	0	0	1.26	81	0	0	0.00%	3.06
0	Yes	2.64	0.13	0	0	0	2.51	204	0	0	-4.34%	5.95
0	Yes	1.63	0.05	0	0	0	1.58	125	4422.000	1320	-2.83%	4.47
0	Yes	1.98	1.54	3	692.800	30	0.44	2	0	0	-4.57%	5.43
0	Yes	2.02	0.17	0	0	0	1.85	49	0	0	-7.27%	4.21
0	Yes	1.77	0.09	0	0	0	1.68	11	0	0	-14.66%	6.11
0	Yes	2.55	0.13	0	0	0	2.42	168	7969.867	1573	-2.56%	6.47
0	Yes	1.56	0.54	0	0	0	1.02	7	0	0	26.11%	2.56
0	Yes	3.42	1.49	1	0	0	1.93	6	0	0	-2.16%	3.17
0	Yes	1.53	0.15	2	0	0	1.38	8	4676.267	193	34.09%	7.67
0	Yes	2.03	0.16	0	0	0	1.87	182	11872.967	32	-3.84%	5.01
0	Yes	1.95	0	0	0	0	1.95	143	61494.333	1495	-14.61%	5.2
0	Yes	2.19	0	0	0	0	2.19	188	7621.083	2184	-9.20%	2.96
0	Yes	1.98	0	0	0	0	1.98	125	0	0	-2.99%	2.6
0	Yes	3.23	0	0	0	0	3.23	174	0	0	-1.83%	7.5
0	Yes	2.07	0.02	0	0	0	2.05	185	0	0	0.83%	8.53
0	Yes	0.85	0	0	0	0	0.85	79	0	0	-2.29%	5.98
0	Yes	0.59	0.05	0	0	0	0.54	77	0	0	-7.24%	2.05
0	Yes	1.54	0.37	0	0	0	1.17	58	0	0	-2.21%	7.08
0	Yes	1.28	0.03	0	0	0	1.25	64	0	0	-3.58%	5.11
0	Yes	2.13	0.05	0	0	0	2.08	156	0	0	-13.04%	4.8
0	Yes	3.37	0.32	0	0	0	3.05	24	38926.800	567	-4.57%	3.76
0	Yes	3.21	0.96	0	0	0	2.25	24	0	0	-9.02%	8.47
0	Yes	2.08	0.16	0	0	0	1.92	141	2576.167	754	5.32%	5.74
0	Yes	1.99	0.16	1	0	0	1.83	82	0	0	-0.69%	5.73
0	Yes	1.61	0	0	0	0	1.61	38	18933.200	264	0.40%	5.05
0	Yes	3.17	0.16	0	0	0	3.01	145	0	0	-15.22%	6.24
0	Yes	1.06	0.06	0	0	0	1	14	0	0	10.29%	5.79
0	Yes	2.4	0.13	0	0	0	2.27	127	5518.900	1446	2.43%	6.32
0	Yes	2.35	0.16	0	0	0	2.19	132	0	0	0.64%	7.91
0	Yes	1.02	0.32	0	0	0	0.7	52	0	0	-8.22%	5.25

(N) Number of Automatic Line Sectionalizing Devices on the	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	0.44	0.07	0	0	0	0.37	23	0	0	-8.90%	5.63
0	Yes	2.48	0.24	0	0	0	2.24	36	0	0	-20.39%	4.1
0	Yes	1.25	0.37	0	0	0	0.88	8	15668.333	79	10.38%	3.51
0	Yes	3.37	0.34	0	0	0	3.03	44	17766.667	325	14.08%	6.24
0	Yes	2.79	0.4	0	0	0	2.39	110	0	0	-1.22%	5.65
0	Yes	1.19	0.04	0	0	0	1.15	65	0	0	-6.16%	2.59
0	Yes	1.28	0.93	0	0	0	0.35	16	0	0	3.02%	5.45
0	Yes	2.52	0.4	0	0	0	2.12	77	24300.933	604	-8.52%	4.83
0	Yes	2.81	0.24	0	0	0	2.57	146	0	0	-1.37%	6.5
0	Yes	1.35	0.19	0	0	0	1.16	124	37443.850	1644	-19.46%	2.69
0	Yes	1.35	0.21	0	0	0	1.14	92	0	0	-2.65%	4.04
0	Yes	3.79	1.13	0	14136.250	43	2.66	149	14831.700	45	-27.27%	6.72
0	Yes	2.63	0.94	0	0	0	1.69	102	0	0	100.00%	4.2
0	Yes	3.38	0.1	0	0	0	3.28	86	0	0	0.76%	7.99
0	Yes	6.76	2.11	0	0	0	4.65	96	0	0	-16.02%	7.18
0	Yes	4.52	0.07	0	0	0	4.45	109	0	0	2.34%	7.01
0	Yes	6.16	0.07	0	0	0	6.09	46	57181.250	1307	-10.30%	7.66
0	Yes	2.41	0	0	0	0	2.41	66	0	0	145.04%	9.63
0	Yes	2.14	0	0	0	0	2.14	158	0	0	4.11%	3.55
0	Yes	3.83	0.13	0	0	0	3.7	247	0	0	1.97%	4.65
0	Yes	1.89	0.16	0	0	0	1.73	160	0	0	3.76%	3.59
0	Yes	2.16	0.14	0	0	0	2.02	84	0	0	-5.50%	5.15
0	Yes	1.65	0	0	0	0	1.65	50	73396.250	1130	-0.81%	6.11
0	Yes	1.45	0.27	0	0	0	1.18	46	12.283	2	-0.95%	6.24
0	Yes	3.29	0.15	0	0	0	3.14	152	70560.950	1207	2.55%	7.23
0	Yes	2.71	1.3	0	0	0	1.41	107	0	0	-18.89%	5.11
0	Yes	2.15	0.31	0	0	0	1.84	26	0	0	6.09%	5.05
0	Yes	1.97	0.45	0	0	0	1.52	54	0	0	-10.53%	4.25
0	Yes	4.79	0.21	0	0	0	4.58	252	216318.967	1560	-17.54%	8.04
0	Yes	1.05	0.17	0	0	0	0.88	37	0	0	5.29%	1.99
0	Yes	3.54	1.56	0	0	0	1.98	102	0	0	-2.03%	9.63
0	Yes	2.23	0.07	0	0	0	2.16	63	0	0	13.98%	5.38
0	Yes	0	0	0	0	0	0	0	0	0	0.00%	0
0	Yes	7.54	3.07	0	0	0	4.47	93	194675.133	4756	9.88%	8.34
0	Yes	7.83	1.1	0	0	0	6.73	152	17875.433	5547	-3.34%	9.56
0	Yes	2.28	0.09	0	0	0	2.19	17	0	0	-20.13%	4.8
0	Yes	3.17	1	0	0	0	2.17	27	0	0	-1.83%	6.44
0	Yes	3.11	0.31	0	4.200	3	2.8	62	8.750	5	14.49%	8.69
0	Yes	1.42	0.09	0	0	0	1.33	49	59630.083	897	33.88%	6.56
0	Yes	2.98	0.03	0	0	0	2.95	123	0	0	-29.13%	3.6
0	Yes	3.68	0.03	0	0	0	3.65	103	0	0	25.73%	6.01

(N) Number of Automatic Line Sectionalizing Devices on the	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	4.19	1.66	0	0	0	2.53	130	171402.733	1765	-9.35%	6.11
0	Yes	6.69	0.61	0	0	0	6.08	32	37314.333	790	-41.11%	3.08
0	Yes	4.09	0	0	0	0	4.09	118	121826.517	1833	-9.49%	8.11
0	Yes	3.37	0.03	0	0	0	3.34	105	0	0	-2.97%	5.89
0	Yes	2.01	0.13	0	0	0	1.88	49	0	0	-6.96%	4.28
0	Yes	4.44	0.13	0	0	0	4.31	150	0	0	44.81%	7.4
0	Yes	1.01	0.13	0	0	0	0.88	17	0	0	-0.42%	2.38
0	Yes	3.72	0.96	0	0	0	2.76	61	217838.300	2391	1.91%	8.53
0	Yes	1.19	0.12	0	0	0	1.07	55	46530.000	374	6.40%	2.16
0	Yes	1.49	0.08	0	0	0	1.41	27	0	0	4.23%	2.96
0	Yes	1.38	0.16	0	0	0	1.22	99	144469.383	1003	47.86%	4.14
0	Yes	1.43	0.13	0	0	0	1.3	38	50088.333	1025	10.24%	4.95
0	Yes	1.7	0.04	0	0	0	1.66	64	134392.550	1544	5.58%	7.95
0	Yes	0.61	0.25	0	0	0	0.36	33	2074.017	1368	-16.43%	4.12
0	Yes	1.45	0.38	0	0	0	1.07	135	0	0	-40.04%	5.9
0	Yes	1.1	0.28	0	0	0	0.82	69	166682.867	1829	-4.80%	5.35
0	Yes	3.4	1.33	24	0	0	2.07	205	0	0	-3.53%	7.93
0	Yes	9.89	0.4	0	0	0	9.49	69	62331.800	1455	-8.29%	3.43
0	Yes	6.14	0.07	0	0	0	6.07	69	32362.083	1049	-4.95%	7.49
0	Yes	6.01	0.07	0	0	0	5.94	67	0	0	-10.53%	3.23
0	Yes	3.49	0.37	0	0	0	3.12	86	40949.217	641	0.24%	8.26
0	Yes	3.54	0.02	0	0	0	3.52	22	0	0	-3.37%	5.73
0	Yes	3.1	0.13	0	0	0	2.97	146	0	0	-2.58%	6.05
0	Yes	1.42	0.04	0	0	0	1.38	53	9828.050	1098	-0.43%	4.62
0	Yes	1.35	0	0	0	0	1.35	79	118480.500	2034	2.31%	7.52
0	Yes	3.05	1.04	0	0	0	2.01	60	0	0	2.25%	7.26
0	Yes	2.14	0.07	0	0	0	2.07	68	34503.733	1215	-9.48%	4.68
0	Yes	1.22	0.34	0	0	0	0.88	71	0	0	2.88%	3.57
0	Yes	0.86	0.86	0	0	0	0	0	0	0	77.85%	5.3
0	Yes	1.59	0.09	0	0	0	1.5	131	0	0	-1.86%	7.37
0	Yes	0.8	0.06	0	0	0	0.74	29	0	0	99.35%	6.16
0	Yes	0.51	0.06	0	0	0	0.45	49	0	0	-2.19%	2.68
0	Yes	1.34	0.02	0	0	0	1.32	109	0	0	1.93%	7.41
0	Yes	1.58	0.08	0	0	0	1.5	188	623895.967	2287	-3.24%	6.87
0	Yes	1.77	0.36	0	0	0	1.41	31	55221.233	762	-2.03%	5.78
0	Yes	0.48	0.3	0	0	0	0.18	2	0	0	1.11%	3.63
0	Yes	4.18	0.81	0	0	0	3.37	218	0	0	-8.97%	7
0	Yes	1.47	0.04	0	0	0	1.43	133	0	0	-2.03%	7.73
0	Yes	3.65	1.65	0	0	0	2	17	0	0	-4.41%	7.16
0	Yes	4.9	1.93	0	0	0	2.97	13	153716.767	2989	-6.93%	9.26
0	Yes	4.11	0.15	0	0	0	3.96	79	0	0	-4.37%	8.76

(N) Number of Automatic Line Sectionalizing Devices on the	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	3.54	0.11	0	0	0	3.43	63	0	0	12.21%	4.32
0	Yes	3.87	1.94	12	0	0	1.93	13	0	0	0.12%	8.13
0	Yes	2.77	0.35	0	215598.150	3070	2.42	16	0	0	-1.09%	8.16
0	Yes	4.52	0.23	0	0	0	4.29	168	0	0	3.63%	9.13
0	Yes	3.76	0.36	0	0	0	3.4	103	165504.267	2120	6.30%	8.77
0	Yes	1.7	0.2	0	0	0	1.5	106	20284.550	429	-9.19%	3.26
0	Yes	2.99	0.38	0	0	0	2.61	55	32911.900	647	11.41%	6.15
0	Yes	1.54	0.73	0	0	0	0.81	42	39613.283	881	27.52%	4.17
0	Yes	2.09	0.17	0	0	0	1.92	93	71131.350	2528	7.69%	6.72
0	Yes	1.26	0.22	0	0	0	1.04	41	0	0	-11.02%	3.15
0	Yes	2.12	0.4	0	0	0	1.72	66	0	0	-2.09%	2.34
0	Yes	1.25	0.06	0	0	0	1.19	66	0	0	-6.07%	4.02
0	Yes	2.27	0	0	0	0	2.27	156	0	0	-8.13%	2.94
0	Yes	2.21	0.06	0	0	0	2.15	116	0	0	-4.86%	5.09
0	Yes	2.58	0.01	0	0	0	2.57	108	0	0	-2.61%	5.6
0	Yes	1.86	0.16	0	0	0	1.7	70	15157.933	271	34.85%	7.43
0	Yes	4.46	0.51	0	0	0	3.95	132	0	0	-0.52%	7.62
0	Yes	3.53	0.32	0	0	0	3.21	85	0	0	14.49%	7.11
0	Yes	4.33	0.4	0	0	0	3.93	25	0	0	7.78%	7.48
0	Yes	4.99	1.91	0	0	0	3.08	2	119265.917	825	8.76%	3.85
0	Yes	1.33	0.12	0	0	0	1.21	19	15813.400	204	23.72%	2.66
0	Yes	1.43	0.78	3	0	0	0.65	26	0	0	71.22%	5.89
0	Yes	3.12	0.46	0	0	0	2.66	173	0	0	-2.48%	4.72
0	Yes	0.91	0.17	0	0	0	0.74	83	0	0	-19.25%	3.86
0	Yes	0.64	0.05	0	0	0	0.59	46	0	0	25.00%	3.4
0	Yes	2.51	0.95	0	0	0	1.56	91	0	0	6.94%	5.7
0	Yes	2.56	0.23	0	0	0	2.33	123	296200.633	3155	-10.02%	4.31
0	Yes	1.13	0.39	0	0	0	0.74	21	0	0	9.06%	3.25
0	Yes	1.24	0.13	0	0	0	1.11	98	0	0	-5.80%	7.15
0	Yes	0.83	0.16	0	0	0	0.67	23	0	0	-5.12%	6.67
0	Yes	1.22	0.17	0	0	0	1.05	93	0	0	-2.93%	3.64
0	Yes	2.43	0.35	0	0	0	2.08	100	18744.200	1788	-3.94%	5.37
0	Yes	2.24	0.33	0	0	0	1.91	15	0	0	2.33%	7.03
0	Yes	5.71	1.91	0	0	0	3.8	112	88990.500	1845	15.98%	9.58
0	Yes	2.97	0.26	0	0	0	2.71	68	226067.400	3533	-9.85%	4.12
0	Yes	1.66	0.99	0	0	0	0.67	8	0	0	-1.52%	2.6
0	Yes	2.94	0.79	0	0	0	2.15	71	0	0	-8.45%	4.44
0	Yes	2	0.17	0	0	0	1.83	76	80749.433	1397	-6.49%	4.61
0	Yes	2.66	0.14	0	0	0	2.52	194	0	0	-0.95%	7.31
0	Yes	1.36	0.08	0	0	0	1.28	21	0	0	0.00%	3.11
0	Yes	3.08	0.17	0	0	0	2.91	43	0	0	-4.30%	5.34

(N) Number of Automatic Line Sectionalizing Devices on the	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	2.47	0.5	0	0	0	1.97	46	0	0	-8.23%	4.46
0	Yes	2.98	0.23	0	0	0	2.75	65	22261.867	516	-5.22%	3.63
0	Yes	3.25	0.83	0	0	0	2.42	67	0	0	-9.95%	7.06
0	Yes	0.58	0.06	0	0	0	0.52	7	37530.000	834	-10.05%	3.85
0	Yes	2.53	0.13	0	0	0	2.4	33	6551.000	1374	-1.24%	7.97
0	Yes	3.18	0.04	0	0	0	3.14	75	52052.067	4056	-11.75%	6.91
0	Yes	3.54	0.23	0	0	0	3.31	79	113872.583	1419	0.56%	7.12
0	Yes	2.36	0.11	0	0	0	2.25	84	5640.883	2727	-1.50%	5.92
0	Yes	2.67	0.26	7	0	0	2.41	112	39097.800	1218	-0.56%	5.32
0	Yes	3.44	0.17	0	0	0	3.27	90	0	0	2.37%	6.48
0	Yes	5.69	1.8	0	0	0	3.89	10	0	0	-72.37%	1.92
0	Yes	7.39	4.21	0	0	0	3.18	3	0	0	-30.94%	8.46
0	Yes	6.68	2.85	0	0	0	3.83	8	0	0	176.43%	4.34
0	Yes	4.77	3.13	0	0	0	1.64	3	2861.817	2601	-5.80%	12.02
0	Yes	5.78	4.8	0	0	0	0.98	3	0	0	-9.90%	6.92
0	Yes	3.35	1.38	0	0	0	1.97	4	0	0	-28.09%	8.27
0	Yes	4.03	1.81	0	0	0	2.22	15	0	0	-20.94%	3.85
0	Yes	2.68	0	0	0	0	2.68	89	0	0	-1.61%	6.71
0	Yes	3.6	0.1	0	0	0	3.5	84	0	0	-17.22%	4.23
0	Yes	2.67	0.17	0	0	0	2.5	160	90612.883	4142	-4.70%	6.49
0	Yes	0.46	0.02	0	0	0	0.44	0	0	0	-24.97%	5.59
0	Yes	12.58	0.11	0	0	0	12.47	140	123574.150	3751	-15.22%	6.07
0	Yes	1.99	0.28	0	0	0	1.71	4	87907.200	2640	-25.43%	3.49
0	Yes	0.34	0.34	0	0	0	0	0	0	0	-12.96%	5.44
0	Yes	0.76	0.76	0	0	0	0	0	0	0	-4.06%	4.96
0	Yes	0	0	0	0	0	0	0	0	0	100.00%	0.42
0	Yes	0.78	0.78	0	0	0	0	0	0	0	15.38%	2.85
0	Yes	0.76	0.76	0	0	0	0	0	0	0	-100.00%	0
0	Yes	1.09	1.09	0	0	0	0	0	40.933	1	-50.41%	0.6
0	Yes	1.53	1.51	133	0	0	0.02	0	42579.883	942	1.18%	6.02
0	Yes	0.62	0.62	0	0	0	0	0	1163.950	34	20.78%	2.79
0	Yes	2.14	0.47	0	0	0	1.67	4	0	0	-14.56%	7.63
0	Yes	2.88	0.09	0	0	0	2.79	8	0	0	48.86%	4.57

(N) Number of Automatic Line Sectionalizing Devices on the	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	2.45	0.16	0	0	0	2.29	9	0	0	29.24%	2.21
0	Yes	1.5	0.51	0	0	0	0.99	4	0	0	-32.69%	1.4
0	Yes	2.32	2.32	0	0	0	0	0	0	0	-9.70%	2.7
0	Yes	1.68	1.68	0	0	0	0	0	0	0	183.64%	6.24
0	Yes	3.99	0.11	0	0	0	3.88	194	8806.817	959	-25.19%	4.99
0	Yes	5.77	0.97	0	0	0	4.8	218	0	0	-4.82%	6.32
0	Yes	2.84	0.33	0	0	0	2.51	50	0	0	45.29%	5.55
0	Yes	0.95	0.94	0	0	0	0.01	0	0	0	-11.52%	8.6
0	Yes	1.22	1.21	0	0	0	0.01	0	0	0	15.72%	7.51
0	Yes	1.24	1.24	0	0	0	0	0	0	0	10.19%	7.14
0	Yes	1.52	0.22	0	0	0	1.3	27	0	0	-4.76%	5.6
0	Yes	3.04	0.17	0	0	0	2.87	85	249613.717	4367	-3.38%	3.72
0	Yes	3.01	0.12	0	0	0	2.89	175	0	0	-4.62%	3.92
0	Yes	4.51	0.74	0	0	0	3.77	79	0	0	-39.20%	5.01
0	Yes	3.09	0.12	0	0	0	2.97	148	1635.817	127	-1.30%	3.03
0	Yes	3.43	0.07	0	0	0	3.36	134	9815.167	1645	-15.03%	4.75
0	Yes	5.42	0.3	0	0	0	5.12	150	0	0	9.97%	6.51
0	Yes	3.77	0.62	0	0	0	3.15	43	0	0	-3.27%	5.03
0	Yes	6.75	1.1	0	0	0	5.65	145	0	0	-20.33%	6.74
0	Yes	3.82	0.12	0	0	0	3.7	152	118213.217	1322	8.75%	5.59
0	Yes	24.02	0	0	0	0	24.02	107	143871.167	1538	-15.18%	5.81
0	Yes	3.22	0.08	0	0	0	3.14	36	297666.400	2733	-24.38%	6.67
0	Yes	3.01	1.48	0	0	0	1.53	8	54953.317	1714	1.09%	6.48
0	Yes	4.38	0.49	0	0	0	3.89	87	6297.833	1303	-4.44%	8.6
0	Yes	5.62	3.63	0	0	0	1.99	3	13602.583	3343	-18.01%	6.6
0	Yes	3.45	3.12	0	0	0	0.33	0	0	0	12.53%	4.94
0	Yes	3.86	0.24	0	0	0	3.62	171	5733.200	44	-5.60%	6.07
0	Yes	1.7	0.04	0	0	0	1.66	44	0	0	5.32%	3.96
0	Yes	1.36	0.05	0	0	0	1.31	20	0	0	-3.47%	3.06
0	Yes	3.06	0.16	0	0	0	2.9	149	2.050	1	23.46%	4.42
0	Yes	3.21	0.12	0	0	0	3.09	83	46017.833	946	0.54%	7.41
0	Yes	2.07	0.44	0	0	0	1.63	28	0	0	-2.89%	5.71
0	Yes	2.48	0.63	0	0	0	1.85	43	34039.850	935	-8.98%	3.85
0	Yes	0.58	0.58	0	0	0	0	0	0	0	64.29%	1.38
0	Yes	3.79	3.47	0	0	0	0.32	3	0	0	-12.43%	4.65
0	Yes	1.17	1.17	0	0	0	0	0	0	0	0.00%	0.07
0	Yes	0.97	0.97	0	0	0	0	0	0	0	16.67%	0.07
0	Yes	1.12	1.12	0	0	0	0	0	0	0	0.00%	0.07

(N) Number of Automatic Line Sectionalizing Devices on the	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	2.14	2.14	0	0	0	0	0	0	0	-36.98%	1.21
0	Yes	3.12	2.76	1	0	0	0.36	1	0	0	15.88%	3.94
0	Yes	1.52	1.33	0	0	0	0.19	11	0	0	1.69%	1.81
0	Yes	4.45	0.1	0	0	0	4.35	50	1464.900	428	33.33%	5.08
0	Yes	6.83	0.11	0	0	0	6.72	61	6290.000	60	-6.85%	5.98
0	Yes	1.76	0.37	0	0	0	1.39	5	24244.000	464	-12.86%	7.66
0	Yes	1.35	0.07	0	0	0	1.28	7	0	0	110.83%	3.31
0	Yes	1.5	0.07	0	0	0	1.43	34	0	0	-3.46%	3.35
0	Yes	3.61	0.06	0	0	0	3.55	128	0	0	9.22%	4.62
0	Yes	5.04	0.2	0	0	0	4.84	164	10720.317	2851	-7.05%	6.72
0	Yes	3.88	0.11	0	0	0	3.77	97	195491.533	3394	-6.92%	4.44
0	Yes	1.88	0.06	0	0	0	1.82	67	49888.900	1833	-3.27%	5.03
0	Yes	2.26	0.19	0	0	0	2.07	83	98588.333	1620	-0.69%	4.32
0	Yes	2.39	0.31	0	0	0	2.08	74	0	0	3.34%	5.88
0	Yes	2.23	1.01	0	0	0	1.22	7	1516.500	27	21.52%	4.97
0	Yes	1.5	0.12	0	0	0	1.38	6	0	0	-20.20%	5.49
0	Yes	2.69	0.16	0	0	0	2.53	173	88561.083	1370	4.97%	6.55
0	Yes	4.01	0.27	0	0	0	3.74	33	44993.950	800	-19.26%	5.03
0	Yes	1.61	1.21	1	0	0	0.4	0	0	0	-0.26%	7.77
0	Yes	4.45	1.06	0	0	0	3.39	18	0	0	115.92%	10.17
0	Yes	6.09	2.73	0	0	0	3.36	31	300276.300	9223	-26.64%	3.58
0	Yes	5.4	0.31	0	0	0	5.09	53	84025.433	1404	-18.16%	7.66
0	Yes	4.77	2.91	0	0	0	1.86	5	0	0	7.54%	7.42
0	Yes	2.16	0.83	0	0	0	1.33	4	0	0	334.91%	10.09
0	Yes	5.27	2.51	0	0	0	2.76	32	0	0	52.86%	10.44
0	Yes	2.85	0.35	0	0	0	2.5	210	0	0	-7.59%	6.82
0	Yes	1.6	0.72	0	0	0	0.88	10	0	0	-4.98%	2.29
0	Yes	0.68	0.39	0	0	0	0.29	6	0	0	-31.91%	3.35
0	Yes	2.19	1.14	0	0	0	1.05	29	0	0	2.40%	5.55
0	Yes	2.1	0.94	0	0	0	1.16	45	0	0	-9.48%	4.39
0	Yes	2.58	2.58	0	0	0	0	0	0	0	-52.77%	1.28
0	Yes	2.43	0.08	0	0	0	2.35	53	103512.933	1586	-12.39%	7.21
0	Yes	1.02	0.74	0	0	0	0.28	2	0	0	38.54%	6.65
0	Yes	2.56	0.77	0	0	0	1.79	190	0	0	53.25%	8.49
0	Yes	3.37	1.41	0	0	0	1.96	82	0	0	-2.92%	5.98
0	Yes	1.66	0.81	0	0	0	0.85	4	0	0	22.22%	0.11

(N) Number of Automatic Line Sectionalizing Devices on the	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	0.4	0.08	0	0	0	0.32	1	0	0	242.71%	6.58
0	Yes	1.03	0.97	0	0	0	0.06	0	0	0	-100.00%	0
0	Yes	0.39	0.09	0	0	0	0.3	2	0	0	3.41%	0.91
0	Yes	5.55	2	0	0	0	3.55	15	0	0	-11.63%	6.38
0	Yes	1.23	0.82	0	0	0	0.41	4	36.833	10	37.28%	6.26
0	Yes	1.51	0.76	0	0	0	0.75	1	0	0	-77.06%	1.53
0	Yes	0.09	0.09	0	0	0	0	0	0	0	-14.53%	2.53
0	Yes	0.15	0.15	0	0	0	0	1	0	0	-2.58%	4.54
0	Yes	3.06	0.18	0	0	0	2.88	183	76435.867	1454	-30.38%	5.11
0	Yes	2.58	0.12	6	0	0	2.46	45	0	0	-15.69%	4.89
0	Yes	1.3	0.11	0	0	0	1.19	17	0	0	2.70%	5.7
0	Yes	3.9	0.19	0	0	0	3.71	179	0	0	49.46%	9.67
0	Yes	0.87	0.87	0	0	0	0	0	0	0	-18.52%	1.54
0	Yes	1.03	1.03	0	0	0	0	0	0	0	26.14%	1.93
0	Yes	3.02	0.79	0	0	0	2.23	78	175016.133	2219	1.57%	5.83
0	Yes	0.01	0.01	0	0	0	0	0	0	0	0.00%	0
0	Yes	1.15	1.15	0	0	0	0	0	0	0	14.42%	6.11
0	Yes	0.16	0.16	0	0	0	0	0	0	0	-17.95%	0.32
0	Yes	0.19	0.19	0	0	0	0	0	0	0	6.25%	0.68
0	Yes	1.19	1.19	0	0	0	0	0	0	0	5.10%	5.77
0	Yes	0.98	0.98	2	0	0	0	0	0	0	34.74%	4.15
0	Yes	0.83	0.83	0	0	0	0	0	0	0	33.75%	4.24
0	Yes	0.02	0.02	0	0	0	0	0	0	0	0.00%	0
0	Yes	5.02	0.85	0	0	0	4.17	110	342119.983	3686	-13.72%	5.41
0	Yes	6.49	0.04	0	0	0	6.45	163	47756.333	3431	7.51%	5.3
0	Yes	6.47	0.3	0	0	0	6.17	225	24807.583	5134	-10.69%	6.35
0	Yes	8.97	0.24	0	0	0	8.73	177	2699.267	1702	2.41%	8.09
0	Yes	1.07	0.11	0	0	0	0.96	36	0	0	18.05%	2.42
0	Yes	2.03	1.78	224	0	0	0.25	3	0	0	-32.75%	3.86
0	Yes	0.36	0.24	0	0	0	0.12	3	0	0	15.79%	1.98
0	Yes	3.18	1.66	0	0	0	1.52	38	8938.050	1498	-14.38%	3.93
0	Yes	2.96	0.53	0	0	0	2.43	25	19230.717	653	-12.17%	1.66
0	Yes	5.12	1.12	0	0	0	4	29	20069.400	332	53.72%	4.75
0	Yes	4.46	1.22	0	0	0	3.24	155	0	0	18.62%	4.97
0	Yes	0.63	0.05	0	0	0	0.58	20	0	0	1067.69%	7.59
0	Yes	6.95	0.39	0	0	0	6.56	262	0	0	-32.18%	5.29
0	Yes	3.16	0.26	0	0	0	2.9	182	34010.733	649	-5.65%	5.01
0	Yes	1.84	0.11	0	0	0	1.73	152	0	0	-7.28%	5.99
0	Yes	1.61	0.14	0	0	0	1.47	141	15900.100	1598	-2.33%	7.14
0	Yes	2.09	0.08	0	0	0	2.01	136	5509.333	2066	-3.23%	6.29
0	Yes	8.77	0.38	0	0	0	8.39	103	904916.333	2473	-9.87%	5.66

(N) Number of Automatic Line Sectionalizing Devices on the	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	3.38	0.19	0	0	0	3.19	60	0	0	-9.13%	4.38
0	Yes	2.51	0.92	0	0	0	1.59	7	0	0	19.03%	7.63
0	Yes	1.15	0.07	0	0	0	1.08	16	47260.900	1758	-2.79%	6.97
0	Yes	0.17	0.08	0	0	0	0.09	0	0	0	3.97%	1.31
0	Yes	3.33	0.78	0	0	0	2.55	68	40446.400	2304	-14.90%	4.74
0	Yes	5.18	1.45	0	1.350	1	3.73	90	154284.150	5274	-5.26%	4.86
0	Yes	12.72	7.88	0	0	0	4.84	26	423837.700	642	244.44%	5.58
0	Yes	3.38	1.08	0	119451.367	1661	2.3	39	0	0	-11.86%	5.87
0	Yes	3.63	0.37	0	0	0	3.26	52	52241.567	696	-16.63%	6.92
0	Yes	4.32	0.1	0	210514.983	1510	4.22	215	0	0	3.75%	6.91
0	Yes	3.06	0.1	0	0	0	2.96	37	0	0	-0.22%	4.63
0	Yes	4.65	0.12	0	0	0	4.53	202	248418.217	2754	-3.78%	6.37
0	Yes	5.5	3.64	0	0	0	1.86	12	190504.767	3101	-7.52%	8.49
0	Yes	4.14	0.71	0	0	0	3.43	148	0	0	26.49%	5.73
0	Yes	8.44	2.43	0	0	0	6.01	17	65.417	1	-35.19%	6.5
0	Yes	2.12	0.13	0	0	0	1.99	50	61455.050	2682	-10.25%	9.63
0	Yes	3.19	0.05	0	0	0	3.14	72	0	0	-4.59%	7.06
0	Yes	2.45	0.19	0	0	0	2.26	117	63733.433	2267	-5.47%	3.11
0	Yes	1.25	1.25	0	0	0	0	0	0	0	-1.35%	2.93
0	Yes	0.95	0.12	0	0	0	0.83	23	4098.133	113	37.83%	6.74
0	Yes	1.15	0.68	0	0	0	0.47	17	0	0	1.48%	3.42
0	Yes	1.8	1.02	0	0	0	0.78	25	11693.517	890	2.35%	4.8
0	Yes	2.2	1	0	0	0	1.2	42	0	0	6.83%	6.57
0	Yes	1.22	0.34	0	0	0	0.88	16	0	0	5.49%	4.42
0	Yes	0.75	0.14	0	0	0	0.61	30	0	0	23.23%	1.22
0	Yes	4.45	3.98	1	0	0	0.47	10	3598.733	46	22.18%	6.83
0	Yes	2.3	0.22	0	0	0	2.08	41	343392.850	4493	0.29%	6.96
0	Yes	2.1	0.13	0	0	0	1.97	37	25566.467	999	-12.33%	3.84
0	Yes	2.47	0.7	0	0	0	1.77	33	0	0	-2.20%	4
0	Yes	2.59	0.07	0	0	0	2.52	74	81248.667	856	-8.54%	4.07
0	Yes	8.27	0.59	0	0	0	7.68	97	105091.200	661	-3.94%	3.41
0	Yes	7.97	3.28	0	0	0	4.69	99	0	0	-20.19%	5.02
0	Yes	7.38	0.23	0	0	0	7.15	62	54866.417	1217	-0.37%	5.37
0	Yes	8.55	0.89	0	0	0	7.66	120	193875.383	5781	-7.47%	7.56
0	Yes	4.1	0.49	0	0	0	3.61	74	0	0	-5.20%	9.66
0	Yes	2.94	0.02	0	0	0	2.92	65	0	0	-19.46%	1.78
0	Yes	4.47	0.11	0	0	0	4.36	119	0	0	-75.13%	2.32
0	Yes	1.76	0.12	0	0	0	1.64	65	620.717	343	-32.26%	4.62
0	Yes	1.9	1.88	0	0	0	0.02	0	0	0	-1.79%	2.2

(N) Number of Automatic Line Sectionalizing Devices on the	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	2.97	0.4	0	0	0	2.57	102	0	0	-3.24%	4.48
0	Yes	4.04	0.49	0	0	0	3.55	49	0	0	-14.71%	7.25
0	Yes	4.16	0.05	0	0	0	4.11	108	0	0	-4.83%	8.47
0	Yes	4.07	0.61	0	0	0	3.46	83	121619.517	2077	-12.08%	3.93
0	Yes	4.33	0.04	0	0	0	4.29	146	0	0	-22.39%	5.13
0	Yes	4.82	0.05	0	0	0	4.77	81	0	0	-17.54%	5.69
0	Yes	0.96	0.02	0	0	0	0.94	6	0	0	-4.44%	5.16
0	Yes	5.6	2.59	0	0	0	3.01	3	189591.600	1906	-1.61%	3.66
0	Yes	2.64	0.77	0	0	0	1.87	6	0	0	11.37%	8.13
0	Yes	1.99	1.69	0	0	0	0.3	3	0	0	-4.17%	6.21
0	Yes	4.05	1	0	0	0	3.05	24	0	0	-10.68%	5.02
0	Yes	2.58	0.19	0	0	0	2.39	19	0	0	0.16%	6.19
0	Yes	3.35	0.84	0	0	0	2.51	202	0	0	-6.59%	6.66
0	Yes	4.56	0.81	0	0	0	3.75	70	65431.500	1570	-1.52%	3.88
0	Yes	1.94	0.08	0	0	0	1.86	96	9067.300	930	-5.30%	4.29
0	Yes	3.06	0.21	0	0	0	2.85	57	0	0	-1.86%	5.28
0	Yes	2.02	0.28	0	0	0	1.74	46	0	0	-11.65%	5.84
0	Yes	2.09	0.49	0	0	0	1.6	93	0	0	0.34%	2.97
0	Yes	2.57	0.97	0	0	0	1.6	7	0	0	-30.46%	2.26
0	Yes	3.52	2.13	0	0	0	1.39	40	0	0	-56.17%	2.31
0	Yes	1.93	0.09	0	0	0	1.84	13	0	0	58.63%	4.41
0	Yes	3.51	2.41	0	0	0	1.1	4	0	0	-24.73%	4.87
0	Yes	0.77	0.77	0	0	0	0	0	0	0	14.22%	4.9
0	Yes	3.33	1.67	0	0	0	1.66	2	2828.800	52	-5.15%	6.26
0	Yes	1.84	0.21	0	0	0	1.63	7	5814.400	69	11.40%	6.74
0	Yes	5.08	1.31	0	0	0	3.77	104	162860.867	2636	14.60%	8.32
0	Yes	2.12	1.3	0	0	0	0.82	4	0	0	18.01%	4.39
0	Yes	2.81	1.36	0	0	0	1.45	38	0	0	1.23%	5.76
0	Yes	4.76	1.74	0	0	0	3.02	30	0	0	5.92%	5.01
0	Yes	1.69	1.38	0	0	0	0.31	1	0	0	-12.09%	4.29
0	Yes	2.63	0.74	0	0	0	1.89	9	0	0	-19.75%	7.19
0	Yes	1.96	0.07	0	0	0	1.89	35	0	0	-2.11%	6.04
0	Yes	2.32	0.39	0	0	0	1.93	70	0	0	6.03%	5.45
0	Yes	2.27	0.29	0	0	0	1.98	36	0	0	-11.28%	5.82
0	Yes	0.95	0.56	0	0	0	0.39	9	0	0	6.63%	4.18
0	Yes	3.63	0.32	0	0	0	3.31	42	0	0	-4.28%	4.25
0	Yes	1.89	0.12	0	0	0	1.77	74	0	0	3.59%	4.91
0	Yes	1.87	0.07	0	0	0	1.8	33	0	0	-3.72%	6.47
0	Yes	1.39	0.37	0	0	0	1.02	59	0	0	-0.23%	4.3

(N) Number of Automatic Line Sectionalizing Devices on the	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	1.06	0.02	0	0	0	1.04	62	2915.500	98	172.37%	2.07
0	Yes	2.24	0.53	0	0	0	1.71	57	0	0	2.36%	4.33
0	Yes	0.75	0.33	0	0	0	0.42	10	0	0	-5.84%	4.19
0	Yes	1.87	0.69	0	2.800	2	1.18	149	5569.450	1536	12.93%	6.55
0	Yes	2.06	0.1	0	0	0	1.96	262	0	0	20.22%	5.53
0	Yes	1.26	0.33	0	0	0	0.93	71	0	0	-9.72%	7.06
0	Yes	0.85	0.18	0	0	0	0.67	0	1254.833	873	12.21%	3.86
0	Yes	3.17	0.95	0	0	0	2.22	37	33942.883	1183	-10.35%	4.07
0	Yes	1.93	0.04	0	0	0	1.89	58	0	0	-48.94%	5.08
0	Yes	2.99	0.07	0	0	0	2.92	95	0	0	-10.88%	5.65
0	Yes	2.16	0.08	0	0	0	2.08	92	9254.850	2250	-0.85%	8.15
0	Yes	2.41	1.07	1	0	0	1.34	11	0	0	-1.37%	6.47
0	Yes	2.02	0.12	0	0	0	1.9	9	39678.700	1095	-5.53%	4.78
0	Yes	1.96	0.08	0	0	0	1.88	4	0	0	-11.51%	2.46
0	Yes	1.54	1.54	0	54801.383	1002	0	0	0	0	5.93%	5.54
0	Yes	2.03	0.06	0	0	0	1.97	10	0	0	3.10%	2.99
0	Yes	5.38	0.96	4	0	0	4.42	73	14699.300	437	-8.65%	8.03
0	Yes	3.47	0.15	0	0	0	3.32	75	115357.050	608	-15.12%	3.93
0	Yes	0.37	0.11	0	0	0	0.26	0	0	0	15.22%	0.53
0	Yes	2.16	0.28	0	0	0	1.88	9	920.500	10	-17.41%	4.27
0	Yes	0.6	0.6	0	0	0	0	0	0	0	17.66%	4.73
0	Yes	0.34	0.34	0	0	0	0	0	0	0	-34.01%	2.6
0	Yes	2.34	2.34	0	0	0	0	0	0	0	26.56%	2.43
0	Yes	3.98	3.98	0	0	0	0	0	0	0	20.65%	2.98
0	Yes	3.13	3.13	0	0	0	0	0	12315.733	184	27.24%	3.41
0	Yes	2.24	2.24	0	0	0	0	0	0	0	-21.36%	1.73
0	Yes	2.16	2.16	0	0	0	0	0	0	0	8.76%	3.6
0	Yes	2.73	2.73	0	0	0	0	0	0	0	33.50%	2.75
0	Yes	1.14	1.14	0	0	0	0	0	31014.650	610	-100.00%	0
0	Yes	1.11	1.11	0	0	0	0	0	11147.500	210	-16.85%	0.74
0	Yes	1.13	0.21	0	0	0	0.92	8	69654.167	1238	2.42%	3.81
0	Yes	1.02	0.27	0	0	0	0.75	5	0	0	-7.61%	4.25
0	Yes	1.78	0.04	0	0	0	1.74	54	0	0	-5.46%	3.98
0	Yes	1.16	0.24	0	0	0	0.92	18	0	0	-2.62%	2.6
0	Yes	4.8	0.4	0	0	0	4.4	141	208242.167	3541	-1.16%	7.7
0	Yes	3.35	0.02	0	0	0	3.33	83	0	0	-4.73%	4.63
0	Yes	3.36	0.15	0	0	0	3.21	87	7781.600	1644	1.15%	7.92
0	Yes	5.81	2.05	1	0	0	3.76	36	92808.450	1323	-2.69%	9.4
0	Yes	3.1	0.22	0	0	0	2.88	10	194836.533	3015	9.09%	5.52
0	Yes	2.14	0.05	0	0	0	2.09	7	0	0	9.64%	4.89
0	Yes	1.65	0.44	0	0	0	1.21	9	97300.733	1426	-1.98%	5.93

(N) Number of Automatic Line Sectionalizing Devices on the	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	3.5	0.86	0	0	0	2.64	30	0	0	-0.14%	6.94
0	Yes	2.82	1.05	0	0	0	1.77	6	8190.567	2146	-3.67%	7.08
0	Yes	5.04	2.2	0	0	0	2.84	9	87643.267	1346	-17.13%	5.95
0	Yes	3.29	0.03	0	0	0	3.26	184	0	0	-37.44%	4.06
0	Yes	3.76	0.12	0	0	0	3.64	254	0	0	81.12%	11.61
0	Yes	2.05	0.16	0	0	0	1.89	109	0	0	-1.99%	5.41
0	Yes	2.66	0.24	0	0	0	2.42	115	0	0	6.91%	4.18
0	Yes	1.82	1.82	0	0	0	0	0	0	0	-2.54%	1.15
0	Yes	1.52	0.14	0	0	0	1.38	59	1229.550	1171	1.32%	6.89
0	Yes	2.12	0.11	0	0	0	2.01	115	0	0	-7.10%	5.1
0	Yes	0.87	0.87	0	0	0	0	0	0	0	100.00%	2.56
0	Yes	0.88	0.2	0	0	0	0.68	18	0	0	2.07%	2.47
0	Yes	1.44	0.05	0	0	0	1.39	70	0	0	-1.83%	1.07
0	Yes	0	0	0	0	0	0	0	0	0	-3.24%	8.96
0	Yes	0	0	0	0	0	0	0	0	0	27.85%	18.41
0	Yes	1.49	0.45	0	0	0	1.04	47	0	0	1.02%	5.93
0	Yes	0.9	0.16	0	0	0	0.74	18	0	0	-7.22%	2.44
0	Yes	1.37	0.14	0	0	0	1.23	48	0	0	-4.24%	5.19
0	Yes	1.29	0.26	0	0	0	1.03	66	13643.050	1085	5.28%	3.79
0	Yes	0	0	0	0	0	0	0	0	0	0.00%	0
0	Yes	3.1	0.02	0	0	0	3.08	31	14605.667	1717	15.81%	3.15
0	Yes	2.07	0.06	0	0	0	2.01	9	0	0	2.00%	9.18
0	Yes	3.87	0.04	0	0	0	3.83	53	0	0	-7.37%	4.02
0	Yes	3.68	0.36	0	0	0	3.32	229	0	0	-1.16%	5.97
0	Yes	2.29	0.32	0	0	0	1.97	90	49592.250	3891	0.70%	7.15
0	Yes	2.15	0.09	0	0	0	2.06	99	1041.333	710	4.55%	2.76
0	Yes	3.92	0.31	0	0	0	3.61	131	0	0	7.84%	6.19
0	Yes	2.79	1.37	0	0	0	1.42	14	0	0	62.69%	8.59
0	Yes	1.87	0.73	0	0	0	1.14	3	0	0	1.40%	5.06
0	Yes	3.16	1.64	0	222.000	4	1.52	24	9785.150	177	-9.09%	1.7
0	Yes	2.11	0.51	0	0	0	1.6	46	0	0	4.26%	2.45
0	Yes	0.42	0.42	0	0	0	0	0	0	0	0.00%	0
0	Yes	3.39	3.39	0	0	0	0	0	0	0	71.37%	8.5
0	Yes	3.6	3.6	0	0	0	0	0	0	0	-9.63%	1.69
0	Yes	3.25	3.25	0	0	0	0	0	0	0	-34.58%	3.14
0	Yes	6.76	6.76	0	0	0	0	0	0	0	5.70%	2.78
0	Yes	5.2	2.77	0	0	0	2.43	20	0	0	52.95%	11.41
0	Yes	4.73	1.59	0	0	0	3.14	8	0	0	-23.89%	6.88
0	Yes	4.74	3.97	0	0	0	0.77	15	0	0	-5.53%	9.74

(N) Number of Automatic Line Sectionalizing Devices on the	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	8.03	1.94	0	0	0	6.09	110	92789.250	2847	-18.71%	6.17
0	Yes	1.72	0.12	7	0	0	1.6	41	0	0	-18.91%	2.53
0	Yes	3.44	2.22	0	0	0	1.22	2	0	0	-8.35%	4.5
0	Yes	6.51	1.75	0	0	0	4.76	47	191250.800	1855	-17.44%	8.19
0	Yes	3.51	1.96	0	0	0	1.55	15	0	0	44.92%	6.71
0	Yes	3.23	0.08	0	0	0	3.15	66	0	0	-3.24%	4.18
0	Yes	8.89	0.35	0	0	0	8.54	158	16451.800	3779	-5.72%	8.9
0	Yes	3.89	0.18	0	0	0	3.71	96	0	0	55.65%	3.86
0	Yes	5	1.42	0	0	0	3.58	81	88670.067	1388	-13.02%	4.81
0	Yes	5.7	3.01	0	0	0	2.69	5	47543.967	793	-21.69%	2.6
0	Yes	5.58	1.98	0	0	0	3.6	45	0	0	-19.46%	8.36
0	Yes	3.17	2.05	8	0	0	1.12	22	35836.067	3531	-22.88%	7.28
0	Yes	2.62	0.61	16	0	0	2.01	56	0	0	-13.42%	4.84
0	Yes	0.9	0.11	0	0	0	0.79	1	85431.750	1950	3.17%	2.93
0	Yes	3.12	1.67	0	0	0	1.45	20	81114.833	1757	-5.67%	5.99
0	Yes	4.36	0.84	0	0	0	3.52	15	337612.300	6872	3.34%	8.35
0	Yes	4.03	1.95	0	0	0	2.08	10	101814.967	3639	-18.09%	4.8
0	Yes	5.13	2.25	0	0	0	2.88	10	0	0	25.05%	5.94
0	Yes	7.79	5.06	0	0	0	2.73	16	126451.633	1332	-12.84%	7.06
0	Yes	3.74	0.92	0	0	0	2.82	14	91268.800	3415	-9.71%	7.44
0	Yes	4.82	0.48	0	0	0	4.34	74	0	0	-17.80%	7.71
0	Yes	4.65	1.9	0	0	0	2.75	64	146171.400	4284	-4.11%	8.4
0	Yes	2.78	0.13	0	0	0	2.65	55	0	0	-5.19%	8.03
0	Yes	7.22	0.22	10	0	0	7	198	100262.250	1485	-12.95%	8
0	Yes	2.76	1.2	0	0	0	1.56	22	0	0	8.74%	6.47
0	Yes	3.27	0.73	0	0	0	2.54	14	0	0	1.30%	5.47
0	Yes	2.17	0.12	0	0	0	2.05	14	0	0	1.63%	3.12
0	Yes	3.69	0.99	0	0	0	2.7	61	0	0	5.22%	5.44
0	Yes	3.25	0.03	0	0	0	3.22	100	173939.767	1917	-33.33%	6.6
0	Yes	4.56	0.14	0	0	0	4.42	195	32747.367	3160	0.71%	8.48
0	Yes	3.45	0.62	0	0	0	2.83	63	0	0	-83.77%	0.5
0	Yes	5.45	0.66	0	0	0	4.79	103	58342.267	902	0.28%	7.26
0	Yes	2.53	0.51	0	0	0	2.02	16	0	0	-6.58%	4.4
0	Yes	3.23	0.14	0	0	0	3.09	56	0	0	-2.26%	6.92
0	Yes	2.77	0.2	0	0	0	2.57	56	0	0	-1.80%	7.62
0	Yes	3.43	0.92	0	0	0	2.51	17	49236.100	1093	1.42%	4.99
0	Yes	4.14	0.8	0	0	0	3.34	22	469483.000	9692	-7.09%	7.73

(N) Number of Automatic Line Sectionalizing Devices on the	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	2.64	0.12	0	0	0	2.52	52	0	0	-2.46%	4.76
0	Yes	3.12	0.23	0	0	0	2.89	66	0	0	-1.47%	10.04
0	Yes	4.29	1.04	0	0	0	3.25	12	523163.400	5304	-0.20%	9.89
0	Yes	5.71	0.93	0	0	0	4.78	128	60662.300	1094	0.54%	5.58
0	Yes	0.25	0.07	0	0	0	0.18	0	0	0	0.00%	0.01
0	Yes	5.02	2.3	0	0	0	2.72	26	0	0	-1.90%	8.8
0	Yes	5.24	2.19	1	0	0	3.05	40	213398.733	3496	-20.13%	6.35
0	Yes	4.38	0.78	0	0	0	3.6	57	0	0	5.63%	3.19
0	Yes	5.37	2.28	0	0	0	3.09	16	0	0	-18.62%	4.72
0	Yes	3.96	2.87	0	0	0	1.09	0	0	0	-2.17%	6.32
0	Yes	4.22	1.95	0	0	0	2.27	15	0	0	-42.16%	3.8
0	Yes	3.46	0.02	0	0	0	3.44	80	45751.400	528	-6.62%	5.78
0	Yes	4.5	0.07	0	0	0	4.43	48	179048.933	1967	-13.64%	3.61
0	Yes	8.05	1.91	8	57.150	1	6.14	137	54027.100	2103	-3.90%	7.14
0	Yes	2.56	0.07	0	0	0	2.49	10	0	0	-7.46%	5.46
0	Yes	2.86	1.63	0	0	0	1.23	2	0	0	1.41%	4.32
0	Yes	1.92	1.78	0	0	0	0.14	0	0	0	-1.42%	7.61
0	Yes	4.18	2.3	0	0	0	1.88	9	0	0	-13.96%	9.18
0	Yes	2.59	0.36	0	0	0	2.23	168	0	0	8.78%	4.71
0	Yes	2.41	0.96	7	0	0	1.45	76	2603.767	707	-0.62%	6.37
0	Yes	1.45	0.45	0	0	0	1	18	46323.783	549	21.07%	3.39
0	Yes	1.33	0.3	0	0	0	1.03	81	110229.900	1426	-2.85%	6.13
0	Yes	0.55	0.55	0	0	0	0	0	0	0	-13.62%	2.79
0	Yes	0.34	0.34	0	0	0	0	0	0	0	14.00%	0.57
0	Yes	3.57	2.2	0	0	0	1.37	211	0	0	29.29%	4.37
0	Yes	2.95	0.42	0	0	0	2.53	23	0	0	7.60%	7.5
0	Yes	1.56	0.22	0	0	0	1.34	33	0	0	4.66%	3.59
0	Yes	3.79	0.39	0	0	0	3.4	61	0	0	2.54%	7.28
0	Yes	2.14	0.31	0	0	0	1.83	35	68239.500	3085	6.00%	5.83
0	Yes	3.68	0.38	0	0	0	3.3	28	30423.533	965	26.22%	4.38
0	Yes	1.76	0.03	0	0	0	1.73	165	0	0	4.17%	4.75
0	Yes	0.9	0.14	3	0	0	0.76	55	6134.033	2228	-0.60%	6.66
0	Yes	1.59	0.38	0	0	0	1.21	94	105864.733	1804	-3.28%	5.9
0	Yes	1.6	0.64	0	0	0	0.96	14	1144.267	1085	-4.38%	3.06
0	Yes	3.04	2.03	0	0	0	1.01	15	3832.733	55	27.31%	6.2
0	Yes	0.53	0.53	0	0	0	0	0	0	0	-7.21%	2.83
0	Yes	0.88	0.13	0	0	0	0.75	10	0	0	10.32%	5.13
0	Yes	0.85	0.85	12	0	0	0	0	270.617	16	4.14%	1.76
0	Yes	2.43	2.43	0	0	0	0	0	0	0	-32.39%	1.19
0	Yes	7.79	1.76	0	274673.833	2335	6.03	47	198159.000	2340	-41.34%	5.76
0	Yes	4.65	0.6	0	0	0	4.05	123	0	0	-18.66%	8.5

(N) Number of Automatic Line Sectionalizing Devices on the	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	7.54	3.89	0	0	0	3.65	17	0	0	168.17%	7.75
0	Yes	4.56	2.2	0	131.683	3	2.36	111	243871.100	3442	17.25%	8.02
0	Yes	2.48	0.55	0	0	0	1.93	75	0	0	-10.30%	7.14
0	Yes	1.11	0.18	0	0	0	0.93	12	0	0	-8.92%	5.92
0	Yes	9.05	6.07	0	0	0	2.98	39	0	0	-20.20%	3.91
0	Yes	6.74	0.56	0	0	0	6.18	104	25351.267	928	-14.65%	3.73
0	Yes	8.92	0.34	0	0	0	8.58	147	0	0	-3.27%	6.8
0	Yes	3.14	0.77	0	0	0	2.37	54	95659.067	1695	-3.01%	7.08
0	Yes	3.54	0.14	0	0	0	3.4	60	108601.400	3714	-3.25%	8.04
0	Yes	3.38	0.54	0	0	0	2.84	41	0	0	-0.93%	5.32
0	Yes	3.56	0.35	0	0	0	3.21	70	68746.667	2155	-4.69%	8.53
0	Yes	2.09	0.25	0	0	0	1.84	26	0	0	27.07%	8.73
0	Yes	2.78	0.29	0	0	0	2.49	46	0	0	-4.97%	6.5
0	Yes	5.65	0.03	0	0	0	5.62	95	0	0	-7.75%	5.83
0	Yes	11.81	0.1	0	0	0	11.71	245	50800.833	3724	-7.09%	6.03
0	Yes	16.86	0.24	0	0	0	16.62	174	8681.167	2126	-9.56%	8.14
0	Yes	5.13	0.03	0	0	0	5.1	51	393893.950	4616	-7.32%	3.42
0	Yes	6.32	0.26	0	11907.733	664	6.06	26	39809.850	2180	-15.84%	2.55
0	Yes	6.56	1.16	14	0	0	5.4	115	408925.333	6628	29.71%	9.78
0	Yes	5.79	1.71	0	0	0	4.08	5	6393.183	1195	-44.92%	2.98
0	Yes	2.74	0.83	0	0	0	1.91	6	0	0	3.55%	1.46
0	Yes	2.73	1.58	0	0	0	1.15	11	0	0	-17.46%	1.04
0	Yes	5.77	3.79	7	2006.400	418	1.98	19	69243.767	2898	5.25%	6.42
0	Yes	0.49	0.22	0	0	0	0.27	0	0	0	6.80%	1.57
0	Yes	2.58	0.02	0	0	0	2.56	155	0	0	-15.36%	5.18
0	Yes	4.28	1.69	0	0	0	2.59	109	55555.867	2257	51.49%	8.15
0	Yes	1.15	0.04	0	0	0	1.11	45	0	0	-13.80%	3.06
0	Yes	1.7	0.15	0	0	0	1.55	25	0	0	-13.68%	6.12
0	Yes	3.27	0.05	0	0	0	3.22	18	0	0	-4.50%	3.61
0	Yes	3.6	0.63	0	0	0	2.97	65	0	0	-3.97%	3.87
0	Yes	1.45	0.03	0	0	0	1.42	71	0	0	-4.24%	3.39
0	Yes	1.51	0.9	0	0	0	0.61	14	0	0	4.74%	2.43
0	Yes	0.07	0.07	0	0	0	0	1	0	0	12.75%	3.98
0	Yes	0.11	0.11	0	0	0	0	0	0	0	-7.18%	3.36

(N) Number of Automatic Line Sectionalizing Devices on the	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	1.38	0.03	0	0	0	1.35	26	0	0	-10.85%	5.01
0	Yes	2.97	1.34	0	0	0	1.63	23	18447.933	655	6.21%	5.13
0	Yes	2.69	0.53	0	0	0	2.16	53	128709.217	2179	-4.32%	5.1
0	Yes	5.12	0.59	0	0	0	4.53	202	5723.550	1817	-6.00%	6.74
0	Yes	5.58	0.12	0	0	0	5.46	107	184877.983	3866	23.85%	10.75
0	Yes	4.84	0.17	0	0	0	4.67	175	0	0	-1.16%	6.81
0	Yes	1.64	1.22	0	0	0	0.42	0	0	0	45.60%	5.3
0	Yes	2.79	0.74	0	0	0	2.05	16	0	0	-6.62%	6.07
0	Yes	0.44	0.44	0	0	0	0	0	0	0	16.52%	3.95
0	Yes	1.87	0.8	0	0	0	1.07	1	0	0	0.50%	4
0	Yes	4.35	2.81	0	0	0	1.54	9	112747.083	4084	0.12%	8.12
0	Yes	5.57	1.11	0	0	0	4.46	48	0	0	-5.64%	8.37
0	Yes	0.44	0.44	0	0	0	0	0	0	0	30.19%	5.52
0	Yes	2.12	2.12	0	0	0	0	0	0	0	-100.00%	0
0	Yes	1.6	0.1	0	0	0	1.5	8	0	0	-8.51%	5.48
0	Yes	1.78	0.84	0	0	0	0.94	12	0	0	18.52%	3.52
0	Yes	2.51	0.26	0	0	0	2.25	70	0	0	26.42%	4.88
0	Yes	5.12	1.06	0	0	0	4.06	50	0	0	-4.02%	8.83
0	Yes	1.56	0.16	0	0	0	1.4	7	15941.933	282	22.98%	7.17
0	Yes	2.14	0.19	0	0	0	1.95	50	14561.167	245	25.64%	5.39
0	Yes	1.11	0.1	0	0	0	1.01	9	0	0	13.02%	6.25
0	Yes	1.89	0.03	0	0	0	1.86	25	0	0	4.40%	7.12
0	Yes	2.09	0.36	0	0	0	1.73	12	97067.167	2204	-28.39%	3.86
0	Yes	1.53	1.44	9	0	0	0.09	0	0	0	-4.18%	3.67
0	Yes	0.74	0.02	0	0	0	0.72	5	0	0	-3.51%	7.15
0	Yes	2.63	0.41	0	0	0	2.22	22	60241.300	1469	0.34%	5.99
0	Yes	2.85	1.73	0	0	0	1.12	10	0	0	7.44%	7.22
0	Yes	2.51	1.35	0	0	0	1.16	9	190702.367	4992	2.45%	7.95
0	Yes	1.78	1.18	0	0	0	0.6	4	0	0	17.39%	4.05
0	Yes	1.27	1.27	0	0	0	0	0	0	0	-8.04%	2.86
0	Yes	2.76	1.04	0	0	0	1.72	30	0	0	28.11%	6.7
0	Yes	2.2	0.28	0	0	0	1.92	11	0	0	5.51%	6.7
0	Yes	2.65	0.89	0	0	0	1.76	11	0	0	-0.41%	4.81
0	Yes	2.18	1.76	0	0	0	0.42	1	0	0	6.04%	4.74
0	Yes	2.59	0.44	0	2858.133	2345	2.15	9	0	0	-15.67%	4.79
0	Yes	3.3	0.33	0	0	0	2.97	56	96721.200	1760	1.33%	10.65
0	Yes	1.63	0.07	0	0	0	1.56	59	23116.333	1472	40.32%	5.22
0	Yes	2.25	1.48	0	0	0	0.77	14	47544.933	1397	0.15%	6.73
0	Yes	2.85	0.12	0	0	0	2.73	18	0	0	-2.69%	6.52
0	Yes	0.2	0.2	0	0	0	0	0	0	0	100.00%	0.01
0	Yes	2.22	0.2	0	0	0	2.02	15	15471.700	323	18.85%	4.98

(N) Number of Automatic Line Sectionalizing Devices on the	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	5.2	2.27	10	0	0	2.93	55	81660.567	3560	-14.95%	5.86
0	Yes	7.26	4.63	0	0	0	2.63	9	0	0	-41.15%	3.49
0	Yes	9.39	4.92	0	0	0	4.47	6	208036.700	4752	60.70%	9.61
0	Yes	3.94	0.12	0	0	0	3.82	104	0	0	-11.04%	6.69
0	Yes	5.61	1.07	0	0	0	4.54	21	9474.300	2349	-14.94%	8.2
0	Yes	4.46	3.8	0	0	0	0.66	0	0	0	-7.84%	5.88
0	Yes	4.06	0.13	0	0	0	3.93	61	0	0	-21.21%	7.28
0	Yes	2.49	0.11	0	0	0	2.38	103	0	0	3.94%	5.81
0	Yes	3.81	0.08	0	0	0	3.73	152	0	0	-3.15%	5.85
0	Yes	2.26	0.16	0	0	0	2.1	53	438734.017	4421	-21.00%	5.08
0	Yes	1.47	0.07	0	0	0	1.4	14	106656.450	1697	-12.54%	5.79
0	Yes	2.48	0.19	0	0	0	2.29	15	0	0	-3.81%	4.04
0	Yes	0.79	0.2	0	0	0	0.59	12	0	0	108.57%	1.46
0	Yes	2.52	0.33	0	0	0	2.19	12	0	0	-7.90%	5.71
0	Yes	1.68	0.1	0	0	0	1.58	44	0	0	-6.80%	2.88
0	Yes	5.68	1.99	0	0	0	3.69	3	0	0	-3.43%	7.31
0	Yes	31.88	2.13	0	0	0	29.75	144	8402.200	2456	-18.50%	5.2
0	Yes	6.05	0.32	0	0	0	5.73	66	171485.467	3746	-16.98%	7.43
0	Yes	0	0	0	0	0	0	0	0	0	0.00%	0
0	Yes	1.59	0.05	0	0	0	1.54	24	35339.383	470	-0.46%	2.15
0	Yes	2.34	0.12	0	0	0	2.22	30	0	0	8.06%	6.7
0	Yes	2.47	0.29	0	0	0	2.18	80	0	0	-24.57%	3.1
0	Yes	3.05	0.08	0	0	0	2.97	78	0	0	1.67%	6.08
0	Yes	0.02	0.02	0	0	0	0	0	0	0	-27.31%	12.22
0	Yes	1.52	1.49	380	0	0	0.03	4	0	0	13.58%	3.43
0	Yes	1.78	0.93	0	0	0	0.85	80	0	0	84.21%	5.6
0	Yes	1.61	1.47	0	0	0	0.14	9	14833.133	452	0.98%	1.03
0	Yes	1.14	1.14	0	0	0	0	0	0	0	-100.00%	0
0	Yes	2.78	0.06	0	0	0	2.72	201	0	0	5.80%	4.38
0	Yes	3.3	0.12	0	0	0	3.18	203	76960.900	1283	-100.00%	0
0	Yes	3.4	0.06	0	0	0	3.34	168	79775.933	1272	9.32%	6.8
0	Yes	2.28	0.63	0	0	0	1.65	26	192.000	192	11.76%	3.99
0	Yes	1.11	0.21	0	1449.000	70	0.9	5	253.283	13	5.48%	3.27
0	Yes	2.56	0.19	0	0	0	2.37	26	0	0	11.40%	8.01
0	Yes	2.35	0.45	0	0	0	1.9	16	0	0	89.80%	4.84
0	Yes	1.38	0.22	1	0	0	1.16	7	0	0	74.47%	0.82

(N) Number of Automatic Line Sectionalizing Devices on the	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	2.08	0.72	0	0	0	1.36	9	0	0	23.21%	2.76
0	Yes	2.15	1.67	0	0	0	0.48	4	0	0	25.15%	4.18
0	Yes	7.39	3.24	0	0	0	4.15	29	285197.317	14057	-44.76%	3.11
0	Yes	1.89	0.13	0	0	0	1.76	10	0	0	69.16%	8.61
0	Yes	9.56	2.73	0	0	0	6.83	93	51488.650	1029	44.75%	8.96
0	Yes	2.71	1.01	0	0	0	1.7	46	0	0	19.55%	3.73
0	Yes	2.01	0.19	0	0	0	1.82	30	0	0	8.00%	4.32
0	Yes	3.6	0.07	0	0	0	3.53	106	0	0	1.52%	7.37
0	Yes	3.02	0.06	0	0	0	2.96	168	0	0	-1.91%	3.6
0	Yes	3.96	1.36	0	0	0	2.6	56	402515.150	11325	-79.39%	1.48
0	Yes	3.95	0.1	0	0	0	3.85	13	179516.650	2502	-11.43%	7.9
0	Yes	1.37	0.18	0	0	0	1.19	14	0	0	55.23%	6.83
0	Yes	0	0	0	0	0	0	0	0	0	0.00%	0
0	Yes	2.81	0.16	0	412.333	10	2.65	2	424.050	11	0.00%	0
0	Yes	4.4	0.25	0	0	0	4.15	91	4376153.333	400	-100.00%	0
0	Yes	4.66	1.53	0	0	0	3.13	93	163745.433	3003	-72.39%	1.51
0	Yes	6.23	1.08	0	0	0	5.15	101	0	0	0.22%	9.11
0	Yes	2.81	0.27	0	0	0	2.54	15	0	0	102.82%	10.06
0	Yes	3.08	2	0	0	0	1.08	4	0	0	5.86%	6.5
0	Yes	6.09	2.84	0	140816.683	2423	3.25	8	134866.983	1103	-7.16%	4.93
0	Yes	3.35	3.35	0	0	0	0	0	0	0	-12.39%	5.87
0	Yes	4.22	2.39	0	0	0	1.83	5	0	0	-10.10%	6.59
0	Yes	3.45	2.46	0	0	0	0.99	0	0	0	88.71%	11.7
0	Yes	6.51	4.3	0	0	0	2.21	10	0	0	-59.96%	4.32
0	Yes	7.13	5.55	0	0	0	1.58	1	0	0	-0.97%	5.13
0	Yes	4.96	0.17	0	0	0	4.79	96	26767.500	1245	-0.87%	5.68
0	Yes	0.1	0.1	0	0	0	0	0	0	0	0.00%	0
0	Yes	5.15	0.31	0	0	0	4.84	81	83357.117	1608	37.64%	6.18
0	Yes	0.62	0.13	0	0	0	0.49	0	0	0	241.43%	2.39
0	Yes	3.59	2.95	0	0	0	0.64	4	0	0	-4.26%	4.05
0	Yes	0.43	0.04	0	0	0	0.39	1	239.867	4	-11.19%	1.19
0	Yes	1.9	1.9	0	0	0	0	0	3525.383	53	-16.27%	6.38
0	Yes	2.83	2.34	0	0	0	0.49	1	0	0	6.60%	10.18
0	Yes	7.72	0.87	0	0	0	6.85	62	17107.067	4010	-12.97%	7.45
0	Yes	0.34	0.06	0	0	0	0.28	1	45712.433	1380	-11.89%	2.52
0	Yes	2.83	0.58	0	0	0	2.25	12	67549.300	1242	17.04%	9.34
0	Yes	5.09	0.06	0	0	0	5.03	144	0	0	-7.73%	6.45
0	Yes	2.74	0.48	0	0	0	2.26	13	0	0	12.70%	6.48

(N) Number of Automatic Line Sectionalizing Devices on the	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	6.57	0.35	5	0	0	6.22	92	275345.583	5620	-46.04%	5.65
0	Yes	3.07	0.33	0	0	0	2.74	57	0	0	-10.91%	8.57
0	Yes	3.93	1.92	0	0	0	2.01	19	211967.917	2900	176.14%	10.88
0	Yes	2.71	1.04	0	0	0	1.67	8	0	0	-8.61%	2.44
0	Yes	3.43	1.35	0	0	0	2.08	38	0	0	-3.58%	11.3
0	Yes	2.65	0.44	0	0	0	2.21	27	0	0	-10.52%	7.74
0	Yes	2.9	1.32	0	0	0	1.58	39	0	0	-2.33%	6.28
0	Yes	1.66	0.95	0	0	0	0.71	4	491.167	421	25.22%	4.27
0	Yes	1.31	1.26	0	0	0	0.05	0	0	0	16.89%	2.63
0	Yes	3.72	2.27	2	0	0	1.45	1	87754.233	2029	-3.58%	8.07
0	Yes	4.49	0.35	0	0	0	4.14	100	0	0	-9.37%	6.77
0	Yes	5.23	0.5	2	0	0	4.73	69	159105.767	3301	-1.14%	7.78
0	Yes	3.24	0.1	0	0	0	3.14	45	11448.383	1324	92.93%	10.92
0	Yes	1.51	1.51	0	0	0	0	0	0	0	-9.74%	4.82
0	Yes	4.38	1.05	0	0	0	3.33	60	31347.000	516	-13.13%	6.68
0	Yes	10.78	0.76	0	0	0	10.02	8	0	0	100.57%	3.51
0	Yes	0.04	0	0	0	0	0.04	0	0	0	0.00%	0
0	Yes	1.99	1.99	1	0	0	0	0	117167.033	1139	-0.86%	5.77
0	Yes	0.84	0.84	0	0	0	0	0	0	0	73.42%	3.85
0	Yes	2.32	2.32	212	0	0	0	0	0	0	4.54%	8.06
0	Yes	1.52	1.52	143	0	0	0	0	0	0	-0.40%	4.94
0	Yes	0.88	0.88	0	0	0	0	0	0	0	-80.23%	0.17
0	Yes	6.64	5.02	0	0	0	1.62	14	232131.983	4106	-5.31%	7.14
0	Yes	3.83	1.45	0	0	0	2.38	15	66686.433	1199	6.44%	7.77
0	Yes	8.17	4.67	0	0	0	3.5	30	120837.567	3408	0.10%	9.57
0	Yes	6.55	4.41	1	0	0	2.14	1	0	0	4.63%	7.01
0	Yes	2.75	2.16	0	0	0	0.59	0	0	0	-7.55%	6.49
0	Yes	3.65	3	0	0	0	0.65	20	0	0	-1.99%	7.37
0	Yes	3.08	3.08	0	0	0	0	0	0	0	1.37%	5.92
0	Yes	4.61	4.34	0	0	0	0.27	1	0	0	0.91%	7.73
0	Yes	3.57	1.65	0	0	0	1.92	3	0	0	100.00%	7.31
0	Yes	8.42	5.26	0	0	0	3.16	7	0	0	163.14%	10.21
0	Yes	4.65	3.36	0	0	0	1.29	12	40919.200	690	-0.51%	5.83
0	Yes	4.43	2.68	0	0	0	1.75	1	0	0	-29.35%	4.14
0	Yes	3.48	2.52	0	0	0	0.96	4	0	0	-100.00%	0
0	Yes	5.52	3.94	0	0	0	1.58	10	0	0	9.42%	7.9
0	Yes	3.19	3.19	0	0	0	0	0	0	0	70.25%	9.67
0	Yes	4.98	4.14	0	0	0	0.84	0	0	0	-1.12%	6.18

(N) Number of Automatic Line Sectionalizing Devices on the	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	7.05	2.7	0	0	0	4.35	11	0	0	-3.25%	4.47
0	Yes	4	4	0	0	0	0	0	0	0	-2.75%	7.42
0	Yes	5.65	5.65	0	0	0	0	0	0	0	0.28%	7.27
0	Yes	6.96	5.06	1	0	0	1.9	17	0	0	1.89%	9.16
0	Yes	1.7	0.27	0	0	0	1.43	19	0	0	-3.94%	3.17
0	Yes	2.57	0.14	0	0	0	2.43	16	0	0	23.12%	7.19
0	Yes	2.92	0.04	0	0	0	2.88	63	0	0	0.00%	6.68
0	Yes	3.05	0.21	0	58446.850	987	2.84	34	59.217	1	-5.61%	7.4
0	Yes	3.71	0.15	0	0	0	3.56	45	12865.500	1632	-0.97%	7.14
0	Yes	2.88	1.58	1	0	0	1.3	14	607.083	155	4.76%	5.94
0	Yes	1.94	0.15	0	0	0	1.79	49	0	0	-4.91%	3.87
0	Yes	1.82	0.2	0	0	0	1.62	34	996.783	198	0.00%	6.02
0	Yes	2.47	1.52	0	0	0	0.95	1	0	0	-5.05%	11.84
0	Yes	4.89	2.93	0	0	0	1.96	11	0	0	-8.67%	9.58
0	Yes	2.68	1.29	0	0	0	1.39	4	0	0	2.11%	5.33
0	Yes	3.24	3.05	0	0	0	0.19	0	0	0	12.32%	10.03
0	Yes	6.74	3.08	0	0	0	3.66	46	0	0	0.60%	6.69
0	Yes	6.72	3.26	0	0	0	3.46	76	0	0	-26.09%	4.22
0	Yes	5.99	4.45	1	0	0	1.54	6	105580.700	1702	100.00%	7.37
0	Yes	2.97	0.21	0	165573.333	3445	2.76	30	0	0	2.04%	6.49
0	Yes	5.52	3.61	0	0	0	1.91	3	0	0	-7.41%	6.87
0	Yes	10.41	5.34	0	0	0	5.07	31	0	0	-34.13%	5.77
0	Yes	5.52	2.7	0	0	0	2.82	13	0	0	100.00%	4.3
0	Yes	7.16	4.73	0	0	0	2.43	16	30065.650	765	1.18%	2.57
0	Yes	5.4	3.02	0	0	0	2.38	34	0	0	6.88%	2.33
0	Yes	0.02	0.02	0	0	0	0	0	0	0	-11.43%	5.89
0	Yes	2.24	0.14	1	0	0	2.1	17	9161.850	103	9.48%	2.54
0	Yes	3.48	1.08	0	0	0	2.4	45	28914.583	1028	6.24%	5.79
0	Yes	2.73	0.61	0	0	0	2.12	20	0	0	33.47%	6.54
0	Yes	0.07	0.07	0	0	0	0	0	0	0	-0.98%	5.07
0	Yes	0.1	0.1	0	0	0	0	0	0	0	20.56%	8.62
0	Yes	5.87	1.28	0	0	0	4.59	5	102254.567	4134	-82.33%	0.79
0	Yes	2.42	1.38	0	0	0	1.04	6	0	0	75.54%	4.88
0	Yes	0.24	0.05	0	0	0	0.19	0	0	0	14.39%	3.18

(N) Number of Automatic Line Sectionalizing Devices on the	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	0.33	0.15	0	0	0	0.18	0	0	0	-27.22%	2.54
0	Yes	0.5	0.08	0	0	0	0.42	0	0	0	120.79%	2.23
0	Yes	0.19	0.19	0	0	0	0	0	0	0	51.91%	3.57
0	Yes	7.03	3.56	0	0	0	3.47	4	21163.050	131	1310.53%	8.04
0	Yes	3.17	1.1	0	0	0	2.07	3	155034.483	2992	-13.71%	3.02
0	Yes	6.48	3.97	0	0	0	2.51	0	0	0	-8.42%	6.85
0	Yes	4.54	2.78	0	0	0	1.76	1	0	0	-8.97%	6.29
0	Yes	9.18	9.05	0	0	0	0.13	0	0	0	-16.96%	3.77
0	Yes	1.99	1.94	165	0	0	0.05	4	0	0	-100.00%	0
0	Yes	0.74	0.74	0	0	0	0	0	0	0	-100.00%	0
0	Yes	0.94	0.94	0	0	0	0	0	0	0	7.08%	1.21
0	Yes	0.71	0.71	0	0	0	0	0	0	0	0.00%	0
0	Yes	0.84	0.84	0	0	0	0	0	0	0	11.11%	0.4
0	Yes	0.33	0.33	0	0	0	0	0	0	0	0.00%	0.01
0	Yes	0.39	0.39	0	0	0	0	0	0	0	0.00%	0.02
0	Yes	0	0	0	0	0	0	0	0	0	0.00%	0
0	Yes	5.98	3.18	0	0	0	2.8	38	0	0	55.26%	6.49
0	Yes	1.35	0.21	0	0	0	1.14	7	43617.933	722	-7.39%	2.38
0	Yes	8.14	5.43	0	0	0	2.71	1	242405.333	3898	16.81%	9.73
0	Yes	13.61	2.91	0	0	0	10.7	47	0	0	258.55%	6.92
0	Yes	4.33	0.43	0	0	0	3.9	63	267055.517	5334	-3.19%	7.58
0	Yes	4.15	2.4	0	0	0	1.75	3	0	0	1.42%	6.41
0	Yes	3	1.66	0	0	0	1.34	0	0	0	1.08%	3.73
0	Yes	0.11	0.11	0	0	0	0	0	0	0	0.00%	0
0	Yes	6.12	1.01	0	0	0	5.11	92	1649.300	1112	-8.56%	5.45
0	Yes	5.54	3.22	1	0	0	2.32	12	0	0	-6.97%	7.48
0	Yes	3.63	0.51	0	0	0	3.12	68	89504.317	2360	33.19%	3.17
0	Yes	0.4	0.12	0	0	0	0.28	0	0	0	4.97%	12.24
0	Yes	8.85	8.85	0	0	0	0	0	101865.817	2133	104.03%	6.08
0	Yes	3.32	3.32	0	0	0	0	0	0	0	-77.61%	2.85
0	Yes	2.55	2.55	0	0	0	0	0	0	0	-7.25%	1.92
0	Yes	3.4	1.98	0	0	0	1.42	7	70098.967	814	7.86%	4.53
0	Yes	2.44	1.37	0	0	0	1.07	0	2878.067	46	-40.00%	0.06
0	Yes	0	0	0	0	0	0	0	0	0	0.00%	0

(N) Number of Automatic Line Sectionalizing Devices on the	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	0.02	0.02	0	0	0	0	0	0	0	-99.77%	0.01
0	Yes	2.22	0.54	0	0	0	1.68	27	0	0	-10.63%	7.57
0	Yes	3.7	2.44	0	0	0	1.26	11	0	0	-1.84%	7.47
0	Yes	2.42	1.69	0	0	0	0.73	7	0	0	-11.09%	5.77
0	Yes	3.6	1.45	0	0	0	2.15	49	0	0	7.14%	7.65
0	Yes	5.81	3.76	0	0	0	2.05	4	0	0	2.19%	4.2
0	Yes	4.64	1.76	0	0	0	2.88	20	0	0	2.88%	7.86
0	Yes	2.68	1.05	0	0	0	1.63	5	0	0	1.96%	9.36
0	Yes	4.98	0.92	0	0	0	4.06	72	0	0	-20.98%	3.88
0	Yes	4.74	3.97	0	0	0	0.77	0	0	0	0.00%	0
0	Yes	7.94	7.92	0	0	0	0.02	0	0	0	-26.19%	1.24
0	Yes	5.27	2.51	0	0	0	2.76	0	0	0	0.00%	0
0	Yes	2.76	1.04	0	0	0	1.72	0	0	0	0.00%	0
0	Yes	0	0	0	0	0	0	0	0	0	0.00%	0