



**Robert Nelcoski**  
Principal Strategic & Systems Planner

Florida Public Service Commission  
Greg Davis and Phillip Ellis  
Division of Engineering  
2540 Shumard Oak Blvd.  
Tallahassee, FL 32399-0850  
E-Filing addresses: [GDavis@psc.state.fl.us](mailto:GDavis@psc.state.fl.us); [PEllis@psc.state.fl.us](mailto:PEllis@psc.state.fl.us)

**Re: FMIPA's 2025 Ten-Year Site Plan**

March 28, 2025

Dear Greg and Phillip:

Pursuant to Rule 25-22.071(1) Florida Administrative Code and pursuant to the FPSC staff's email dated February 20, 2025, FMIPA is hereby submitting an electronic copy of its 2025 Ten-Year Site Plan and the associated schedules and tables. All additional responses required by Data Request #1 will be e-mailed and filed electronically on or before May 1, 2025, as indicated in the February 20th email. Please do not hesitate to contact me at (321) 239-1048 if you have any questions.

Sincerely,

*Bob Nelcoski*

3F00ED9AA443BE00ECC484CC5EB054C5

readysign

**03/28/2025**

Robert Nelcoski  
Principal Strategic and Systems Planner

Enc.

cc. File



## **TEN-YEAR SITE PLAN**

---

**2025-2034**

**Submitted to  
Florida Public Service Commission  
April 1, 2025**

**Florida Municipal Power Agency  
8553 Commodity Circle  
Orlando, FL 32819  
(407) 355-7767**

FLORIDA MUNICIPAL  
POWER AGENCY

2025 Ten-Year Site Plan

April 1, 2025

## Table of Contents

Executive Summary .....	1
Section 1      Description of FMPA .....	1-1
1.1      FMPA .....	1-1
1.2      All-Requirements Power Supply Project.....	1-2
1.3      Other FMPA Power Supply Projects.....	1-6
1.4      Summary of Projects .....	1-9
Section 2      Description of Existing Facilities .....	2-1
2.1      ARP Supply-Side Resources .....	2-1
2.2      ARP Transmission System .....	2-2
2.2.1      ARP Participant Transmission Systems .....	2-3
2.2.2      ARP Transmission Agreements.....	2-6
Section 3      Forecast of Demand and Energy for the All-Requirements Power Supply Project .....	3-1
3.1      Introduction .....	3-1
3.2      Load Forecast Process .....	3-1
3.3      Load Forecast Overview .....	3-2
3.4      Methodology .....	3-3
3.4.1      Model Specifications .....	3-4
3.4.2      Projection of NEL and Peak Demand.....	3-4
3.5      Data Sources.....	3-5
3.5.1      Historical ARP Participant Retail Sales Data .....	3-5
3.5.2      Weather Data .....	3-5
3.5.3      Economic Data .....	3-6
3.5.4      Real Electricity Price Data.....	3-6
3.5.5      Electric Vehicle Data .....	3-6
3.6      Overview of Results .....	3-7
3.6.1      Base Case Forecast .....	3-7
3.6.2      Economic and Other Sources of Uncertainty of the Forecast.....	3-7
3.7      Load Forecast Schedules .....	3-8
Section 4      Renewable Resources and Conservation Programs .....	4-1
4.1      Introduction .....	4-1
4.2      Renewable Resources.....	4-1
4.2.1      Solar Photovoltaic.....	4-1
4.2.2      Biomass .....	4-2
4.3      Conservation & Energy Efficiency Program.....	4-2
4.4      Net Metering Program.....	4-3
4.5      Load Management Program .....	4-4
Section 5      Forecast of Facilities Requirements .....	5-1
5.1      ARP Planning Process.....	5-1
5.2      Planned ARP Generating Facility Requirements .....	5-1

5.3	Capacity and Power Purchase Requirements .....	5-2
5.4	Summary of Current and Future ARP Resource Capacity .....	5-22
Section 6	Site and Facility Descriptions.....	6-1

## **List of Figures, Tables and Required Schedules**

Table ES-1	FMPA ARP Summer 2024 Capacity Resources .....	2
Figure ES-1	ARP Participants and FMPA Power Supply Resource Locations .....	4
Figure 1-1	ARP Participant Cities .....	1-3
Table 1-1	St. Lucie Project Participants .....	1-6
Table 1-2	Stanton Project Participants.....	1-7
Table 1-3	Tri-City Project Participants.....	1-7
Table 1-4	Stanton II Project Participants .....	1-8
Table 1-5	Florida Municipal Solar Project Phase II Participants .....	1-8
Table 1-6	Summary of FMPA Power Supply Project Participants .....	1-9
Table 2-1	ARP Supply-Side Resources Summer 2024 .....	2-1
Schedule 1	Existing Generating Facilities as of December 31, 2023.....	2-7
Figure 3-1	Load Forecast Process.....	3-1
Schedule 2.1	History and Forecast of Energy Consumption and Number of Customers by Customer Class All-Requirements Project.....	3-9
Schedule 2.2	History and Forecast of Energy Consumption and Number of Customers by Customer Class All-Requirements Project.....	3-10
Schedule 2.3	History and Forecast of Energy Consumption and Number of Customers by Customer Class All-Requirements Project.....	3-11
Schedule 3.1	History and Forecast of Summer Peak Demand (MW) All- Requirements Project – Base Case.....	3-12
Schedule 3.2	History and Forecast of Winter Peak Demand (MW) All-Requirements Project – Base Case .....	3-13
Schedule 3.3	History and Forecast of Annual Net Energy for Load (GWh) All- Requirements Project – Base Case.....	3-14
Schedule 3.1a	Forecast of Summer Peak Demand (MW) All-Requirements Project – Low Case [1] .....	3-15
Schedule 3.1b	Forecast of Summer Peak Demand (MW) All-Requirements Project – High Case [1] .....	3-16
Schedule 3.2a	Forecast of Winter Peak Demand (MW) All-Requirements Project – Low Case [1] .....	3-17
Schedule 3.2b	Forecast of Winter Peak Demand (MW) All-Requirements Project – High Case [1] .....	3-18
Schedule 3.3a	Forecast of Annual Net Energy for Load (GWh) All-Requirements Project – Low Case [1].....	3-19
Schedule 3.3b	Forecast of Annual Net Energy for Load (GWh) All-Requirements Project – High Case [1].....	3-20

Schedule 4 Previous Year and 2-Year Forecast of Peak Demand and Net Energy for Load by Month .....	3-21
Table 5-1 Summary of All-Requirements Power Supply Project Resource Summer Capacity .....	5-4
Table 5-2 Summary of All-Requirements Power Supply Project Resource Winter Capacity .....	5-5
Schedule 5 Fuel Requirements – All-Requirements Power Supply Project .....	5-6
Schedule 6.1 Energy Sources (GWh) – All-Requirements Power Supply Project .....	5-7
Schedule 6.2 Energy Sources (%) – All-Requirements Power Supply Project .....	5-8
Schedule 7.1 Forecast of Capacity, Demand, and Scheduled Maintenance at Time of Summer Peak All-Requirements Power Supply Project .....	5-9
Schedule 7.2 Forecast of Capacity, Demand, and Scheduled Maintenance at Time of Winter Peak All-Requirements Power Supply Project .....	5-10
Schedule 8 Planned and Prospective Generating Facility Additions and Changes .....	5-11
Schedule 9 Status Report and Specifications of Proposed Generating Facilities .....	6-3
Schedule 10 Status Report and Specifications of Proposed Directly Associated Transmission Lines .....	6-4

## **Appendices**

Appendix I	List of Abbreviations .....	I-1
Appendix II	ARP Participant Transmission Information .....	II-1

## Executive Summary

The following information is provided in accordance with Florida Public Service Commission (PSC) Rules 25-22.070, 25-22.071, and 25-22.072, which require certain electric utilities in the State of Florida to submit a Ten-Year Site Plan (TYSP). The TYSP provides, among other things, a description of existing electric utility resources, a 10-year forecast of electric power generating needs and an identification of the general location and type of any proposed generation capacity and transmission additions for the next 10-year period.

The Florida Municipal Power Agency (FMPA or the Agency) is a project-oriented, joint-action agency. There are currently 33 Members of FMPA – each a municipal electric utility – located throughout the State of Florida. As a joint-action agency, FMPA facilitates opportunities for FMPA Members to achieve economies of scale in power generation and related services. FMPA’s direct responsibility for power supply planning can be separated into two roles. First, for the active 13 All Requirements Power Supply Project (ARP) Participants who receive capacity and energy from the ARP, FMPA supplies all of the electric power and energy, transmission and associated services, unless limited by a contract rate of delivery, except for certain excluded resources. The ARP also provides power to a number of members that are not ARP participants, either on a full requirements or other basis. Second, for member systems that do not purchase their full requirements from the ARP, the Agency’s role has been to evaluate joint action opportunities and make the findings available to such members, whereby each member can elect whether to participate in that project. FMPA currently has six such power supply projects in addition to the ARP – Stanton, Tri-City, Stanton II, St. Lucie and Solar II Project, and Solar III Project. FMPA’s TYSP is focused on the resources of, and planning for, the ARP.

The total summer capacity of ARP resources for the year 2025 is 2,027 MW. This capacity is comprised of ARP Participant-owned resources, ARP Participant and ARP entitlements and ownership shares in nuclear, coal and gas-fired power plants located in the State of Florida, ARP owned resources, and power purchase agreements, and is summarized below in Table ES-1.

**Table ES-1**  
**FMPA ARP Summer 2025 Capacity Resources**

<b>Resource Category</b>	<b>Summer Capacity (MW)</b>
Nuclear (Excluded Resource and ARP)	48
ARP System Generation	1,675
Power Purchases excluding Solar	268
Power Purchases of Solar	35
<b>Net Total 2025 ARP Resources [1]</b>	<b>2,027</b>

[1] Totals may not add due to rounding

The ARP expects to meet its generation capacity requirements and maintain a 15% reserve margin with existing and planned resources through the end of 2034. FMPA, on behalf of the ARP, is expected to close on a natural gas combined cycle facility in the beginning of 2026. This planned acquisition will bring the ARP generation capacity above the 15% reserve margin over the study period. The projected peak native ARP summer load, inclusive of sales for resale, is 1,626 MW in 2025 and 1,487 MW in 2034, with reductions driven solely from assumed changes in sales for resale. Currently, FMPA is expecting to no longer burn coal after 2027. FMPA is working with the majority owner on a plan to exit participation in one of the owned coal units (Stanton 1) with a target for the end of 2025, and the second is currently expected to undergo a conversion to 100 percent natural gas in 2027. For the 2025 TYSP, FMPA has adjusted its assumption regarding the longevity of the Stanton II Project, and the ARP will rely upon said capacity and energy to support the ARP's resource adequacy over the study horizon. FMPA will continue to evaluate and develop sufficient, cost-effective resource alternatives for the ARP through its integrated resource planning process and work to optimize reserve levels to reduce costs for the ARP Participants.

FMPA, on behalf of the ARP, began supplying the City of Winter Park wholesale capacity and energy on January 1, 2019, under an agreement that will run for nine years. Through 2027, the ARP will serve Winter Park on a partial requirements basis, net of other existing Winter Park wholesale power agreements. In 2020, FMPA entered into a long-term agreement to supply Williston's full-requirements power supply needs from January 2021 through the end of 2027. In 2021, FMPA entered into a long-term agreement to supply Alachua on a partial-requirements basis, net of other existing Alachua wholesale power agreements, from April 2022 through the end of 2027. Additionally, (i) the ARP has




entered into a short-term wholesale power agreement with Tampa Electric to supply economy, seasonal firm capacity and energy on an as-scheduled basis from December 2024 through February 2025, and (ii) the ARP has entered into an agreement to provide no greater than 15 MW of capacity to the City of Homestead through the end of 2026. In 2022, FMPA entered into a long-term agreement to supply the Central Florida Tourism Oversight District on a partial requirements basis, net of other wholesale power agreements, from October 2024 through the end of 2029. The ARP has entered into a short-term wholesale power agreement with The Energy Authority (TEA) to supply economy, seasonal firm capacity and energy on an as-scheduled basis from January 2025 through February 2025. The projections of future ARP obligations for Winter Park, Williston, Alachua, Tampa Electric, Homestead, TEA, and Central Florida Tourism Oversight District are included in the ARP's load and resource balance and all TYSP schedules herein.

FMPA is actively involved in planning and developing new renewable energy resources and demand side resource opportunities consistent with, and in consideration of the planning requirements of the State of Florida and the Public Utility Regulatory Policies Act (PURPA). Currently, the ARP purchases renewable energy from a cogeneration plant fueled by sugar bagasse and utilizes landfill gas as a secondary fuel to supplement its coal fuel requirements. In December 2009, the ARP commissioned its first solar photovoltaic system, a jointly-owned 30 kW DC system located in Key West, FL. In addition, ARP-Participants are engaged in an ARP-sponsored energy conservation program. In March 2018, FMPA's ARP Executive Committee approved a 20-year power purchase agreement resulting in 40.5 MW-AC of solar energy as an ARP resource that started commercial operation in 2020. In February 2020, the ARP further expanded solar in the portfolio by approving a second 20-year power purchase agreement for approximately 96 MW-AC of solar energy as an ARP resource, which was later amended to approximately 75 MW-AC. The first site, providing 48.125 MW-AC, achieved commercial operation in December 2024, with the remainder estimated to achieve commercial operation in 2025. In June 2023, FMPA entered into additional power purchase agreements for four new solar sites with commercial operation expected in early 2026, a portion of which constitute the ARP's share of approximately 96.5 MW-AC (collectively, Phase III). Due to a variety of market and site-specific factors, the Phase III solar sites have either been cancelled or are in the process of being cancelled. FMPA has included its future solar entitlements in its energy mix projections herein.

A map of the ARP Participants and FMPA’s power resources as of December 31, 2024, is shown in Figure ES-1. Note that solar sites shown are approximate locations.

**Figure ES-1**  
**ARP Participants and FMPA Power Supply Resource Locations**

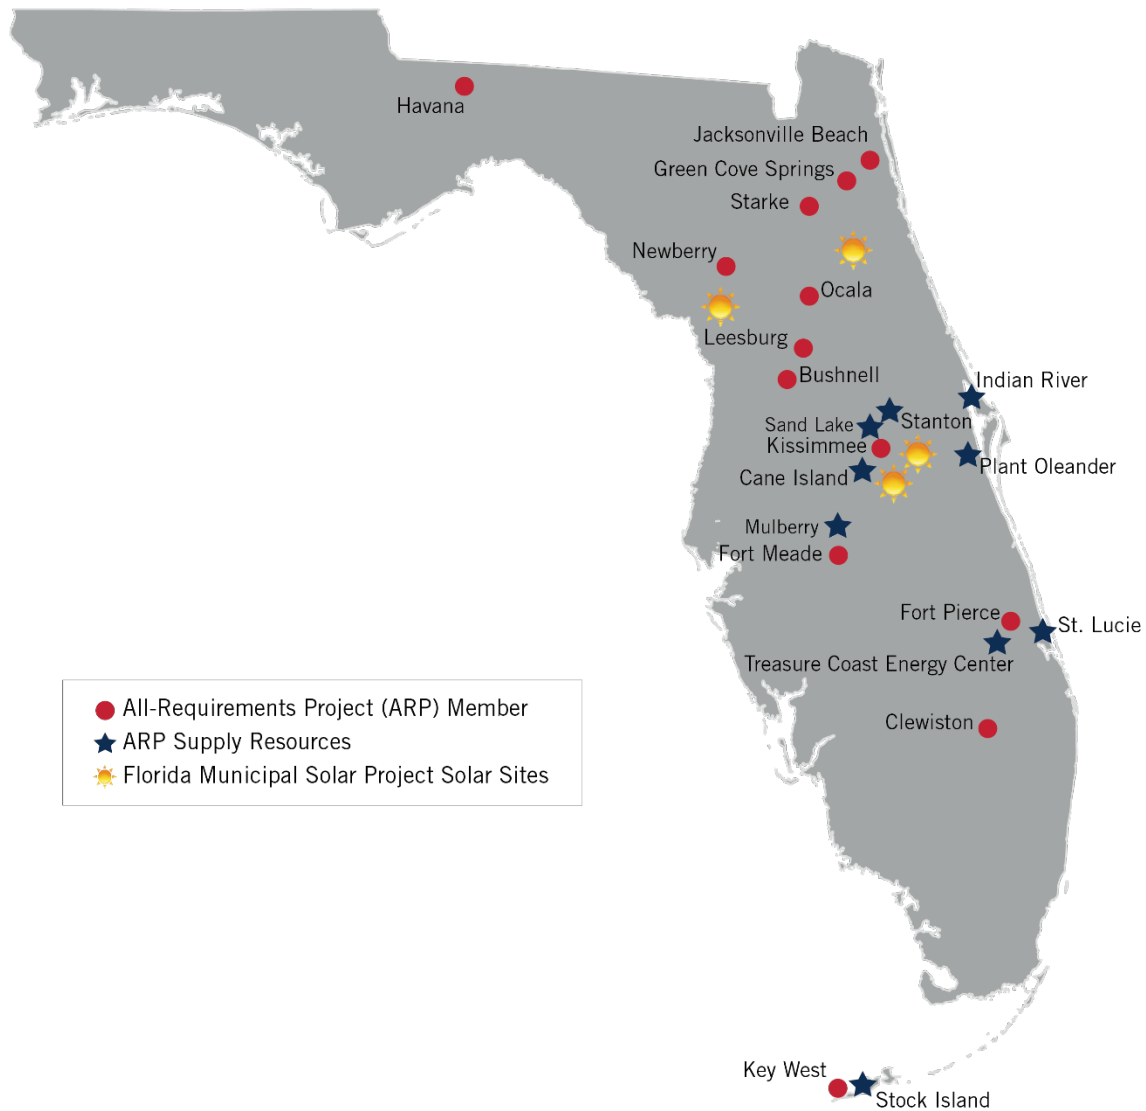

## Section 1 Description of FMPA

### 1.1 FMPA

Florida Municipal Power Agency (FMPA or the Agency) is a governmental wholesale power company owned by municipal electric utilities. FMPA provides economies of scale in power generation and related services to support community-owned electric utilities.

FMPA was created on February 24, 1978, by the signing of the Interlocal Agreement among its original members to provide a means by which its members could cooperatively gain mutual advantage and meet present and projected electric energy requirements. This agreement specifies the purposes and authority of FMPA. FMPA was formed under the provisions of the Florida Interlocal Cooperation Act of 1969, Section 163.01, Florida Statutes and the supplemental authority granted by the Joint Power Act, Part II, Chapter 361, Florida Statutes, implementing Article VII, Section 10 of the Florida Constitution.

The Interlocal Cooperation Act of 1969 authorizes municipal electric utilities to cooperate with each other on the basis of mutual advantage to provide services and facilities in a manner and in a form of governmental organization that will accord best with geographic, economic, population, and other factors influencing the needs and development of local communities. The Florida Constitution and the Joint Power Act provide the supplemental authority for municipal electric utilities to join together with public utilities, electric cooperatives, foreign public utilities and other persons, as defined, for the joint financing, constructing, acquiring, managing, operating, utilizing, and owning of electric power plants.

Each city commission and council, utility commission, board, or authority that is a signatory to the Interlocal Agreement has the right to appoint one member to FMPA's Board of Directors, the governing body of FMPA. The Board has the responsibility of approving FMPA's project budgets (except for the All-Requirements Power Supply Project budget which is approved by the FMPA Executive Committee), approving new projects and project financing (except for All-Requirements Power Supply Project financing which is approved by the FMPA Executive Committee), hiring a General Manager and General Counsel, establishing by-laws that govern how FMPA operates, and creating policies that implement such by-laws. At its annual meeting, the Board elects a Chairperson, Vice Chairperson, Secretary, and Treasurer.

The Executive Committee consists of 13 members, representing the 14 participants in the All-Requirements Power Supply Project (ARP)<sup>1</sup>, 13 of which are supplied capacity and energy by the ARP. The Executive Committee has the responsibility of approving the ARP budget and agency general budget, approving and financing ARP projects, approving ARP expenditures and contracts, and governs and manages the business and affairs of the ARP. At its annual meeting, the Executive Committee elects a Chairperson and Vice Chairperson.

## 1.2 All-Requirements Power Supply Project

FMPA developed the ARP to secure an adequate, economical, and reliable supply of electric capacity and energy as directed by FMPA Members. Currently, 14 FMPA Members (the ARP Participants) participate in the ARP. The geographical locations of the ARP Participants are shown in Figure 1-1.

Unless they have elected to receive power through a contract rate of delivery (CROD, which converts the full-requirements to a specified peak capacity and energy shape to be served by the ARP), ARP Participants are required to purchase all of their capacity and energy requirements above their excluded resources, if any, from the ARP pursuant to the All-Requirements Power Supply Project Contract at rates that are established by the Executive Committee to recover all ARP costs. The active ARP Participants that own generating resources or have entitlements in FMPA power supply projects (other than entitlements in the St. Lucie Project), contract with the ARP to sell the electric capacity and energy of their resource entitlements to the ARP.

---

<sup>1</sup>The City of Lake Worth Beach has exercised the right to modify its ARP participation by implementation of a Contract Rate of Delivery (CROD). The CROD amount for Lake Worth Beach pursuant to contract terms is 0 MW. While Lake Worth Beach remains a participant in the ARP, effective January 1, 2014, they no longer are purchasing capacity and energy from the ARP and no longer have a representative on the Executive Committee.

**Figure 1-1  
ARP Participant Cities**



Following is a brief description of each of the ARP Participants who is provided capacity and energy from the ARP.

### **City of Bushnell**

The City of Bushnell is located in central Florida in Sumter County. The City joined the ARP in May 1986. Mike Eastburn is the City Manager and Finance Director. The City's service area is approximately 1.4 square miles. For more information about the City of Bushnell, please visit [www.cityofbushnellfl.com](http://www.cityofbushnellfl.com).

### **City of Clewiston**

The City of Clewiston is located in southern Florida in Hendry County. The City joined the ARP in May 1991. Danny Williams is the Director of Utilities. The City's service area is approximately 5 square miles. For more information about the City of Clewiston, please visit [www.clewiston-fl.gov](http://www.clewiston-fl.gov).

**City of Fort Meade**

The City of Fort Meade is located in central Florida in Polk County. The City joined the ARP in February 2000. Alis Drumgo the Interim City Manager. The City's service area is approximately 5 square miles. For more information about the City of Fort Meade, please visit [www.cityoffortmeade.com](http://www.cityoffortmeade.com).

**Fort Pierce Utilities Authority**

The City of Fort Pierce is located on Florida's east coast in St. Lucie County. Fort Pierce Utilities Authority (FPUA) joined the ARP in January 1998. Javier Cisneros, P.E., is the Director of Utilities. FPUA's service area is approximately 35 square miles. For more information about Fort Pierce Utilities Authority, please visit [www.fpua.com](http://www.fpua.com).

**City of Green Cove Springs**

The City of Green Cove Springs is located in northeast Florida in Clay County. The City joined the ARP in May 1986. Steve Kennedy is the City Manager. The City's service area is approximately 25 square miles. For more information about the City of Green Cove Springs, please visit [www.greencovesprings.com](http://www.greencovesprings.com).

**Town of Havana**

The Town of Havana is located in the panhandle of Florida in Gadsden County. The Town joined the ARP in July 2000. Kendrah Wilkerson is the Town Manager. The Town's service area is approximately 5 square miles. For more information about the Town of Havana, please visit [www.townofhavana.com](http://www.townofhavana.com).

**City of Jacksonville Beach, d/b/a Beaches Energy Services**

The City of Jacksonville Beach is located in northeast Florida in Duval County. Jacksonville Beach's electric department, operating under the name Beaches Energy Services (Beaches), serves customers in Duval and St. Johns Counties. Beaches joined the ARP in May 1986. Allen Putnam is the Director of Electric Utilities. Beaches' service area is approximately 45 square miles. For more information about Beaches, please visit [www.beachesenergy.com](http://www.beachesenergy.com).

**Utility Board of the City of Key West**

The Utility Board of the City of Key West, Florida, doing business as Keys Energy Services (KEYS), provides electric service to the lower Keys in Monroe County. KEYS joined the ARP in April 1998. Lynne Tejeda is the General Manager and CEO. KEYS' service area is approximately

45 square miles. For more information about Keys Energy Services, please visit [www.keysenergy.com](http://www.keysenergy.com).

### **Kissimmee Utility Authority**

The City of Kissimmee is located in central Florida in Osceola County. Kissimmee Utility Authority (KUA) joined the ARP in October 2002. Brian Horton is the President & General Manager/CEO, Jason Terry is the Vice President of Power Supply, and Larry Mattern is the Vice President of Operations. KUA's service area is approximately 85 square miles. For more information about KUA, please visit [www.kua.com](http://www.kua.com).

### **City of Lake Worth Beach**

The City of Lake Worth Beach is located in Palm Beach County. The City joined the ARP in October 2002. Ed Liberty is the Utilities Director. The City's service territory is approximately 12.5 square miles. Effective January 1, 2014, the City of Lake Worth Beach elected a contract rate of delivery, which was calculated according to the All-Requirements Power Supply Project Contract, as amended, at 0.0 MW. As such, the City of Lake Worth Beach no longer purchases capacity and energy from the ARP.

### **City of Leesburg**

The City of Leesburg is located in central Florida in Lake County. The City joined the ARP in May 1986. Brad Chase is the Director of Electric Department. The City's service area is approximately 50 square miles. For more information about the City of Leesburg, please visit [www.leesburgflorida.gov](http://www.leesburgflorida.gov).

### **City of Newberry**

The City of Newberry is located in north central Florida in Alachua County. The City joined the ARP in December 2000. Jamie Jones is the Utilities Director, and Dallas Lee is the interim City Manager. The City's service area is approximately 3 square miles. For more information about the City of Newberry, please visit [www.newberryfl.gov](http://www.newberryfl.gov).

### **City of Ocala**

The City of Ocala, doing business as Ocala Electric Utility, is located in central Florida in Marion County. The City joined the ARP in May 1986. Peter Lee is the City Manager. Doug Peebles is the Director of Electric Utility. The City's service area is approximately 161 square miles. For more information about Ocala Utility Services, please visit [www.ocalaelectric.com](http://www.ocalaelectric.com).

**City of Starke**

The City of Starke is located in north Florida in Bradford County. The city joined the ARP in October 1997. Russell Mullins is the City Manager. The City's service area is approximately 6.5 square miles. For more information about the City of Starke, please visit [www.cityofstarke.org](http://www.cityofstarke.org).

**1.3 Other FMPA Power Supply Projects**

In addition to the ARP, FMPA facilitates the participation of FMPA Members in six other power supply projects as discussed below.

**St. Lucie Project**

On May 12, 1983, FMPA purchased from Florida Power & Light Company (FPL) an 8.806 percent undivided ownership interest in St. Lucie Unit No. 2 (the St. Lucie Project), a nuclear generating unit located in St. Lucie County. St. Lucie Unit No. 2 was declared in commercial operation on August 8, 1983, and in Firm Operation, as defined in the participation agreement, on August 14, 1983. Fourteen FMPA Members and the ARP are participants in the St. Lucie Project, with the following entitlements to FMPA's undivided ownership interest as shown in Table 1-1.

**Table 1-1  
St. Lucie Project Participants**

<b>Participant</b>	<b>% Entitlement</b>	<b>Participant</b>	<b>% Entitlement</b>
Alachua	0.431	Clewiston	2.202
Fort Meade	0.336	Fort Pierce	15.206
Green Cove Springs	1.757	Homestead	8.269
Jacksonville Beach	7.329	Kissimmee	9.405
Lake Worth	24.870	Leesburg	2.326
Moore Haven	0.384	Newberry	0.184
New Smyrna Beach	9.884	Starke	2.215
ARP	15.202		

**Stanton Project**

On August 13, 1984, FMPA purchased from the Orlando Utilities Commission (OUC) a 14.8193 percent undivided ownership interest in Stanton Unit No. 1. Stanton Unit No. 1 went into commercial operation July 1, 1987. Five FMPA Members and the ARP are participants in the Stanton Project with entitlements to FMPA's undivided interest as shown in Table 1-2. FMPA is working with the majority owner on a plan to exit participation in Stanton Unit No. 1 with a target



for the end of 2025. The Stanton Project will terminate after the Stanton Project no longer purchases capacity and energy from Stanton Unit No. 1, and all associated liabilities for FMPA have been satisfied.

**Table 1-2  
Stanton Project Participants**

<b>Participant</b>	<b>% Entitlement</b>	<b>Participant</b>	<b>% Entitlement</b>
Fort Pierce	24.390	Homestead	12.195
Kissimmee	12.195	Lake Worth	16.260
Starke	2.439	ARP	32.521

**Tri-City Project**

On March 22, 1985, the FMPA Board approved the agreements associated with the Tri-City Project, and FMPA purchased from OUC an additional 5.3012 percent undivided ownership interest in Stanton Unit No. 1. Three FMPA Members are participants in the Tri-City Project with the following entitlements to FMPA's undivided interest as shown in Table 1-3. FMPA is working with the majority owner on a plan to exit participation in Stanton Unit No. 1 with a target for the end of 2025. The Tri-City Project will terminate after the Tri-City Project no longer purchases capacity and energy from Stanton Unit No. 1, and all associated liabilities for FMPA have been satisfied.

**Table 1-3  
Tri-City Project Participants**

<b>Participant</b>	<b>% Entitlement</b>
Fort Pierce	22.727
Homestead	22.727
Key West	54.546

**Stanton II Project**

On June 6, 1991, under the Stanton II Project structure, FMPA purchased from OUC a 23.2367 percent undivided ownership interest in OUC's Stanton Unit No. 2. The unit commenced commercial operation in June 1996. Six FMPA Members and the ARP are participants in the Stanton II Project with the following entitlements to FMPA's undivided interest as shown in Table 14. For the 2025 TYSP, FMPA has adjusted the assumption regarding the longevity of the Stanton II Project, and it is currently anticipated that Stanton Unit No. 2 will be converted to 100 percent natural gas.

**Table 1-4  
Stanton II Project Participants**

<b>Participant</b>	<b>% Entitlement</b>	<b>Participant</b>	<b>% Entitlement</b>
Fort Pierce	16.4880	Homestead	8.2443
Key West	9.8932	Kissimmee	32.9774
St. Cloud	14.6711	Starke	1.2366
ARP	16.4887		

**Solar II Project and Solar III Project**

Five FMPA Members are participants in the Solar II Project, which was approved by the FMPA Board of Directors in February 2020. The total entitlement is approximately 75 MW-AC and is allocated as shown in Table 1-5. As of the writing of this TYSP, due to a variety of market factors, the Solar III Project facilities have either been cancelled or are in the process of being cancelled. Consequently, FMPA has removed the ARP's pro-rata share of Solar III Project facilities from our plan.

**Table 1-5  
Florida Municipal Solar II Project Participants**

<b>Participant</b>	<b>% Entitlement</b>
Homestead	15.400
Lake Worth Beach	45.765
Mount Dora	1.339
New Smyrna Beach	6.696
Winter Park	30.800

## 1.4 Summary of Projects

Table 1-6 provides a summary of FMPA project participation as of December 31, 2024.

**Table 1-6  
Summary of FMPA Power Supply Project Participants**

Participant	St. Lucie Project	Stanton Project	Tri-City Project	All-Requirements Power Supply Project	Stanton II Project	Florida Municipal Solar Project Phase II
City of Alachua	X					
City of Bushnell				X		
City of Clewiston	X			X		
City of Ft. Meade	X			X [1]		
Ft. Pierce Utilities Authority	X	X	X	X	X	
City of Green Cove Springs	X			X [2]		
Town of Havana				X		
City of Homestead	X	X	X		X	X
Jacksonville Energy Authority						
City of Jacksonville Beach	X			X		
Utility Board of the City of Key West			X	X	X	
Kissimmee Utility Authority	X	X		X	X	
City of Lake Worth Beach	X	X		X [3]		X
City of Leesburg	X			X		
City of Moore Haven	X					
City of Mount Dora						X
City of Newberry	X			X		
City of New Smyrna Beach	X					X
City of Ocala				X		
City of St. Cloud					X	
City of Starke	X	X		X	X	
City of Winter Park						X
ARP	X [4]	X [4]			X [4]	

[1] Effective January 1, 2015, the City of Ft. Meade exercised the right to modify its ARP full requirements membership (CROD). Under a supplemental power sales agreement, the ARP continues to serve Ft. Meade's full requirements through September 2027.

[2] Effective January 1, 2020, the City of Green Cove Springs exercised the right to modify its ARP full requirements membership (CROD). Under a supplemental service agreement, the ARP continues to serve GCS's full requirements through September 2029.

[3] Effective January 1, 2014, the City of Lake Worth exercised the right to modify its ARP full requirements membership (CROD).

[4] Pursuant to the sale of the City of Vero Beach's electric system to Florida Power and Light in 2018, the ARP accepted and the transfer and assignment of Vero Beach power entitlement shares of the St. Lucie, Stanton, and Stanton II Projects.

## Section 2 Description of Existing Facilities

### 2.1 ARP Supply-Side Resources

The ARP supply-side resources consist of ARP Participant-owned resources, ARP Participant and ARP entitlements and ownership shares in nuclear, coal and gas-fired power plants, ARP owned resources, and power purchase agreements. The supply-side resources for the ARP for the 2025 summer season are shown in Table 2-1.

**Table 2-1**  
**ARP Supply-Side Resources Summer 2025**

Resource Category	Summer Capacity (MW)
1) Nuclear (Excluded Resource and ARP)	48
2) ARP System Generation	
Existing	1,675
New	-
Sub Total ARP System Generation	1,675
3) Power Purchases excluding Solar	268
Power Purchases of Solar	35
Total 2025 ARP Resources	2,027

The resource categories shown in Table 2-1 are described in more detail below.

- 1) **Excluded Resources (Nuclear):** A number of the ARP Participants, as well as the ARP (separate and distinct from such ARP Participants), participate in FMPA's St. Lucie Project, and are entitled to capacity and energy from St. Lucie Unit No. 2. Capacity from the ARP Participants' individual power entitlement shares in the St. Lucie Project is classified as an "Excluded Power Supply Resource" in the All-Requirements Power Supply Project Contract between FMPA and the ARP Participants. As such, the ARP Participants pay their own costs associated with their entitlement in the St. Lucie Project and individually receive the benefits of the capacity and energy from the St. Lucie Project. The ARP's entitlement to the St. Lucie Project, as of the closing of the sale of the City of Vero Beach's electric system to Florida Power and Light, is included in the ARP as a resource

and a cost of the ARP. The ARP provides the balance of capacity and energy requirements for these ARP Participants (unless otherwise limited by CROD). Full Requirements ARP Participants' excluded resources are included in the capacity planning for the ARP.

- 2) **ARP System Generation:** This category includes 1) generation that is wholly or jointly owned by FMPA as agent for the ARP; 2) generation that is wholly or jointly owned by ARP Participants; and 3) generation from ARP Participants' entitlements and the ARP's entitlements in the St. Lucie, Stanton, Tri-City, and Stanton II Projects (as applicable). FMPA has operational control of the ARP's and ARP Participants' capacity and energy from these resources, and such capacity and energy are dedicated solely to serving the ARP. FMPA is working with the majority owner on a plan to exit participation in one of the owned coal units (Stanton 1) with a target for the end of 2025, and Stanton II is currently expected to undergo a conversion to 100 percent natural gas in 2027. If the planned exit of participation from one coal unit and other coal unit refiring occurs as scheduled, coal fired generation will be removed from the ARP's fleet by the end of 2027.
- 3) **Power Purchases:** This category includes power purchases between FMPA, as agent for the ARP, and third parties. Purchased power generation used to serve the ARP as of December 31, 2024, includes capacity and energy purchased from NextEra from their Oleander Unit 5 facility as well as capacity and energy from Power Holdings LLC from their Oleander Unit 1 facility. In addition, the ARP purchases solar energy from Florida Renewable Partners, LLC beginning in Summer of 2020 and from Origis Energy beginning the fall of 2024 and has included this solar energy (including estimated dependable capacity to serve peak demand) in all schedules herein.

Information regarding existing ARP generation resources as of December 31, 2024, can be found in Schedule 1 at the end of this section.

## 2.2 ARP Transmission System

The Florida electric transmission grid is interconnected by high voltage transmission lines ranging from 69 kV to 500 kV. Peninsular Florida's electric grid is tied to the rest of the continental United States at the Florida/Georgia boundary and along the Apalachicola River in the Florida Panhandle, referred to as the Florida – Southern Interface. FPL, Duke Energy Florida (DEF), JEA and the City of Tallahassee own the transmission tie lines at the Florida – Southern Interface. ARP Participants are interconnected to the transmission systems of FPL, DEF, OUC, JEA, Seminole Electric Cooperative Incorporated (SECI), Florida Keys Electric Cooperative Incorporated (FKEC), and Tampa Electric Company (TECO). Some ARP Participants own transmission

facilities within their service territories, and the ARP has an ownership share of the transmission facilities associated with the Cane Island Power Park.

The ARP transmits capacity and energy to the ARP Participants utilizing the transmission systems of FPL, DEF, and OUC. Capacity and energy for the Cities of Jacksonville Beach, Green Cove Springs, Clewiston, Fort Pierce, Starke and KEYS are transmitted across FPL's transmission system. Capacity and energy for the Cities of Ocala, Leesburg, Bushnell, Newberry, Ft. Meade and the Town of Havana are transmitted across the DEF transmission system. Capacity and energy for KUA from resources external to KUA's service territory is transmitted across the transmission systems of FPL, DEF and OUC. Sales to the City of Winter Park are made across DEF's transmission system. Sales to the City of Homestead are made across FPL's transmission system. Sales to Tampa Electric are contingent upon the availability of firm transmission on Tampa Electric's system for delivery of capacity and energy from the ARP's Cane Island Power Park resources. Sales to Williston, Alachua, and the Central Florida Tourism Oversight District are transmitted across the DEF transmission system.

### **2.2.1 ARP Participant Transmission Systems<sup>2</sup>**

#### **FPUA**

FPUA is a municipally owned utility operating electric, water, wastewater, and natural gas utilities. The electric utility owns an internal, looped, 69kV transmission system for system load, supplied by three 138 kV to 69 kV autotransformers, two at Hartman Substation and one at Garden City substation. FPUA supplies power to its distribution system at 13.2 kV via six 69 kV substations. There are two interconnection points with FPL, both at 138 kV. FPUA's Hartman Substation interconnects with FPL's Emerson Substation via one transmission line, and FPL's Midway Substation via two transmission lines. The Emerson and Midway #2 lines have FPL tapped substations along their route. The second interconnection point for FPUA is at the FPL owned Julia Substation. Julia Substation connects to FPUA's Garden City (No. 12) Substation and to FPL's Emerson 138 kV Substation and Canal 138 kV Substation. The tie line from Julia Substation to FPUA's Garden City substation is owned by FPUA.

#### **KEYS**

KEYS maintains and operates an electric generation, transmission, and distribution system, which supplies electric capacity and energy south of FKEC's Marathon Substation to the Lower Florida

---

<sup>2</sup> The City of Lake Worth Beach's transmission system description is not being provided because Lake Worth Beach directly reports to the FRCC on their own system.

Keys and the City of Key West. KEYS and FKEC jointly own a 138 kV transmission system that interconnects to FPL's Farmlife Substation at the Dade/Monroe County Line and proceeds southwest via several FKEC substations to FKEC's Marathon Substation. This system includes two interconnections with FPL at the Dade/ Monroe County line. At these interconnections, FKEC and KEYS own 21 miles of a 36.8-mile 138 kV tie line between the FKEC's Tavernier and FPL's Farmlife Substations and 14 miles of a 27.8-mile 138 kV tie line between FKEC's Jewfish Creek and FPL's Farmlife Substations. KEYS owns and operates a 38.2-mile long 138 kV radial transmission system from Marathon Substation to Big Coppitt Substation. The KEYS radial 138-kV system loops in and out of KEYS' Big Pine and Big Coppitt Substations and taps off at Cudjoe Key Substation. KEYS owns two 138 kV lines of approximately 5.5 and 7.84 miles in length connecting Big Coppitt Substation to Stock Island Substation. Two autotransformers at the Stock Island Substation provide transformation between 138 kV and 69 kV. KEYS has six 69 kV and four 138 kV substations which supply power at 13.8 kV to its distribution system. KEYS owns approximately 241 miles of 13.8 kV distribution line. KEYS owns two STATCOM/shunt capacitors installations, one at Big Pine and one at Stock Island Power Plant Substation. Additionally, KEYS and FKEC jointly own a 138 kV series capacitor, installed at FKEC's Islamorada Substation; and an automated transmission protection system to automatically shed load for select contingency conditions. These projects ensure the import limit of the Florida Keys (KEYS/FMPA and FKEC) 138 kV transmission system is equal to the thermal limit of the installed transmission conductor.

### **KUA**

KUA serves a total area of approximately 85 square miles and owns 24.6 circuit miles of 230 kV and 48.1 circuit miles of 69 kV transmission lines that deliver capacity and energy to 11 distribution substations. KUA and FMPA jointly own 21.6 circuit miles of 230 kV lines out of Cane Island Power Park. KUA has direct transmission interconnections with DEF, OUC, TECO and the City of St. Cloud (STC) in the following locations: (1) At Cane Island Substation, one 230 kV transmission line to DEF's Intercession City Substation, one 230 kV transmission line to OUC's Taft Substation, and one 230 kV transmission line to OUC/TECO's Osceola Substation; (2) At KUA's Marydia Substation, one 230 kV transmission line to OUC's Taft Substation; (3) At KUA's Lake Cecile Substation, one 69 kV transmission line to DEF's Lake Bryan Substation; (4) At KUA's Employee Substation, one 69 kV transmission line to DEF's Meadow Woods East Substation; (5) At KUA's Buenaventura Lakes Substation, one 69 kV transmission line to OUC's Taft substation (230 to 69 kV autotransformer owned by KUA) and (6) At KUA's Domingo Toro Substation, one 69 kV line to STC's Central Substation.

**City of Ocala**

The City of Ocala, operating under the name Ocala Electric Utility (OEU), owns its bulk power supply system which consists of three 230 kV to 69 kV substations, 13 miles of 230 kV transmission, 76.6 miles of a 69 kV transmission loop, and 18 – 69 kV distribution substations delivering power at 12.47 kV. Ocala's 230 kV transmission facilities are dedicated to serving the OEU load pocket and are not part of the FRCC networked 230 kV transmission system. The OEU distribution system consists of 759 miles of overhead lines and 384 miles of underground lines.

OEU's 230 kV transmission facilities have interconnections with both DEF's Silver Springs Switching Station and SECI's Silver Springs North Switching Station. OEU's Dearmin Substation interconnects to both DEF's Silver Springs Switching Station and SECI's Silver Springs North Switching Stations. OEU's Ergle and Shaw substations are interconnected at SECI's Silver Springs North Switching Station. The OEU Ergle, Dearmin and Shaw Substations each have two auto-transformers to provide transformation from 230 kV to 69 kV. OEU also has a 69 kV radial tie from its Airport 69 kV Substation to Sumter Electric Cooperative's Martel Substation. OEU owns a 13-mile 230 kV transmission line from Shaw Substation to Silver Springs North Switching Station.

**City of Jacksonville Beach, d/b/a Beaches Energy Services**

Beaches owns and maintains a 138 kV transmission system that supplies electric capacity and energy to its distribution substations, with connections to both FPL and JEA. Beaches owns the 230 kV Sampson transmission switching station that interconnects to FPL at FPL's Valley Substation and to JEA at JEA's Switzerland Substation. Beaches has a second interconnection that ties to JEA's Neptune Beach Substation from its Penman Substation at 138 kV.

Three auto-transformers at Sampson substation provide transformation from 230 kV to 138 kV. Beaches has five 138 kV distribution substations, which deliver energy at 26.4 kV to its distribution system. Beaches owns 46.9 miles of 138 kV transmission lines.

**City of Clewiston**

The City of Clewiston owns two radial 3.5-mile 138 kV transmission lines from FPL's McCarthy Substation (formerly owned by the City of Clewiston) to the City of Clewiston substation. Two transformers at the City of Clewiston substation provide transformation from 138 kV to 12.47 kV to its distribution system. One 138 kV to 13.8 kV transformer at the City of Clewiston Substation provides a connection to the US Sugar co-generation facility.



### **2.2.2 ARP Transmission Agreements**

OUC provides transmission service for delivery of power associated with ARP Participants' entitlements in the Stanton, Tri-City, Stanton II Projects, and St. Lucie and the ARP's ownership interests in Stanton Units 1 and 2. OUC also provides transmission service for delivery of power associated with ARP ownership interests in the Stanton A combined cycle (CC), and the Indian River combustion turbine (CT) units. OUC transmission service is for the delivery of this energy to either the FPL, DEF or KUA interfaces with OUC for subsequent delivery to ARP Participants. Rates for such transmission wheeling service from the Stanton and Indian River units are pursuant to the terms and conditions of Firm Transmission Service Agreements, and rates for transmission wheeling service from Stanton A are pursuant to OUC's OATT.

FMPA also has contracts with DEF and FPL for Network Integration Transmission Service that allow FMPA to integrate its resources to serve its load (those loads interconnected with either FPL or DEF) in a manner comparable to how FPL and DEF integrate resources to serve FPL and DEF native loads. The Network Service and Network Operating Agreements with FPL were executed in March 1996 and were subsequently amended to both conform to FERC's Pro forma Tariff and to modify certain ARP Participant points of delivery. The Network Service and Network Operating Agreements with DEF were executed and filed with FERC in January 2011 and were subsequently amended to modify certain ARP Participant points of delivery.

**Schedule 1**  
**Existing Generating Facilities as of December 31, 2024**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)
Plant Name	Unit No.	Location	Unit Type	Fuel Type		Fuel Transportation		Commercial In-Service MM/YY	Expected Retirement MM/YY	Gen. Max Nameplate MW	Net Capability [1]	
				Primary	Alternate	Primary	Alternate				Summer (MW)	Winter (MW)
Nuclear												
St. Lucie	2	St. Lucie	NP	UR	-	TK	-	08/83	NA	891	48 [2]	50 [2]
Total Nuclear Resources											48	50
ARP System Generation												
Stanton Energy Center	1	Orange	ST	BIT	-	RR	-	07/87	12/25	465	116 [3]	116 [3]
Stanton Energy Center	2	Orange	ST	BIT	-	RR	-	06/96	NA	465	106 [4]	106 [4]
Stanton Energy Center	A	Orange	CC	NG	DFO	PL	TK	10/03	NA	671	44 [5]	47 [5]
Indian River	CT A	Brevard	GT	NG	DFO	PL	TK	06/89	NA	41	16 [6]	19 [6]
Indian River	CT B	Brevard	GT	NG	DFO	PL	TK	07/89	NA	41	16 [6]	19 [6]
Indian River	CT C	Brevard	GT	NG	DFO	PL	TK	08/92	NA	130	22 [7]	23 [7]
Indian River	CT D	Brevard	GT	NG	DFO	PL	TK	10/92	NA	130	22 [7]	23 [7]
Cane Island	1	Osceola	GT	NG	DFO	PL	TK	01/95	NA	40	35 [8]	38 [8]
Cane Island	2	Osceola	CC	NG	-	PL	-	06/95	NA	122	109 [8]	113 [8]
Cane Island	3	Osceola	CC	NG	-	PL	-	01/02	NA	280	250 [8]	260 [8]
Cane Island	4	Osceola	CC	NG	-	PL	-	08/11	NA	350	300	310
Sand Lake Energy Center	1	Orange	CC	NG	-	PL	-	2/24	NA	120	120	120
Mulberry Energy Center	1	Polk	CC	NG	-	PL	-	8/24	NA	120	108	115
Stock Island	CT1	Monroe	GT	DFO	-	WA	-	11/78	NA	20	19	19
Stock Island	CT2	Monroe	GT	DFO	-	WA	-	06/99	NA	21	16	16
Stock Island	CT3	Monroe	GT	DFO	-	WA	-	06/99	NA	21	14	14
Stock Island	GT4	Monroe	GT	DFO	-	WA	-	06/06	NA	61	46	46
Stock Island	MSD1	Monroe	IC	DFO	-	WA	-	06/91	NA	9	8	8
Stock Island	MSD2	Monroe	IC	DFO	-	WA	-	06/91	NA	9	8	8
Stock Island	EP2	Monroe	IC	DFO	-	WA	-	07/12	NA	2	2	2
Treasure Coast	1	St. Lucie	CC	NG	DFO	PL	TK	05/08	NA	350	300	310
Total ARP System Generation											1,675	1,730
Total Generation Resources											1,724	1,781

- [1] Capabilities shown are as of December 31, 2024. Net capabilities shown for the Stanton and Indian River resources reflect the ARP's ownership capacity less losses across OUC's transmission system, which were assumed to be 2 percent over the study period.
- [2] Amounts shown reflect non-CROD ARP Participants' Power Entitlement Shares and the ARP's entitlement share in the St. Lucie Project.
- [3] Amounts shown reflect the total capacity available to the ARP to serve ARP load from Stanton 1.
- [4] Amounts shown reflect the total capacity available to the ARP to serve ARP load from Stanton 2.
- [5] Amounts shown reflect the ARP's (3.5%) and KUA's (3.5%) ownership interests in Stanton A.
- [6] Amounts shown reflect the ARP's (39.0%) and KUA's (12.2%) ownership interests in Indian River CTs A&B.
- [7] Amounts shown reflect the ARP's (21.0%) ownership interest in Indian River CTs C&D.
- [8] The ARP and KUA each own 50% of Cane Island Units 1-3. Amounts shown reflect the entire capability for each unit. FMPS has operational control of the units, which are dedicated entirely to serving the capacity and energy requirements of the ARP.

## Section 3 Forecast of Demand and Energy for the All-Requirements Power Supply Project


### 3.1 Introduction

To secure sufficient capacity and energy, FMPA forecasts each ARP Participant's electrical power demand and energy requirements from the ARP on an individual basis and aggregates the results into a forecast for the ARP. Additional wholesale obligations of the ARP (e.g. Winter Park, Williston, Alachua, Central Florida Tourism Oversight District) are projected using a similar methodology. The following discussion summarizes the load forecasting process and the results of the ARP load forecast contained in this Ten-Year Site Plan.

### 3.2 Load Forecast Process

FMPA prepares its load and energy forecast by month and summarizes the forecast annually. The load and energy forecast includes projections of customers, demand, and energy sales by rate classification for each of the ARP Participants who receive capacity and energy from the ARP. Forecasts are prepared on an individual Participant basis and are then aggregated into projections of the total ARP demand and energy requirements. Projections of the total ARP demand and energy requirements include real power losses on the transmission systems used by FMPA to deliver requirements to the ARP Participants. Figure 3-1 below identifies FMPA's load forecast process.

**Figure 3-1  
Load Forecast Process**

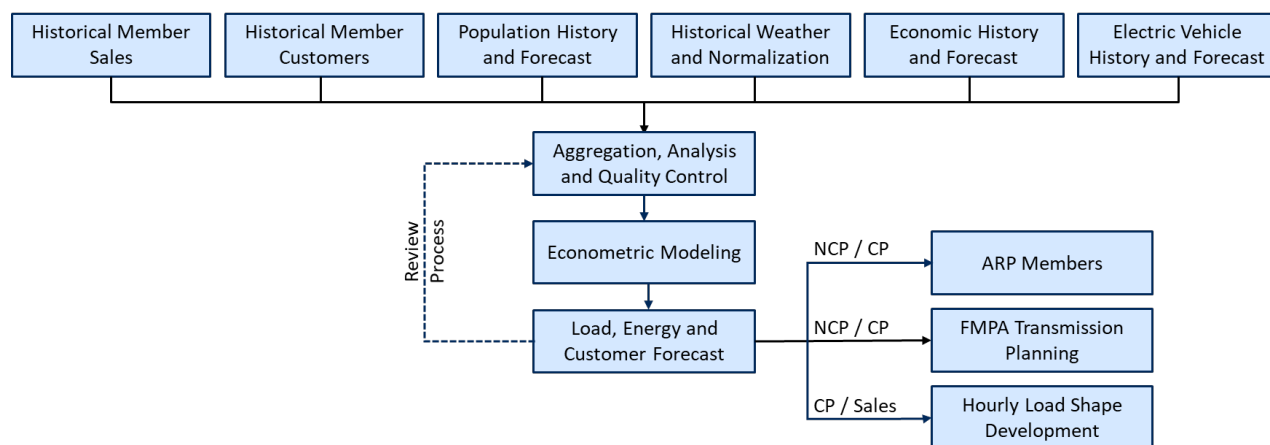

Note on Figure 3-1:

NCP is the Non-Coincident Peak demand, which represents the maximum hourly demand for an ARP Participant in a given month.

CP is the Coincident Peak demand which represents the maximum hourly demand of the ARP system in aggregate, or the hourly demand of the ARP Participant at the time of the ARP CP.

In addition to the Base Case load and energy forecast, FMPA has prepared high and low case forecasts, which are intended to capture the majority of the uncertainty in certain driving variables, for each of the ARP Participants. The high and low load forecast scenarios are considered in FMPA's resource planning process. In this way, power supply plans are tested for their robustness under varying future load conditions.

### **3.3 Load Forecast Overview**

The load and energy forecast (Forecast) was prepared for a 20-year period, beginning fiscal year 2025 through 2044. The Forecast was prepared on a monthly basis using municipal utility data provided to FMPA by the ARP Participants and load data maintained by FMPA. Historical and projected economic and demographic data were provided by the Bureau of Economic and Business Research (BEBR) at the University of Florida and Woods & Poole Economics, nationally recognized providers of such data, from which averages were developed for the forecast horizon. The Forecast also relied on information regarding local economic and demographic issues specific to each ARP Participant. Weather data was provided by the National Oceanic and Atmospheric Administration (NOAA) for a variety of weather stations in close proximity to the ARP Participants. The Forecast assumes normal weather conditions, as reported by NOAA and reflects a rolling thirty-year average. The explicit load impact from the estimated rate of adoption of electric vehicles in the ARP Participant regions are included to this forecast over the study period based on an economic uptake model driven from publicly available national forecasts, and data compiled by the Florida Department of Highway Safety and Motor Vehicles. Likewise, distributed generation expectations are estimated using an economic payback model derived from publicly available information.

The Forecast reflects the City of Fort Meade's and the City of Green Cove Springs' establishment of Contract Rate of Delivery (CROD). However, both Ft. Meade and Green Cove Springs have executed a supplemental agreement with the ARP such that the ARP will serve all of Ft. Meade's and Green Cove Springs' load for the majority of the TYSP study period as if such Participants had not effectuated CROD, and this incremental load is included in the ARP's resource balance herein over the forecast horizon. The results of the Base Case forecast are discussed in Section 3.6.1.

In addition to a base case forecast, FMPA has prepared High and Low forecasts to capture long-term economic uncertainty. The methodology and results of the High and Low cases are discussed in Section 3.6.2.

### **3.4 Methodology**

The forecast of peak demand and net energy for load to be supplied from the ARP relies on an econometric forecast of each ARP Participant's retail sales, combined with various assumptions regarding distribution system loss, load, and coincidence factors, generally based on the recent historical values for such factors. Econometric forecasting makes use of regression to establish historical relationships between energy consumption and various explanatory variables based on fundamental economic theory and experience.

In this approach, the significance of historical relationships is evaluated using commonly accepted statistical measures. Models that, in the view of the analyst, best explain the historical variation of energy consumption are selected. These historical relationships are generally assumed to continue, barring any specific information or assumptions to the contrary. The selected models are then populated with projections of explanatory variables, resulting in projections of energy requirements.

Econometric forecasting can be a more reliable technique for long-term forecasting than trend-based approaches and other techniques because the approach results in an explanation of variations in load rather than simply an extrapolation of history. As a result of this approach, utilities are more likely to anticipate departures from historical trends in energy consumption, given accurate projections of the driving variables. In addition, understanding the underlying relationships which affect energy consumption allows utilities to perform scenario and risk analyses, thereby improving decisions. The High and Low Cases are examples of this capability.

The energy industry is anticipating and must adequately plan for a gradual transition in the transportation sector from internal combustion engine gasoline-fueled vehicles to electric vehicles (EV) over the next few decades. The load forecast reflects an explicit projection of the impact of increased EV adoption. These impacts are then applied to the forecast as adjustments to the monthly peak and annual energy. Likewise, distributed generation uptake expectations for the ARP are estimated using an economic payback model derived from publicly available information. These adjustments are required to align future expectations with the historical relationships estimated econometrically, which cannot endogenously derive future discrete impacts not present in the historical data.

Forecasts of monthly sales were prepared by rate classification for each ARP Participant. In some cases, rate classifications were combined to eliminate the effects of class migration or redefinition. In this way, greater stability is provided in the historical period upon which statistical relationships are based.

### **3.4.1 Model Specifications**

The following discussion summarizes the development of econometric models used to forecast load, energy sales, and customer accounts on a monthly basis. This overview will present a common basis upon which each classification of models was prepared.

For the residential class, the analysis of electric sales was separated into residential usage per customer and the number of customers, the product of which is total residential sales. This process is common for homogenous customer groups. The residential class models typically reflect that energy sales are dependent on or driven by: (i) the number of residential customers, (ii) real personal income per household, (iii) real electricity prices, and (iv) weather variables. The number of residential customers was projected on the basis of the estimated historical relationship between the number of residential customers of the ARP Participants and the number of households in each ARP Participant's county.

The non-residential electricity sales models reflect that energy sales are best explained by: (i) real retail sales, total personal income, or gross domestic product (GDP) as a measure of economic activity and population in and around the ARP Participant's service territory, (ii) the real price of electricity, and (iii) weather variables. For certain large non-residential customers, the forecast was based on assumptions developed in consultation with the Participants (e.g., Clewiston and Key West).

Weather variables include heating and cooling degree days (described further below) for the current month and for the prior month. Lagged degree day variables are included to account for the typical billing cycle offset from calendar data. In other words, sales that are billed in any particular month are typically made up of electricity that was used during some portion of the current month and of the prior month.

### **3.4.2 Projection of NEL and Peak Demand**

The forecasts of sales for each rate classification described above were summed to equal the total retail sales of each ARP Participant. An assumed distribution system loss factor, based either on

a regression analysis or a recent average of historical distribution system loss factors, was then applied to the total sales to derive monthly delivered net energy for load (NEL).

Projections of summer and winter non-coincident peak (NCP) demand were developed by applying projected annual load factors to the forecasted delivered NEL on a total ARP Participant system basis. The projected load factors were based on the average relationship between annual NEL and the seasonal peak demand.

Monthly peak demand was based on the average relationship between each monthly peak and the appropriate seasonal peak. This average relationship was computed after ranking the historical demand data within the summer and winter seasons and reassigning peak demands to each month based on the typical ranking of that month compared to the seasonal peak. This process avoids distortion of the averages due to randomness as to the months in which peak weather conditions occur within each season. For example, a summer peak period typically occurs during July or August of each year. It is important that the shape of the peak demands reflects that only one of those two months is the peak month and that the other is typically some percentage less.

Once the monthly NEL and Peak Demand requirements were projected for each ARP Participant on an as delivered basis (inclusive of any applicable discrete adjustments required), expected losses on the transmission systems used to deliver the requirements, using assumed Real Power Loss percentages throughout the forecasted period, were added in to arrive at NEL and Peak Demand requirements on an as generated basis. These are summed across all ARP Participants for the ARP's total demand and energy requirements.

### **3.5 Data Sources**

#### **3.5.1 Historical ARP Participant Retail Sales Data**

Data was generally available and analyzed over January 1993 through September 2024. Data included historical customer counts, sales, and revenues by rate classification for each of the ARP Participants.

#### **3.5.2 Weather Data**

Historical weather data was provided by the National Climatic Data Center (a subsidiary of the National Oceanic and Atmospheric Administration) (NCDC). Weather stations, from which historical weather was obtained, were selected by their quality and proximity to the ARP Participants. In most cases, the closest "first-order" weather station was the best source of weather data. First-order weather stations (usually airports) generally provide the highest quality and most

reliable weather data. In two cases (Beaches and FPUA), however, weather data from a “cooperative” weather station, which was closer than the closest first-order station, appeared to more accurately reflect the weather conditions that affect the ARP Participants’ loads, based on statistical measures, than the closest first-order weather station.

The influence of weather on electricity sales has been represented through the use of two data series: heating and cooling degree days (HDD and CDD, respectively). Degree days are derived by comparing the average daily temperature and a base temperature, 65 degrees Fahrenheit. To the extent the average daily temperature exceeds 65 degrees Fahrenheit, the difference between that average temperature and the base is the number of CDD for the day in question. Conversely, HDD result from average daily temperatures which are below 65 degrees Fahrenheit. Heating and cooling degree days are then summed over the period of interest, in this case, months.

Normal weather conditions have been assumed in the projected period. Thirty-year normal monthly HDD and CDD are based on a rolling thirty-year average of weather conditions, as reported by NOAA.

### **3.5.3 Economic Data**

BEBR and Woods & Poole Economics, both nationally recognized providers of economic data, provided both historical and projected economic and demographic data for each of the 14 counties in which the ARP Participants’ service territories reside (the service territory of Beaches includes portions of both Duval and St. Johns Counties). This data includes county population, households, employment, personal income, retail sales, and gross domestic product. Although all of the data was not necessarily used in each of the forecast equations, each was examined for its potential to explain changes in the ARP Participants’ historical electric sales.

### **3.5.4 Real Electricity Price Data**

The real price of electricity was derived from a twelve month or multi-year moving average of real average revenue. Projected real electricity prices were assumed to increase at a rate of 0.3% per year, generally based on projections provided by the Energy Information Administration in the 2023 Annual Energy Outlook for Florida. No AEO was published in 2024.

### **3.5.5 Electric Vehicle Data**

Historical data regarding light duty vehicle totals and electric vehicles registered in each of the counties surrounding the ARP Participants was obtained from the Florida Department of Highway Safety and Motor Vehicles. Projections regarding EV adoption were developed from three



sources, specifically the EIA AEO 2023 (Low Adoption Case), Wood Mackenzie (Base Adoption Case), and Bloomberg New Energy Finance (High Adoption Case). EV charging energy requirements and demand profiles were drawn generally from data produced in NREL's EVI-Pro Lite tool and reflect that a small portion of EVs will charge during off-peak periods.

### **3.6 Overview of Results**

#### **3.6.1 Base Case Forecast**

The results of the Forecast show that the Base Case ARP forecast summer coincident peak (CP) demand and NEL for Calendar Year 2025, inclusive of sales for resale and transmission losses, are 1,626 MW and 7,731 GWh, respectively.

#### **3.6.2 Economic and Other Sources of Uncertainty of the Forecast**

In addition to the Base Case forecast, which relies on base case projections of future economic conditions, FMPA has developed high and low economic forecasts, referred to herein as the High and Low cases, intended to capture the volatility resulting from deviations from base case economic conditions equivalent to 90 percent of potential occurrences.

While BEBR does not publish information regarding the potential error of their projections, FMPA relied on such statistics from Woods & Poole, which relies on a similar underlying data set and methodology. Woods & Poole publishes several statistics that define the average amount by which various projections they have prepared through time are different from actual results. FMPA utilizes these statistics to develop ranges of the trends of economic activity and population representing approximately 90% of potential outcomes (i.e., 1.7 standard deviations) and re-simulates our econometric models using these alternative futures. The High and Low cases reflect the results of these revised simulations, which reflect increasing load forecast uncertainty over time commensurate with increased forecast error over time inherent in the economic projections.

Additional sources of load uncertainty are closely monitored by FMPA and are fused into the planning process for the ARP. Recent events across the national power grid that have stressed the ability of certain regions to provide service under extreme weather conditions, as well as the pace with which transportation is electrified and could result in significant load growth are key areas of focus over the current and future study horizons.

FMPA recurrently evaluates severe weather scenarios. These scenarios simulate cold-stressed temperatures at weather stations near the ARP loads to determine the differential that could be experienced with persistent cold as compared to various prior winter peak conditions (e.g., 1989 and 2010 winters, 90% confidence interval for HDD) when controlling for organic load growth

that has occurred (absent weather deviations) since that time. Such scenarios, among other scenarios, are considered in operational planning to support reliable dispatch of wholly owned natural gas generation. FMPA has allocated a budget for weatherization of wholly owned natural gas units as deemed necessary. FMPA intends to continue to maintain dual-fuel capabilities on wholly owned units and maintain natural gas reserves into the future to support reliable operations in extreme weather.

### **3.7 Load Forecast Schedules**

Schedules 2.1 through 2.3 and 3.1 through 3.3 present the Base Case load forecast. Schedules 3.1a and 3.2a present the Low Case, and Schedules 3.1b and 3.2b present the High Case. Schedule 4 presents the actual (2024) and forecasted (Base Case for 2025 and 2026) peak demand and NEL by month.

**Schedule 2.1**  
**History and Forecast of Energy Consumption and Number of Customers by Customer Class**  
**All-Requirements Project**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)
Year [1], [2]	Residential					Commercial		
	Population Served by ARP Participants	Members per Household	GWh	Average No. of Customers	Average kWh Consumption per Customer	GWh	Average No. of Customers	Average kWh Consumption per Customer
2015	NA	NA	2,772	211,026	13,137	2,680	38,337	69,893
2016	NA	NA	2,844	214,422	13,264	2,711	39,004	69,511
2017	NA	NA	2,791	218,399	12,781	2,675	39,300	68,074
2018	NA	NA	2,899	221,799	13,072	2,707	39,347	68,807
2019	NA	NA	2,965	226,405	13,095	2,721	39,694	68,561
2020	NA	NA	3,100	230,856	13,426	2,626	40,262	65,216
2021	NA	NA	3,070	235,640	13,029	2,685	40,771	65,849
2022	NA	NA	3,146	239,772	13,120	2,739	41,631	65,790
2023	NA	NA	3,197	243,829	13,113	2,776	42,216	65,752
2024	NA	NA	3,284	250,371	13,117	2,818	42,859	65,750
2025	NA	NA	3,345	254,988	13,120	2,785	43,357	64,242
2026	NA	NA	3,410	258,534	13,191	2,806	43,772	64,095
2027	NA	NA	3,457	261,648	13,214	2,829	44,144	64,094
2028	NA	NA	3,499	264,508	13,227	2,847	44,499	63,987
2029	NA	NA	3,542	267,276	13,251	2,864	44,848	63,860
2030	NA	NA	3,585	269,934	13,281	2,882	45,196	63,777
2031	NA	NA	3,630	272,424	13,325	2,902	45,538	63,720
2032	NA	NA	3,678	274,829	13,384	2,920	45,865	63,666
2033	NA	NA	3,731	277,197	13,461	2,940	46,193	63,644
2034	NA	NA	3,787	279,546	13,549	2,963	46,523	63,693

[1] Amounts shown for 2015 through 2024 represent historical values. Amounts shown for 2025 through 2034 represent forecast values.

[2] Loads and customer counts only reflects the ARP. Sales to other municipal utilities are shown as Sale for Resale on Schedule 2.3.

**Schedule 2.2**  
**History and Forecast of Energy Consumption and Number of Customers by Customer Class**  
**All-Requirements Project**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)
Year [1]	Industrial			Railroads and Railways GWh	Street & Highway Lighting GWh	Other Sales GWh	Total Sales to Ultimate Customers GWh
	GWh	Average No. of Customers	Average kWh Consumption per Customer				
2015	2	1	1,768,700	0	55	109	5,618
2016	2	1	2,359,000	0	55	109	5,722
2017	2	1	1,734,000	0	56	106	5,630
2018	1	1	992,000	0	56	107	5,771
2019	2	1	1,657,000	0	56	98	5,842
2020	1	1	842,100	0	56	94	5,876
2021	1	1	1,336,000	0	56	92	5,904
2022	2	1	1,625,000	0	56	94	6,036
2023	0	1	258,000	0	55	95	6,124
2024	1	1	1,148,000	0	56	95	6,254
2025	1	1	935,333	0	56	94	6,282
2026	1	1	935,333	0	56	95	6,367
2027	1	1	935,333	0	56	95	6,438
2028	1	1	935,333	0	56	95	6,498
2029	1	1	935,333	0	56	95	6,557
2030	1	1	935,333	0	56	95	6,619
2031	1	1	935,333	0	56	96	6,684
2032	1	1	935,333	0	56	96	6,751
2033	1	1	935,333	0	56	96	6,824
2034	1	1	935,333	0	56	96	6,903

[1] Amounts shown for 2015 through 2024 represent historical values. Amounts shown for 2025 through 2034 represent forecast values.

**Schedule 2.3**  
**History and Forecast of Energy Consumption and Number of Customers by Customer Class**  
**All-Requirements Project**

(1)	(2)	(3)	(4)	(5)	(6)
Year [1], [2]	Sales for Resale GWh	Utility Use & Losses GWh	Net Energy for Load GWh	Other Customers (Average No.)	Total No. of Customers
2015	88	336	6,042	0	249,364
2016	0	317	6,039	0	253,427
2017	0	354	5,984	0	257,700
2018	12	356	6,139	0	261,147
2019	100	348	6,290	0	266,100
2020	389	371	6,637	0	271,119
2021	709	324	6,937	0	276,411
2022	712	349	7,097	0	281,404
2023	769	281	7,174	0	286,046
2024	596	323	7,173	0	293,231
2025	1,137	312	7,731	0	298,346
2026	881	304	7,553	0	302,307
2027	839	289	7,566	0	305,792
2028	375	283	7,156	0	309,008
2029	385	241	7,183	0	312,125
2030	0	193	6,812	0	315,131
2031	0	168	6,852	0	317,964
2032	0	160	6,911	0	320,695
2033	0	118	6,942	0	323,391
2034	0	102	7,005	0	326,070

[1] Amounts shown for 2015 through 2024 represent historical values. Amounts shown for 2025 through 2034 represent forecast values.

[2] Loads and customer counts only reflects the ARP. Wholesale sales other than sales to the ARP Participants are shown as Sale for Resale on Schedule 2.3.

**Schedule 3.1**  
**History and Forecast of Summer Peak Demand (MW)**  
**All-Requirements Project – Base Case**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)
Year [1]	Total	Wholesale	Retail	Interruptible	Residential Load Management	Residential Conservation	Commercial/ Industrial Load Management	Commercial/ Industrial Load Conservation	Net Firm Demand
2015	1,227	1,227	0	0	0	0	0	0	1,227
2016	1,296	1,296	0	0	0	0	0	0	1,296
2017	1,263	1,263	0	0	0	0	0	0	1,263
2018	1,281	1,281	0	0	0	0	0	0	1,281
2019	1,349	1,349	0	0	0	0	0	0	1,349
2020	1,463	1,463	0	0	0	0	0	0	1,463
2021	1,467	1,467	0	0	0	0	0	0	1,467
2022	1,487	1,487	0	0	0	0	0	0	1,487
2023	1,613	1,613	0	0	0	0	0	0	1,613
2024	1,529	1,529	0	0	0	0	0	0	1,529
2025	1,626	1,626	0	0	0	0	0	0	1,626
2026	1,612	1,612	0	0	0	0	0	0	1,612
2027	1,610	1,610	0	0	0	0	0	0	1,610
2028	1,524	1,524	0	0	0	0	0	0	1,524
2029	1,535	1,535	0	0	0	0	0	0	1,535
2030	1,449	1,449	0	0	0	0	0	0	1,449
2031	1,457	1,457	0	0	0	0	0	0	1,457
2032	1,465	1,465	0	0	0	0	0	0	1,465
2033	1,474	1,474	0	0	0	0	0	0	1,474
2034	1,487	1,487	0	0	0	0	0	0	1,487

[1] Amounts shown for 2015 through 2024 represent historical values. Amounts shown for 2025 through 2034 represent forecast values.

**Schedule 3.2**  
**History and Forecast of Winter Peak Demand (MW)**  
**All-Requirements Project – Base Case**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)
Year [1]	Total	Wholesale	Retail	Interruptible	Residential Load Management	Residential Conservation	Commercial/ Industrial Load Management	Commercial/ Industrial Load Conservation	Net Firm Demand
2014/15	1,161	1,161	0	0	0	0	0	0	1,161
2015/16	1,019	1,019	0	0	0	0	0	0	1,019
2016/17	879	879	0	0	0	0	0	0	879
2017/18	1,228	1,228	0	0	0	0	0	0	1,228
2018/19	950	950	0	0	0	0	0	0	950
2019/20	1,165	1,165	0	0	0	0	0	0	1,165
2020/21	1,351	1,351	0	0	0	0	0	0	1,351
2021/22	1,248	1,248	0	0	0	0	0	0	1,248
2022/23	1,210	1,210	0	0	0	0	0	0	1,210
2023/24	1,047	1,047	0	0	0	0	0	0	1,047
2024/25	1,463	1,463	0	0	0	0	0	0	1,463
2025/26	1,236	1,236	0	0	0	0	0	0	1,236
2026/27	1,239	1,239	0	0	0	0	0	0	1,239
2027/28	1,168	1,168	0	0	0	0	0	0	1,168
2028/29	1,177	1,177	0	0	0	0	0	0	1,177
2029/30	1,130	1,130	0	0	0	0	0	0	1,130
2030/31	1,139	1,139	0	0	0	0	0	0	1,139
2031/32	1,149	1,149	0	0	0	0	0	0	1,149
2032/33	1,157	1,157	0	0	0	0	0	0	1,157
2033/34	1,167	1,167	0	0	0	0	0	0	1,167

[1] Amounts shown for 2014/15 through 2023/24 represent historical values. Amounts shown for 2024/25 through 2033/34 represent forecast values.

**Schedule 3.3**  
**History and Forecast of Annual Net Energy for Load (GWh)**  
**All-Requirements Project – Base Case**

(1)	(2)	(3)	(4)	(5)	(6)	(7)
Year [1], [2]	Total Sales to Ultimate Customers (including Sales for Resale)	Residential Conservation	Commercial/ Industrial Conservation	Utility Use & Losses	Net Energy for Load	Load Factor % [2]
2015	5,706	0	0	336	6,042	56%
2016	5,722	0	0	317	6,039	53%
2017	5,630	0	0	354	5,984	54%
2018	5,783	0	0	356	6,139	55%
2019	5,942	0	0	348	6,290	53%
2020	6,266	0	0	371	6,637	52%
2021	6,613	0	0	324	6,937	54%
2022	6,748	0	0	349	7,097	54%
2023	6,893	0	0	281	7,174	51%
2024	6,850	0	0	323	7,173	54%
2025	7,419	0	0	312	7,731	54%
2026	7,249	0	0	304	7,553	53%
2027	7,277	0	0	289	7,566	54%
2028	6,872	0	0	283	7,156	54%
2029	6,943	0	0	241	7,183	53%
2030	6,619	0	0	193	6,812	54%
2031	6,684	0	0	168	6,852	54%
2032	6,751	0	0	160	6,911	54%
2033	6,824	0	0	118	6,942	54%
2034	6,903	0	0	102	7,005	54%

[1] Amounts shown for 2015 through 2024 represent historical values. Amounts shown for 2025 through 2034 represent forecast values.

[2] The load factor reflects the annual calendar peak in the denominator (rather than, for example, the summer peak).



**Schedule 3.1a**  
**Forecast of Summer Peak Demand (MW)**  
**All-Requirements Project – Low Case [1]**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)
Year	Total	Wholesale	Retail	Interruptible	Residential Load Management	Residential Conservation	Commercial/ Industrial Load Management	Commercial/ Industrial Load Conservation	Net Firm Demand
2025	1,502	1,502	0	0	0	0	0	0	1,502
2026	1,498	1,498	0	0	0	0	0	0	1,498
2027	1,480	1,480	0	0	0	0	0	0	1,480
2028	1,385	1,385	0	0	0	0	0	0	1,385
2029	1,383	1,383	0	0	0	0	0	0	1,383
2030	1,378	1,378	0	0	0	0	0	0	1,378
2031	1,377	1,377	0	0	0	0	0	0	1,377
2032	1,378	1,378	0	0	0	0	0	0	1,378
2033	1,380	1,380	0	0	0	0	0	0	1,380
2034	1,386	1,386	0	0	0	0	0	0	1,386

[1] Values represent predicted summer peak demand under pessimistic economic conditions.

**Schedule 3.1b**  
**Forecast of Summer Peak Demand (MW)**  
**All-Requirements Project – High Case [1]**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)
Year	Total	Wholesale	Retail	Interruptible	Residential Load Management	Residential Conservation	Commercial/ Industrial Load Management	Commercial/ Industrial Load Conservation	Net Firm Demand
2025	1,525	1,525	0	0	0	0	0	0	1,525
2026	1,559	1,559	0	0	0	0	0	0	1,559
2027	1,569	1,569	0	0	0	0	0	0	1,569
2028	1,491	1,491	0	0	0	0	0	0	1,491
2029	1,509	1,509	0	0	0	0	0	0	1,509
2030	1,518	1,518	0	0	0	0	0	0	1,518
2031	1,534	1,534	0	0	0	0	0	0	1,534
2032	1,549	1,549	0	0	0	0	0	0	1,549
2033	1,566	1,566	0	0	0	0	0	0	1,566
2034	1,586	1,586	0	0	0	0	0	0	1,586

[1] Values represent predicted summer peak demand under optimistic economic conditions.

**Schedule 3.2a**  
**Forecast of Winter Peak Demand (MW)**  
**All-Requirements Project – Low Case [1]**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)
Year	Total	Wholesale	Retail	Interruptible	Residential Load Management	Residential Conservation	Commercial/ Industrial Load Management	Commercial/ Industrial Load Conservation	Net Firm Demand
2024/25	1,275	1,275	0	0	0	0	0	0	1,275
2025/26	1,175	1,175	0	0	0	0	0	0	1,175
2026/27	1,164	1,164	0	0	0	0	0	0	1,164
2027/28	1,084	1,084	0	0	0	0	0	0	1,084
2028/29	1,083	1,083	0	0	0	0	0	0	1,083
2029/30	1,079	1,079	0	0	0	0	0	0	1,079
2030/31	1,081	1,081	0	0	0	0	0	0	1,081
2031/32	1,085	1,085	0	0	0	0	0	0	1,085
2032/33	1,086	1,086	0	0	0	0	0	0	1,086
2033/34	1,091	1,091	0	0	0	0	0	0	1,091

[1] Values represent predicted winter peak demand under pessimistic economic conditions.

**Schedule 3.2b**  
**Forecast of Winter Peak Demand (MW)**  
**All-Requirements Project – High Case [1]**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)
Year	Total	Wholesale	Retail	Interruptible	Residential Load Management	Residential Conservation	Commercial/ Industrial Load Management	Commercial/ Industrial Load Conservation	Net Firm Demand
2024/25	1,277	1,277	0	0	0	0	0	0	1,277
2025/26	1,209	1,209	0	0	0	0	0	0	1,209
2026/27	1,222	1,222	0	0	0	0	0	0	1,222
2027/28	1,157	1,157	0	0	0	0	0	0	1,157
2028/29	1,173	1,173	0	0	0	0	0	0	1,173
2029/30	1,180	1,180	0	0	0	0	0	0	1,180
2030/31	1,195	1,195	0	0	0	0	0	0	1,195
2031/32	1,212	1,212	0	0	0	0	0	0	1,212
2032/33	1,225	1,225	0	0	0	0	0	0	1,225
2033/34	1,240	1,240	0	0	0	0	0	0	1,240

[1] Values represent predicted winter peak demand under optimistic economic conditions.

**Schedule 3.3a**  
**Forecast of Annual Net Energy for Load (GWh)**  
**All-Requirements Project – Low Case [1]**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)
Year	Total	Residential Conservation	Commercial/ Industrial Conservation	Retail	Wholesale	Utility Use & Losses	Net Energy for Load	Load Factor %
2025	6,239	0	0	6,239	1,131	311	7,681	63%
2026	6,246	0	0	6,246	866	300	7,412	61%
2027	6,257	0	0	6,257	815	282	7,354	60%
2028	6,264	0	0	6,264	361	274	6,900	57%
2029	6,278	0	0	6,278	369	233	6,879	57%
2030	6,298	0	0	6,298	0	192	6,489	54%
2031	6,324	0	0	6,324	0	167	6,491	54%
2032	6,355	0	0	6,355	0	159	6,514	54%
2033	6,394	0	0	6,394	0	118	6,512	54%
2034	6,440	0	0	6,440	0	102	6,542	54%

[1] Values represent predicted net energy for load under pessimistic economic conditions.

**Schedule 3.3b**  
**Forecast of Annual Net Energy for Load (GWh)**  
**All-Requirements Project – High Case [1]**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)
Year	Total	Residential Conservation	Commercial/ Industrial Conservation	Retail	Wholesale	Utility Use & Losses	Net Energy for Load	Load Factor %
2025	6,324	0	0	6,324	1,144	313	7,781	63%
2026	6,487	0	0	6,487	897	308	7,692	61%
2027	6,617	0	0	6,617	862	295	7,774	60%
2028	6,727	0	0	6,727	388	292	7,407	57%
2029	6,831	0	0	6,831	401	248	7,480	57%
2030	6,933	0	0	6,933	0	194	7,127	54%
2031	7,034	0	0	7,034	0	168	7,202	54%
2032	7,135	0	0	7,135	0	161	7,296	54%
2033	7,241	0	0	7,241	0	117	7,358	54%
2034	7,352	0	0	7,352	0	100	7,453	54%

[1] Values represent predicted net energy for load under optimistic economic conditions.

**Schedule 4**  
**Previous Year and 2-Year Forecast of Peak Demand and Net Energy for Load by Month**  
**All-Requirements Project**

(1)	(2)	(3)	(4)	(5)	(6)	(7)
Month	Actual - 2024		Forecast - 2025		Forecast - 2026	
	Peak Demand (MW)	NEL (GWh)	Peak Demand (MW)	NEL (GWh)	Peak Demand (MW)	NEL (GWh)
January	1,047	491	1,463	602	1,236	551
February	888	438	1,391	545	1,153	497
March	1,030	498	1,217	539	1,180	523
April	1,211	526	1,276	562	1,238	545
May	1,429	692	1,441	673	1,403	652
June	1,462	697	1,568	744	1,546	729
July	1,529	779	1,602	807	1,591	798
August	1,483	760	1,626	808	1,612	801
September	1,330	674	1,514	724	1,494	713
October	1,319	581	1,347	638	1,362	645
November	1,128	525	1,125	524	1,139	527
December	1,051	512	1,144	565	1,157	572

## Section 4 Renewable Resources and Conservation Programs

### 4.1 Introduction

FMPA continually evaluates renewable and conservation resource opportunities as part of its integrated resource planning process for the ARP. The ARP currently utilizes renewable energy resources as part of the generation portfolio, including solar photovoltaic (PV) and biomass. In addition, the ARP operates a Conservation & Energy Efficiency Program and has adopted a Net Metering Policy that promotes and facilitates ARP Participants' implementation of their Net Metering programs.

### 4.2 Renewable Resources

The following provides an overview of the ARP's current renewable resources, as well as new resources that are being considered as part of FMPA's integrated resource planning process:

#### 4.2.1 Solar Photovoltaic

In December 2009, the ARP completed construction on a 30 kW (DC) solar photovoltaic (PV) project located in Key West, FL. This project was developed and constructed as a joint partnership between the National Oceanic and Atmospheric Administration (NOAA) and FMPA. FMPA receives 62% of the energy generated from the solar PV system. Since the completion of the project, FMPA has received approximately 376,000 kWh of energy from the system. In 2024, FMPA's share of energy production amounted to 15,600 kWh.

In March 2018, FMPA's ARP Executive Committee approved a 20-year power purchase agreement resulting in 40.5 MW-AC of solar energy as an ARP resource that started commercial operation in 2020. In February 2020, the ARP further expanded solar in the portfolio by approving a second 20-year power purchase agreement for approximately 96 MW-AC of solar energy as an ARP resource, which was later amended to approximately 75 MW-AC. The first site, providing 48.125 MW-AC, achieved commercial operation in December 2024, with the remainder estimated to achieve commercial operation in 2025. In June 2023, FMPA entered into additional power purchase agreements for four new solar sites expecting commercial operation in early 2026, including a share for the ARP, however due to a variety of market and site-specific factors, the contracted solar sites were cancelled, eliminating any entitlement in the remaining sites.



The ARP solar entitlements will increase the proportion of ARP energy derived from renewable generation. Such estimates are included in the schedules that support this TYSP.

#### **4.2.2 Biomass**

FMPA currently receives biomass renewable energy from two sources.

- FMPA purchases as-available power from a cogeneration plant owned and operated by U.S. Sugar Corporation. The U.S. Sugar cogeneration plant is fueled by sugar bagasse, a byproduct of sugar production. U.S. Sugar Corporation uses the bagasse to fuel their generation plants to provide power for their processes. FMPA purchases the excess power produced from these generators. During 2024, FMPA purchased 47,962 MWh of energy from this renewable resource.
- In 2024, the Stanton Units 1 and 2 consumed 394,028 MMBtu of landfill gas as a supplemental fuel source. The ARP receives energy from both the ARP's and ARP Participants' shares in the Stanton Energy Center Units 1 and 2, which amount to 26.02% of the energy output of Stanton Unit 1 and 23.08% of the energy output of Unit 2 as of December 31, 2024. Thus, the ARP utilized 94,502 MMBtu of landfill gas as a supplemental fuel source<sup>3</sup>.

These renewable resources help the ARP meet current and future energy needs.

FMPA's forecast of renewable energy is provided in Schedule 6.1 of Section 5.

### **4.3 Conservation & Energy Efficiency Program**

The ARP Participants have developed the ARP Conservation Program to provide conservation and energy efficiency incentives and assistance to their retail customers. The project is funded through the ARP rates and members are allocated funds based on their energy load ratio share. Each ARP Participant can elect to implement programs that are most suitable for their community.

Conservation programs offered by ARP Participants include, but are not limited to, the following:

- Rebates on ENERGY STAR® qualified appliances
- Rebates on insulation upgrades and duct leak repair

---

<sup>3</sup> For 2019 and beyond, Stanton landfill gas usage includes the ARP's distinct entitlement to Stanton 1 and Stanton 2 capacity and energy.

- Residential and Commercial energy audits
- Customer education materials, including brochures and videos
- Equipment and training for utility energy auditors

Since the inception of the program in 2008, the ARP Participants have allocated approximately \$12.6 million to the ARP Conservation Program. The ARP Participants recurrently evaluate evolving conservation measures and add those measures to their respective portfolio of offerings. FMPA supports these efforts by developing engineering assumptions to track the savings associated with new measures that are adopted and has developed a historical tracking model to integrate participation statistics and estimated energy and demand savings per year since the inception of the program.

FMPA is currently not including the effects of its energy efficiency programs in its forecast of demand and net energy for load as the program results are still under FMPA's designated threshold for level of significance of 0.5 percent of load over the 20-year planning horizon. FMPA has developed reporting tools and techniques in order to be able to estimate program effects on demand and NEL and understand the level of significance of the program. Once the threshold is crossed, FMPA will separately account for the effects of the energy efficiency program in its demand and load forecast. To the extent that recent energy efficiency efforts have been captured in actual consumption data for the last few years, the effects of the program are included in the current load forecast.

#### **4.4 Net Metering Program**

In June 2008, the ARP Participants adopted a Net Metering Policy to permit interconnection of customer-owned renewable generation to its Members' distribution system. This policy facilitates the purchase of excess customer-owned renewable generation and outlines the metering, billing and crediting procedures to be followed by ARP Participants. As of September 2024, ARP Participants had approximately 61,598 kW of solar photovoltaic renewable generation (AC) connected to the grid through their net metering programs.

The ARP load forecast reflected in this TYSP projects that the impact of ARP Participants' net metering programs will exceed the 0.5% FMPA set threshold of significance over the study period. Consequently, FMPA has included the estimated effects of net metering in the forecast schedules included herein. FMPA intends to continue to monitor the trend in installations of distributed generation across the Participants' systems and adapt future forecasts accordingly.

#### **4.5 Load Management Program**

Currently, there are no ARP-sponsored load management programs in place. FMPA is in discussions with ARP Members to identify the potential loads or behind-the-meter generation that could be viable load management resources. If cost-effective, FMPA could utilize these types of resources as alternatives to new build or purchases to maintain a 15% reserve margin.

## Section 5 Forecast of Facilities Requirements

### 5.1 ARP Planning Process

FMPA's integrated resource planning (IRP) policy is to assure, on a long-term basis, a low-cost and reliable electricity supply to ARP Participants that reflects the goals and objectives established by the ARP Participants. FMPA's planning process is consistent with Florida Public Service Commission (PSC) statutory and regulatory requirements which do not specifically subject utilities in Florida to integrated resource planning, but when taken together equate to an integrated resource planning requirement. In addition, FMPA's process is considerate of the Public Utility Regulatory Act (PURPA) which requires certain standards of practice to comply with retail rate regulations.

Annually, FMPA and the ARP Executive Committee will assess the need for an update to the integrated resource plan. The IRP planning process requires that FMPA and the ARP Executive Committee evaluate alternative resource portfolios and make certain decisions regarding implementing a particular preferred plan. Certain requirements, such as maintaining 15 percent Summer Peak Reserves and 15 percent Winter Peak Reserves on a planned basis, and "best efforts" goals, such as achieving the lowest net present value cost over the next 20 years, and integrating demand-side and renewable resources into the ARP power supply portfolio, have been developed as guidelines to assist FMPA and the Executive Committee in communicating and evaluating the key issues associated with making resource portfolio planning decisions.

Any incremental capacity need for the ARP is currently projected to reside outside of the 2025 TYSP study period. As noted above and further below, the ARP is able to meet projected peak demand requirements and maintain 15% planning reserves using existing and already planned generating resources.

### 5.2 Planned ARP Generating Facility Requirements

Based upon FMPA's current Base Case load forecast, planned acquisitions and inclusive of a recent power purchase agreement for reserve peaking capacity executed on behalf of the ARP for the period 2024-2029, the ARP currently does not require any additional resources from undesignated sources to maintain FMPA's 15% reserve margin through the study period. Schedule 8 at the end of this section shows planned and prospective ARP generating resources changes

during the next 10-year period, which include planned upgrades to existing resource entitlement capacities.

FMPA is expected to close on Orange Cogeneration, an LM6000 combined cycle with a net summer capacity of 104 MW, in early 2026. This capacity is included in the relevant TYSP schedules herein.

### 5.3 Capacity and Power Purchase Requirements

The current system firm power supply purchase resources of the ARP include a purchase from NextEra, a newly executed power purchase agreement for reserve peaking capacity, as well as solar power purchase agreements which provide an estimated amount of dependable capacity. Power purchase contracts included in the ARP plans are briefly summarized below:

- **Oleander Unit 5:** FMPA on behalf of the ARP has a contract to purchase the entire capacity of, and energy generated by, NextEra's Oleander Unit 5, an approximately 162 MW (summer rating) or 180 MW (winter rating), simple cycle gas turbine unit primarily fueled with natural gas and located in Brevard County. The term of the purchase ends in December 2027.
- **Oleander Unit 1:** FMPA on behalf of the ARP has a contract to purchase firm capacity and energy generated by Power Holding LLC's Oleander Unit 1, with a capacity purchase equal to approximately 106 MW from 2024 through 2027 that includes the option to execute an additional 49 MW if needed. In 2028 and 2029, FMPA purchased 155 MW of capacity and energy.
- **Solar:** FMPA on behalf of the ARP, has entered into twenty-year power purchase agreements with two different counterparties for solar resources, with the ARP's share of AC output totaling over 115 MW. The estimated dependable capacity associated with solar generation, which varies by year as a function of projected online dates for solar facilities, is included as appropriate in all schedules herein.

### 5.4 Summary of Current and Future ARP Resource Capacity

Tables 5-1 and 5-2 provide a summary, ten-year projection of the ARP resource capacity for the summer and winter seasons, respectively. A projection of the ARP fuel requirements by fuel type is shown in Schedule 5. Schedules 6.1 (quantity) and 6.2 (percent of total) present the forecast of ARP energy sources by resource type. Schedules 7.1 and 7.2 summarize the capacity, demand, and resulting reserve margin forecasts for the summer and winter seasons, respectively.

Information on planned and prospective ARP generating facility additions and changes is included in Schedule 8.

The ARP expects to meet its generation capacity requirements and maintain a 15% reserve margin with existing resources through 2034. FMPA continually monitors and evaluates resource requirements.

**Table 5-1**  
**Summary of All-Requirements Power Supply Project Resource Summer Capacity**

Line No.	Resource Description	Summer Rating (MW)									
		2025	2026	2027	2028	2029	2030	2031	2032	2033	2034
	(a)	(b)	(c)	(d)	(e)	(f)	(g)	(h)	(i)	(j)	(k)
	Installed Capacity										
	Existing Resources										
1	Nuclear [1,6]	48	48	48	48	48	47	47	47	47	47
	Stanton 1	116	-	-	-	-	-	-	-	-	-
	Stanton 2	106	106	106	106	106	106	106	106	106	106
2	Stanton Coal Plant [2,7]	222	106	106	106	106	106	106	106	106	106
3	Stanton CC Unit A [2]	44	44	44	44	44	44	44	44	44	44
	Cane Island 1	35	35	35	35	35	35	35	35	35	35
	Cane Island 2	109	109	109	109	109	109	109	109	109	109
	Cane Island 3	250	250	250	250	250	250	250	250	250	250
	Cane Island 4	300	300	300	300	300	319	319	319	319	319
4	Cane Island 1-4 [3]	694	694	694	694	694	713	713	713	713	713
5	Sand Lake Energy Center	120	120	120	120	120	120	120	120	120	120
6	Mulberry Energy Center	108	108	108	108	108	108	108	108	108	108
	Indian River A	16	16	16	16	16	16	16	16	16	16
	Indian River B	16	16	16	16	16	16	16	16	16	16
	Indian River C	22	22	22	22	22	22	22	22	22	22
	Indian River D	22	22	22	22	22	22	22	22	22	22
7	Indian River CTs [2]	75	75	75	75	75	75	75	75	75	75
8	Treasure Coast Energy Center [4]	300	319	319	319	319	319	319	319	319	319
9	Stock Island Units	113	113	113	113	113	113	113	113	113	113
10	Sub Total Existing Resources	1,724	1,627	1,627	1,626	1,626	1,644	1,644	1,644	1,644	1,644
	Planned Resource Additions										
11	Barlow Energy Center [8]	-	104	104	104	104	104	104	104	104	104
12	Sub Total Planned Resource Additions	-	104	104	104	104	104	104	104	104	104
13	Total Installed Capacity	1,724	1,731	1,731	1,730	1,730	1,748	1,748	1,748	1,748	1,748
	Firm Capacity Import										
14	Oleander Purchase	162	162	162	-	-	-	-	-	-	-
15	Oleander 1 Purchase	106	106	106	155	155	-	-	-	-	-
16	ARP Solar Phase I	16	16	16	16	16	16	16	16	16	16
17	ARP Solar Phase II	19	30	30	30	30	30	30	29	29	29
18	Peaking Purchase(s) [5]	-	-	-	-	-	-	-	-	-	-
19	Total Firm Capacity Import	303	314	314	201	201	45	45	45	45	45
20	Total Available Capacity	2,027	2,045	2,044	1,931	1,931	1,793	1,793	1,793	1,793	1,793

[1] Includes capacity from the St. Lucie Project.

[2] Capacities shown have been reduced to account for losses through the OUC transmission system (assumed to be 2.0% for planning period).

[3] Reflects Cane Island 4 upgrade to increase plant capacity in 2030.

[4] Reflects Treasure Coast Energy Center upgrade to increase plant capacity in 2026.

[5] Additional peaking capacity required to maintain a 15% reserve margin during the summer season.

[6] Reflects decrease in capacity as a result of the expiration of Green Cove Springs' supplemental power purchase agreement with the ARP.

[7] Expected retirement of Stanton 1 in 2025. Stanton Unit No. 2 planned conversion to 100 percent natural gas in 2027.

[8] FMPA is renaming the site, formerly Northern Star Generation Orange.

**Table 5-2**  
**Summary of All-Requirements Power Supply Project Resource Winter Capacity**

Line No.	Resource Description	Winter Rating (MW)									
		2024/25	2025/26	2026/27	2027/28	2028/29	2029/30	2030/31	2031/32	2032/33	2033/34
	(a)	(b)	(c)	(d)	(e)	(f)	(g)	(h)	(i)	(j)	(k)
	Installed Capacity										
	Existing Resources										
1	St. Lucie 2	50	50	50	50	50	48	48	48	48	48
	Nuclear [1]	50	50	50	50	50	48	48	48	48	48
	Stanton 1	116	-	-	-	-	-	-	-	-	-
2	Stanton 2	106	106	106	106	106	106	106	106	106	106
	Stanton Coal Plant [2,6]	222	106	106	106	106	106	106	106	106	106
	Stanton CC Unit A [2]	47	47	47	47	47	47	47	47	47	47
4	Cane Island 1-4 [3]	721	721	721	721	721	740	740	740	740	740
5	Sand Lake Energy Center	120	120	120	120	120	120	120	120	120	120
6	Mulberry	115	115	115	115	115	115	115	115	115	115
7	Indian River A	19	19	19	19	19	19	19	19	19	19
	Indian River B	19	19	19	19	19	19	19	19	19	19
	Indian River C	23	23	23	23	23	23	23	23	23	23
	Indian River D	23	23	23	23	23	23	23	23	23	23
	Indian River CTs [2]	83	83	83	83	83	83	83	83	83	83
8	Treasure Coast Energy Center [4]	310	329	329	329	329	329	329	329	329	329
9	Stock Island Units	113	113	113	113	113	113	113	113	113	113
10	Sub Total Existing Resources	1,781	1,684	1,684	1,683	1,683	1,701	1,701	1,701	1,701	1,701
11		-	-	-	-	-	-	-	-	-	-
	Bartow Energy Center [8]	-	104	104	104	104	104	104	104	104	104
12	Sub Total Planned Resource Additions	-	104	104	104	104	104	104	104	104	104
13	Total Installed Capacity	1,781	1,788	1,788	1,787	1,787	1,805	1,805	1,805	1,805	1,805
	Firm Capacity Import										
14	Oleander Purchase	180	180	180	-	-	-	-	-	-	-
15	Oleander 1 Purchase	106	106	106	155	155	-	-	-	-	-
16	ARP Solar Phase I	-	-	-	-	-	-	-	-	-	-
17	ARP Solar Phase II	-	-	-	-	-	-	-	-	-	-
18	Peaking Purchase(s) [5]	-	-	-	-	-	-	-	-	-	-
19	Total Firm Capacity Import	286	286	286	155	155	-	-	-	-	-
20	Total Available Capacity	2,067	2,074	2,074	1,942	1,942	1,805	1,805	1,805	1,805	1,805

[1] Includes capacity from the St. Lucie Project.

[2] Capacities shown have been reduced to account for losses through the OUC transmission system (assumed to be 2.0% for planning period).

[3] Reflects Cane Island 4 upgrade to increase plant capacity in 2030.

[4] Reflects Treasure Coast Energy Center upgrade to increase plant capacity in 2026.

[5] Additional peaking capacity required to maintain a 15% reserve margin during the summer season.

[6] Reflects decrease in capacity as a result of the expiration of Green Cove Springs' supplemental power purchase agreement with the ARP.

[7] Expected retirement of Stanton 1 in 2025. Stanton Unit No. 2 planned conversion to 100 percent natural gas in 2027.

[8] FMPA is renaming the site, formerly Northern Star Generation Orange.



**Schedule 5**  
**Fuel Requirements – All-Requirements Power Supply Project**

(1)		(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)
Line No.	Fuel Type	Unit Type	Fuel Units	Actual	Forecasted									
				2024	2025	2026	2027	2028	2029	2030	2031	2032	2033	2034
1	Nuclear [1]		Trillion BTU	4	4	4	4	4	4	4	4	4	4	4
2	Coal		000 Ton	292	169	59	57	-	-	-	-	-	-	-
	Residual													
3		Steam	000 BBL	-	-	-	-	-	-	-	-	-	-	-
4		CC	000 BBL	-	-	-	-	-	-	-	-	-	-	-
5		CT	000 BBL	-	-	-	-	-	-	-	-	-	-	-
6		Total	000 BBL	-	-	-	-	-	-	-	-	-	-	-
	Distillate													
7		Steam	000 BBL	-	-	-	-	-	-	-	-	-	-	-
8		CC	000 BBL	-	-	-	-	-	-	-	-	-	-	-
9		CT	000 BBL	7	1	2	2	2	2	3	2	2	2	3
10		Total	000 BBL	7	1	2	2	2	2	3	2	2	2	3
	Natural Gas													
11		Steam [2]	000 MCF	1,516	668	233	227	2,108	2,149	2,265	2,301	2,400	2,562	2,596
12		CC	000 MCF	44,081	47,120	45,942	46,418	43,753	43,969	41,504	41,466	41,878	42,035	42,255
13		CT	000 MCF	2,624	1,039	2,597	1,134	1,960	2,314	1,761	2,055	2,047	2,318	2,576
14		Total	000 MCF	48,221	48,827	48,772	47,778	47,821	48,433	45,530	45,822	46,325	46,915	47,428
	Renewables [3]													
15		Biofuels	Billion BTU	480	356	356	356	356	356	356	356	356	356	356
16		Biomass	Billion BTU	-	-	-	-	-	-	-	-	-	-	-
17		Geothermal	Billion BTU	-	-	-	-	-	-	-	-	-	-	-
18		Hydro	Billion BTU	-	-	-	-	-	-	-	-	-	-	-
19		Landfill Gas	Billion BTU	95	50	17	17	23	23	25	25	26	28	28
20		MSW	Billion BTU	-	-	-	-	-	-	-	-	-	-	-
21		Solar	Billion BTU	-	-	-	-	-	-	-	-	-	-	-
22		Wind	Billion BTU	-	-	-	-	-	-	-	-	-	-	-
23		Other	Billion BTU	-	-	-	-	-	-	-	-	-	-	-
24		Total	Billion BTU	574	406	373	373	379	379	381	381	382	384	384
25	Other		Trillion BTU	-	-	-	-	-	-	-	-	-	-	-

[1] Nuclear generation shown is the ARP Participants' Entitlement Shares in the St. Lucie Project.

[2] Includes natural gas used as an Igniter Fuel at the Stanton Energy Center.

[3] Includes landfill gas consumed by FMPA's ownership share of the Stanton Energy Center as a supplemental fuel source, as well as bagasse consumed by U.S. Sugar cogeneration facility in the production of power purchased by FMPA.

**Schedule 6.1**  
**Energy Sources (GWh) – All-Requirements Power Supply Project**

	(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)
Line No.	Energy Source	Prime Mover	Units	Actual	Forecasted									
				2024	2025	2026	2027	2028	2029	2030	2031	2032	2033	2034
1	Annual Firm Inter-Region Interchange		GWh	-	-	-	-	-	-	-	-	-	-	-
2	Nuclear [1]		GWh	353	393	403	402	400	381	372	390	391	376	390
3	Coal		GWh	582	364	133	135	-	-	-	-	-	-	-
4	Residual	Steam	GWh	-	-	-	-	-	-	-	-	-	-	-
5		CC	GWh	-	-	-	-	-	-	-	-	-	-	-
6		CT	GWh	-	-	-	-	-	-	-	-	-	-	-
7		Total	GWh	-	-	-	-	-	-	-	-	-	-	-
8	Distillate	Steam	GWh	-	-	-	-	-	-	-	-	-	-	-
9		CC	GWh	-	-	-	-	-	-	-	-	-	-	-
10		CT	GWh	3	0	1	0	1	1	1	1	1	1	1
11		Total	GWh	3	0	1	0	1	1	1	1	1	1	1
12	Natural Gas	Steam	GWh	132	62	23	23	182	189	199	204	211	226	230
13		CC [2]	GWh	5,703	6,540	6,395	6,548	6,023	6,029	5,711	5,697	5,751	5,753	5,770
14		CT	GWh	237	91	253	114	205	240	186	218	215	246	276
15		Total	GWh	6,073	6,692	6,670	6,685	6,410	6,457	6,096	6,119	6,177	6,225	6,275
16	NUG		GWh	-	-	-	-	-	-	-	-	-	-	-
17	Renewables [3]	Biofuels	GWh	48	36	36	36	36	36	36	36	36	36	36
18		Biomass	GWh	-	-	-	-	-	-	-	-	-	-	-
19		Geothermal	GWh	-	-	-	-	-	-	-	-	-	-	-
20		Hydro	GWh	-	-	-	-	-	-	-	-	-	-	-
21		Landfill Gas	GWh	8	5	2	2	2	2	2	2	2	2	2
22		MSW	GWh	-	-	-	-	-	-	-	-	-	-	-
23		Solar	GWh	105	241	309	307	308	306	306	305	304	302	301
24		Wind	GWh	-	-	-	-	-	-	-	-	-	-	-
25		Other	GWh	-	-	-	-	-	-	-	-	-	-	-
26		Total	GWh	161	282	347	344	345	344	343	342	342	340	340
27	Interchange [4]		GWh	-	-	-	-	-	-	-	-	-	-	-
28	Net Energy for Load		GWh	7,173	7,731	7,553	7,566	7,156	7,183	6,812	6,852	6,911	6,942	7,005

[1] Nuclear generation shown is the ARP Participants' Entitlement Shares in the St. Lucie Project.

[2] Includes non-firm net interchange.

[3] Includes power purchased from U.S. Sugar cogeneration facility and power generated from FMFA's ownership share of the Stanton Energy Center using landfill gas.

[4] Includes firm interchange.

**Schedule 6.2**  
**Energy Sources (%) – All-Requirements Power Supply Project**

	(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)
Line No.	Energy Source	Prime Mover	Units	Actual 2024	2025	2026	2027	2028	2029	2030	2031	2032	2033	2034
1	Annual Firm Inter-Region Interchange		%	-	-	-	-	-	-	-	-	-	-	-
2	Nuclear [1]		%	4.9%	5.1%	5.3%	5.3%	5.6%	5.3%	5.5%	5.7%	5.7%	5.4%	5.6%
3	Coal		%	8.1%	4.7%	1.8%	1.8%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
4	Residual	Steam	%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
5		CC	%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
6		CT	%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
7		Total	%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
8	Distillate	Steam	%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
9		CC	%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
10		CT	%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
11		Total	%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
12	Natural Gas	Steam	%	1.8%	0.8%	0.3%	0.3%	2.5%	2.6%	2.9%	3.0%	3.1%	3.3%	3.3%
13		CC	%	79.5%	84.6%	84.7%	86.6%	84.2%	83.9%	83.8%	83.1%	83.2%	82.9%	82.4%
14		CT	%	3.3%	1.2%	3.3%	1.5%	2.9%	3.3%	2.7%	3.2%	3.1%	3.5%	3.9%
15		Total	%	84.7%	86.6%	88.3%	88.4%	89.6%	89.9%	89.5%	89.3%	89.4%	89.7%	89.6%
16	NUG		%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
17	Renewables	Biofuels	%	0.7%	0.5%	0.5%	0.5%	0.5%	0.5%	0.5%	0.5%	0.5%	0.5%	0.5%
18		Biomass	%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
19		Geothermal	%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
20		Hydro	%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
21		Landfill Gas	%	0.1%	0.1%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
22		MSW	%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
23		Solar	%	1.5%	3.1%	4.1%	4.1%	4.3%	4.3%	4.5%	4.4%	4.4%	4.4%	4.3%
24		Wind	%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
25		Other	%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
26		Total	%	2.3%	3.6%	4.6%	4.5%	4.8%	4.8%	5.0%	5.0%	4.9%	4.9%	4.8%
27	Interchange		%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
28	Net Energy for Load		%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%

[1] Nuclear generation shown is the ARP Participants' Entitlement Shares in the St. Lucie Project.

**Schedule 7.1**  
**Forecast of Capacity, Demand, and Scheduled Maintenance at Time of Summer Peak**  
**All-Requirements Power Supply Project**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)
Year	Total Installed Capacity (MW) [1]	Firm Capacity Import (MW)	Firm Capacity Export (MW)	QF (MW)	Total Available Capacity (MW)	System Firm Summer Peak Demand [2] (MW)	Reserve Margin before Maintenance		Scheduled Maintenance (MW)	Reserve Margin after Maintenance	
							(MW)	(% of Peak)		(MW)	(% of Peak)
2025	1,724	303	0	0	2,027	1,626	401	25%	0	401	25%
2026	1,731	314	0	0	2,045	1,612	433	27%	0	433	27%
2027	1,731	314	0	0	2,044	1,610	435	27%	0	435	27%
2028	1,730	201	0	0	1,931	1,524	407	27%	0	407	27%
2029	1,730	201	0	0	1,931	1,535	396	26%	0	396	26%
2030	1,748	45	0	0	1,793	1,449	345	24%	0	345	24%
2031	1,748	45	0	0	1,793	1,457	336	23%	0	336	23%
2032	1,748	45	0	0	1,793	1,465	328	22%	0	328	22%
2033	1,748	45	0	0	1,793	1,474	318	22%	0	318	22%
2034	1,748	45	0	0	1,793	1,487	305	21%	0	305	21%

[1] See Table 5-1 for a listing of the resources identified as Installed Capacity and Firm Capacity Import

[2] System Firm Summer Peak Demand includes transmission losses for the ARP Participants and additional ARP wholesale obligations served through FPL, DEF, and KUA.

**Schedule 7.2**  
**Forecast of Capacity, Demand, and Scheduled Maintenance at Time of Winter Peak**  
**All-Requirements Power Supply Project**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)
Year	Total Installed Capacity (MW) [1]	Firm Capacity Import (MW) [1]	Firm Capacity Export (MW) [2]	QF (MW)	Total Available Capacity (MW)	System Firm Winter Peak Demand [2] (MW)	Reserve Margin before Maintenance		Scheduled Maintenance (MW)	Reserve Margin after Maintenance	
							(MW)	(% of Peak)		(MW)	(% of Peak)
2024/25	1,781	286	0	0	2,067	1,463	604	41%	0	604	41%
2025/26	1,788	286	0	0	2,074	1,236	837	68%	0	837	68%
2026/27	1,788	286	0	0	2,074	1,239	835	67%	0	835	67%
2027/28	1,787	155	0	0	1,942	1,168	775	66%	0	775	66%
2028/29	1,787	155	0	0	1,942	1,177	765	65%	0	765	65%
2029/30	1,805	0	0	0	1,805	1,130	674	60%	0	674	60%
2030/31	1,805	0	0	0	1,805	1,139	666	58%	0	666	58%
2031/32	1,805	0	0	0	1,805	1,149	655	57%	0	655	57%
2032/33	1,805	0	0	0	1,805	1,157	648	56%	0	648	56%
2033/34	1,805	0	0	0	1,805	1,167	638	55%	0	638	55%

[1] See Table 5-2 for a listing of the resources identified as Installed Capacity and Firm Capacity Import.

[2] System Firm Winter Peak Demand includes transmission losses for the ARP Participants and additional ARP wholesale obligations served through FPL, DEF, and KUA.

**Schedule 8**  
**Planned and Prospective Generating Facility Additions and Changes**

Plant Name	Unit No.	Location (County)	Unit Type	Fuel		Fuel Transport		Alt. Fuel Days Use	Commercial In-Service MM/YY	Expected Retirement MM/YY	Gen. Max. Nameplate kW	Net Capability		Status
				Primary	Alt.	Primary	Alt.					Summer MW	Winter MW	
Resource Additions														
Changes to Existing Resources														
TREASURE COAST	1	ST. LUCIE	CT	NG	DFO	PL	TK		04/26			10	10	A [1]
TREASURE COAST	1	ST. LUCIE	CA	WH	DFO	NA	TK		04/26			10	10	A [1]
CANE ISLAND	4CT	OSCEOLA	CT	NG		PL			01/30			10	10	A [1]
CANE ISLAND	4CW	OSCEOLA	CA	WH		NA			01/30			10	10	A [1]
St. Lucie	2	ST. LUCIE	NP	UR		TK			10/27			(0)	(0)	OT [2]
St. Lucie	2	ST. LUCIE	NP	UR		TK			10/29			(2)	(2)	OT [3]
Stanton Energy Center	1	ORANGE	ST	BIT		RR				12/25		(118)	(118)	RT [4]
Stanton Energy Center	2	ORANGE	ST	NG		PL			01/28			0	0	FC [5]
Bartow Energy Center	1CT	POLK	CT	NG		PL			01/26			40	40	CO [6]
Bartow Energy Center	2CT	POLK	CT	NG		PL			01/26			40	40	CO [6]
Bartow Energy Center	3CA	POLK	CA	WH		NA			01/26			25	25	CO [6]

[1] Upgrade to increase plant capacity. Reflects upgrade to ARP capacity and entitlements only.

[2] Reflects decrease in St. Lucie capacity available to the ARP as a result of the expiration of Ft. Meade's supplemental power purchase agreement with the ARP.

[3] Reflects decrease in St. Lucie capacity available to the ARP as a result of the expiration of Green Cove Springs' supplemental power purchase agreement with the ARP.

[4] Expected retirement of SEC 1 to occur during 2025.

[5] Stanton Unit No. 2 planned conversion to 100 percent natural gas.

[6] The ARP is expected to purchase existing generation known as Norther Star Generation Orange Cogeneration. Upon acquisition, FMPA will rename the facility to Bartow Energy Center.

## Section 6 Site and Facility Descriptions

Florida Public Service Commission Rule 25-22.072 F.A.C. requires that the State of Florida Public Service Commission Electric Utility Ten-Year Site Plan Information and Data Requirements Form PSC/EAG 43 dated 11/97 govern the submittal of information regarding Potential and Identified Preferred sites. Ownership or control is required for sites to be Potential or Identified Preferred. The following are Potential sites for FMPA as specified by PSC/EAG 43.

- Cane Island Power Park – Potential Site
- Treasure Coast Energy Center – Potential Site
- Stock Island – Potential Site

FMPA anticipates that simple cycle combustion turbines could be installed at existing generation sites located within or adjacent to the service territories of ARP Participants, such as the Stock Island site at KEYS, the Cane Island Power Park site at KUA, or the Treasure Coast Energy Center in Fort Pierce. FMPA also anticipates that combined cycle generation could be installed at the Treasure Coast Energy Center site. FMPA continuously explores the feasibility of other sites located within Florida with the expectation that ARP Participants' service territories would provide the best option for future development.

### **Cane Island Power Park**

Cane Island Power Park is located south and west of KUA's service area and contains 694 MW (summer ratings) of gas turbine and combined cycle capacity: Units 1-3 include a simple cycle gas turbine and two combined cycle generating units, each of which is 50 percent owned by FMPA on behalf of the ARP and 50 percent owned by KUA. Cane Island Unit 4 (CI4), a nominal 300 MW (summer rating), natural gas-fired 1x1 GE 7FA combined cycle unit, is wholly owned by the FMPA ARP.

### **Treasure Coast Energy Center**

FMPA commissioned Treasure Coast Energy Center (TCEC) Unit 1, a dual fuel low sulfur diesel and natural gas-fired 300 MW (summer rating) 1x1 GE 7FA combined cycle unit in May 2008. The Treasure Coast Energy Center is located in St. Lucie County in the City of Fort Pierce. The site was certified in June 2006 and can accommodate construction of future units beyond TCEC Unit 1, up to a total of 1,200 MW.

**Stock Island**

The Stock Island site currently consists of four combustion turbines and three diesel generating units, one of which is a high-speed diesel that had been previously retired but refurbished and brought back into service in July of 2012. The site receives water from the Florida Keys Aqueduct Authority via a pipeline from the mainland and uses on-site groundwater. The site receives delivery of fuel oil to its unloading system through deliveries primarily via truck and also has the capability of receiving fuel oil via waterborne delivery.

**Sand Lake Energy Center**

Sand Lake Energy Center (SLEC) combined cycle is a 120 MW (summer rating) asset made up of one Alstom GT11NMC combustion turbine (with EV burner) and one Siemens VAX steam turbine. FMPA acquired the site in 2024, and it is located in Orange County in the city of Orlando. The site was formerly known as Orlando Cogen.

**Mulberry Energy Center**

Mulberry Energy Center (MEC) Unit 1 combined cycle is a 108 MW (summer rating) asset made up of one GE 7EA combustion turbine and one GE steam turbine. FMPA acquired the site in 2024, and it is located in Polk County near the city of Bartow. The site was formerly known as Mulberry Cogen (Polk Power Partners).

**General**

Schedule 9 presents the status report and specifications for any proposed ARP generating facility, if applicable. Schedule 10 contains the status report and specifications for proposed ARP transmission line projects.



**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**  
**All-Requirements Power Supply Project**  
**(Preliminary Information)**

**(No Proposed Generating Facilities)**

(1)	Plant Name and Unit Number	
(2)	Capacity a. Summer b. Winter	
(3)	Technology Type	
(4)	Anticipated Construction Timing a. Field Construction Start Date b. Commercial In-Service Date	
(5)	Fuel a. Primary Fuel b. Alternate Fuel	
(6)	Air Pollution Control Strategy	
(7)	Cooling Method	
(8)	Total Site Area	
(9)	Construction Status	
(10)	Certification Status	
(11)	Status with Federal Agencies	
(12)	Projected Unit Performance Data Planned Outage Factor (POF) Forced Outage Factor (FOF) Equivalent Availability Factor Resulting Capacity Factor Average Net Operating Heat Rate (ANOHR)	
(13)	Projected Unit Financial Data Book Life (Years) Total Installed Cost (In-Service Year \$/kW) Direct Construction Cost (2010 \$/kW) AFUDC Amount (\$/kW) [1] Escalation (\$/kW) Fixed O&M (\$/kW) Variable O&M (\$/MWh)	

[1] Includes AFUDC and bond issuance expenses

**Schedule 10**  
**Status Report and Specifications of Proposed Directly Associated Transmission Lines**  
**All-Requirements Power Supply Project**

(1)	Point of Origin and Termination	(See note below)
(2)	Number of Lines	
(3)	Right-of-Way	
(4)	Line Length	
(5)	Voltage	
(6)	Anticipated Construction Timing	
(7)	Anticipated Capital Investment	
(8)	Substations	
(9)	Participation with Other Utilities	

Note: FMPA currently has no new proposed transmission lines.

## Appendix I List of Abbreviations

### Generator Type

CA	Steam Portion of Combined Cycle
CC	Combined Cycle (Total Unit)
CT	Combustion Turbine Portion of Combined Cycle
GT	Combustion Turbine
IC	Internal Combustion Engine
NP	Nuclear Power
ST	Steam Turbine

### Fuel Type

BIT	Bituminous Coal
DFO	Distillate Fuel Oil
NG	Natural Gas
RFO	Residual Fuel Oil
UR	Uranium
WH	Waste Heat

### Fuel Transportation Method

PL	Pipeline
RR	Railroad
TK	Truck
WA	Water Transportation

### Status of Generating Facilities

P	Planned Unit (Not Under Construction)
L	Regulatory Approval Pending. Not Under Construction
RT	Existing Generator Scheduled for Retirement
U	Under Construction, Less Than or Equal to 50% Complete
V	Under Construction, More Than 50% Complete
A	Generation Unit Capability Increased
OT	Other
FC	Existing generator planned for conversion to other energy source
IR	Inactive Reserve (Emergency Only)
CO	Change in ownership

### Other

NA	Not Available or Not Applicable
----	---------------------------------

## Appendix II

### ARP Participant Transmission Information

Table II-1  
Planned and Proposed Transmission Additions for ARP Participants  
2025 through 2034 (69 kV and Above)

City	Project Description	MVA	Voltage	Circuit	Estimated In-Service Date
Beaches Energy Services	Sampson Substation: Replace breakers 805N & 805NT1	-	138 kV	-	12/2026
	Penman Substation: Replace breakers 800T2 & 800N	-	138 kV	-	12/2026
	Fort Diego Substation: Replace breaker 806W	-	138 kV	-	12/2027
	Sampson Substation: Replace breaker 8W85	-	230 kV	-	12/2028
	Butler Substation: Replace breakers 802T2, 802N, 803S & 803T1	-	138 kV	-	12/2028
	Fort Diego Substation: Replace TR1	50	138/26.4kV	-	12/2028
	Jacksonville Beach Substation: Replace TR1	50	138/26.4kV	-	12/2030
	Sampson Substation: Replace TR1 Auto-Transformer	250	230/138 kV	1	12/2031
Kissimmee Utility Authority	Van Meter Substation (New); In & Out on Line 04-0710	80	69 kV	-	12/2026
	Airport Substation (Expansion); (2 x 40MVA Transformers)	160	69 kV	-	12/2030
	Domingo Toro – 4th transformer expansion (40MVA)	160	69 kV	-	12/2032
	Marydia Substation: Replace T01741 Auto-Transformer (Non-upgrade)	120	230/69 kV	-	12/2035
	Marydia Substation: Replace T01422 (30MVA) with 40MVA - Transformer	80	69 kV	-	12/2029
	Taft Substation: Replace T15741 Auto-Transformer	150	230/69kV	-	12/2033
	Pleasant Hill Substation – 3rd transformer expansion (40MVA)	120	69 kV	-	12/2029
	OH to URD conversion (1,700'); Lines 04-2127/04-2123	-	69 KV	2	12/2027
	Lines 04-2023/04-1420 – Pole Relocation for FDOT project	-	69 KV	2	12/2027
	Reconductor (Non-upgrade) – Marydia to Taft – Maintenance/Storm Hardening	-	230 kV	1	12/2027
	Reconductor (UPGRADE) Marydia to Hord Transmission Line	173	69 kV	1	12/2026
	Reconductor (UPGRADE) Buenaventura Lakes to Carl Wall Transmission Line	173	69 kV	1	12/2026
	Reconductor (UPGRADE) Airport to Lake Cecile Transmission Line	173	69 kV	1	12/2028
	Reconductor (UPGRADE) Lake Bryan to Lake Cecile Transmssion Line	173	69 kV	1	12/2028
	Reconductor (UPGRADE) Domingo Toro to Hansel	173	69 kV	1	12/2031
-	PRC027 Relay Coordination Study – BES only	-	230KV	-	12/2026
Fort Pierce Utility Authority	Garden City Substation: Replace breakers G6902	-	69 kV	-	10/2025
	Hartman: Upgrade Auto-Transformer #1	120	138/69 kV	1	12/2025
	Hartman: Upgrade Auto-Transformer #2	120	138/69 kV	2	12/2025
	Garden City Substation: Replace breakers G6910	-	69 kV	-	04/2026
	Lawnwood Substation: Replace breakers L6902	-	69 kV	-	10/2026
	Lawnwood Substation: Replace breakers L6903	-	69 kV	-	04/2027
	Causeway Substation: Replace breaker C69T2	-	69 kV	-	10/2027
	HD King Substation: Replace breaker K69T2	-	69 kV	-	11/2025
	HD King Substation: Replace breaker K6905	-	69 kV	-	11/2025
Keys Energy Services	US1 Substation: Repalce Auto Transformer	100	138/69 kV	2	12/2027
Ocala Electric Utility	Reconductor Dearmin to White Transmission Line	-	69 kV	1	06/2029
	Dearmin Substation: Replace Auto-Transformer #1	110	230/69 kV	1	12/2026
	Dearmin Substation: Replace Auto-Transformer #2	110	230/69 kV	2	12/2026
	Cardinal/College Substation: New distribution substation	-	69 kV	-	06/2027
	Leo White Substation: Rebuild existing substation	-	69 kV	-	06/2028
	Ergle Substation: Replace Auto-Transformer	-	230/69 kV	-	12/2031